

EXTERNAL AND LOAD BEARING WALLS

Existing brickwork to be tied in by using stainless steel wall starter connectors or providing pockets to the old brickwork.  
External walls to be 102mm facing brick, 100mm cavity and 100mm blockwork.  
Existing external brickwork to be matched if possible, 90mm Kingspan Kooltherm K106 Cavity Board insulation with a thermal conductivity of 0.019W/mK; taped with Wraptite breathable self adhesive tape on all joints and around ties or suitable equivalent, inner leaf of external walls to be 100mm Celcon lightweight blocks with a thermal conductivity of 0.15W/mK. Internal face of external walls to be fitted with plasterboard.  
Stainless steel wall ties staggered at 750 horizontal and 450 vertical centres to BS EN 845-1 and double number wall ties around openings.  
All new or enlarged windows, door and access reveals to be bridged over by a suitable insulated Catnic lintel (as specified on approved plan) or equivalent and approved with min. 150mm bearing unless specified otherwise on approved plan. Provide cavity tray over any item bridging cavity.

SOLID FLOOR

65mm s/c screed over 150mm concrete slab with separation layer on Kingspan Kooltherm K103 100mm thickness on 2000g visqueen DPM lapped and bonded to DPC, on 12mm sand blinding on 150mm minimum well compacted hardcore.  
Cavity wall insulation to extend down past DPC level to level of floor insulation.  
Perimeter floor slab up stand insulation to be Kingspan 30mm thickness fitted to touch floor insulation where floor slab meets external walls.  
New floor to meet latest current Building Regulations and U-value requirements of 0.18W/m²K complying with approved documents.

GAS MEMBRANE

If required, a gas membrane shall be laid over the ground slab, Visqueen Ultimate HC BLOK (or equal and approved) conforming to BS8485:2015 + A1:2019 for Methane and Carbon Dioxide protection shall be installed as per the manufacturers instructions, to prevent the ingress of VOC's due to the structures proximity to a historic Landfill site.

PITCHED ROOF.

Roof tiles in colour to match existing as near as possible; to be Marley Modern or equal and approved.  
Nailed or clipped to 50x25mm battens on sarking felt to BS747  
Correctly sized and spaced timber joist calculated from span tables - C24 - minimum 50x225mm at 400mm centers.  
Ridge Board 75x225mm  
Ceiling insulation to be laid between and over joists. Insulation to be Knarf Loft Roll 44 to minimum of 300mm thick.  
100x75mm wall plate strapped to masonry at 1200mm centres with 1200x30x5mm galvanised steel restraint straps.  
Where appropriate, 1200x30x5mm galvanised steel restraint straps to be nailed over min. 3no. rafters at max. 2m centres, with suitably sized noggins under.  
Any new pitched roof to achieve a U-value of 0.15 W/m²/K or better, to comply with approved documents.

ELECTRICAL

Smoke detector to be installed in extension bedroom and either interlinked with any existing hardwired mains connected system or where none exists, hardwired to mains itself.  
Remote test switch to be installed.  
Sockets and switches to be between 450mm and 1200 AFFL, and to comply with part M 8.3 of the Building Regulations.  
All wiring and electrical work to be designed, installed, inspected and tested in accordance with BS7671, IEE 18th edition regulations and Part P of the Building Regulations approved document.  
Contractor to provide Electrical Completion Certificates and Electrical Test Certificates to comply with the above.

DRAINAGE

112mm half round gutters fixed to timber fascia boards to run to 68mm downpipe and discharge into gully.  
All new SV pipes to be 100mm UPVC and to be 900mm minimum above highest opening with suitable cage cover.  
75mm deep seal traps to new WHB and WC and floor drain.  
Provide rodding access at base of stack 150mm above ground level. Elsewhere, all new drainage runs shall be roddable.  
Other sanitary waste connection to be minimum 200mm above waste connection.  
Inspection chambers to be uPVC 450 diameter installed at all changes of level, direction and connection  
New WC to connect to existing SVP.  
All drains to have 1:40 falls on a minimum 150mm bed of pea gravel. Any drainage run through brickwork to be bridged with RC lintel leaving 50mm gap around and be packed with polystyrene.


VENTILATION

Any new bathrooms or WC rooms to have light switch operated low voltage extract fan to give air change of 15litres/second and a minimum 15 minute override. 30l/s to Kitchen.


DOORS AND WINDOWS

All openings to have vertical and horizontal insulated DPC's; any new windows and external doors to be supplied and installed by a FENSA registered contractor and in accordance with FENSA regulations. Window glass to be e-glass double glazing with 20mm argon gas filled cavity. Windows to have max. U-value of 1.4 W/m²/K (where in new extension) and replacement windows to existing dwelling to have max.  
U-Value of 1.6 W/m²/K to comply with approved document.  
All opening lights to have trickle vents 8000sq mm and be weather tight to BS6375-1.  
All escape windows to have minimum opening 850mm high and 500mm wide with maximum cill height at 850 from finished floor level. I  
n critical areas, safety glazing to conform to BS6206: 1981 to be fitted.  
All new doorways to have a wheelchair accessible threshold.

Foundation and Wall Detail -  
600 Foundation - Concrete Slab.

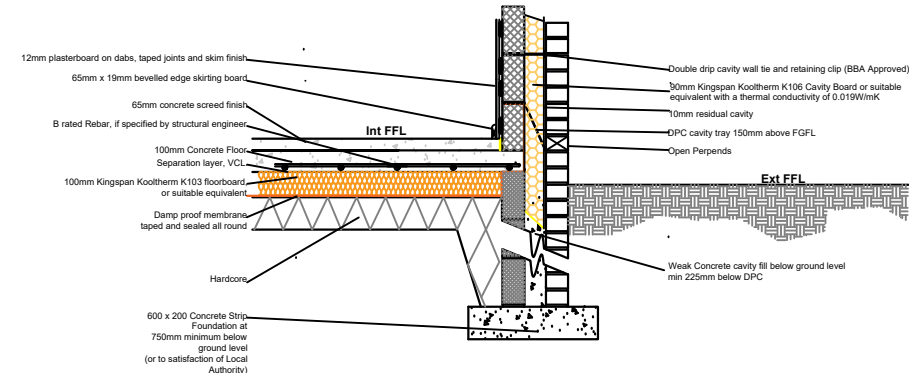

Eaves and Roof Detail,  
pitch may vary.

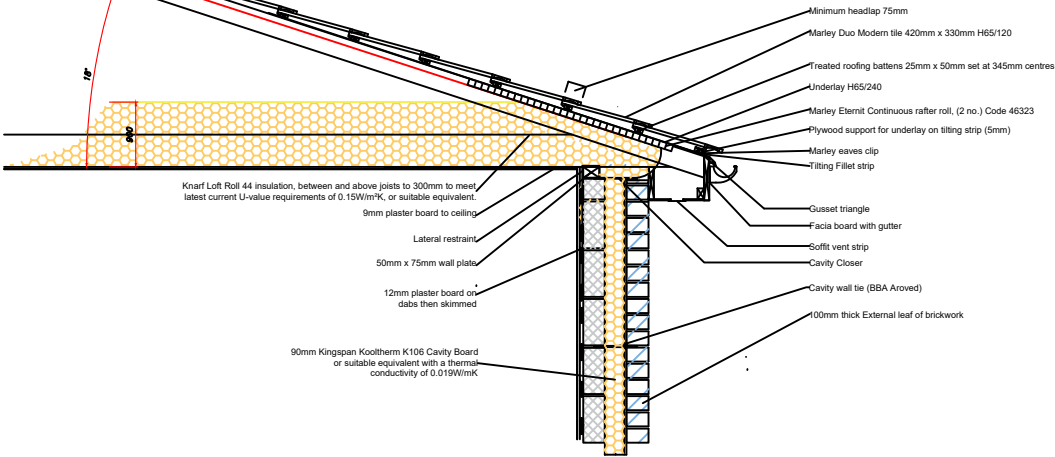

|                                                                                                                                                                        |                                                                                                                                         |                        |                           |                                                                                                                          |
|------------------------------------------------------------------------------------------------------------------------------------------------------------------------|-----------------------------------------------------------------------------------------------------------------------------------------|------------------------|---------------------------|--------------------------------------------------------------------------------------------------------------------------|
| <div>Manchester Equipment and Adaptations Partnership</div> <div>Technical Officer Service</div> <div>Philips Park Road<br/>Beswick,<br/>Manchester,<br/>M11 3FU</div> | <div>Applicants Name:<br/>Miss Carmel Millar</div> <div>Property Address:<br/>230 Kingsway<br/>Burnage<br/>Manchester<br/>M19 1DD</div> | <div>REVISIONS -</div> | Date: 25/10/2024          | <div><div><div><div></div><div>MEAP</div></div><div>Manchester Equipment &amp; Adaptations Partnership</div></div></div> |
|                                                                                                                                                                        |                                                                                                                                         |                        | Paper Size: A3            |                                                                                                                          |
|                                                                                                                                                                        |                                                                                                                                         |                        | Scale: 1:100              |                                                                                                                          |
|                                                                                                                                                                        |                                                                                                                                         |                        | Drawn By:<br>Brian Taylor |                                                                                                                          |