
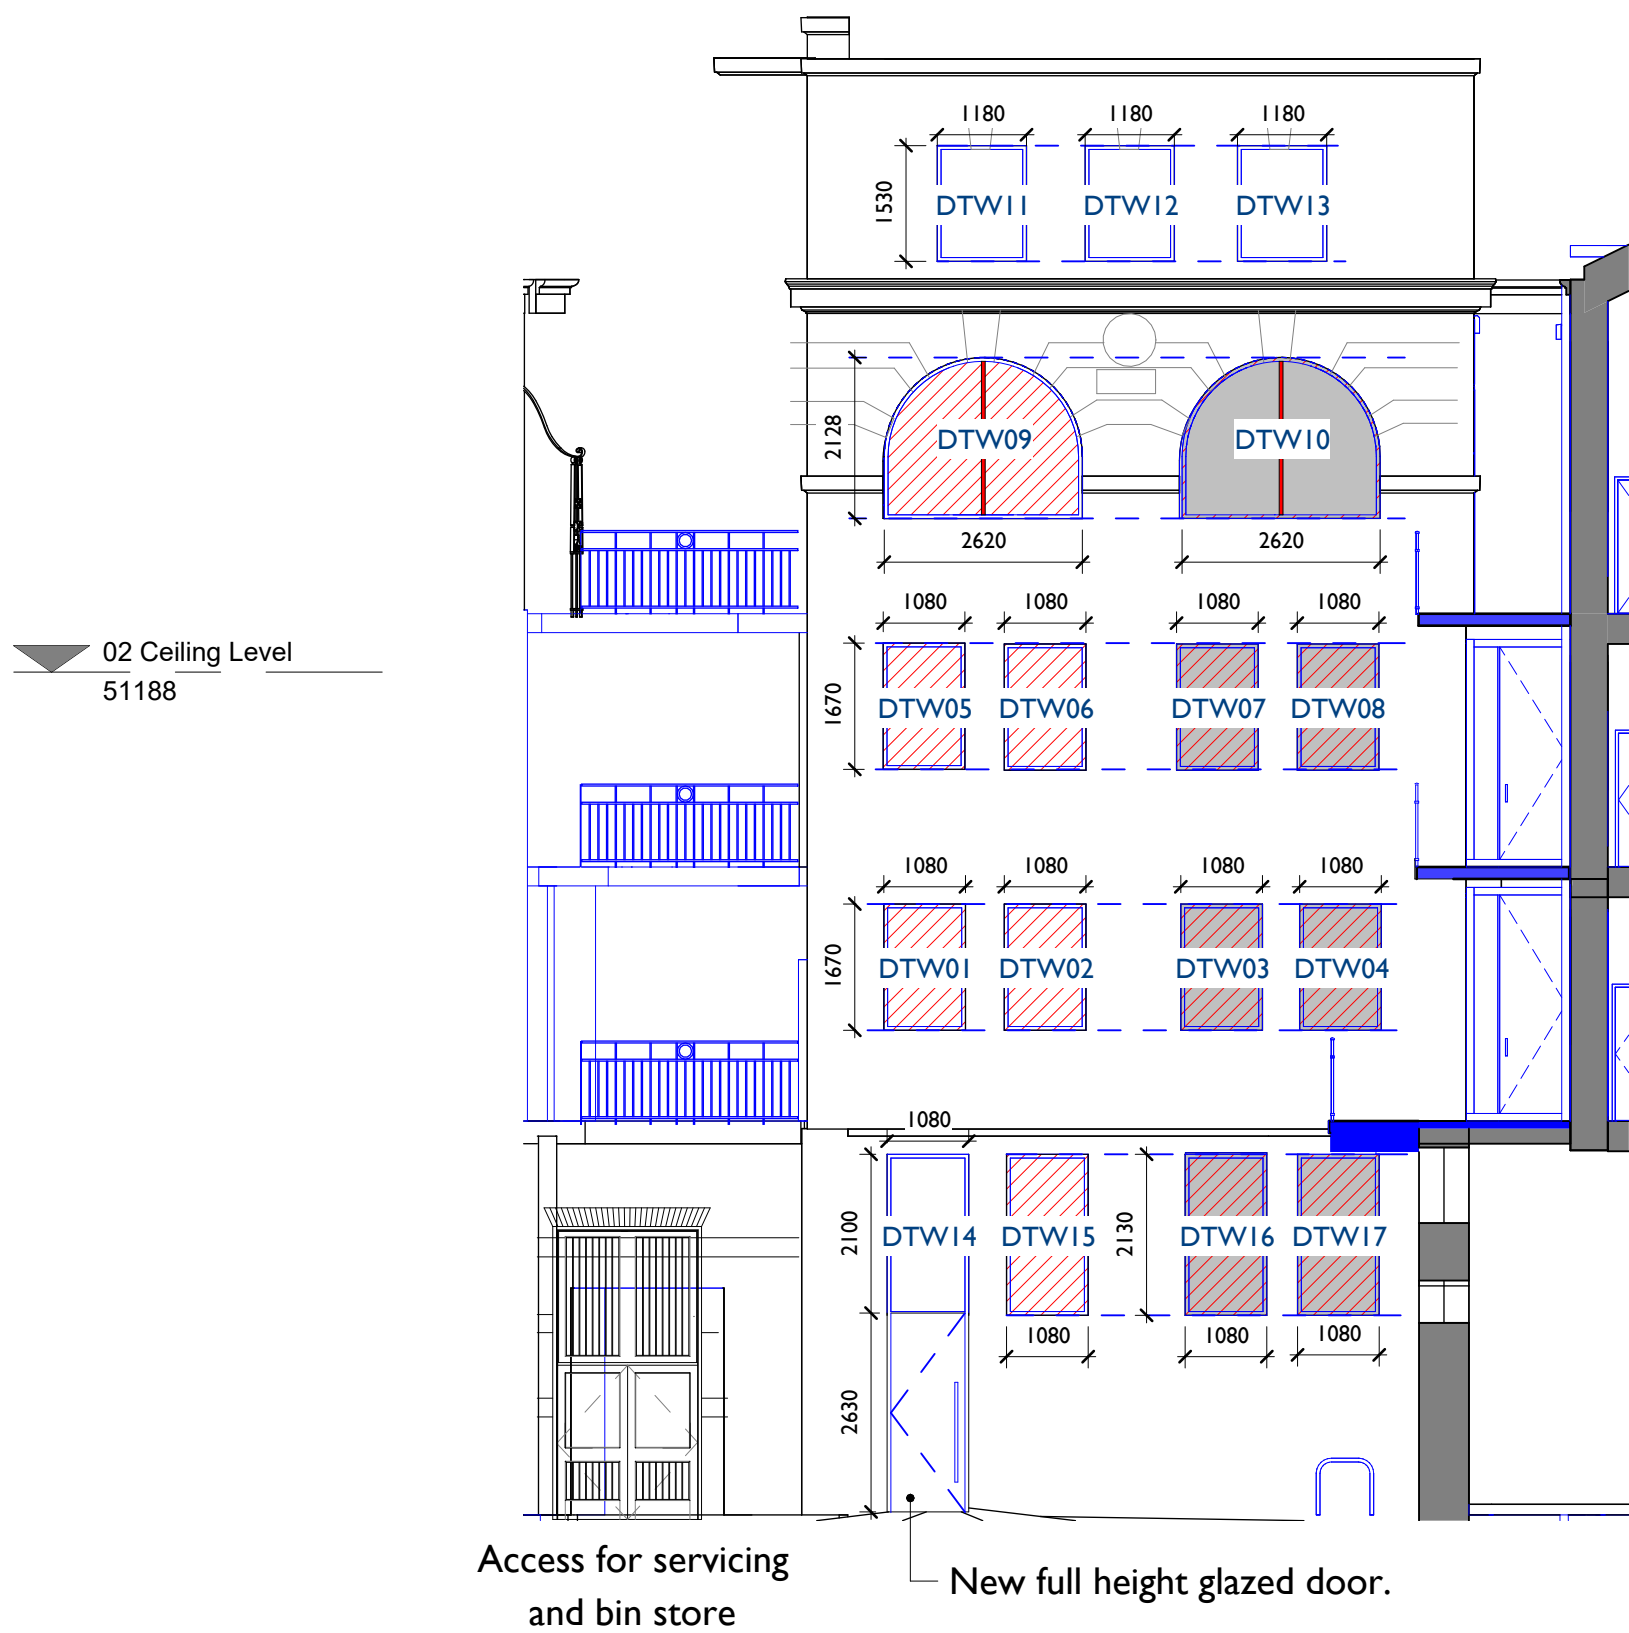




I
0218
Minshull Street Courtyard Elevation
I : 100

- Windows to be EI60 Fire rated
- Glazing to be obscured. Window specification to comply with the lift Engineer's requirements below.

“Glass panels, plane or formed shall be made of laminated glass. They and their fixings shall withstand 1000 N horizontal static force on an area of 0,30 m x 0,30 m at any point, from both inside and outside the well, without permanent deformation.”

Note:

- To be read in conjunction with M&E drawings.
- Locations as Architects drawings
- All SVP Penetrations and louvres to be reviewed following design changes from Consolux.
- Proposed first floor glazed canopy and hotel canopy omitted.
- All existing openings to be confirmed on site.
- Lighting scheme to be submitted as a separate condition

Notes:


Drawings are based on survey data and may not accurately represent what is physically present.

Do not scale from this drawing. All dimensions are to be verified on site before proceeding with the work.

All dimensions are in millimeters unless noted otherwise.

Purcell shall be notified in writing of any discrepancies.

Key Plan

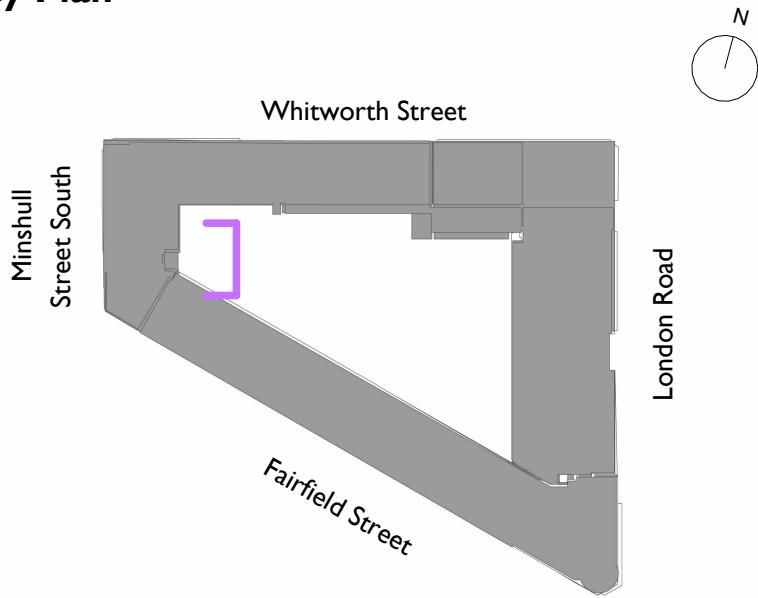

- New elements
- Ventilation louvre H71/45I
- Ventilation louvre H71/45I - hidden behind building elements in elevation
- SVP penetrations through roof
- SVP penetrations through roof - hidden behind building elements in elevation
- Windows with secondary glazing
- Proposed fabric

C.06	24.10.2024	Updates for Shell and Core Scope
C.07	30.10.2024	Updates to elevations for Shell and Core scope
P.15	06.12.2024	Planning issue

REV	DATE	DESCRIPTION
-----	------	-------------

CLIENT	
Allied London	
PROJECT	
London Road Fire Station	
JOB NUMBER	
240242	

TITLE
Proposed Minshull Street Courtyard Elevation

SIZE	SCALE	LAST REVISED	DRAWN	CHECKED
A1L	As indicated	06/12/2024 15:22:28	JS	JPH

REV	SUITABILITY/REASON FOR ISSUE
P.15	S4 - PLANNING

DRAWING NUMBER
LRFS-PUR-00-ZZ-DR-A-0218