


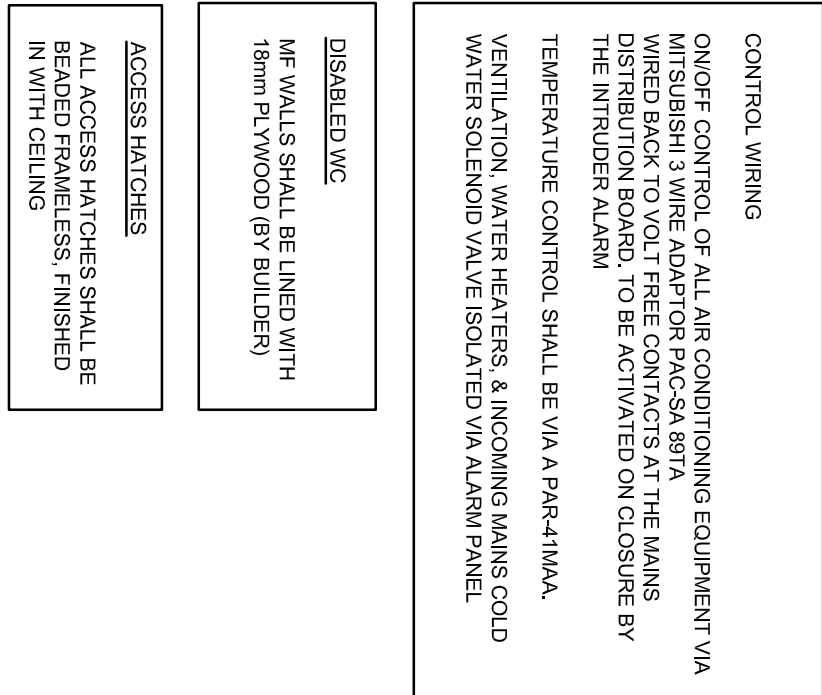

CONTROL WIRING
ON/OFF CONTROL OF ALL AIR CONDITIONING EQUIPMENT VIA
MOTOR-OPERATED PACKS SHALL BE PROVIDED. ALL PACKS
WIRING BACK TO MCAI PREE CONTACTS AT THE MAINS
DISTRIBUTION BOARD, TO BE ACTIVATED ON CLOSURE BY
THE INTRUDER ALARM
TEMPERATURE CONTROL SHALL BE VIA A PAR-41MAA,
VENTILATION, WATER-HEATERS, & INCOMING MAINS COLD
WATER SOLENOID VALVE ISOLATED VIA ALARM PANEL.

DISABLED WC
MF WALLS SHALL BE LINED WITH
18mm PL YWOOD (BY BUILDER)

ACCESS HATCHES