



CONTINUATION OF DRAWING 'MARDEN STREET'

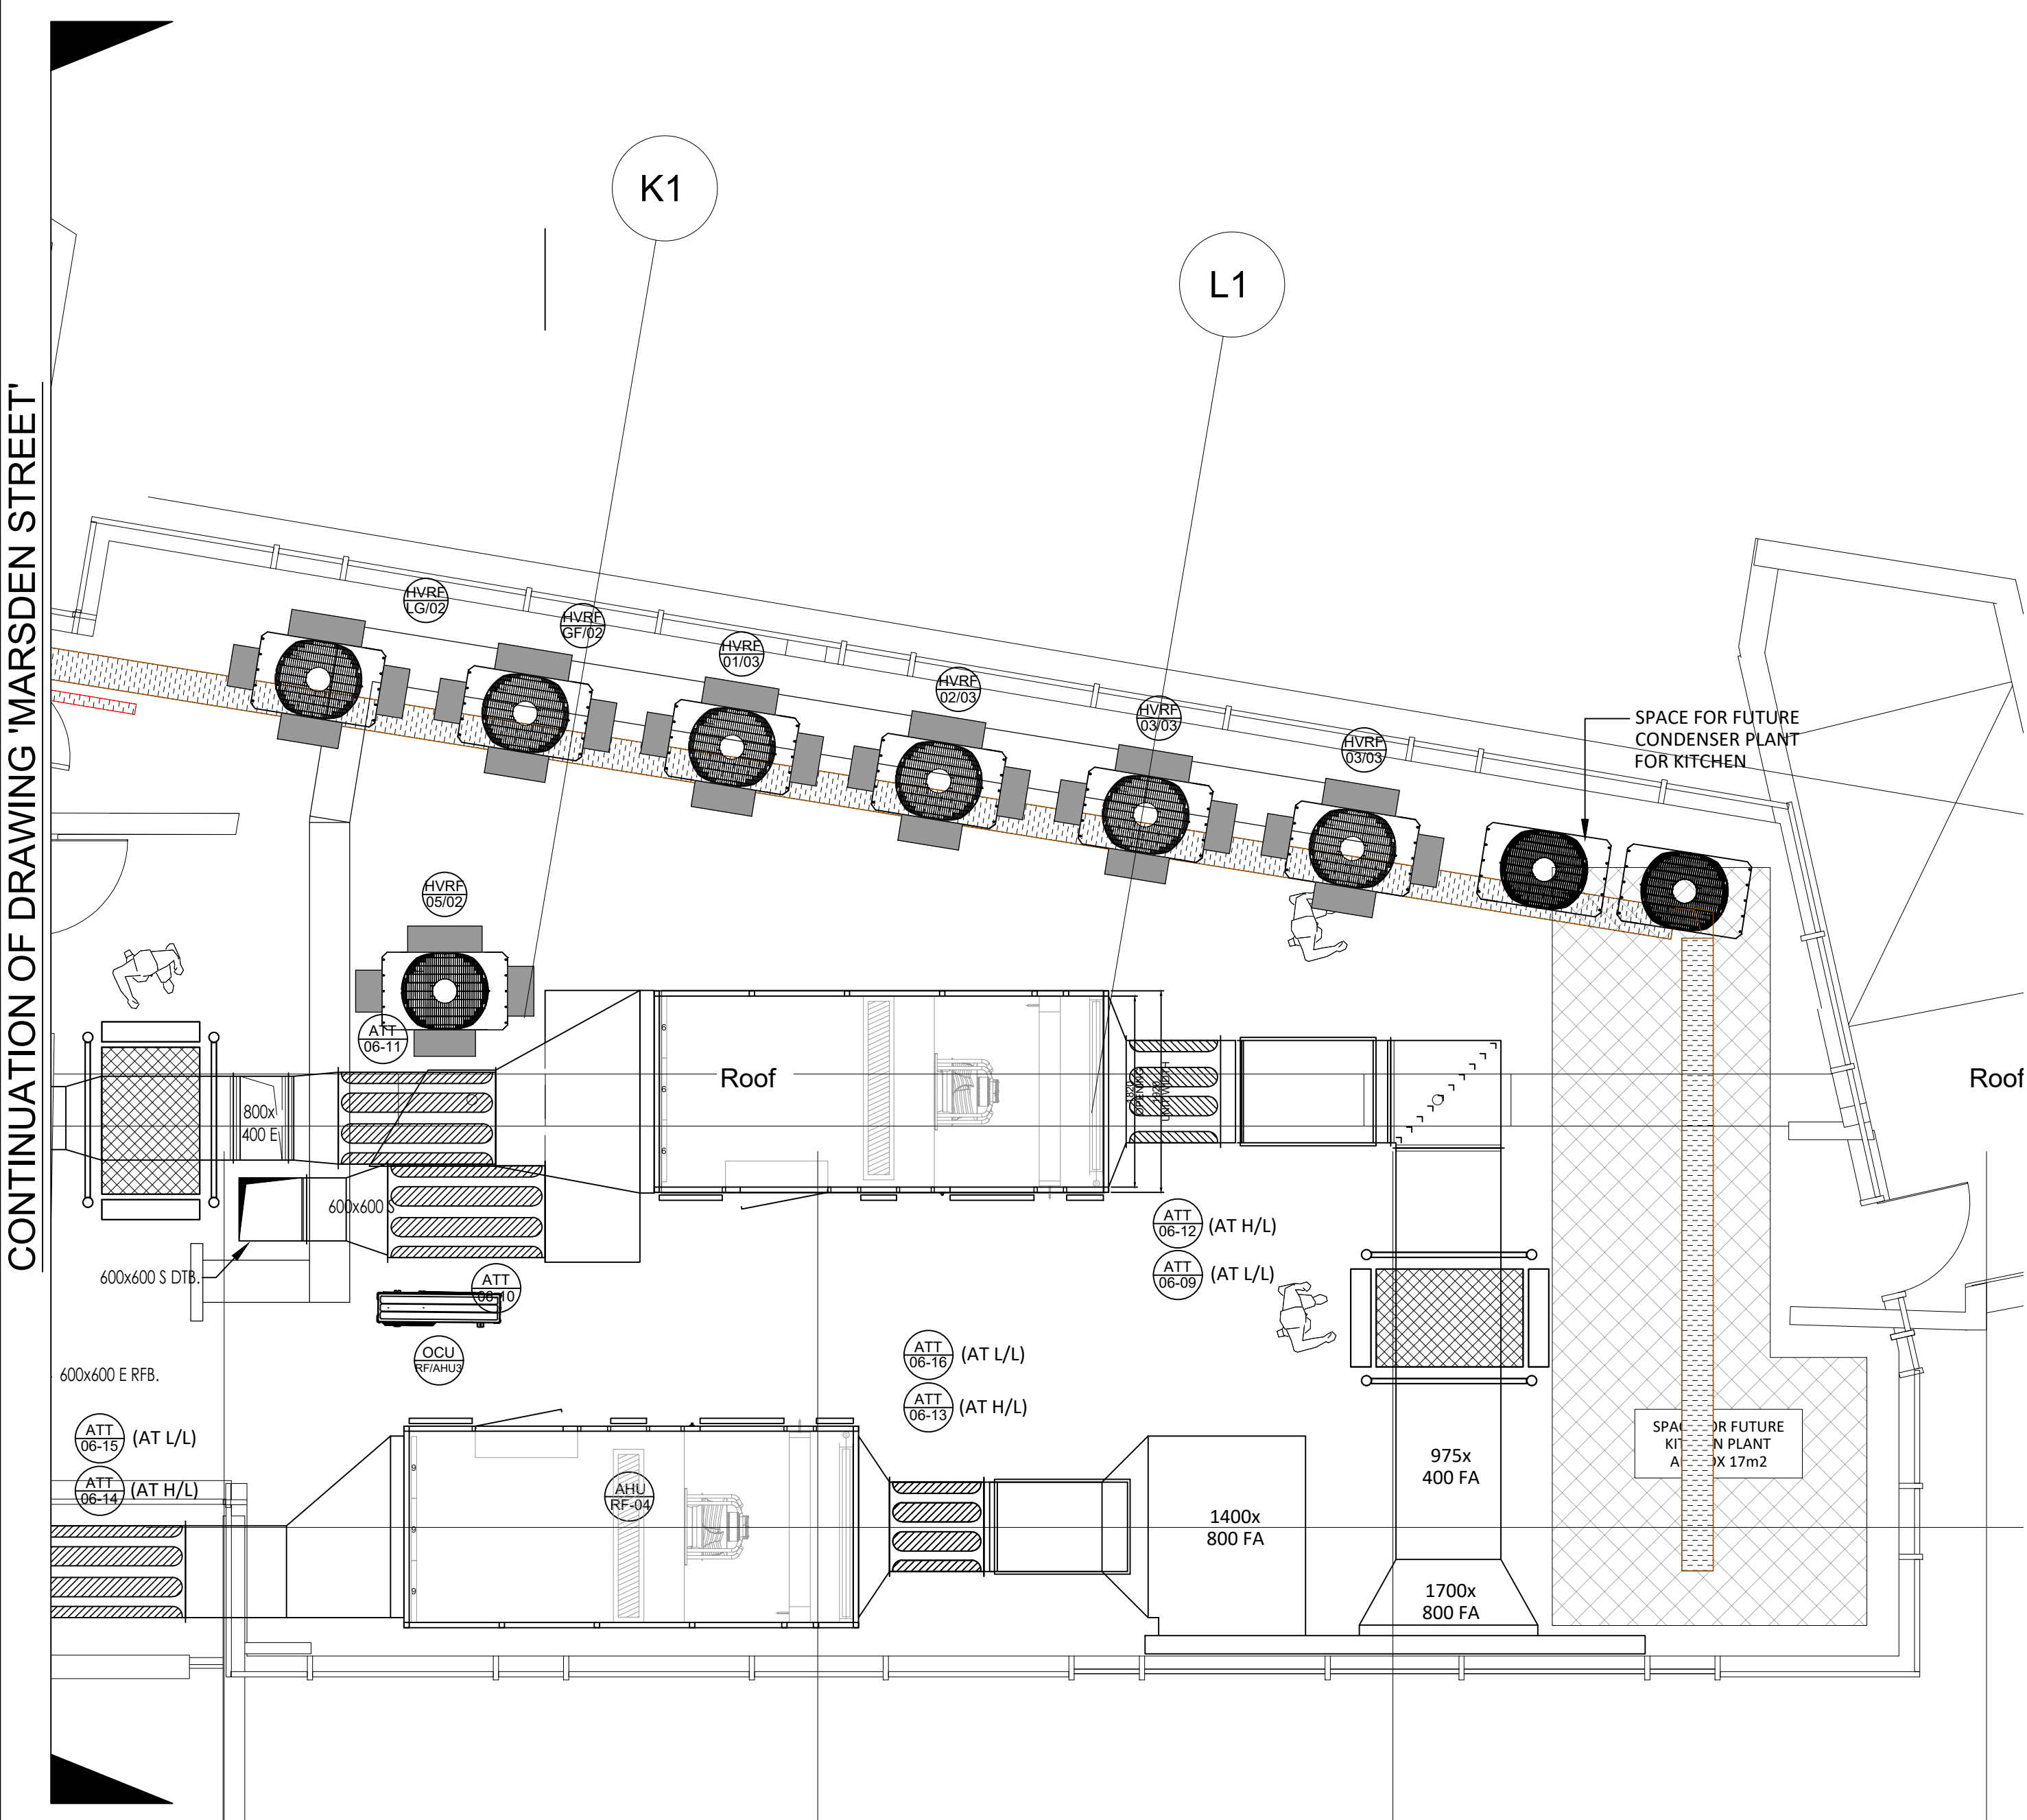


SECTION 'A' - 'A' ON GRID LINE 7 Scale 1:50

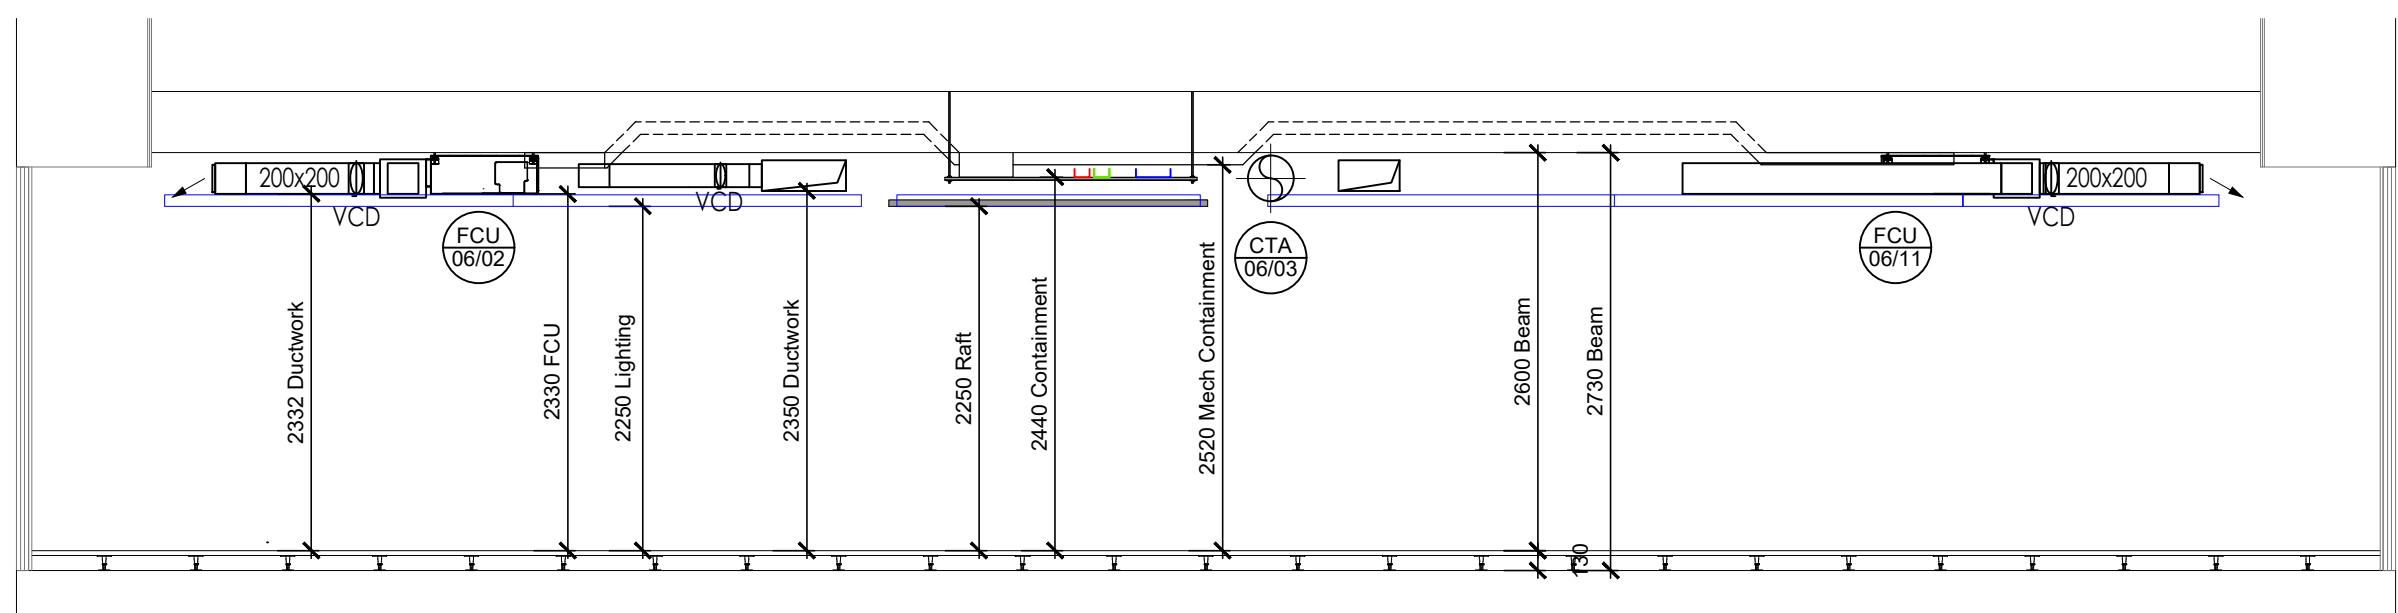

PLAN AT 6th FLOOR LEVEL Scale 1:50

HVRF Tower Block 6th Floor Zone 1									
CU Ref	Location	Model	Cooling kW	Heating kW	CO2 P	FLC A	Input kW	Fuse	
HVRF-06-01	Tower Roof	PURV-EN400YHW	45	13.63	12.9 / 22.9	13.55	40/30		
Unit Ref	Room	Model	Type	Air l/s	Required Sensible Cooling kW	Required Heating kW	NR		
FCU-06-01	Arrival Lounge 6.19	PEFY-WP32VMA-E	FCU	242	3.11	1.98	29		
FCU-06-02	BP Meeting Room	PEFY-WP32VMA-E	FCU	242	3.03	1.89	29		
FCU-06-03	52P Office 06.16	PEFY-WP32VMA-E	FCU	242	3.29	2.03	29		
FCU-06-04	52P Office 06.16	PEFY-WP32VMA-E	FCU	242	3.29	2.03	29		
FCU-06-05	52P Office 06.16	PEFY-WP32VMA-E	FCU	242	3.29	2.03	29		
FCU-06-06	52P Office 06.16	PEFY-WP32VMA-E	FCU	242	3.29	2.03	29		
FCU-06-07	52P Office 06.16	PEFY-WP32VMA-E	FCU	242	3.29	2.03	29		
FCU-06-08	52P Office 06.16	PEFY-WP32VMA-E	FCU	200	1.76	0.88	26		
FCU-06-09	Teapoint 6.13	PEFY-WP32VMA-E	FCU	146	1.76	0.98	26		
FCU-06-10	4P Meeting Rm 6.10	PEFY-WP32VMA-E	FCU	200	2.34	1.33	27		
FCU-06-11	Library/Touchdown	PEFY-WP32VMA-E	FCU	242	3.29	2.03	29		
FCU-06-12	10P Meeting Rm	PEFY-WP32VMA-E	FCU	242	3.29	2.03	29		
HBC Ref	Location	Model	No	Size	SC A	FLC A	Input kW	Fuse	
HBC-06-01	Corridor	CHB-WM108V-AA	8	150x650x30	x	2.83	0.46	6	
HBC-06-01a	Corridor	CHB-WM108V-AA	8	150x650x30	x	2.83	0.46	6	

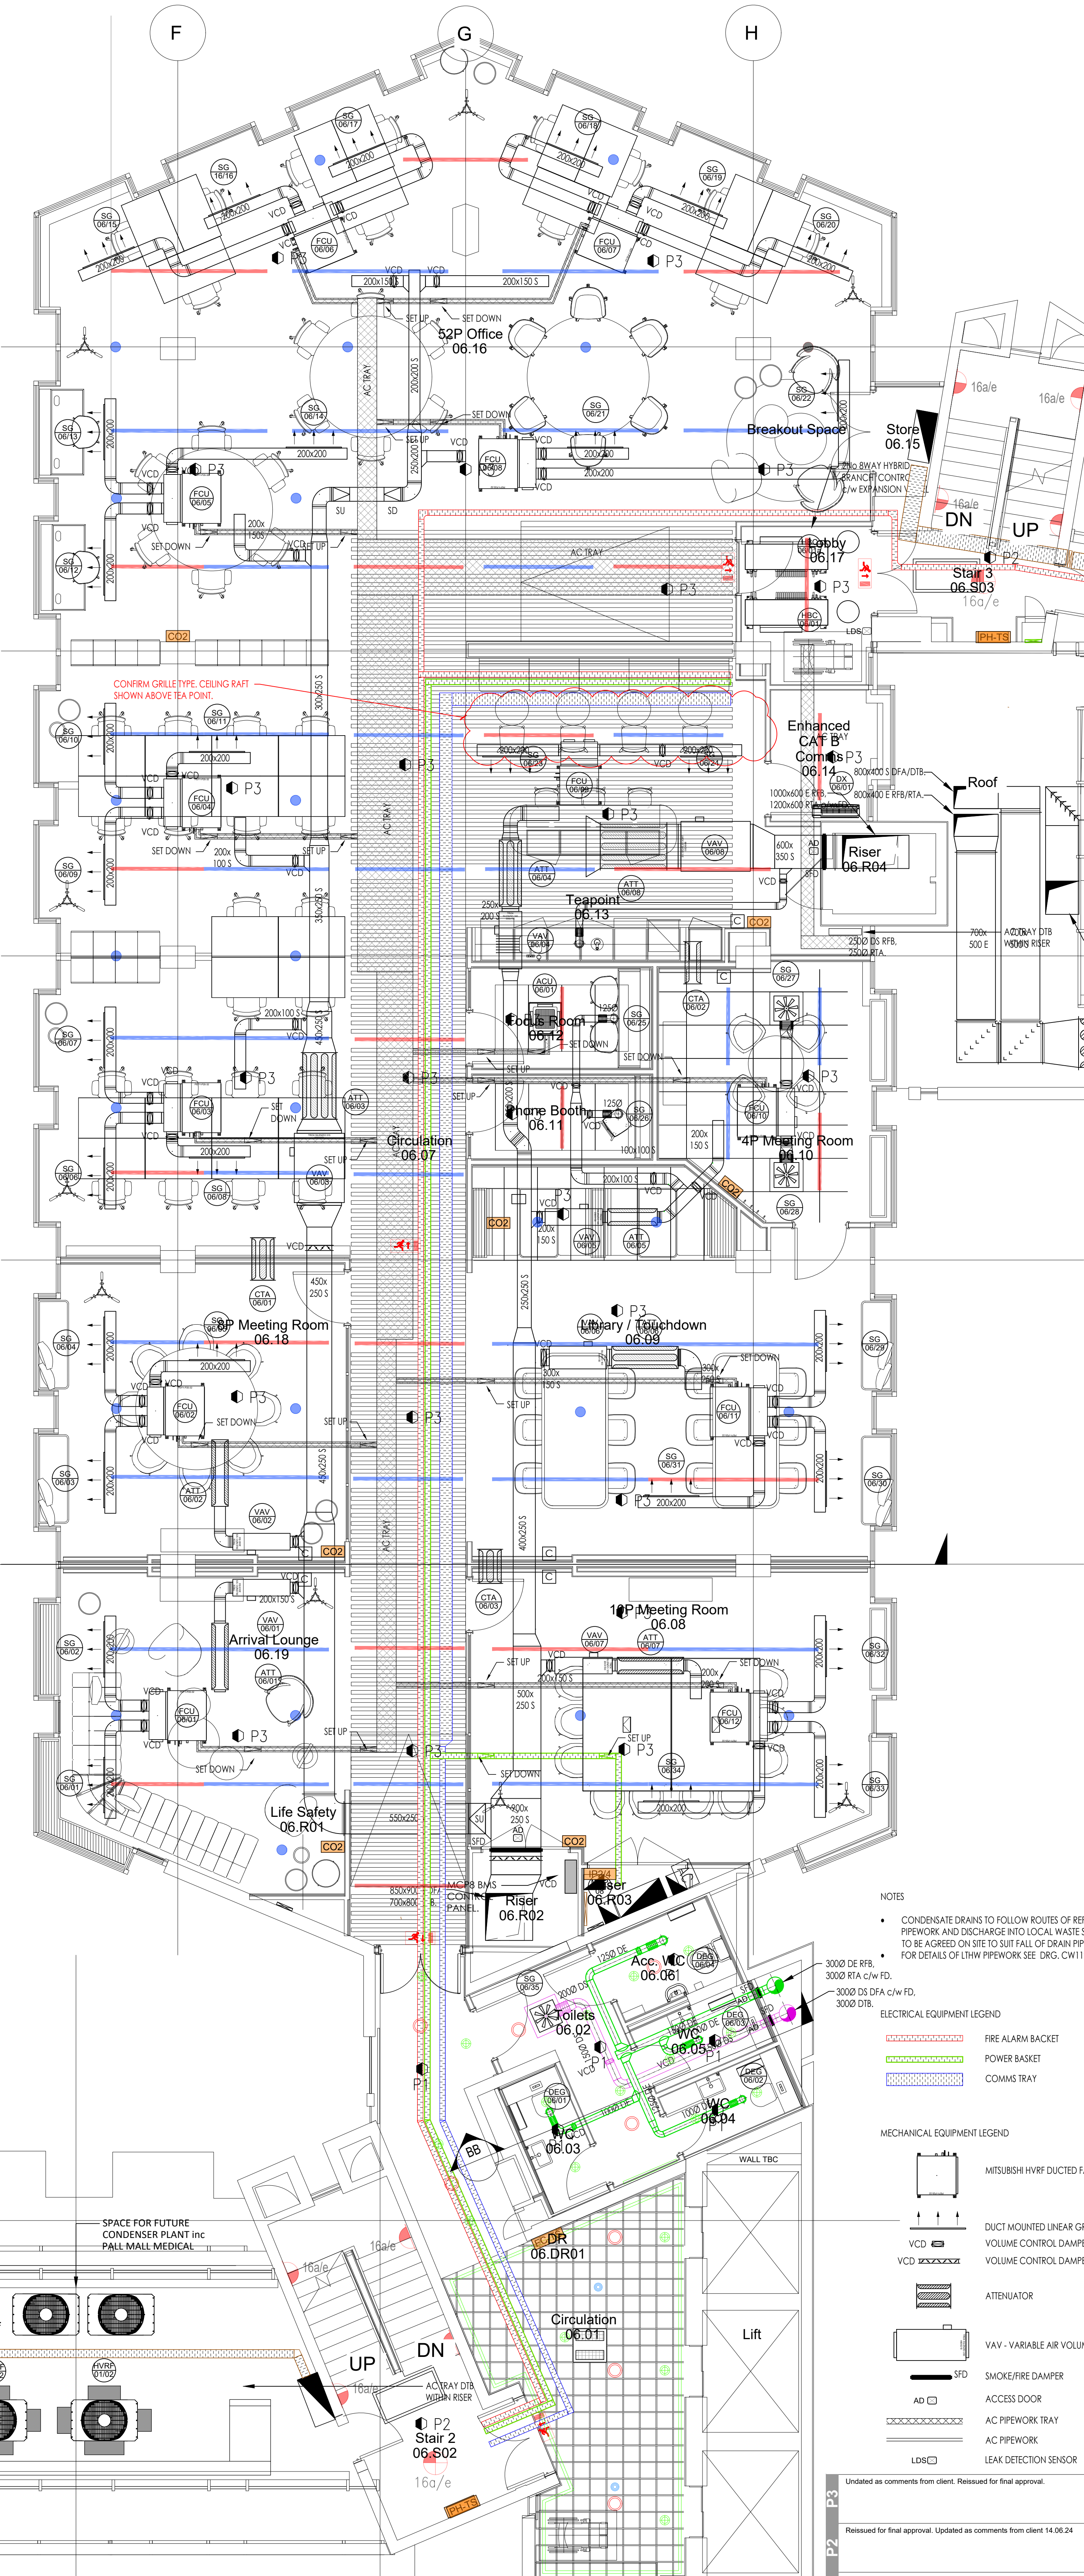

NOTES
• CONDENSATE DRAINS TO FOLLOW ROUTES OF REFRIGERATION PIPEWORK AND DISCHARGE INTO LOCAL WASTE STACK (LOCATION TO BE AGREED ON SITE TO SUIT FALL OF DRAIN PIPEWORK)
• FOR DETAILS OF LITH PIPEWORK SEE ENG. CW1193-14-36-06-01

ELECTRICAL EQUIPMENT LEGEND
FIRE ALARM BASKET
POWER BASKET
CONCRETE TRAY

MECHANICAL EQUIPMENT LEGEND
MITSUBISHI HVRF DUCTED FAN COIL
DUCT MOUNTED LINEAR GRILLE
VOLUME CONTROL DAMPER
VOLUME CONTROL DAMPER
ATTENUATOR
VAV - VARIABLE AIR VOLUME UNIT
SMOKE/FIRE DAMPER
ACCESS DOOR
AC PIPEWORK TRAY
AC PIPEWORK
LEAK DETECTION SENSOR

Undated as comments from client. Released for final approval.

Released for final approval. Updated as comments from client 14.06.24

For Approval

Revision description

Client

Project

Coordinated M+E Services Layout

6th Floor Level

Drawn by P.S.

Checked by D.I.

Approved by S.K.

Scale 1:50

Sheet Size A0

Issue Date March 24

Contract No. CW1193


Drawing No. ME-59-06-01

Revision P2

The contractor is to check all dimensions and conditions on site before commencing. DO NOT SCALE - USE 100% FOR DIMENSIONS ONLY. This drawing is confidential & is the property of CubicWorks Ltd. It must not be copied, loaned or disclosed to any third party without prior written consent.

CONTINUATION OF DRAWING 'MARDEN STREET'

SECTION ON 'B' - 'B' Scale 1:50

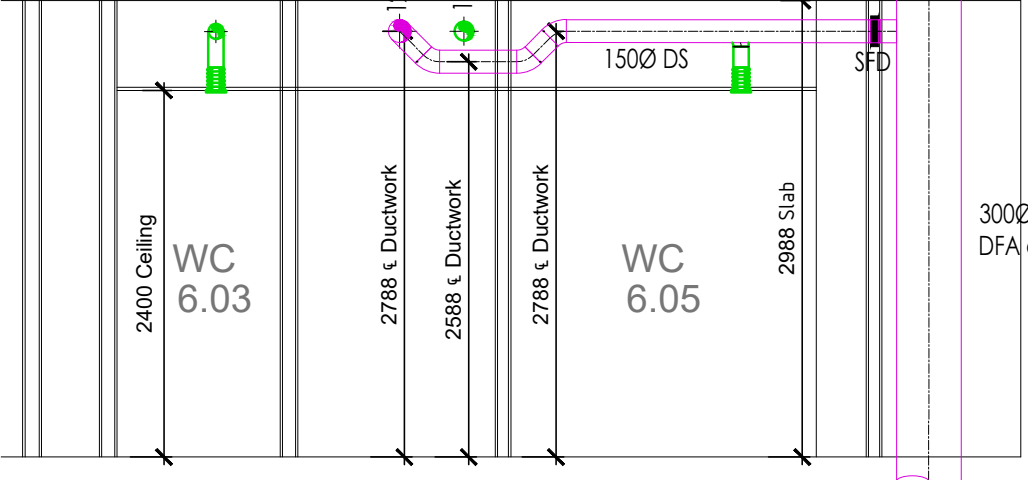

ISSUED FOR APPROVAL



2nd Floor Spinnaker Court,
31 Broadway, Salford,
Manchester M50 2YR