



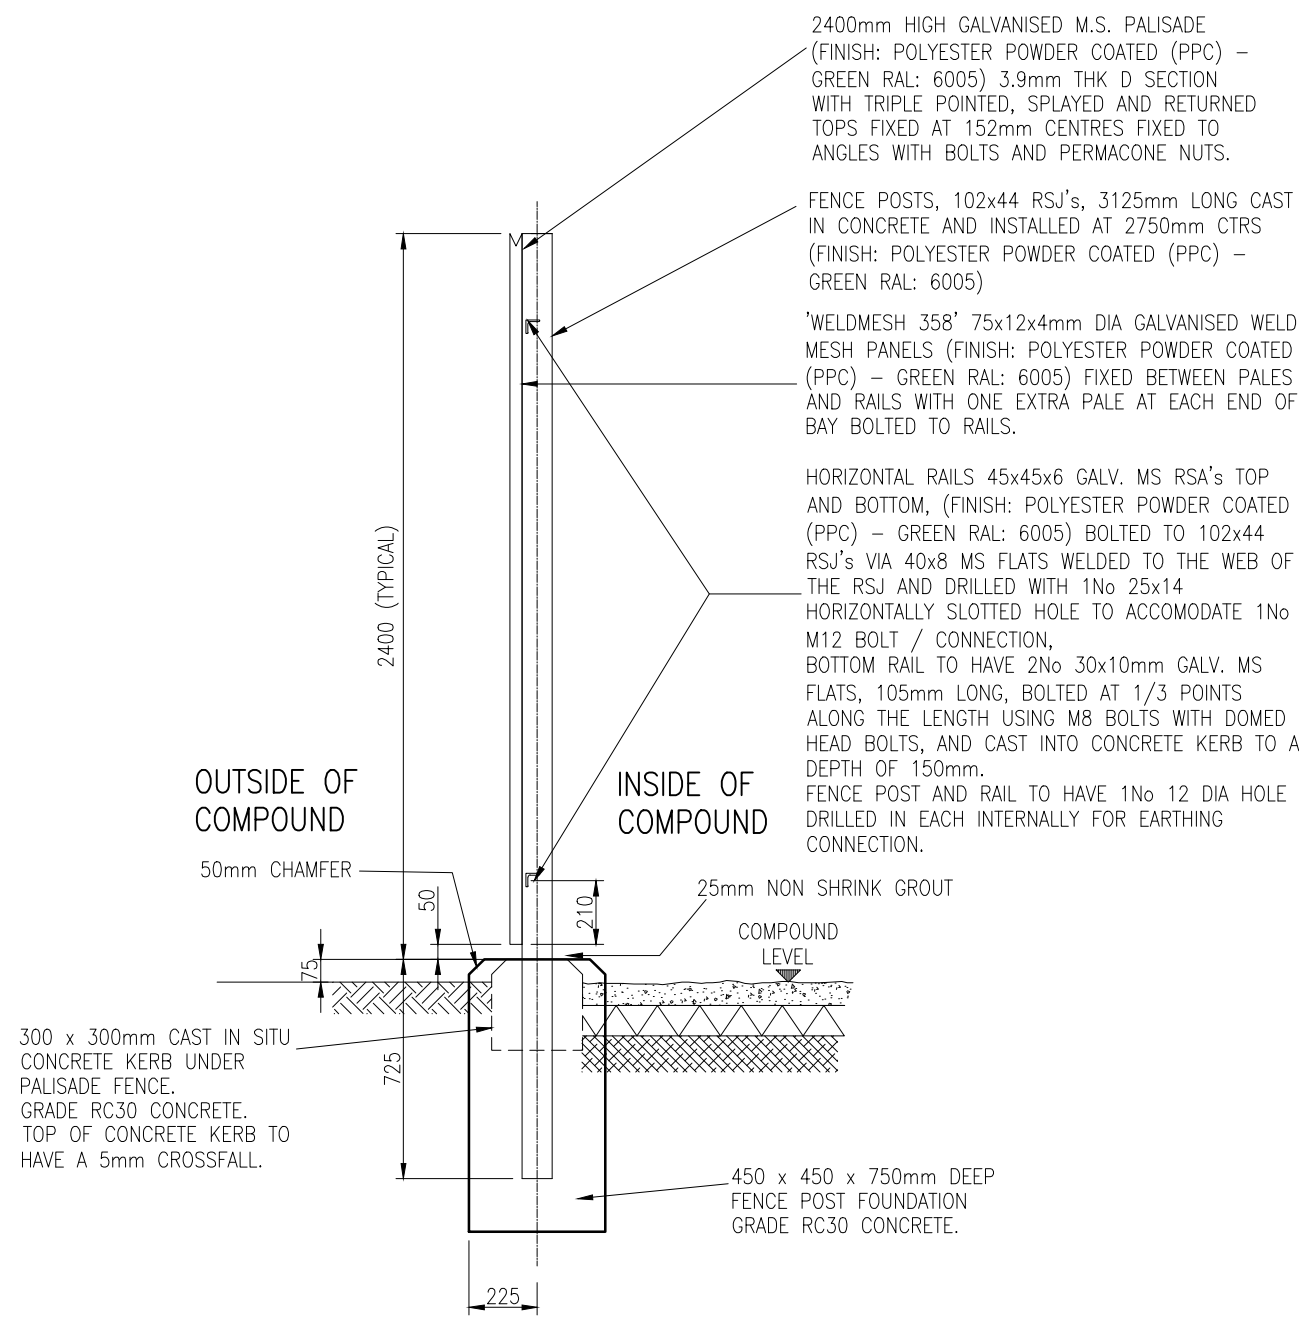

SECTION THROUGH PALISADE FENCE
SCALE: 1:20

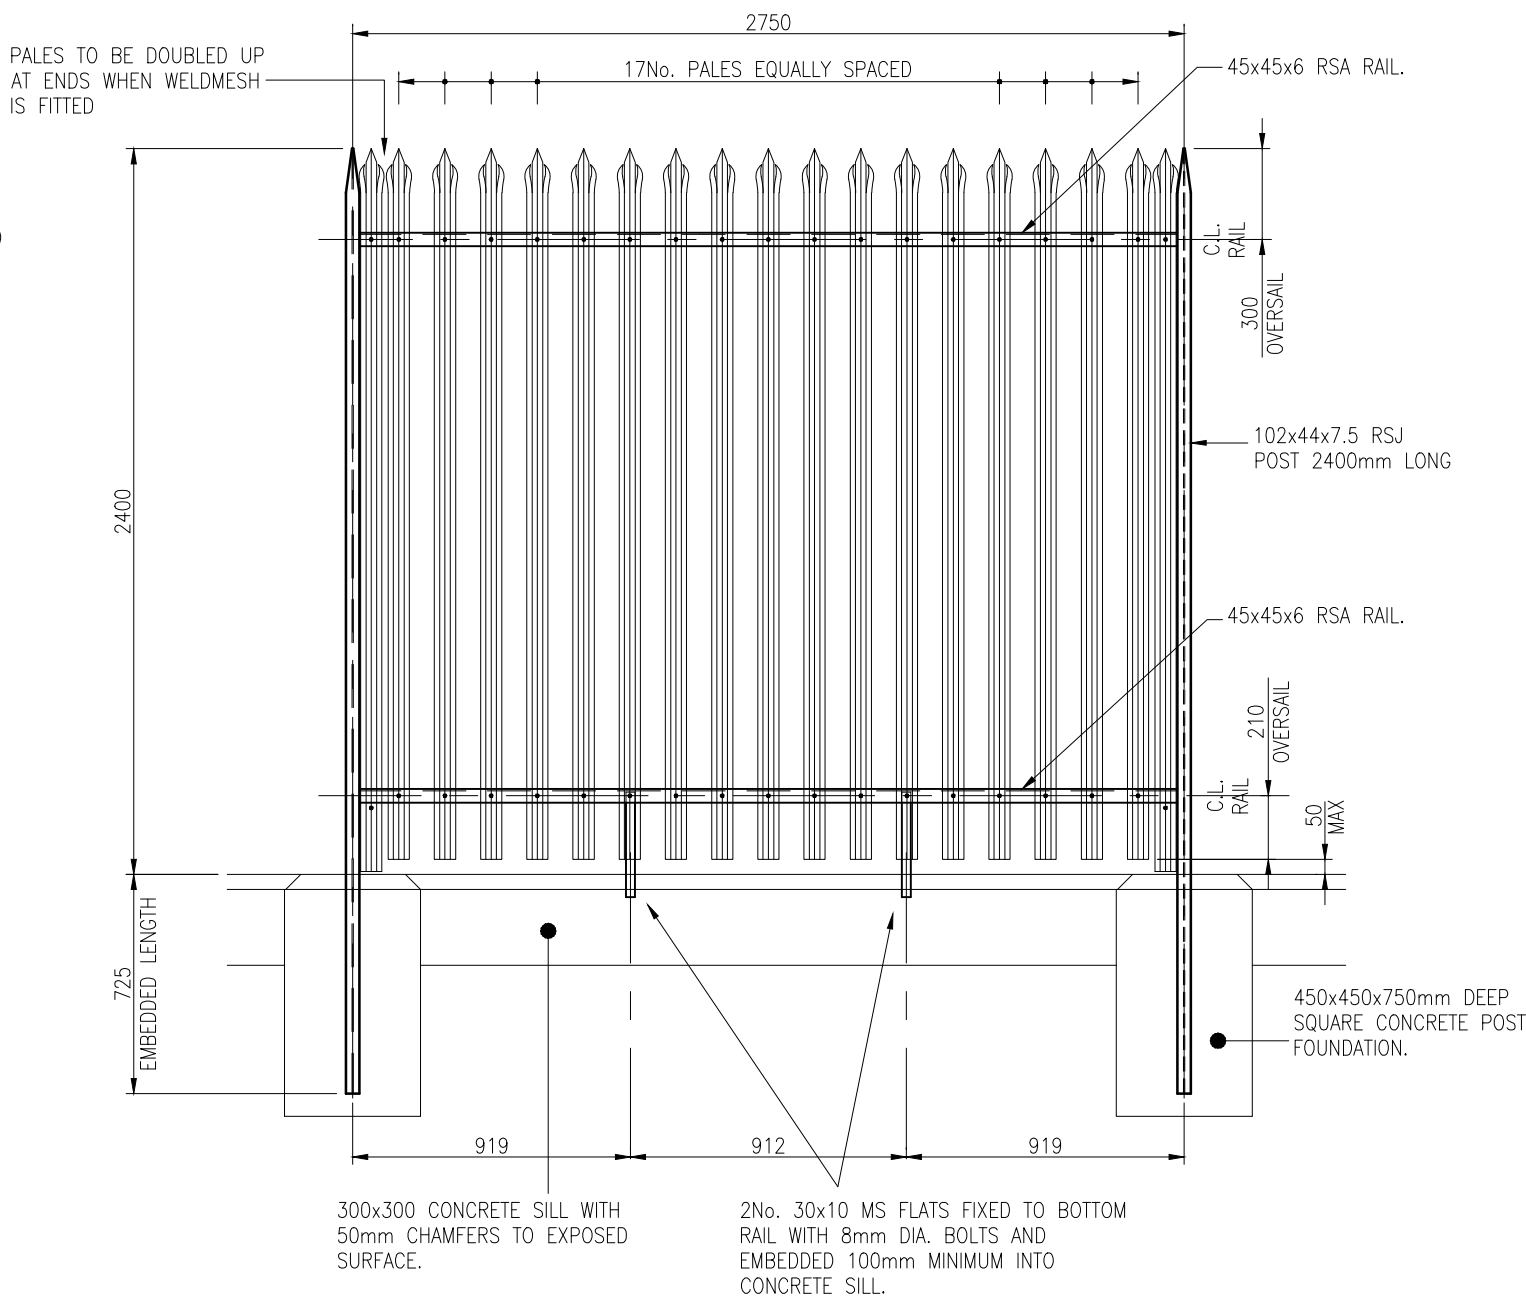

ELEVATION ON PALISADE FENCE PANEL
SCALE: 1:20

- NOTES:**
- PALISADE FENCING DETAILS TO COMPLY WITH BS 1722-12 : 2016.
 - FENCE POSTS, RAILS AND PALES AS A MINIMUM TO BE CONSTRUCTED USING S275 GRADE STEEL.
 - ALL STEELWORK COMPONENTS TO BE HOT DIPPED GALVANISED TO BS EN ISO 1461:2009. THE MINIMUM THICKNESS OF HOT DIPPED GALVANISED TO BE 85 MICRONS.
 - STEELWORK TO BE DRILLED PRIOR TO HOT DIPPED GALVANISING. FIXINGS MADE AFTER GALVANISING TO BE MADE USING CLAMPED FIXINGS.
 - BOLTS TO BE MINIMUM STRENGTH GRADE OF 8.8. NUTS TO BE GRADE OF 8.
 - ALL WELDS ARE TO BE DESIGNED BY THE MANUFACTURER
 - NOTICES AND SIGNS TO TO COMPLY WITH "BS 1722-17 FENCES - PART 17: SPECIFICATION FOR FENCES - DESIGN, INSTALLATION AND MAINTENANCE."
 - FENCING TO BE FINISHED USING POLYESTER POWDER COATED (PPC) - GREEN RAL: 6005)



ELECTRICITY NORTH WEST
FREDERICK ROAD
SALFORD M6 6QH

HULME PRIMARY SUBSTATION

TYPICAL PALISADE FENCING DETAILS
WITH WELDMESH

SCALE	AS NOTED	SITE NAME	HULME PRIMARY SUBSTATION		
DRAWN	D. HADWIN	PROJECT			
APPROVED	JAB	P.F.R. NO.	101045	DWG STATUS	Released
DATE	NOV 24		DRAWING NUMBER		REVISION
SHEET SIZE	A1		101045-00009		001
OLD DWG NO					

THIS DRAWING AND ANY INFORMATION OR DESCRIPTIVE MATTER SET OUT HEREON ARE THE CONFIDENTIAL AND COPYRIGHT PROPERTY OF ELECTRICITY NORTH WEST LIMITED AND MUST NOT BE DISCLOSED, LOANED, COPIED OR USED FOR ANY PURPOSE WITHOUT WRITTEN PERMISSION.			
NOT TO BE SCALED. UNLESS OTHERWISE STATED DIMENSIONS ARE IN MILLIMETRES.			
REV	AMENDMENTS	DRAWN	APP. DATE
001	FIRST ISSUE	D. HADWIN	JAB FEB 2024