





FOR EXTERNAL DATA CABLE ROUTES REFER TO SKETCH M14420-RPS-ZZ-ZZ-SK-E-6805


EXTERNAL CABLE TO BE EXTERNAL GRADE AND INSTALLED WITHIN A COPEX OR OTHER UNIVERSITY APPROVED DUCT WHICH SHALL ALSO BE INSTALLED WITHIN THE EXTERNAL PVC DUCT SYSTEM ALONG SIDE MAINS RATED CABLES.

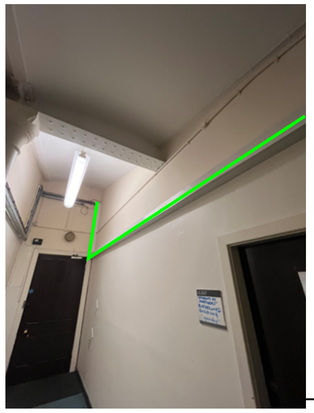

DATA CABLES TO ENTER C3 CORRIDOR FROM CEILING VOID UTILISING EXISTING DATA TRUNKING. CABLES FROM DATA CABINET TO DATA CABLE JUNCTION BOX IN ROOM LG.029 TO BE SCREENED CAT5A.

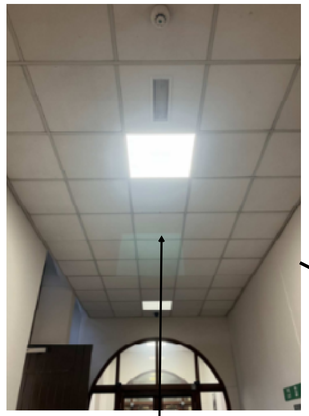


TRUNKING TO RUN WITHIN CEILING VOID. PICTURE TAKEN FROM OUTSIDE 034 LOBBY ROOM WHERE THE DATA CABINET IS LOCATED

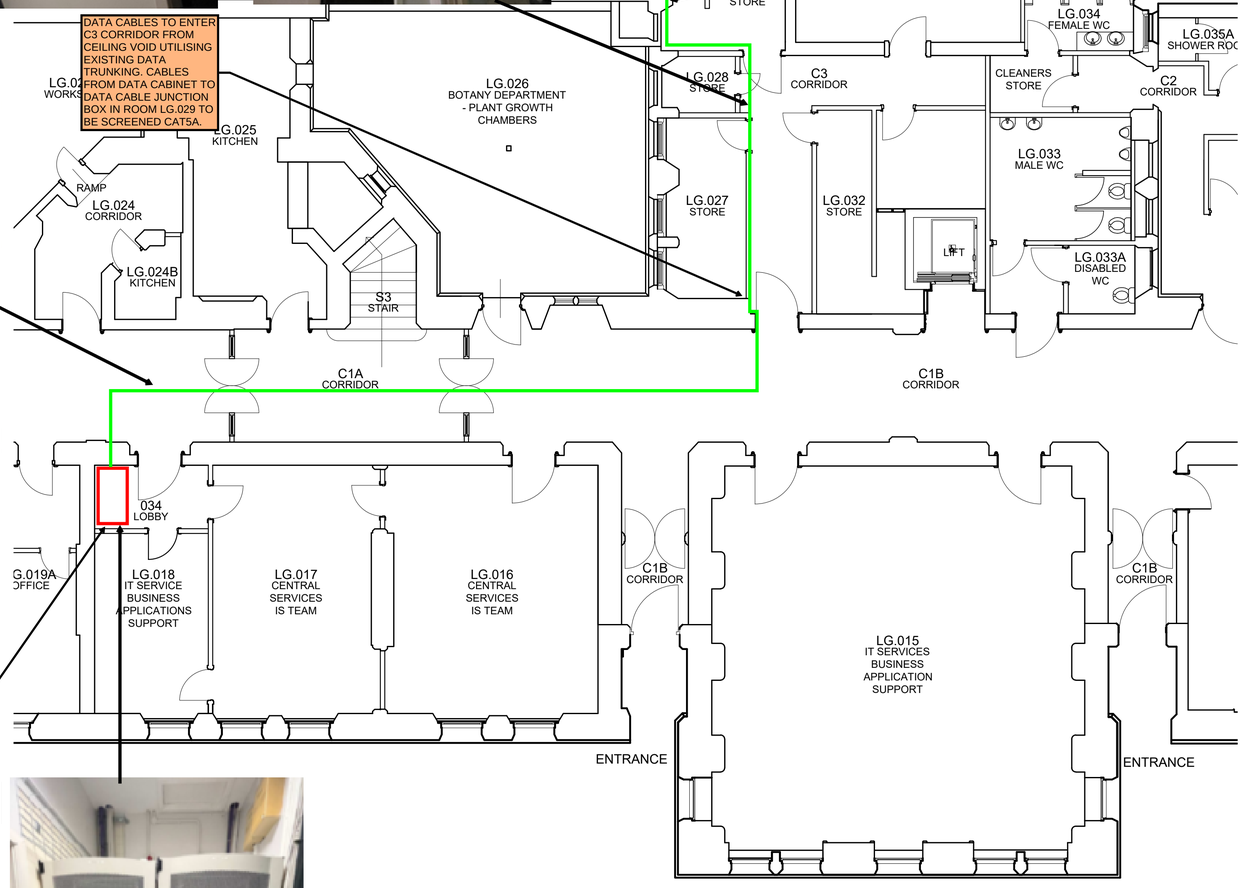

EXISTING DATA CABINETS LOCATED IN 034 LOBBY.



EXTERNAL GRADE DATA CABLES TO ENTER EXISTING BURIED DUCT SYSTEM.

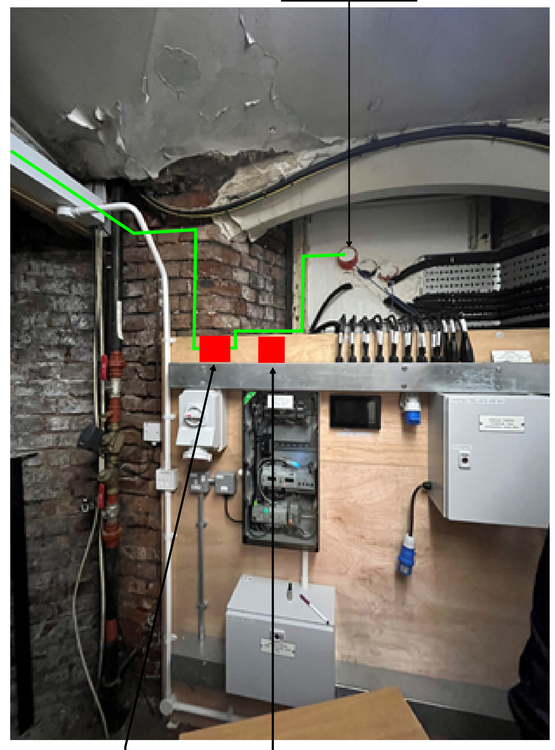

DATA JUNCTION BOX TO JOINT THE INTERNAL CAT5A DATA CABLE TO THE EXTERNAL GRADE DATA CABLE.

NEW SINGLE SOCKET OUTLET FOR POWER INJECTOR (FOR PoE) SERVED FROM ADJACENT DISTRIBUTION BOARD FOR DATA JUNCTION BOX.

JOWN OWENS BUILDING LOWER GROUND FLOOR LAYOUT

5 New York Street
Manchester M1 4JB, United Kingdom
T +44 161 228 1800
Email:lnfoman@rpsgroup.com
www:www.rpsgroup.com

Project:	UoM Old Quadrangle
Project Ref:	BSM14420
Title:	CCTV SERVICES ROUTES JOHN OWENS BUILDING
Reference:	M14420-RPS-ZZ-ZZ-SK-E-6811

Rev	Date	By
C04	JUNE' 24	NT