


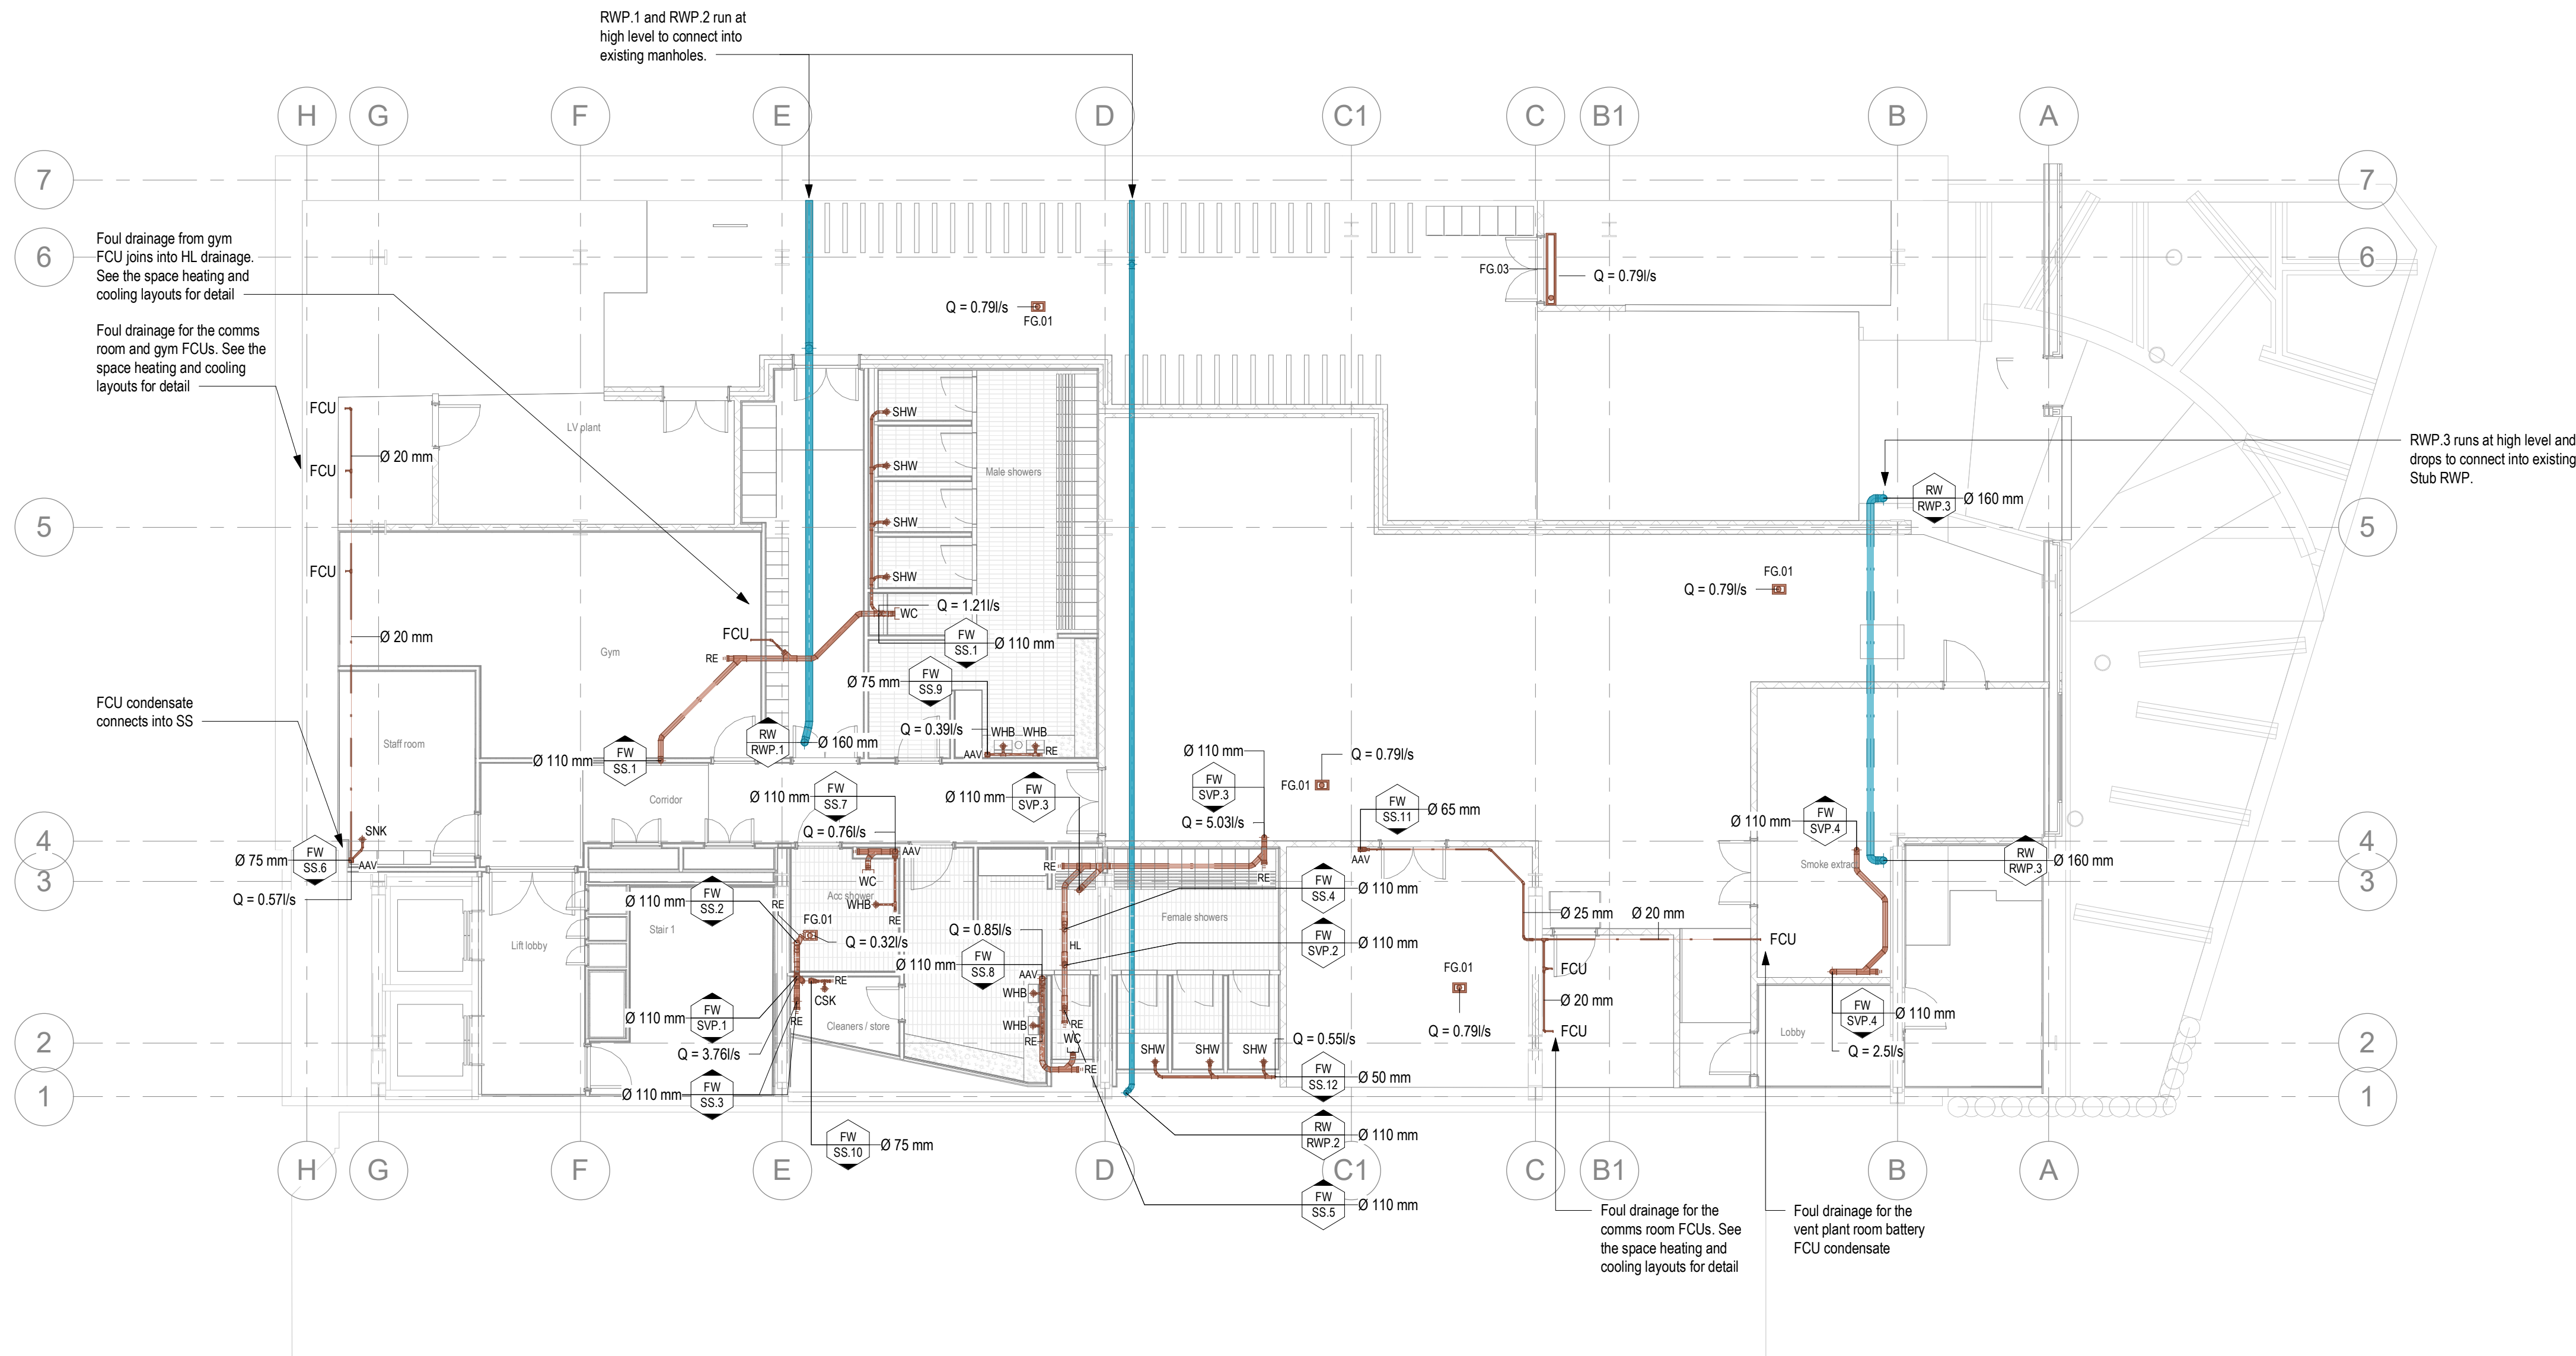


- GENERAL NOTES**
- Do not scale from this drawing.
 - Print this drawing in colour.
 - This drawing is to be read in conjunction with all other MXF documents (drawings, schedules and specification) along with other design team documentation.
 - Level 2 drawings are typical of level 01-07.
 - For details of below ground drainage installation and associated connections, refer to Structural Engineer's package.
 - For details of rainwater outlets, channels, external downpipes and general rainwater installation, refer to Architect's package.
 - All Soil Vent Pipes shown are new unless indicated otherwise.
 - All Branch Discharge Pipes are drawn with fall recommended in Table 6 of EN 12056-2.
 - All Drains drawn with a fall to achieve self-cleaning velocities as per BS EN 16399-2.
 - Pipework sizing - all main stacks and final branch sizes to standard fittings as listed below unless stated otherwise on layouts: RWP to pass through occupied areas to be acoustically insulated.

Main Stacks	
SVP	110mm
SS	110mm

Final Connections	
WC	110mm
WHB	40mm
Sink	40mm
Shower	50mm
Dishwasher	40mm
Washing Machine	40mm
Condensate	22mm

KEY

- Soil vent pipe
- Vent pipe
- Rainwater Pipe
- High Level Pipe
- WC Connector
- Rodding Eye
- From above
- To below
- Dish Washer
- Rodding Eye
- Floor Gully
- Wash Hand Basin
- Water Closet
- Cleaners Sink
- Kitchen Sink
- Fan Coil Unit

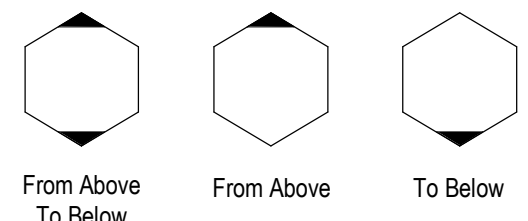

MAX FORDHAM

www.maxfordham.com

client:
Bywater Properties Ltd
job no. **J7424** project leader **IJS** scale at A1 **1 : 100**
status code and description
A1 - For Tender

project name
35 Fountain Street

issue date **29/11/2024** revision **C02** classification **Ss_50_30_04_00**

drawing title
Above Ground Waste Water Drainage Level B1

project code **35FS** - orig. **MXF** - volume **ZZ** - level **B1** - type **DR** - role **P** - number **12100**