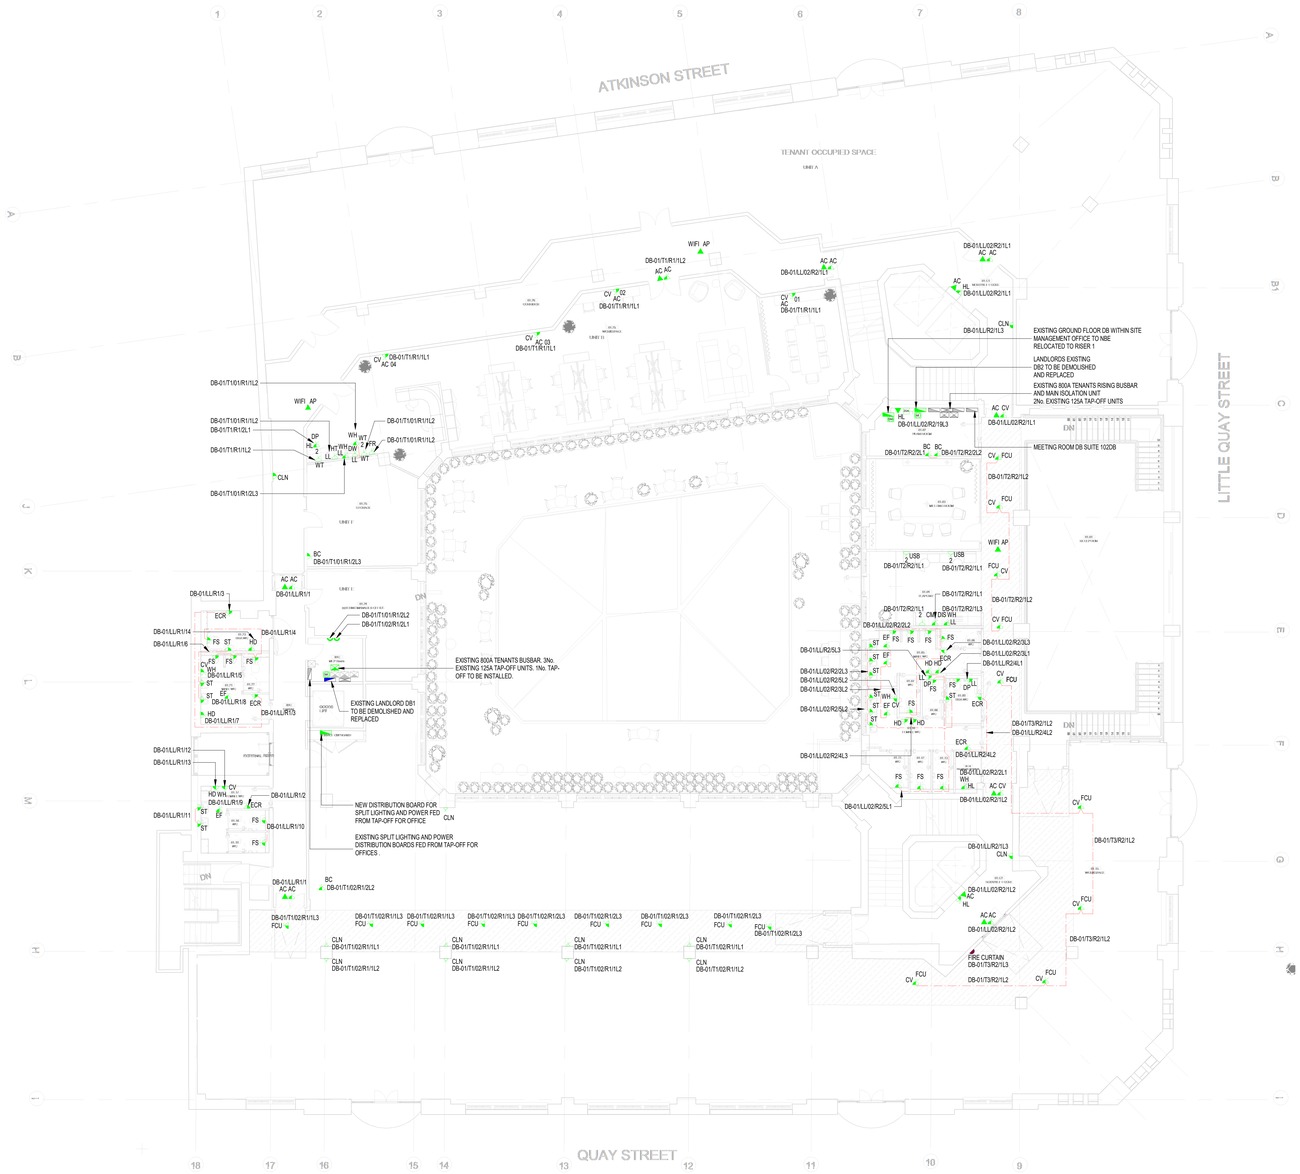

ABBREVIATIONS:

HD	HAND DRYER
EF	EXTRACT FAN
CV	CEILING VOID
EPH	ELECTRIC PANEL HEATER
ST	SENSOR TRAP
CLN	CLEANERS SOCKET
FS	FLOW SWITCH
FCU	FAN COIL UNIT
AC	ACCESS CONTROL
ECR	ELECTRIC CONTROL RADIATOR
WH	WATER HEATER
DP	DRAIN PUMP
LL	MOUNTED AT LOW LEVEL
ML	MOUNTED AT MID LEVEL
HL	MOUNTED AT HIGH LEVEL
DAS	DISABLE ALARM SYSTEM
EAC	ELECTRIC AIR CURTAIN
HT	HOT WATER TAP
FSN	FIBRE SPLITTER NODE
BC	BRANCH CONTROLLER
FR	FRIDGE
MW	MICROWAVE
WT	WORK TOP (FOR KITCHENETTES)
BWT	BELOW WORK TOP (FOR KITCHENETTES)
DW	DISH WASHER

ARCHITECTURE IS BASED ON ANOMALY DESIGN ARCHITECTS DRAWING NO. SLH-AND-PO-01-DR-A-05101 (D01) LEVEL 01 PLAN
REDRAWN 09.08.2024

THIS DRAWING IS FOR INFORMATION ONLY DO NOT SCALE

CDM REGULATIONS

HAZARDS	DATE ADDED	DATE MITIGATED	RISK ASSESSMENT DATE

LEGEND:

- 5PAN DISTRIBUTION BOARD
- TPAN DISTRIBUTION BOARD
- MAIN SWITCH BOARD/LV PANEL
- UNSWITCHED 13A SINGLE SOCKET OUTLET
- UNSWITCHED 13A TWIN SOCKET OUTLET
- SWITCHED 13A SINGLE SOCKET OUTLET
- SWITCHED 13A SINGLE SOCKET OUTLET - CLN DENOTES CLEANERS SOCKET
- TWIN 13A SWITCHED SOCKET OUTLET
- UNSWITCHED FUSED CONNECTION UNIT
- SWITCHED FUSED CONNECTION UNIT
- SWITCHED FUSED CONNECTION UNIT c/w NEON INDICATOR
- RED DP 13A FUSED CONNECTION UNIT c/w NEON INDICATOR & BARREL LOCK
- COMMANDO SOCKET
- DOUBLE POLE ISOLATING SWITCH (20SA)
- THREE POLE ISOLATING SWITCH
- 3 POLE ISOLATOR
- XXA 20XX — 5PAN ISOLATOR
- XXA 40XX — TPAN ISOLATOR
- RJ45 DATA OUTLET POINT
- TELEPHONE OUTLET POINT
- COOKER CONNECTION UNIT
- AV — AUDIO/VISUAL PLATE
- DADO TRUNKING
- HDMI — HDMI PORT
- DADO DROPPERS
- EPO — EMERGENCY STOP BUTTON
- FB1 — 1 No. TWIN SWITCHED SOCKET & 2 No. DATA OUTLETS (2 COMPARTMENT FLOORBOX)
- DISABLED ALARM PULL CORD SWITCH c/w INTEGRAL REASSURANCE LAMP
- R — RESET PUSH BUTTON
- DISABLED ALARM INDICATOR LAMP c/w INTEGRAL SOUNDER
- 3 COMPARTMENT DADO DROPPER
- DU BOX — DISTRIBUTION UNIT BOX
- CL — CLEANERS SOCKET FLOOR GORMET
- FB2 — SOCKET & 2No. DATA OUTLETS (4 COMPARTMENT FLOORBOX).
- 6A — UNSWITCHED FUSE SPUR FOR FIRE CURTAIN (IN COMPLIANCE WITH 8524)
- CLG -131 SUSPENDED PLASTERBOARD BULKHEAD FINISHED IN PNT-191, INCLUDE CLG-911 ACCESS PANELS
- 63A UNDERFLOOR BUS BAR POWER TRACK
- FSN — FIBRE SPLITTER NODE
- SM — SMART METER
- MI — MID METER
- WIFI AP
- 10A 400V — BOOSTER PUMP

REV	DATE	AMENDMENTS	BY	CKD
P01	23.08.24	ISSUED FOR COMMENT & APPROVAL	DB	SH

FOR COMMENT & APPROVAL

Commercial Services Design Ltd
Unit 5
Woodside Court
Clayton Wood Rise
Leeds
LS16 6RF
Tel: 0113 3223190
Web: www.csdesign.uk.com

CLIENT
G&H BUILDING SERVICES

PROJECT
SUNLIGHT HOUSE
LITTLE QUAY STREET
MANCHESTER M3 3HP

TITLE
ELECTRICAL SERVICES SMALL POWER AND DATA LAYOUT
LEVEL 01

SCALE @ A1:	1:100	CSD REF:	CSD 1298
DRAWN:	MW	ENGINEER:	DB
STARTED:	JUNE 24	ISSUED:	AUGUST 24
CHECKED:	DB	APPROVED:	BW

DRAWING NO: **1298-CSD-XX-01-DR-E-6202** REV: **P01**
Project-Originator-Volume-Level-Type-Discipline-DrawingNumber

This drawing is the property of Commercial Services Design Ltd. Copyright is reserved by them and is issued on the condition that it is not copied in whole or in part nor disclosed to a third party without consent of the copyright owners. Figured dimensions only to be taken from this publication and not from scale. All dimensions to be checked on site before commencement of any work. This drawing is to be read in conjunction with all other relevant consultants' drawings and specifications.