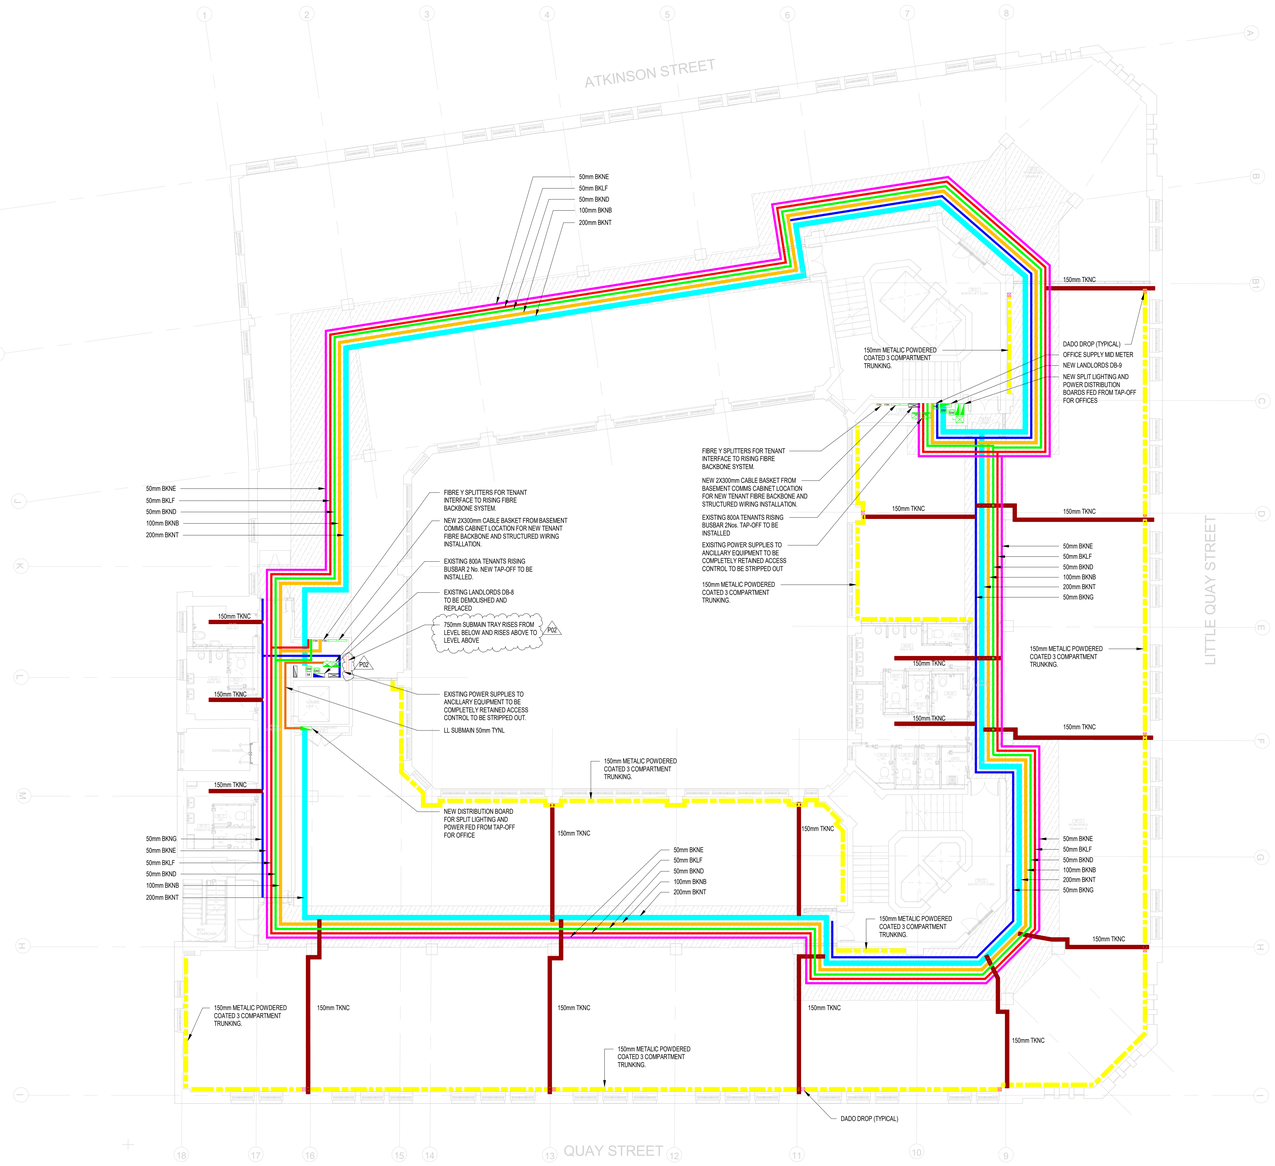

CONTAINMENT LEGEND

CONTAINMENT TYPE	SERVICE DESIGNATION	SERVICE TYPE	SERVICE DESCRIPTION	COLOUR DESIGNATION
LD - LADDER RACK	E - ESSENTIAL	H - HIGH VOLTAGE	HV SUBMAIN CABLES	
TY - CABLE TRAY	N - NON ESSENTIAL	L - LOW VOLTAGE	LV SUBMAIN CABLE CONTAINMENT	
BK- CABLE BASKET	L - LIFE SAFETY	E - EXTRA LOW VOLTAGE	LANDLORD ELV CONTAINMENT	
TK- TRUNKING		G - GENERAL LIGHTING & POWER	LANDLORD GENERAL LIGHTING & POWER CONTAINMENT	
		D - DATA	LANDLORD DATA CONTAINMENT	
		F - FIRE ALARM	LANDLORD FIRE SYSTEM CONTAINMENT	
		B - BUILDING MANAGEMENT SYSTEM	TENANT DATA CONTAINMENT	
		S - SECURITY	SECURITY (SPECIFIC)	
		T - TENANT	TENANT POWER AND LIGHTING CONTAINMENT	
		C - GENERAL LIGHTING & POWER, DATA & BMS, FIRE ALARM	THREE COMPARTMENT TRUNKING FOR GENERAL LIGHTING & POWER, DATA & BMS, FIRE ALARM	

NOTES

1. ALL TRAY WORK IS DEEMED TO BE 25mm RETURN MEDIUM DUTY GALVANISED STEEL TYPE UNLESS OTHERWISE DETAILED.
2. ALL WIRE BASKET IS DEEMED TO BE 54mm RETURN ZINK STEEL TYPE UNLESS OTHERWISE DETAILED.

TABLE OF POWER & INFORMATION TECHNOLOGY SEPARATION

TYPE OF INSTALLATION	WITHOUT A DIVIDER	WITH A NON-METALIC DIVIDER	STEEL DIVIDER
UNSCREENED POWER CABLE & UNSCREENED IT CABLE	200mm		
UNSCREENED POWER CABLE & SCREENED IT CABLE	50mm		
SCREENED POWER CABLE & UNSCREENED IT CABLE	30mm		
SCREENED POWER CABLE & SCREENED IT CABLE	0mm		

NOTES

1. THE TABLE ABOVE DETAILS THE POWER SEPARATION FROM DATA & VOICE CARRYING CABLES IN REFERENCE WITH ISO 11801 & EN 50174 & ECA (EMC) GUIDELINES.
2. HORIZONTAL CABLING RUNS OF MORE THAN 35m NO SEPARATION IS REQUIRED FOR THE FINAL 15m.

DADO DROP

CONTAINMENT LAYOUT TO BE REVIEWED AND POSSIBLY REVISED FOLLOWING RECEIPT OF FIRE ALARM, SECURITY, PVx, ACCESS CONTROL DESIGN INFORMATIONAND DRAWINGS BY THE SPECIALIST.

THIS DRAWING IS FOR INFORMATION ONLY DO NOT SCALE

CDM REGULATIONS

HAZARDS	DATE NOTED	DATE MITIGATED	RISK ASSESSMENT DATE

NOTES:

1. THIS DRAWING IS TO BE READ IN CONJUNCTION WITH THE M&E SPECIFICATION AND ALL LATEST ARCHITECTS AND ENGINEERS DRAWINGS.

2. PRIMARY CONTAINMENT ONLY IS INDICATED ON THIS DRAWING. THE CONTRACTOR SHALL INCLUDE FOR ALL SECONDARY CONTAINMENT REQUIRED TO FORM A COMPLETE END TO END CONTAINMENT SYSTEM, INCLUDING BUT NOT LIMITED TO RUNS FROM PRIMARY CONTAINMENT TO POINTS OF USE.

3. ALL CABLE TRAY SHALL BE HEAVY DUTY (50mm DEPTH) UNLESS SPECIFICALLY STATED ON THE LAYOUT.

4. ALL CABLE BASKET SHALL BE 54mm DEEP UNLESS SPECIFICALLY STATED ON THE LAYOUT.

5. CONTAINMENT RUNS TO DADO DROPS SHALL BE INSTALLED AS BELOW UNLESS A SPECIFIC SIZE IS PROVIDED ON THE LAYOUT:
5.1. GENERAL LIGHTING & POWER - 50mm BASKET (BKNG)
5.2. DATA - 50mm BASKET (BKND)

6. FOR SERVICES RUNNING WITHIN THE CEILING BULKHEAD, SEE DRAWING 1298-CSD-XX-XX-DR-ME-0001.

7. FINAL CONTAINMENT SIZES AND ROUTES TO BE CONFIRMED FOLLOWING CONFIRMATION OF MECHANICAL HEATING COOLING LOAD, FIRE ALARM, ACCESS CONTROL AND CCTV DESIGN INFORMATION.

P02

REV	DATE	AMENDMENTS	BY	CHD
P02	11.07.24	ISSUED FOR COMMENT & APPROVAL	OI	DB
P01	16.06.24	ISSUED FOR COMMENT & APPROVAL	OI	DB

FOR COMMENT & APPROVAL

Commercial Services Design Ltd
Unit 5
Woodside Court
Clayton Wood Rise
Leeds
LS16 6RF
Tel: 0113 3223190
Web: www.csdesign.uk.com

G&H GROUP OF COMPANIES

CLIENT
G&H BUILDING SERVICES

PROJECT
SUNLIGHT HOUSE
LITTLE QUAY STREET
MANCHESTER M3 3HP

TITLE
ELECTRICAL SERVICES CONTAINMENT LAYOUT LEVEL 08

SCALE @ A0: 1:100	CSD REF: CSD 1298
DRAWN: MV	ENGINEER: OI
STARTED: JUNE 24	ISSUED: JULY 24
CHECKED: DB	APPROVED: BW

DRAWING NO: **1298-CSD-XX-08-DR-E-6109** REV: **P02**

Project-Originator-Volume-Level-Type-Discipline-DrawingNumber

ARCHITECTURE IS BASED ON ANOMALY DESIGN ARCHITECTS DRAWING NO. SLH-AND-PO-08-DR-A-05108 (C01) LEVEL 08 PLAN
RECEIVED 05.06.2024

The drawing is the property of Commercial Services Design Ltd. Copyright is reserved by them and is issued on the condition that it is not reproduced, copied, lent or disclosed to a third party without the written permission of Commercial Services Design Ltd. Do not scale this drawing. All dimensions to be verified on site before commencement of any work. This drawing is to be read in conjunction with the specification when working and all other consultants' drawings.