MURRAYWOOD CONSTRUCTION LTD

QA Form – Drainage Lines


Installation of Drainage Lines			Sheet No:	002
Project	First Street Manchester		**Date:**	15/3/23
Location	MHFW02 to MHFW01 Length between Manholes: 12M	**Drawing No:**	MN2A-RAM-ZZ-XX-DR-C-000100	
Pipe Details:	FOUL/[redacted] Type of Pipe: Ridgidrain Ribbed Size: 150ø	**INVERTS:**	Upstream: 29.465 Downstream: 29.365	
Incoming Connections:	Distance from MH : N/A Pipe Size: Distance from MH : Pipe Size: Distance from MH : Pipe Size:		Distance from MH : N/A Pipe Size: Distance from MH : Pipe Size: Distance from MH : Pipe Size:	

WORK TO BE INSPECTED	Accepted Yes/ No or N/a	Comments	MW Construction Eng/QA Signed as Checked:-
Setting out to drawing	Y	FW01 MH Move up line 1.5M due to clash with ducts	M. S
Trench excavation supported	N/A		
Installation of pipe bedding to correct levels	Y		MS
Installation of all drainage materials	Y		MS
Connections installed and recorded distance and size	Y		MS
Testing of drainage line by Murraywood Operatives	Y		MS
MWC Signature confirming readiness to backfill:-	M. S	**Date**	15/3/23
Client Signature confirming acceptance to backfill:-		**Date**	15/3/23

MURRAYWOOD CONSTRUCTION LTD	QA Form – Drainage Lines

HANDOVER				
WORK TO BE INSPECTED	Accepted Yes/ No	Comments	MW Construction Eng/QA Signed as Checked:-	
Backfilling completed to correct level and in layers as instructed in the specification	Y		M. [signature]	
Pipeline tested by Building Inspector and accepted.				
Client Signature confirming Handover of Drainage Line:-	[signature]		**Date**	15/3/23
MWC Signature confirming Handover of Drainage Line:-	M. [signature]		**Date**	15/3/23

SKETCH

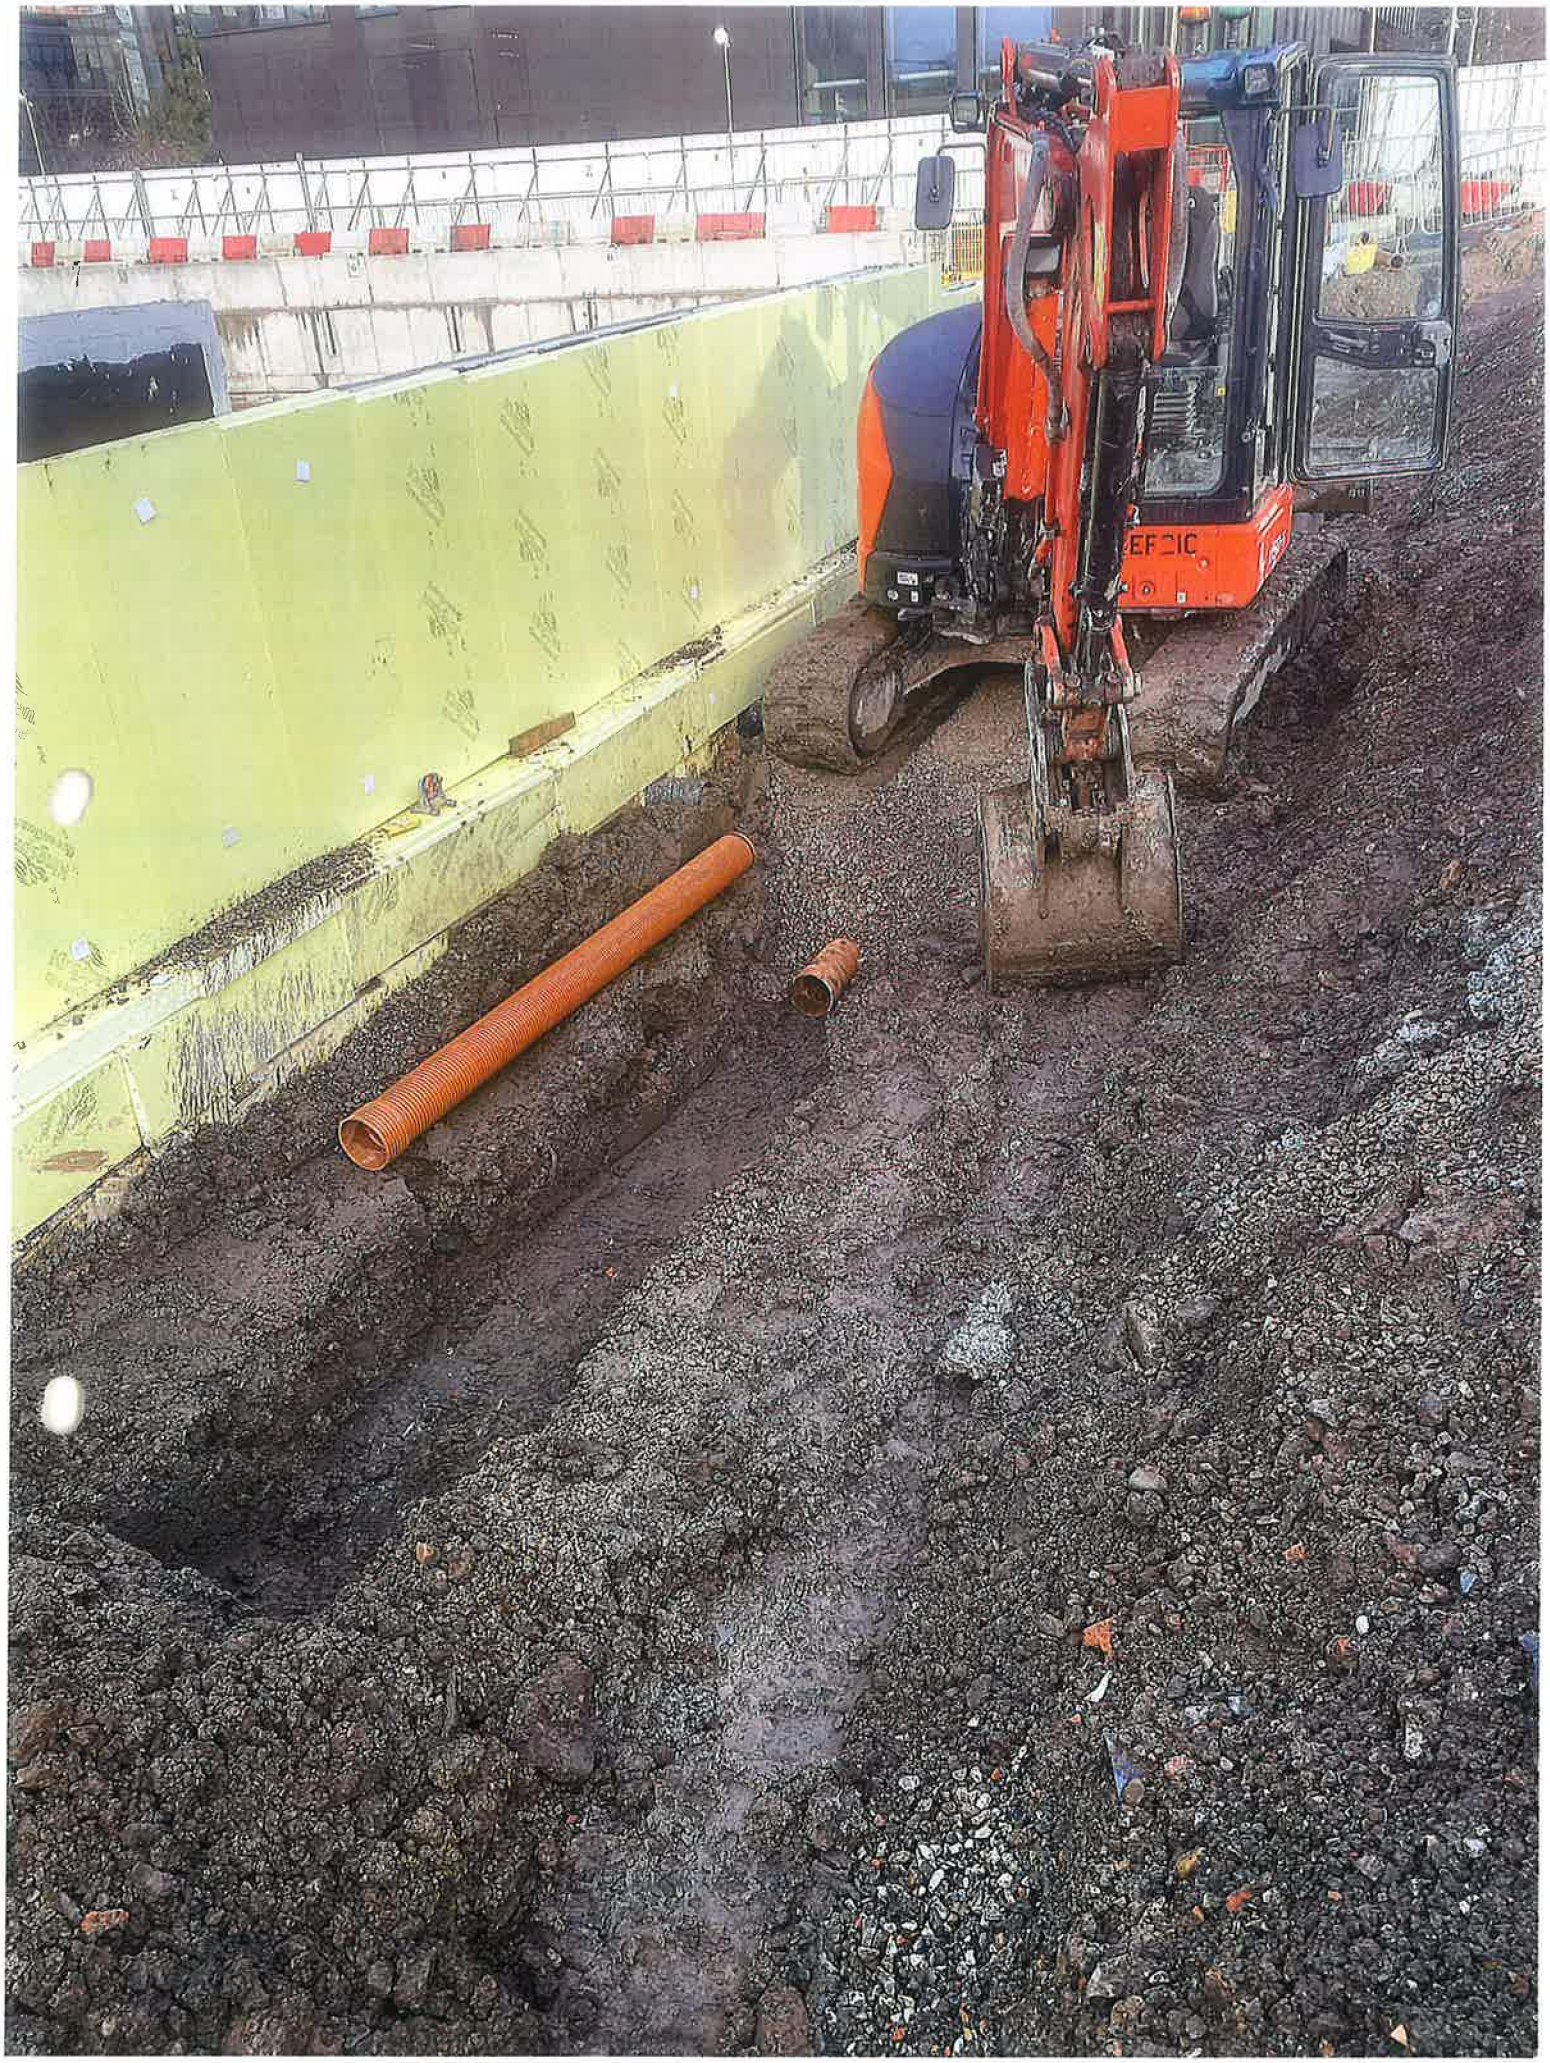


BND Ducts Clash
With M/Hole.
MHFWOI Moved 1.5 further up line


MURRAYWOOD