


FOR DETAILS OF RISKS REFER TO CDM RISK REGISTER
RUK2022N00181-RAM-HS-00004




- LL = LOW LEVEL
- HL = HIGH LEVEL
- RT = RISE TO

18. ADDITIONAL SURVEYS ON SITE REQUIRED TO DETERMINE SPACE AVAILABILITY AROUND THE EXISTING 700x400 EXTRACT DUCT AND ANY OTHER RETAINED EXISTING SERVICES WITH THE VOID SPACE.

III. GRILLES ARE TO BE PROVIDED FOR VENTILATION TO THE CEILING SPACES WHERE GAS PIPEWORK IS PRESENT IN LINE WITH IGM-UP-2. ANY EXISTING, RETAINED GAS SERVICES WITHIN THE CEILING VOID ARE TO BE DETERMINED BY INTRUSIVE SURVEYS.

Project No:	Scale (@ A1):	Date:	Drawn:
1620013964	1:50	04/10/24	BS

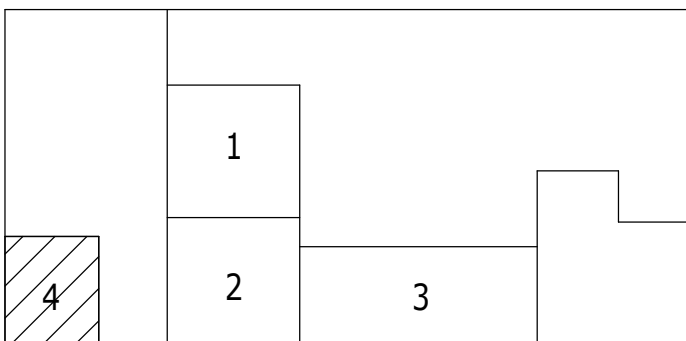

KEY PLAN