


1m Steplift 800W
1m Steplift 900W

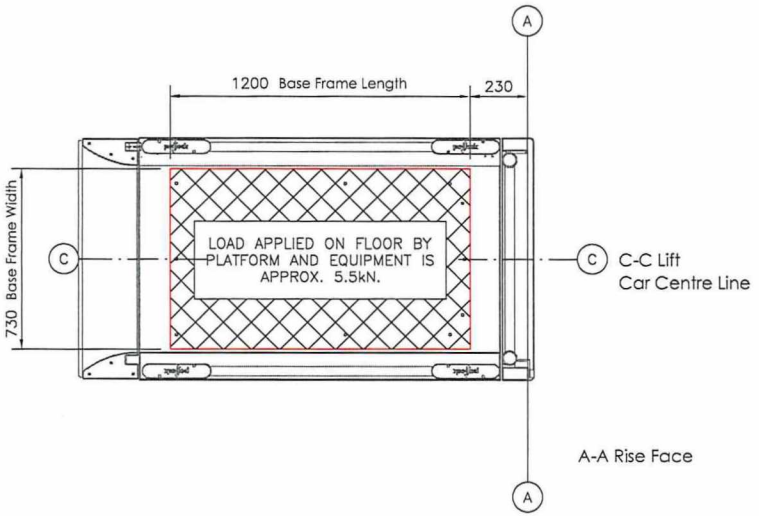


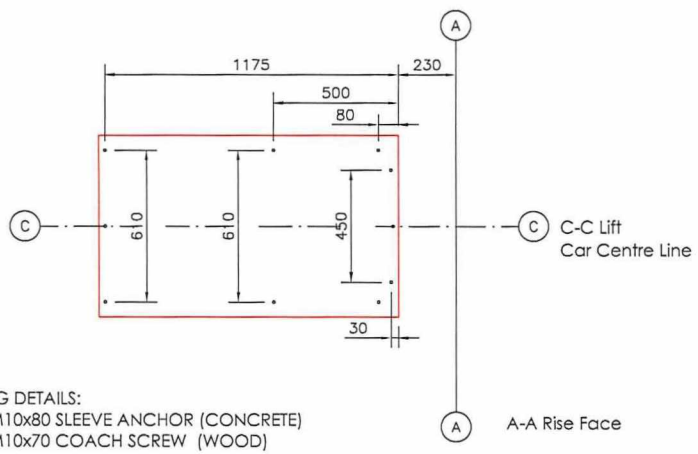

FIXING DETAILS:
10~ M10x80 SLEEVE ANCHOR (CONCRETE)
10~ M10x70 COACH SCREW (WOOD)

Im Steplift 1100W

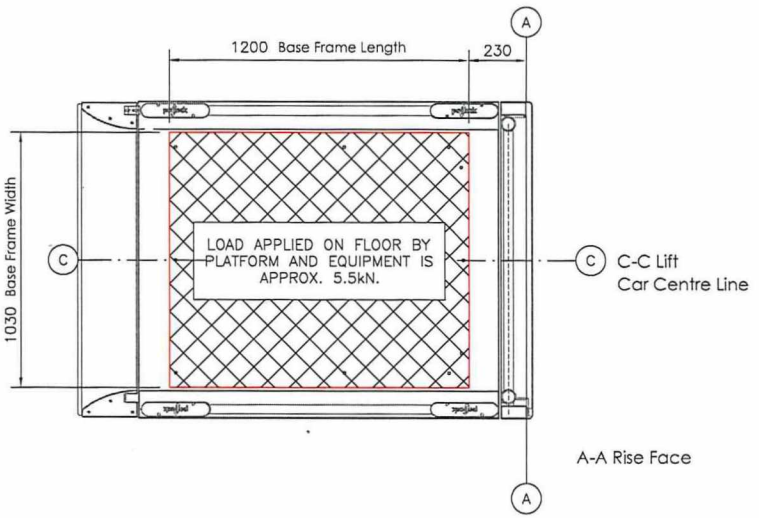

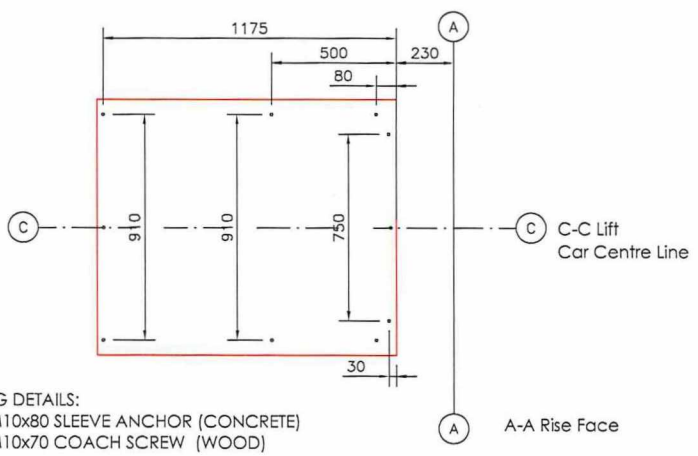

FIXING DETAILS:
10~ M10x80 SLEEVE ANCHOR (CONCRETE)
10~ M10x70 COACH SCREW (WOOD)

Change History Record			
Issue	CHANGE No.	DATE	INITIALS
A	---------	27/01/14	TL
B	---------	10/04/14	TL
C	CR0742	01/07/14	TL

APPROVAL

APPROVED WORKING DRAWING

BY:..... COMP:.....

SIGNED:..... DATE:.....

PLATFORM SIZE	800W / 900W /1100W
TRAVEL	(MIN 100mm MAX 1000mm) .....mm TBC

COPYRIGHT

pollock Lifts

UNIT 1 SLOEFIELD DRIVE
CARRICKFERGUS
COUNTY ANTRIM
NORTHERN IRELAND
BT38 8GX
TEL: 00 44 (0) 28 93368167
WEB: WWW.POLLOCKLIFTS.CO.UK

UNIT: STEPLIFT


NAME: CLASSIC and EXECUTIVE – THRU ACCESS – BASE DRAWING


40900950

ADJACENT SURFACE DISTANCE BS6440:2011

Table A

GAP BETWEEN THE PLATFORM & ADJACENT WALL (mm)	FULL HEIGHT CONTINUOUS AND SMOOTH WALL	PARTIAL HEIGHT WALL WITH PROJECTION OR RECESSES
<10	✓	SENSITIVE EDGE, PHOTO CELL OR LIGHT CURTAIN REQUIRED
>10 - <100	SENSITIVE EDGE, PHOTO CELL OR LIGHT CURTAIN REQUIRED	SENSITIVE EDGE, PHOTO CELL OR LIGHT CURTAIN REQUIRED
>100 - <300	✓	SENSITIVE EDGE, PHOTO CELL OR LIGHT CURTAIN REQUIRED
>300	✓	✓

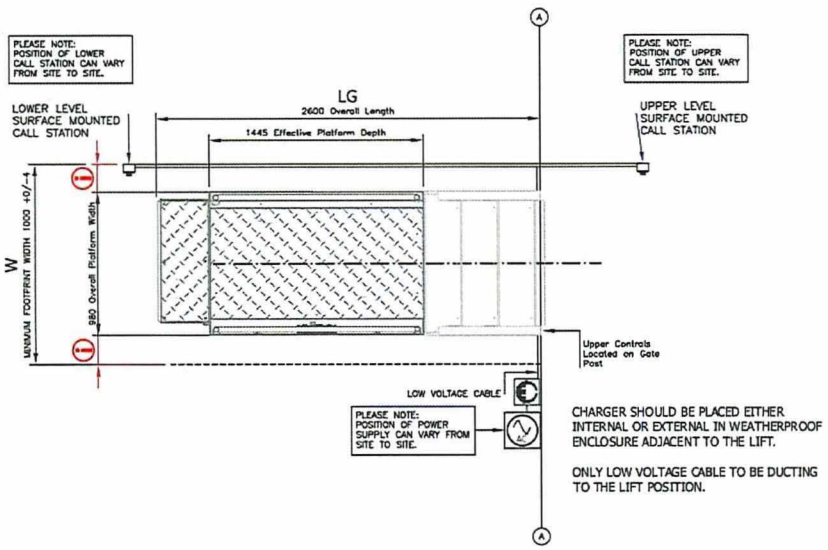

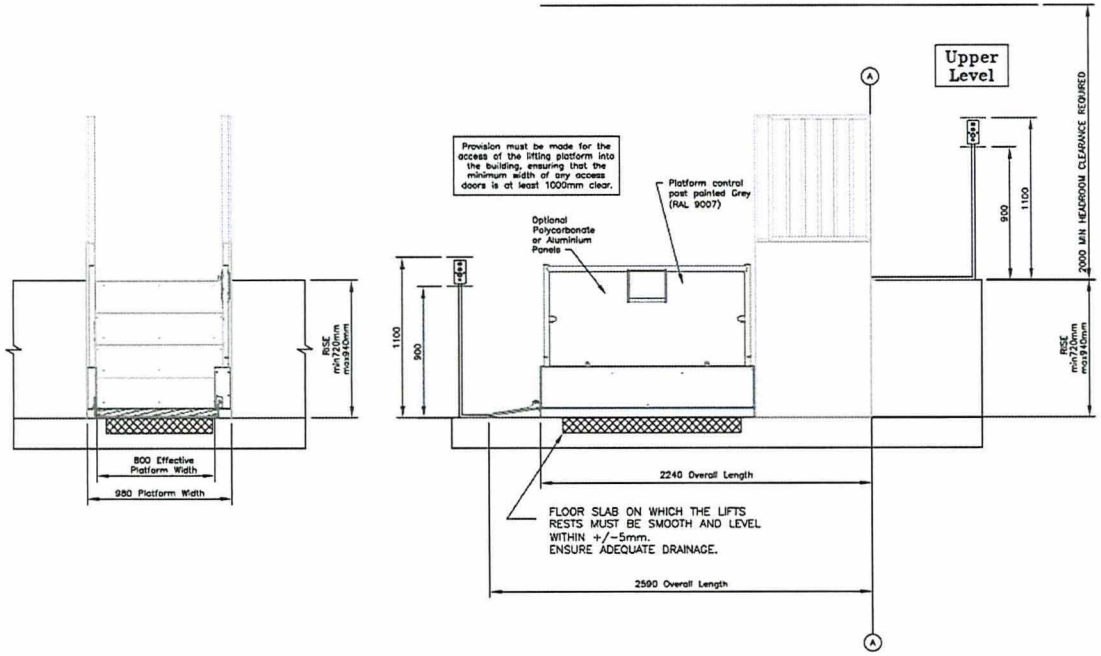

Change History Record

Issue	CHANGE No.	DATE	INITIALS
A	---------	24/02/14	TL
B	---------	24/02/20	TL

Minimum Footprint Width (W)	1000mm
Minimum Ground Footprint Length (Lg)	2600mm
Minimum Upper Footprint Length (Lu)	1500mm

FOR EXTERNAL LIFT POWER SUPPLY NEED TO BE LOCATED INSIDE BUILDING AND DUCTED TO LIFT POSITION

BUILDERS WORK AND GENERAL NOTES – STEP LIFT

The customer is responsible for carrying out the work below. These are required for the lift to comply with the Supply of Machinery (Safety) Regulations 1992. If any points are not clear, please contact Pollocklifts without delay.

1.0 GENERAL
1.1 Clear access into and through the building for the passage of the lift equipment and personnel must be maintained.
1.2 Unload delivered materials and store in a suitable dry and secure location within 5m of intended lift site. Parts should be handled with care and slung correctly to avoid damaging components and decorative finishes. Parts may become damaged by storage outside or in damp conditions.

2.0 DIMENSIONS AND TOLERANCES
Do not scale from the drawings. All dimensions are in millimetres except where otherwise stated. All dimensions are to be measured from datum line AA.

3.0 LIFT AREA
3.1 Floor and side walls in the area where the platform lift is to be located must be firm, smooth level, suitably drained and have no projections or recesses across their face. Any walls surrounding the lift should be positioned as per Table A away from the lift edges in order to eliminate trapping hazards.
3.2 Make good where necessary around the platform lift and its associated equipment after they are finally positioned and fixed.

4.0 ELECTRICAL WORKS
4.1 Provide a 230V, 1 phase, 50 hertz, 3 wire permanent supply terminating in a fused spur 13A within close vicinity of the lift (within the fabric of the building + A 20mm Duct installed terminating at lift position as indicated). The switch 5A Charging Circuit must be able to accept 1 x 5A HRC fuse, GEC type 'T' or equivalent fuses to BS88 Part 2.
4.2 For External Installation it is recommended that lighting is provided controlled by PIR's.
4.3 The electrical work must comply with the latest revision of the IEE Wiring Regulations.
4.5 It is recommended that the supply is protected by a suitable RCD.
4.6 Where flush / surface mounted call stations are required, walls should be chased out prior to lift installation to allow for mounting of cable conduit and call panels. Client to make good after lift commisioning.

BUILDING WORK REQUIRED

1- .....

2- .....

3- .....

4- .....

5- .....

6- .....

APPROVAL

APPROVED WORKING DRAWING

BY:..... COMP:.....

SIGNED:..... DATE:.....

NOTE: THE ABOVE BUILDING WORK MUST BE CARRIED OUT PRIOD TO THE LIFT INSTALLATION

LIFT DATA

PLATFORM SIZE	800W	THROUGH ACCESS	COLOUR 9007	FLOOR MOUNTED
UPPER GATE HANDED	N/A	--------		
LOWER GATE HANDED	N/A	--------		
LOWER LEVEL RAMP	ON BOARD RAMP			
TRAVEL	(MIN 720mm MAX 940mm)		.....mm TBC	

COPYRIGHT

pollock Lifts

UNIT 1 SLOEFIELD DRIVE
CARRICKFERGUS
COUNTY ANTRIM
NORTHERN IRELAND
BT38 8GX
TEL: 00 44 (0) 28 93368167
WEB: WWW.POLLOCKLIFTS.CO.UK

UNIT: STEP LIFT

NAME: CLASSIC 800W with 3 Bridging Step

40900352-A