# RETAINING WALL DAMP PROOFING WITH TYPICAL UNDERPINNING DETAIL + BEAM AND BLOCK

Ground conditions
TBC on site

Combined dead and imposed load should not exceed 70kN/m at base of wall

For general guidance only where all underpinning proposals to designed by structural engineer and undertaken in accordance with structural engineer's details

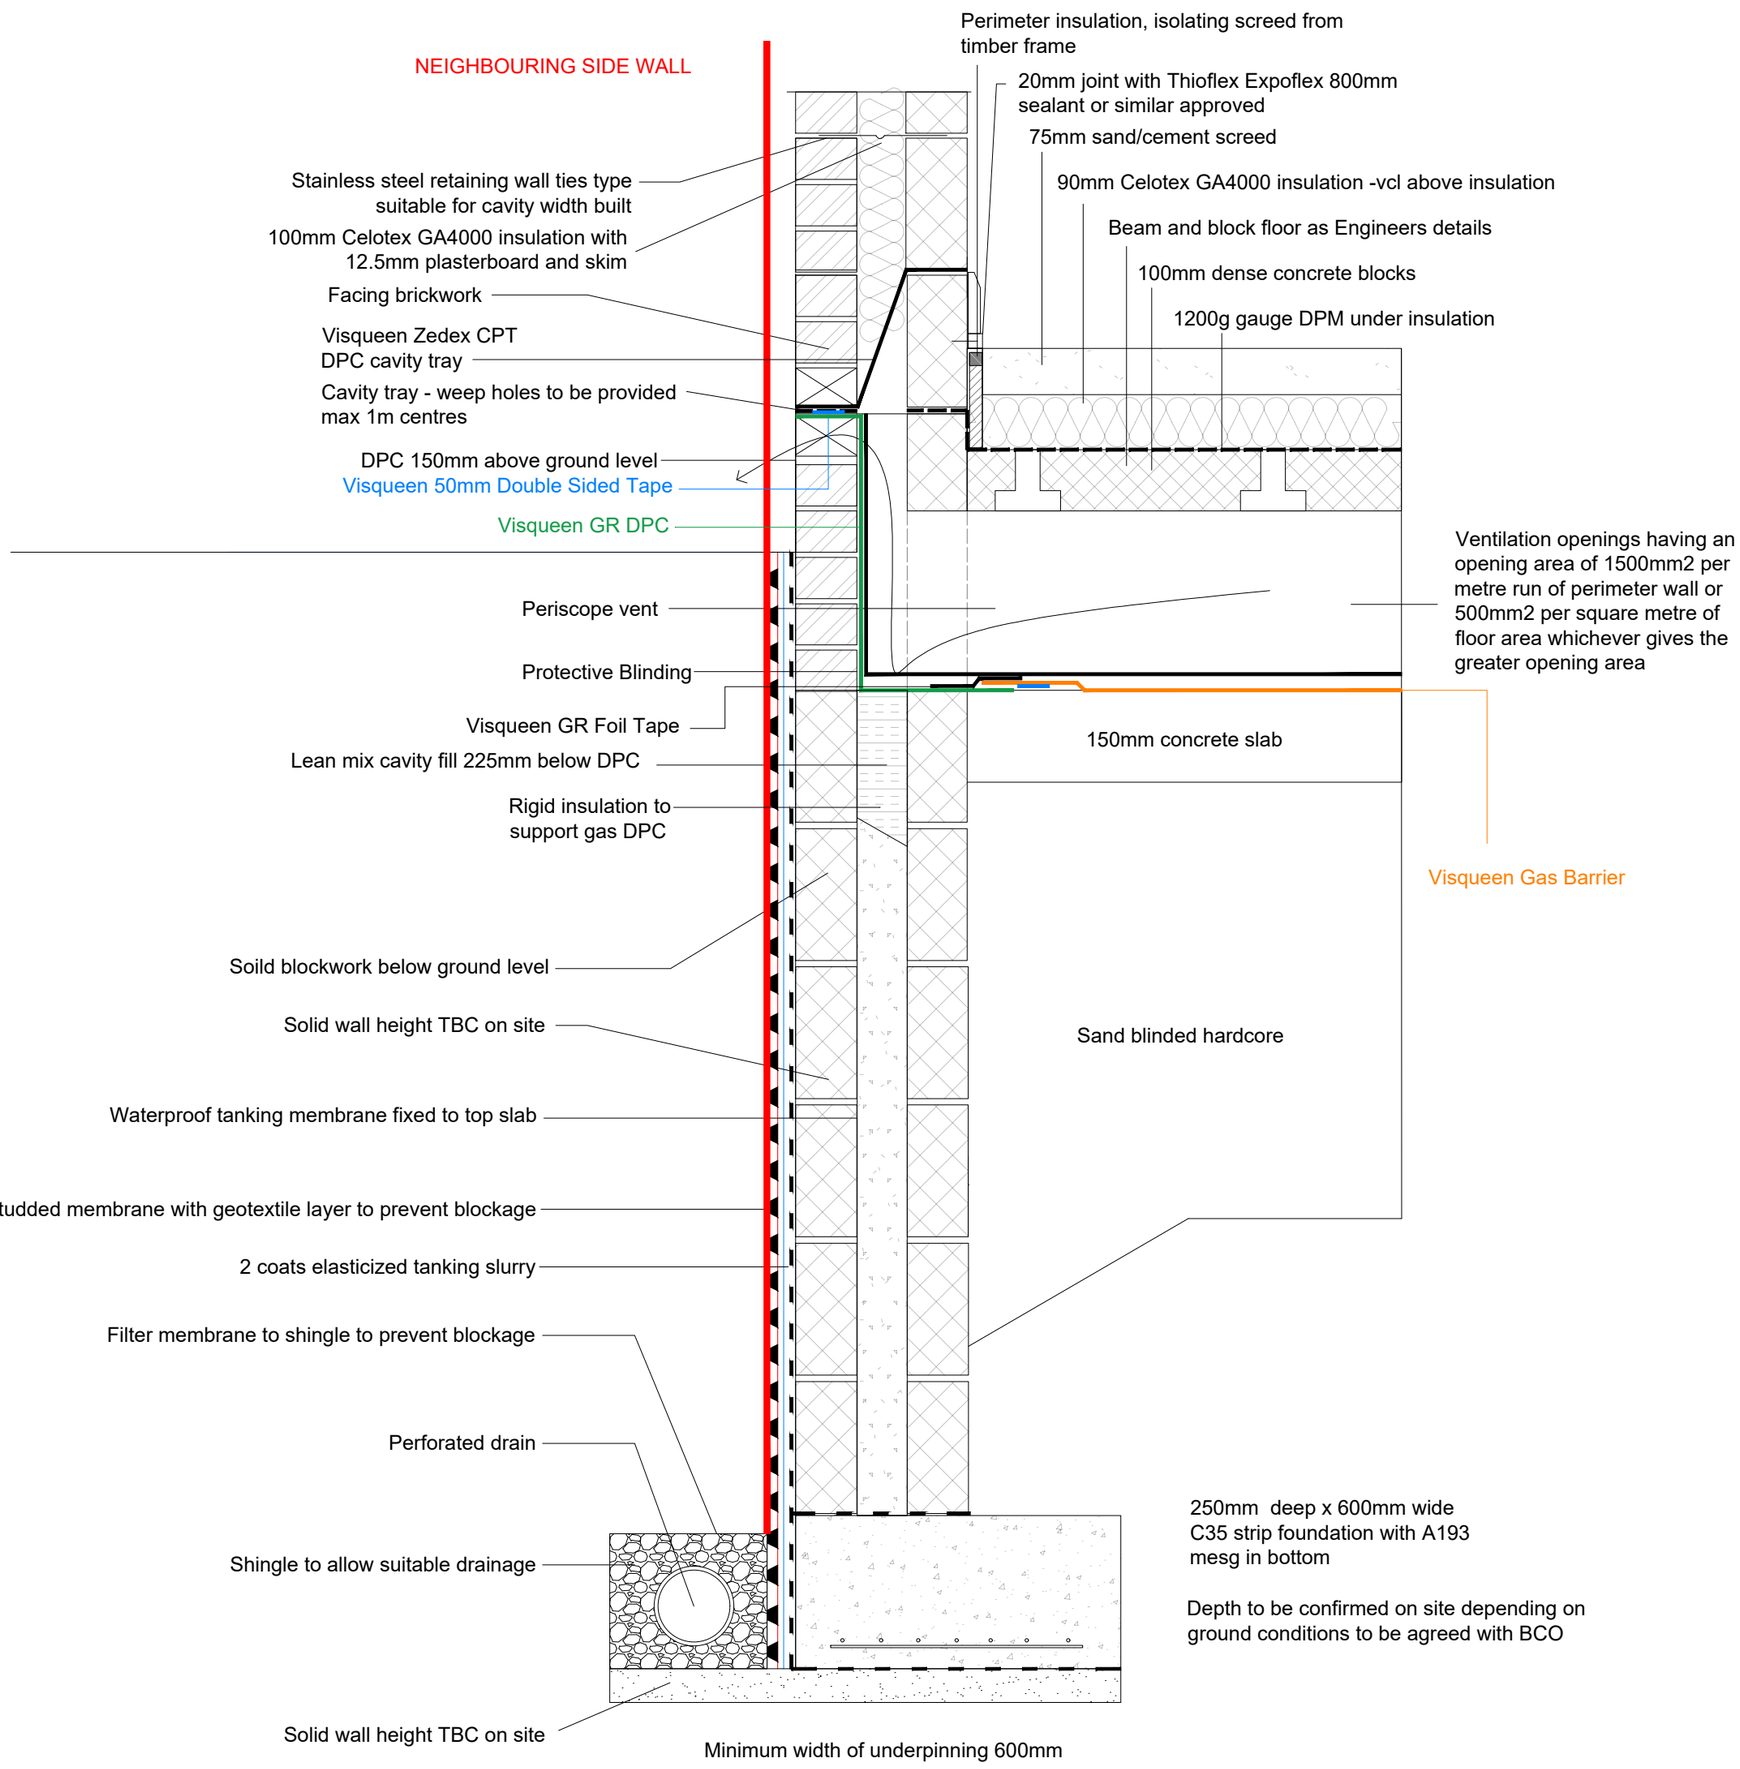


1:10

200mm 0 200mm 400mm 600mm 800mm 1000mm

**Construction**

Project
**81 Ashley Lane, Moston, Manchester**

Title
**Detailed Drawing 4 - Proprietary Gas Membrane Single Storey Rear Extension (Planning Condition)**

| Drawn | Date: | Scale (at A2) |
|---|---|---|
| **KO** | **June 2024** | **1:10** |

| Dwg no. | Revision No. |
|---|---|
| **SK152QT/CONS05** | **-** |