
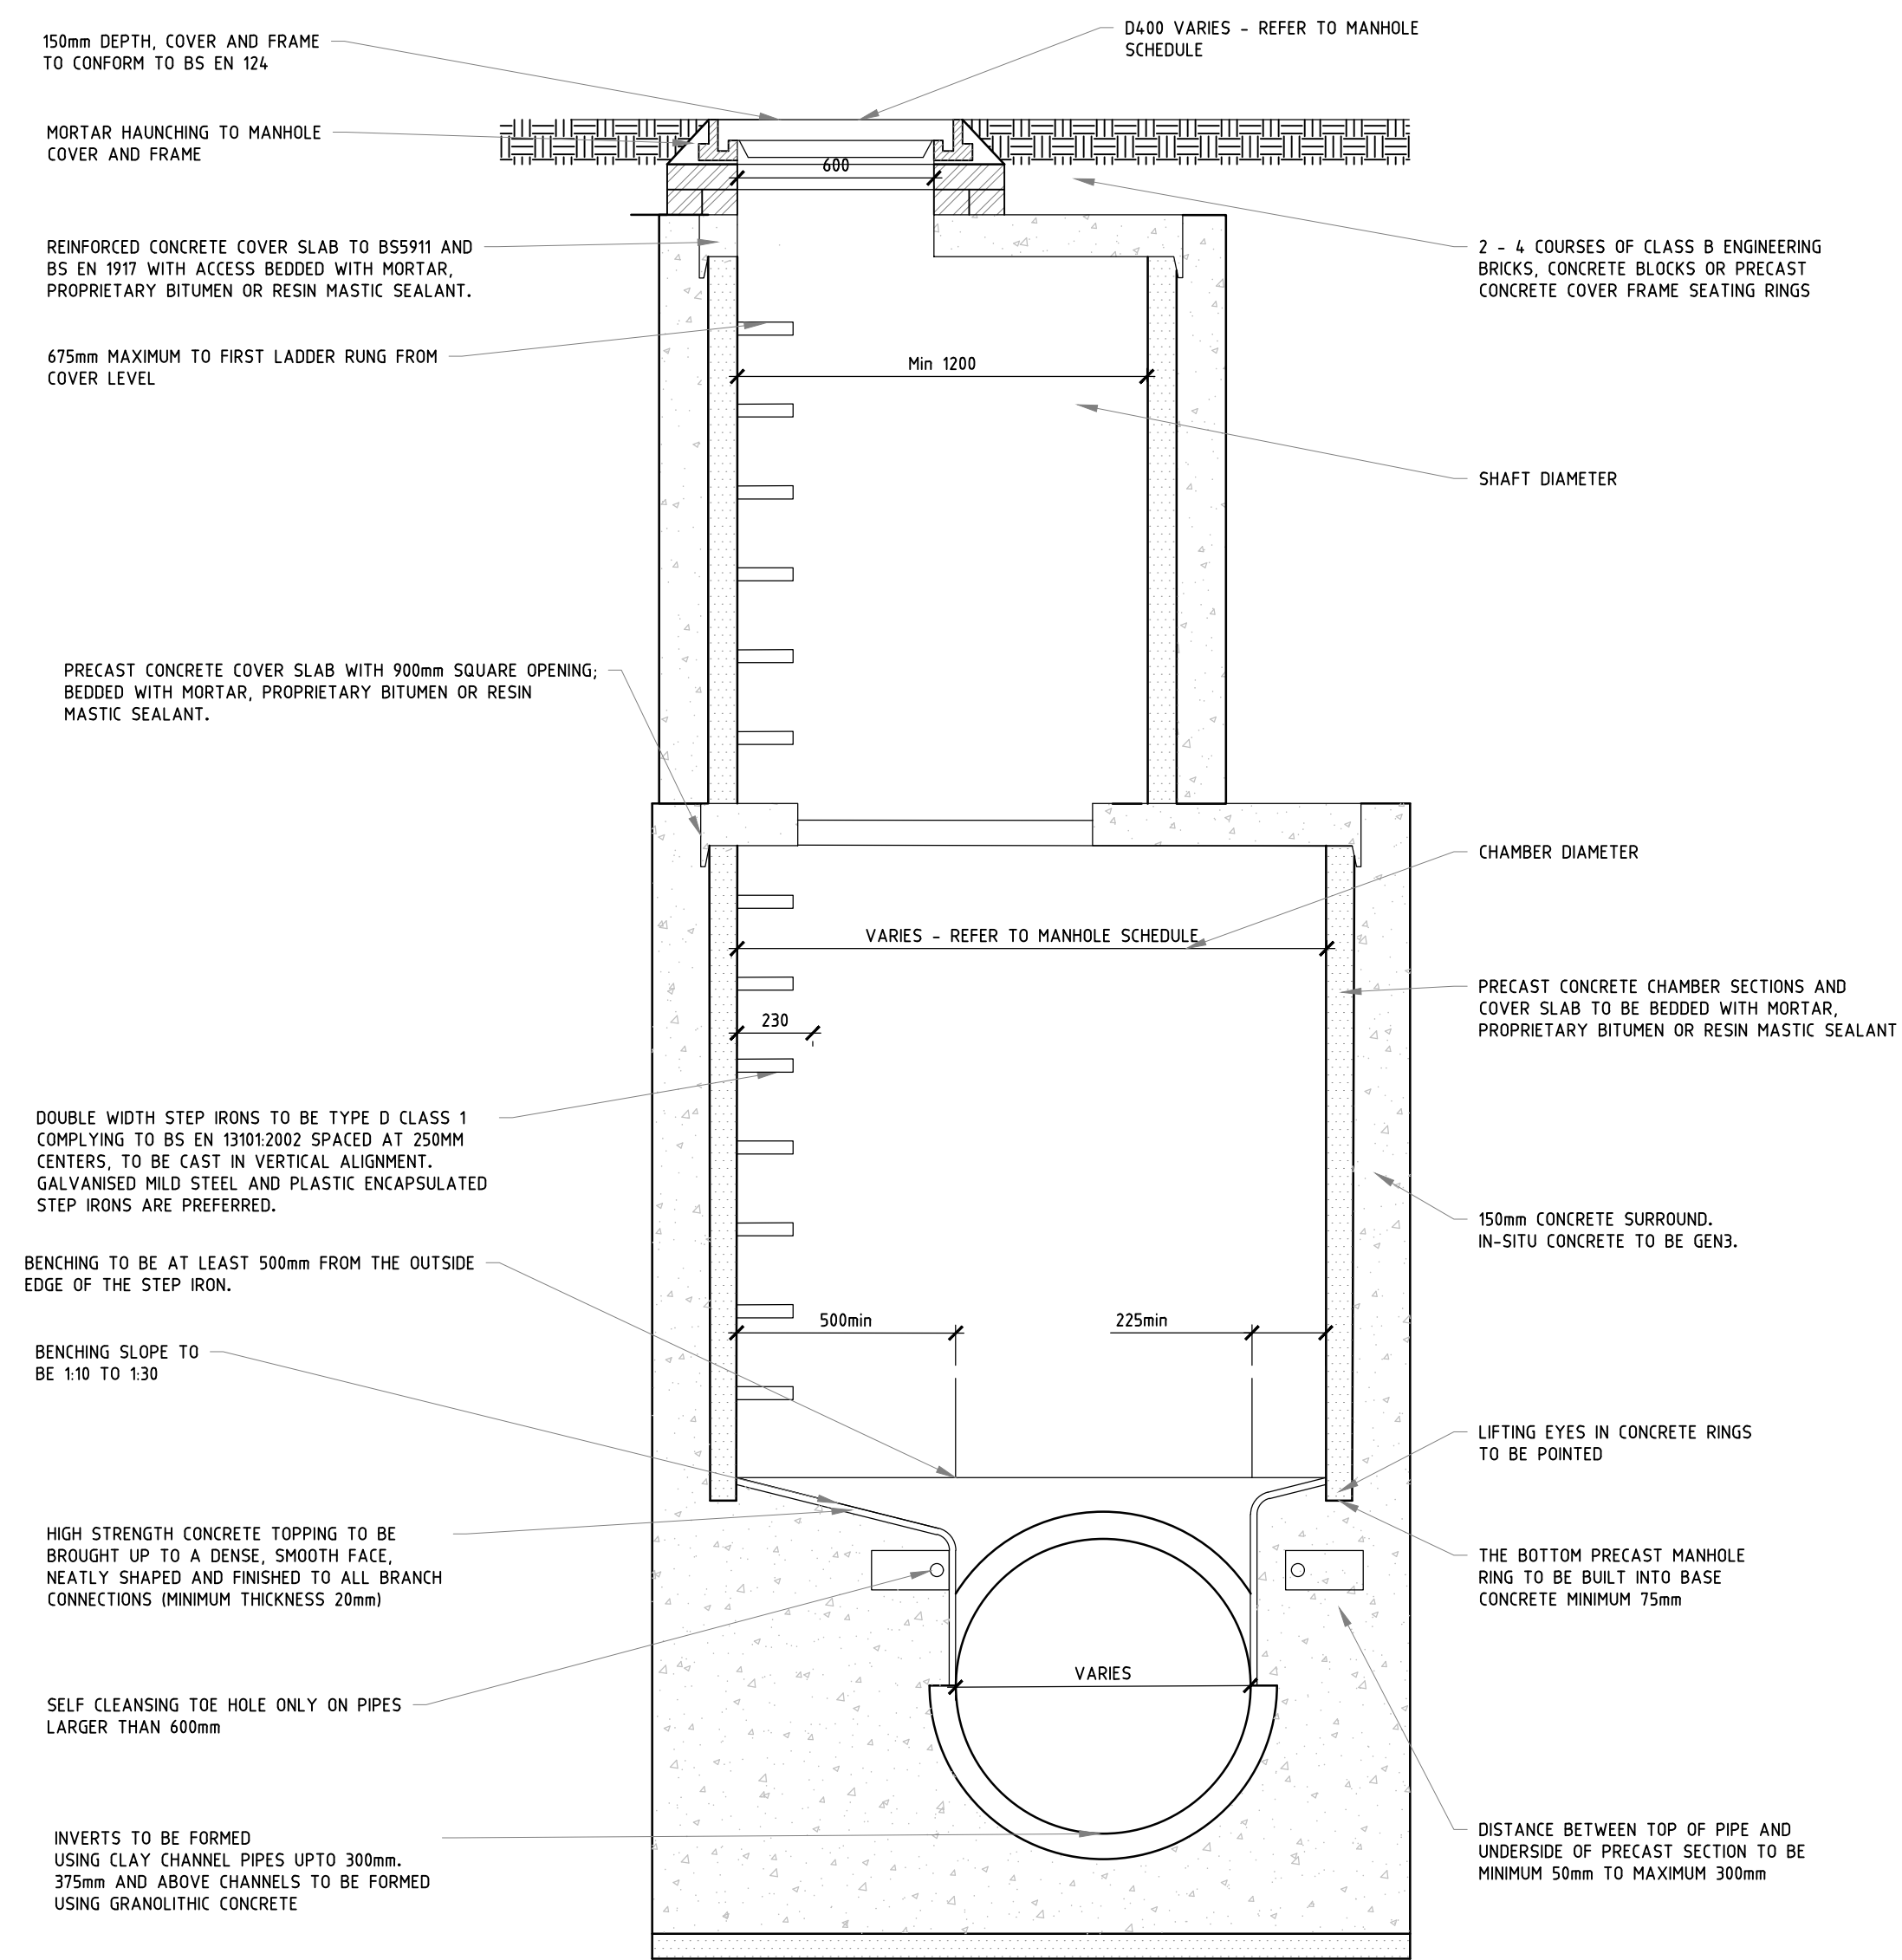
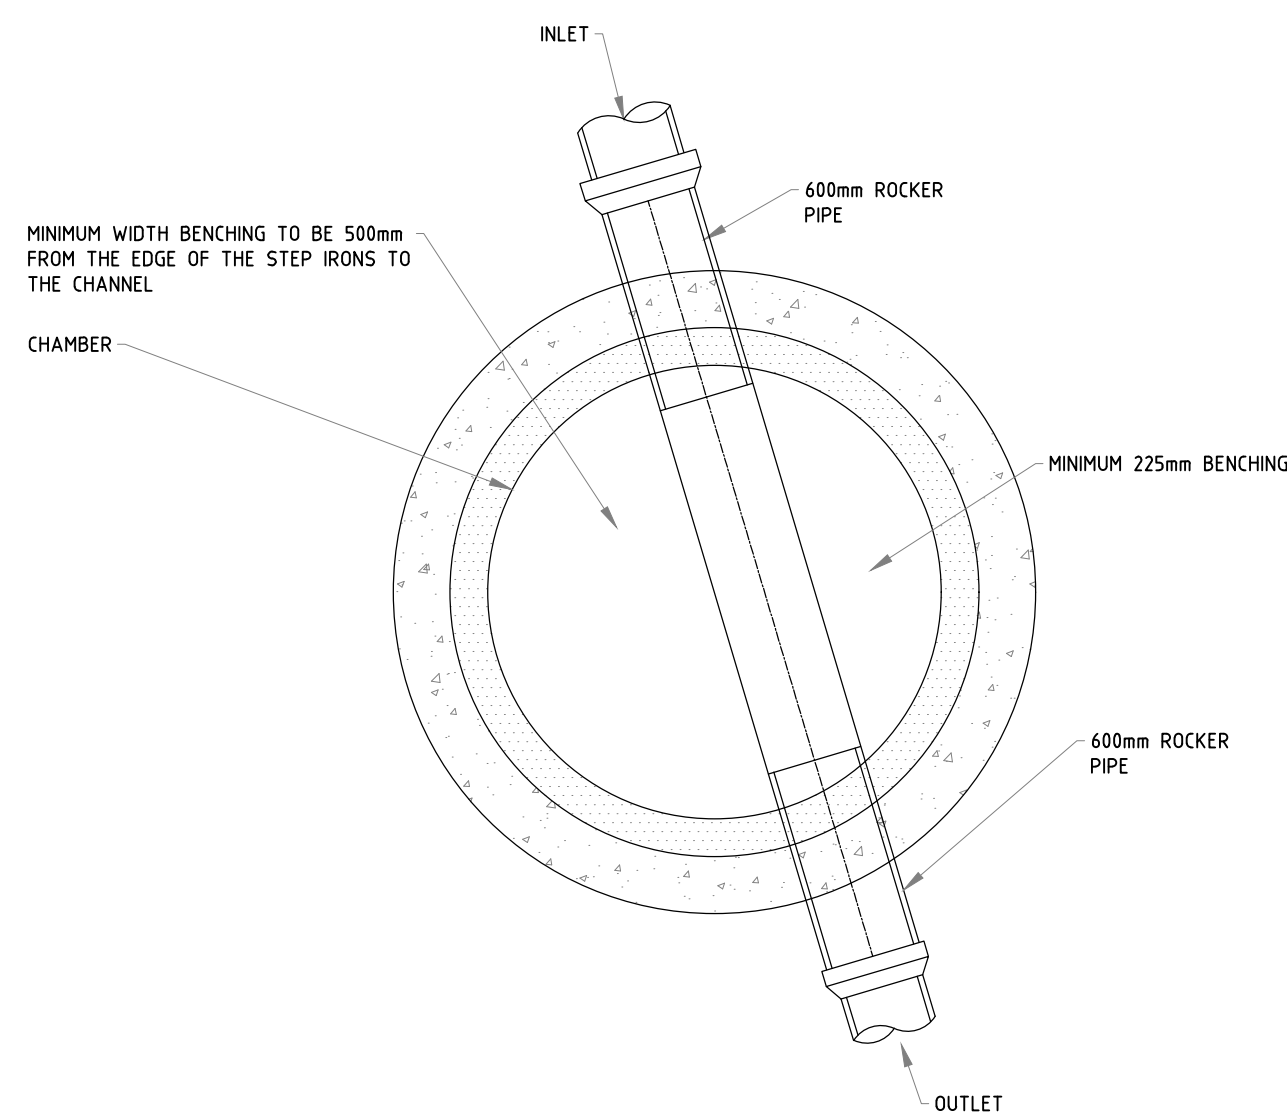
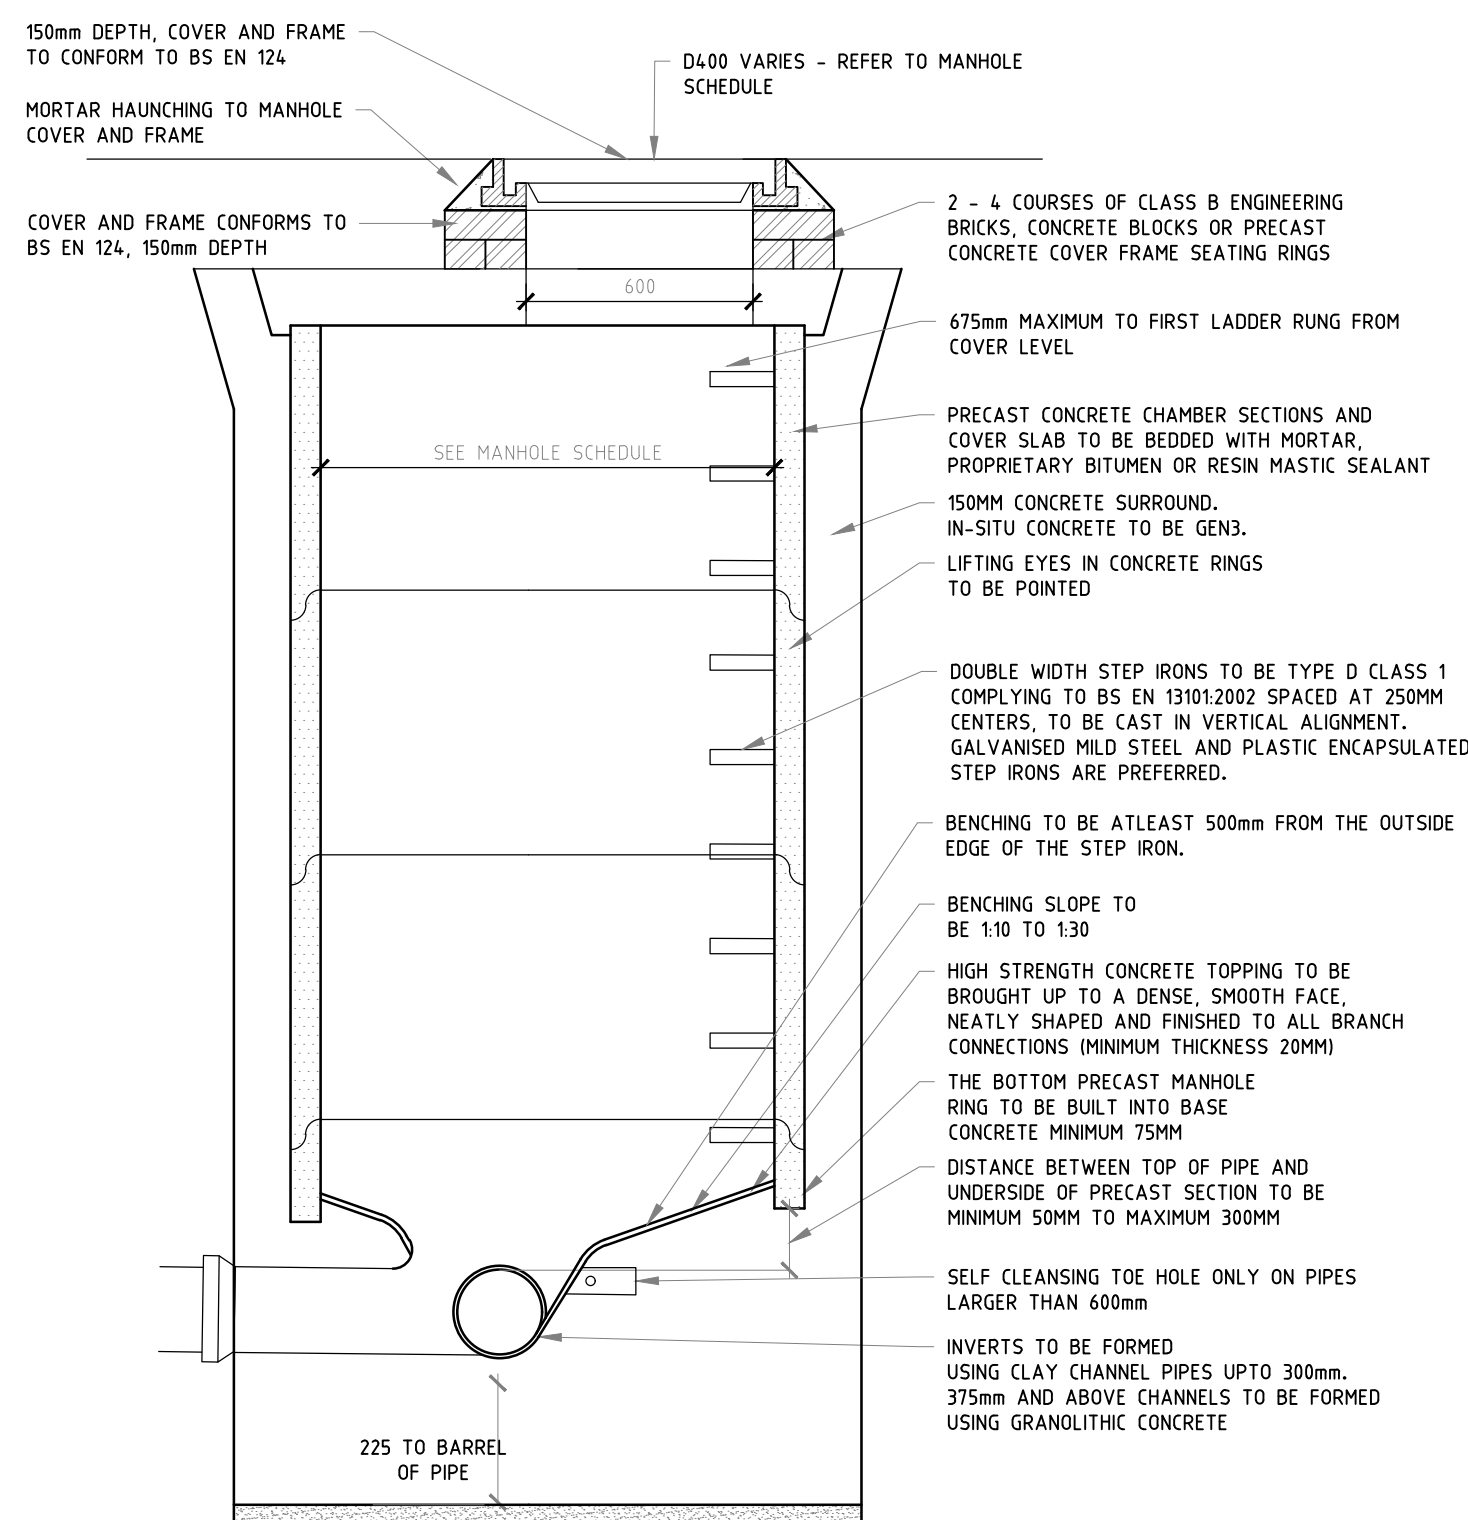


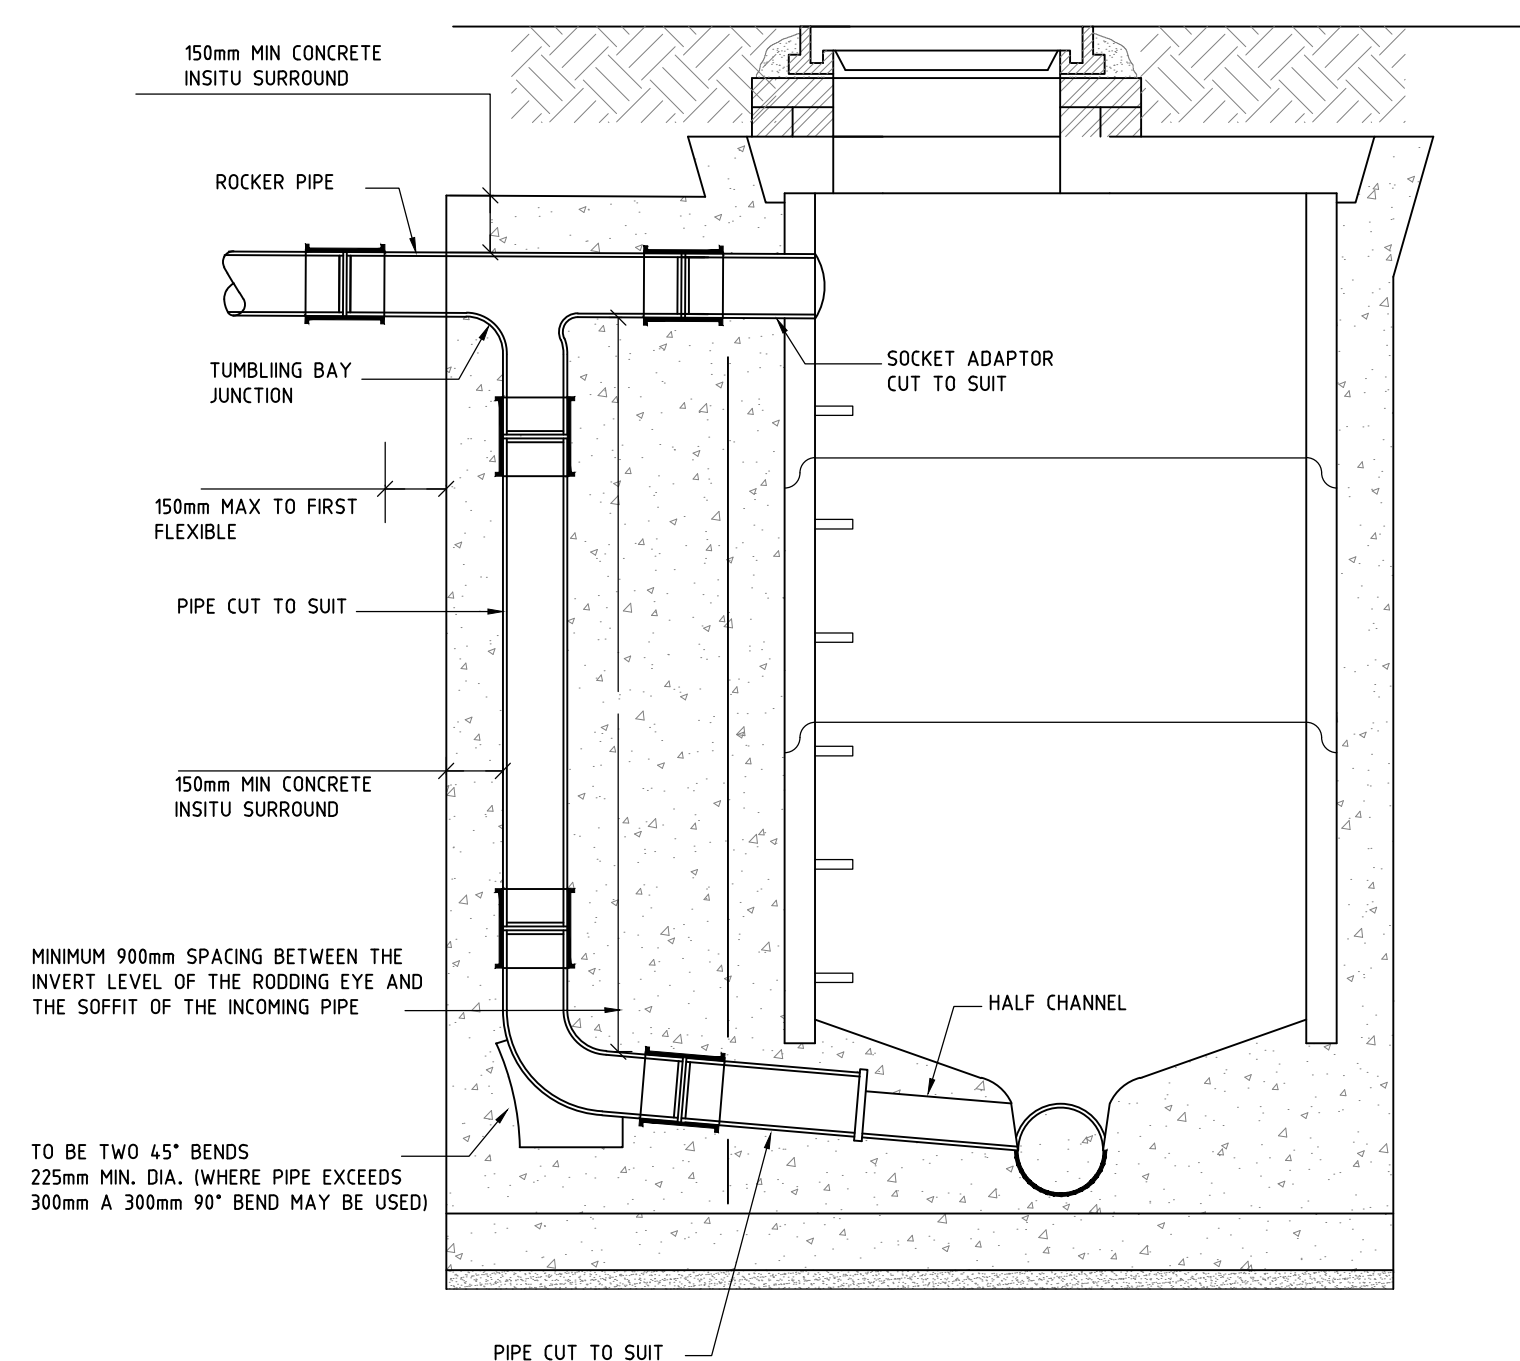

NOTES:

1. ALL SEWERS ARE DESIGNED IN ACCORDANCE WITH BUILDING REGULATIONS APPROVED DOCUMENT H.
2. SEWERS WITH COVER TO SOFIT GREATER THAN 1.2M IN TRAFFICKED AREAS AND 0.9M IN FIELDS SHALL HAVE BED AND SURROUND CLASS 5.
3. ANY SEWER WITH A COVER OF LESS THAN 1.2M TO PIPE SOFIT IN TRAFFICKED AREAS OR 0.9M TO PIPE SOFIT IN FIELDS WILL HAVE A MINIMUM 150MM GEN 3 CONCRETE BED AND SURROUND WITH FLEXIBILITY MAINTAINED WITH FLEXVELL EXPANSION JOINT FILLER OR SHALL BE APPROVED AT EACH PIPE JOINT.
4. WHERE THE DEPTH TO INVERT LEVEL IS A MAXIMUM OF 1.2M PRIVATE DRAINAGE CHAMBERS WILL BE A 450MM DIAMETER PPIC IN ACCORDANCE WITH BS EN 15959-1.
5. WHERE THE DEPTH TO INVERT LEVEL IS A MAXIMUM OF 3M PRIVATE DRAINAGE CHAMBERS WILL BE 450MM DIAMETER PPIC IN ACCORDANCE WITH BS EN 15959-2.
6. WHERE CHAMBERS ARE SITED IN TRAFFICKED AREAS A D400 GRADE COVER MUST BE USED.
7. PRIVATE DRAINAGE PIPES TO BE 100MM DIAMETER UNLESS STATED OTHERWISE.