




VENTILATION CONTROLS PHILOSOPHY

BOOST MODE OPERATING WITH EITHER:

- OPERATION OF LIGHT SWITCHES WITHIN BATHROOM OR ENSUITE - AUTOMATIC BOOST
- HIGH HUMIDITY SENSED WITHIN WHR UNIT - AUTOMATIC BOOST
- OPERATION OF KITCHEN BOOST SWITCH - MANUAL BOOST

AUTOMATIC BOOST FUNCTION INCLUDES FIXED RUN ON TIMER SET TO 10mins

MANUAL BOOST FUNCTION DOES NOT PROVIDE RUN ON FUNCTION

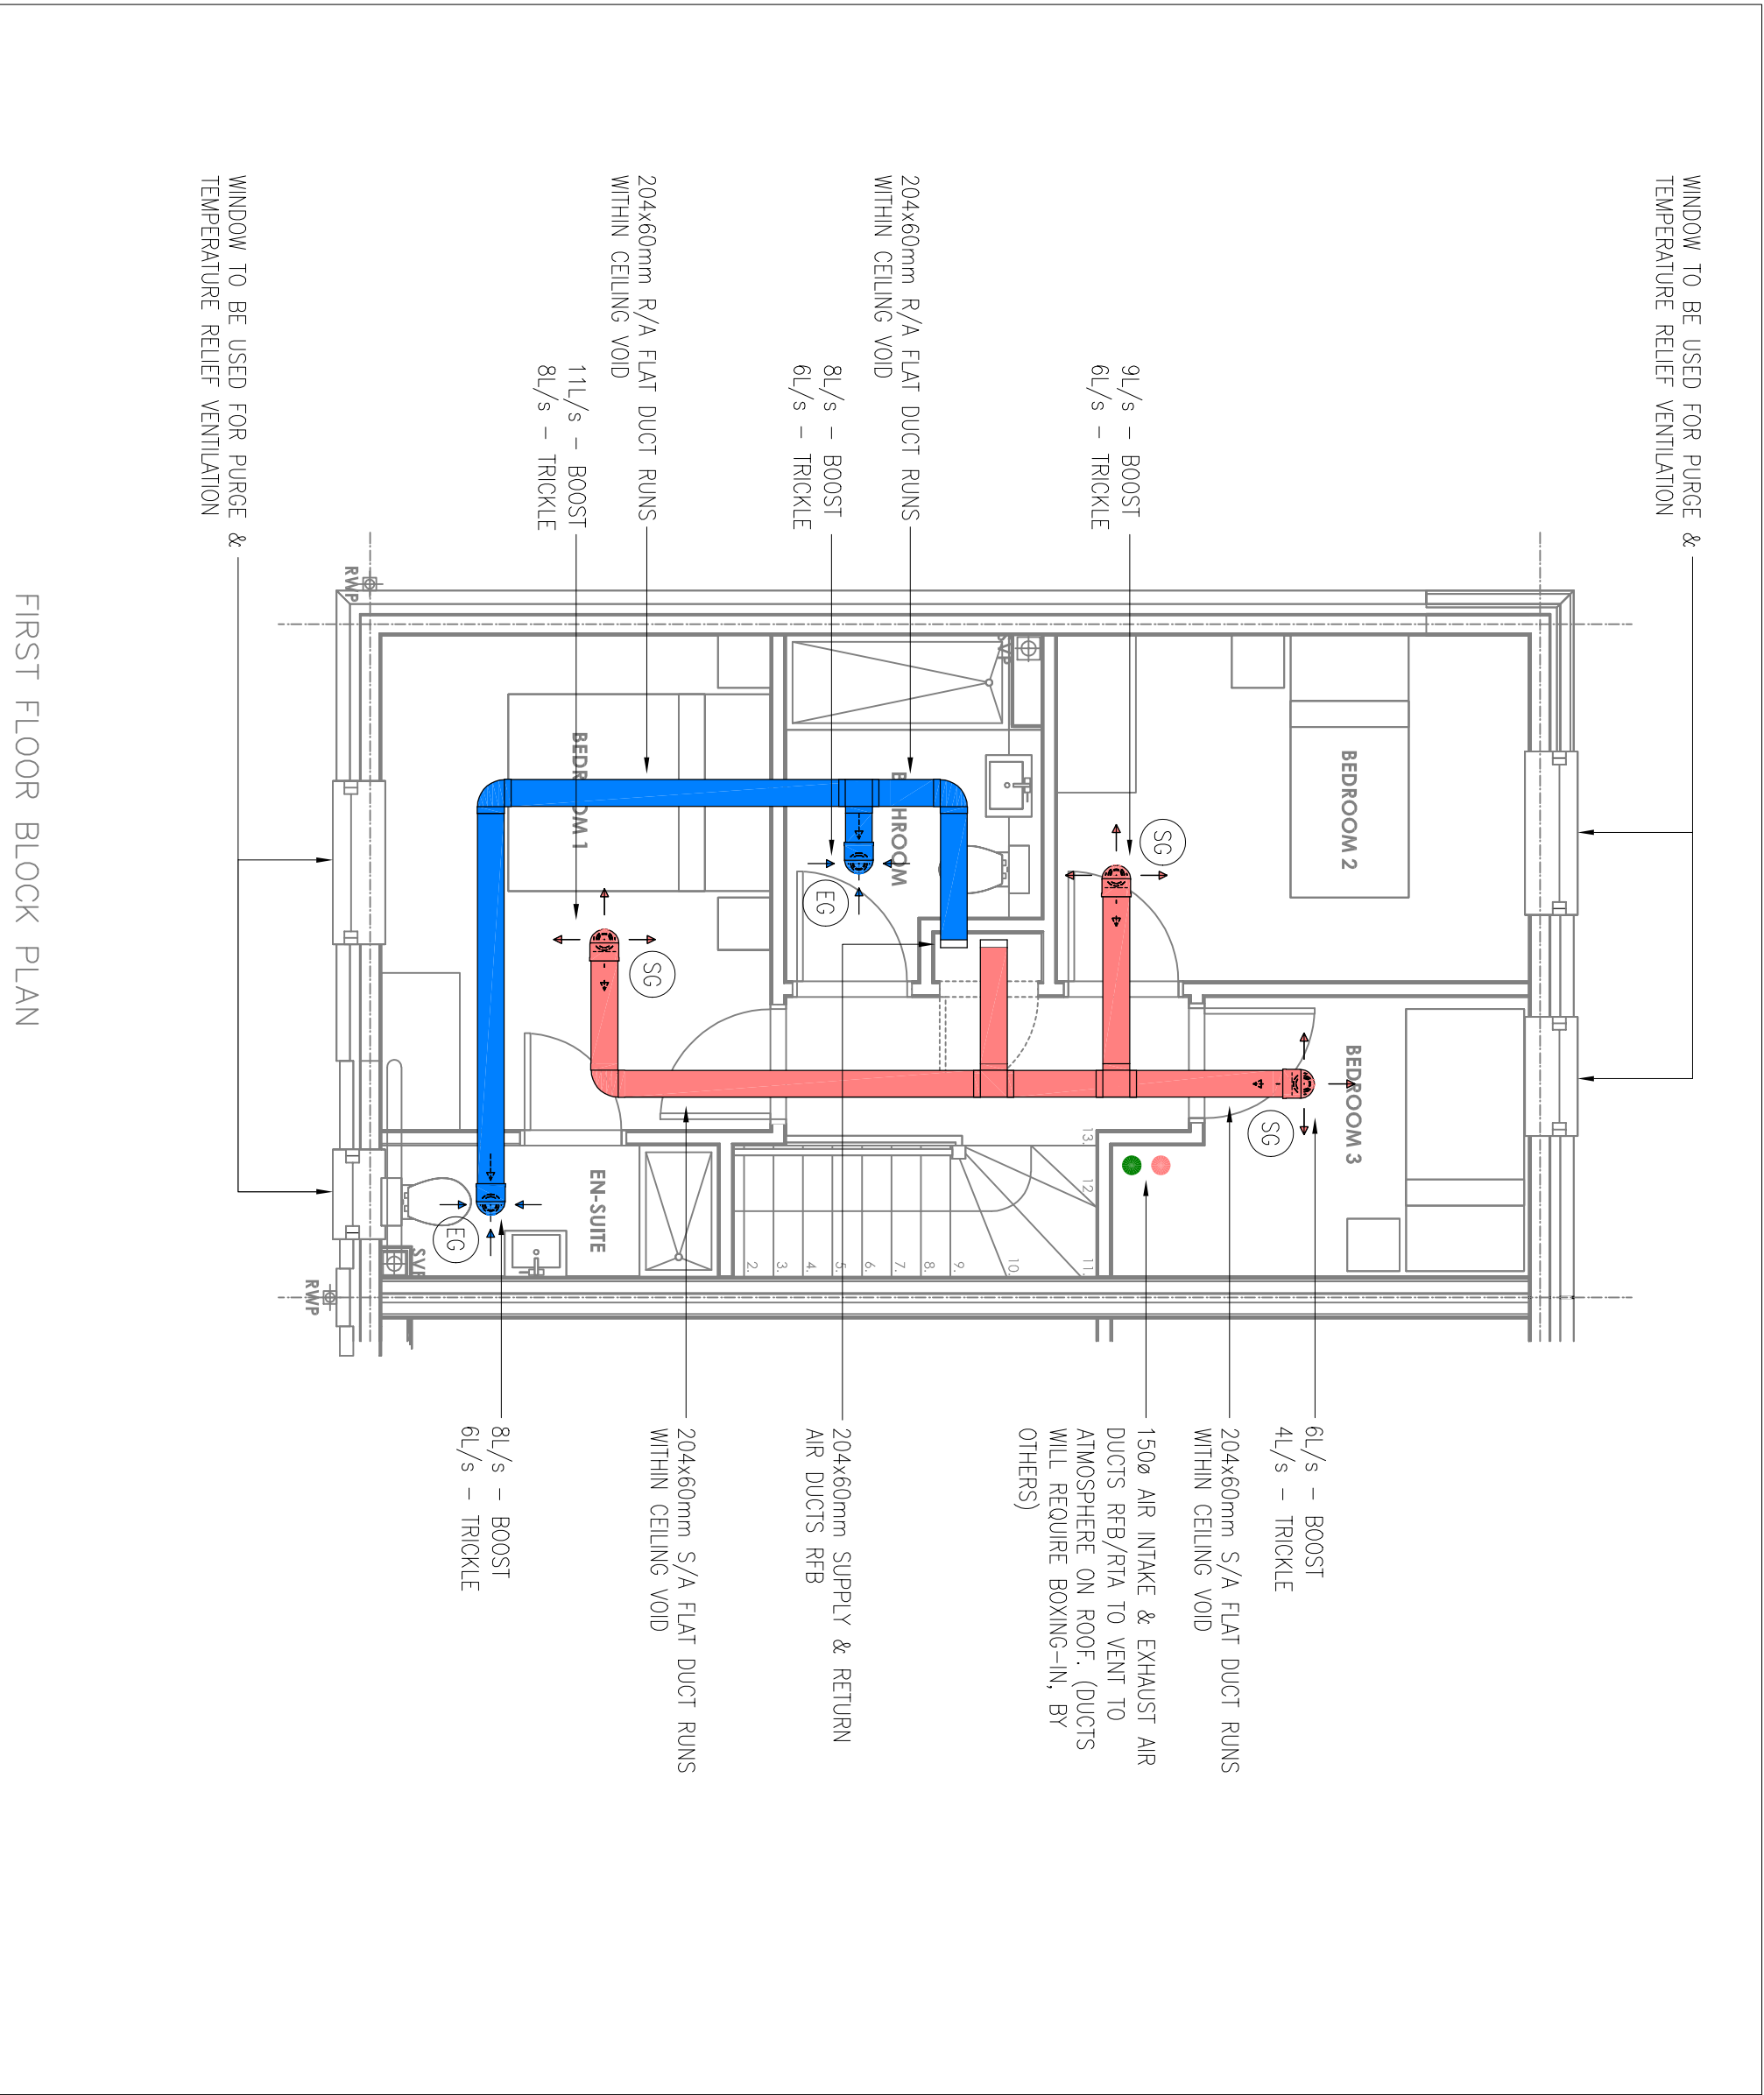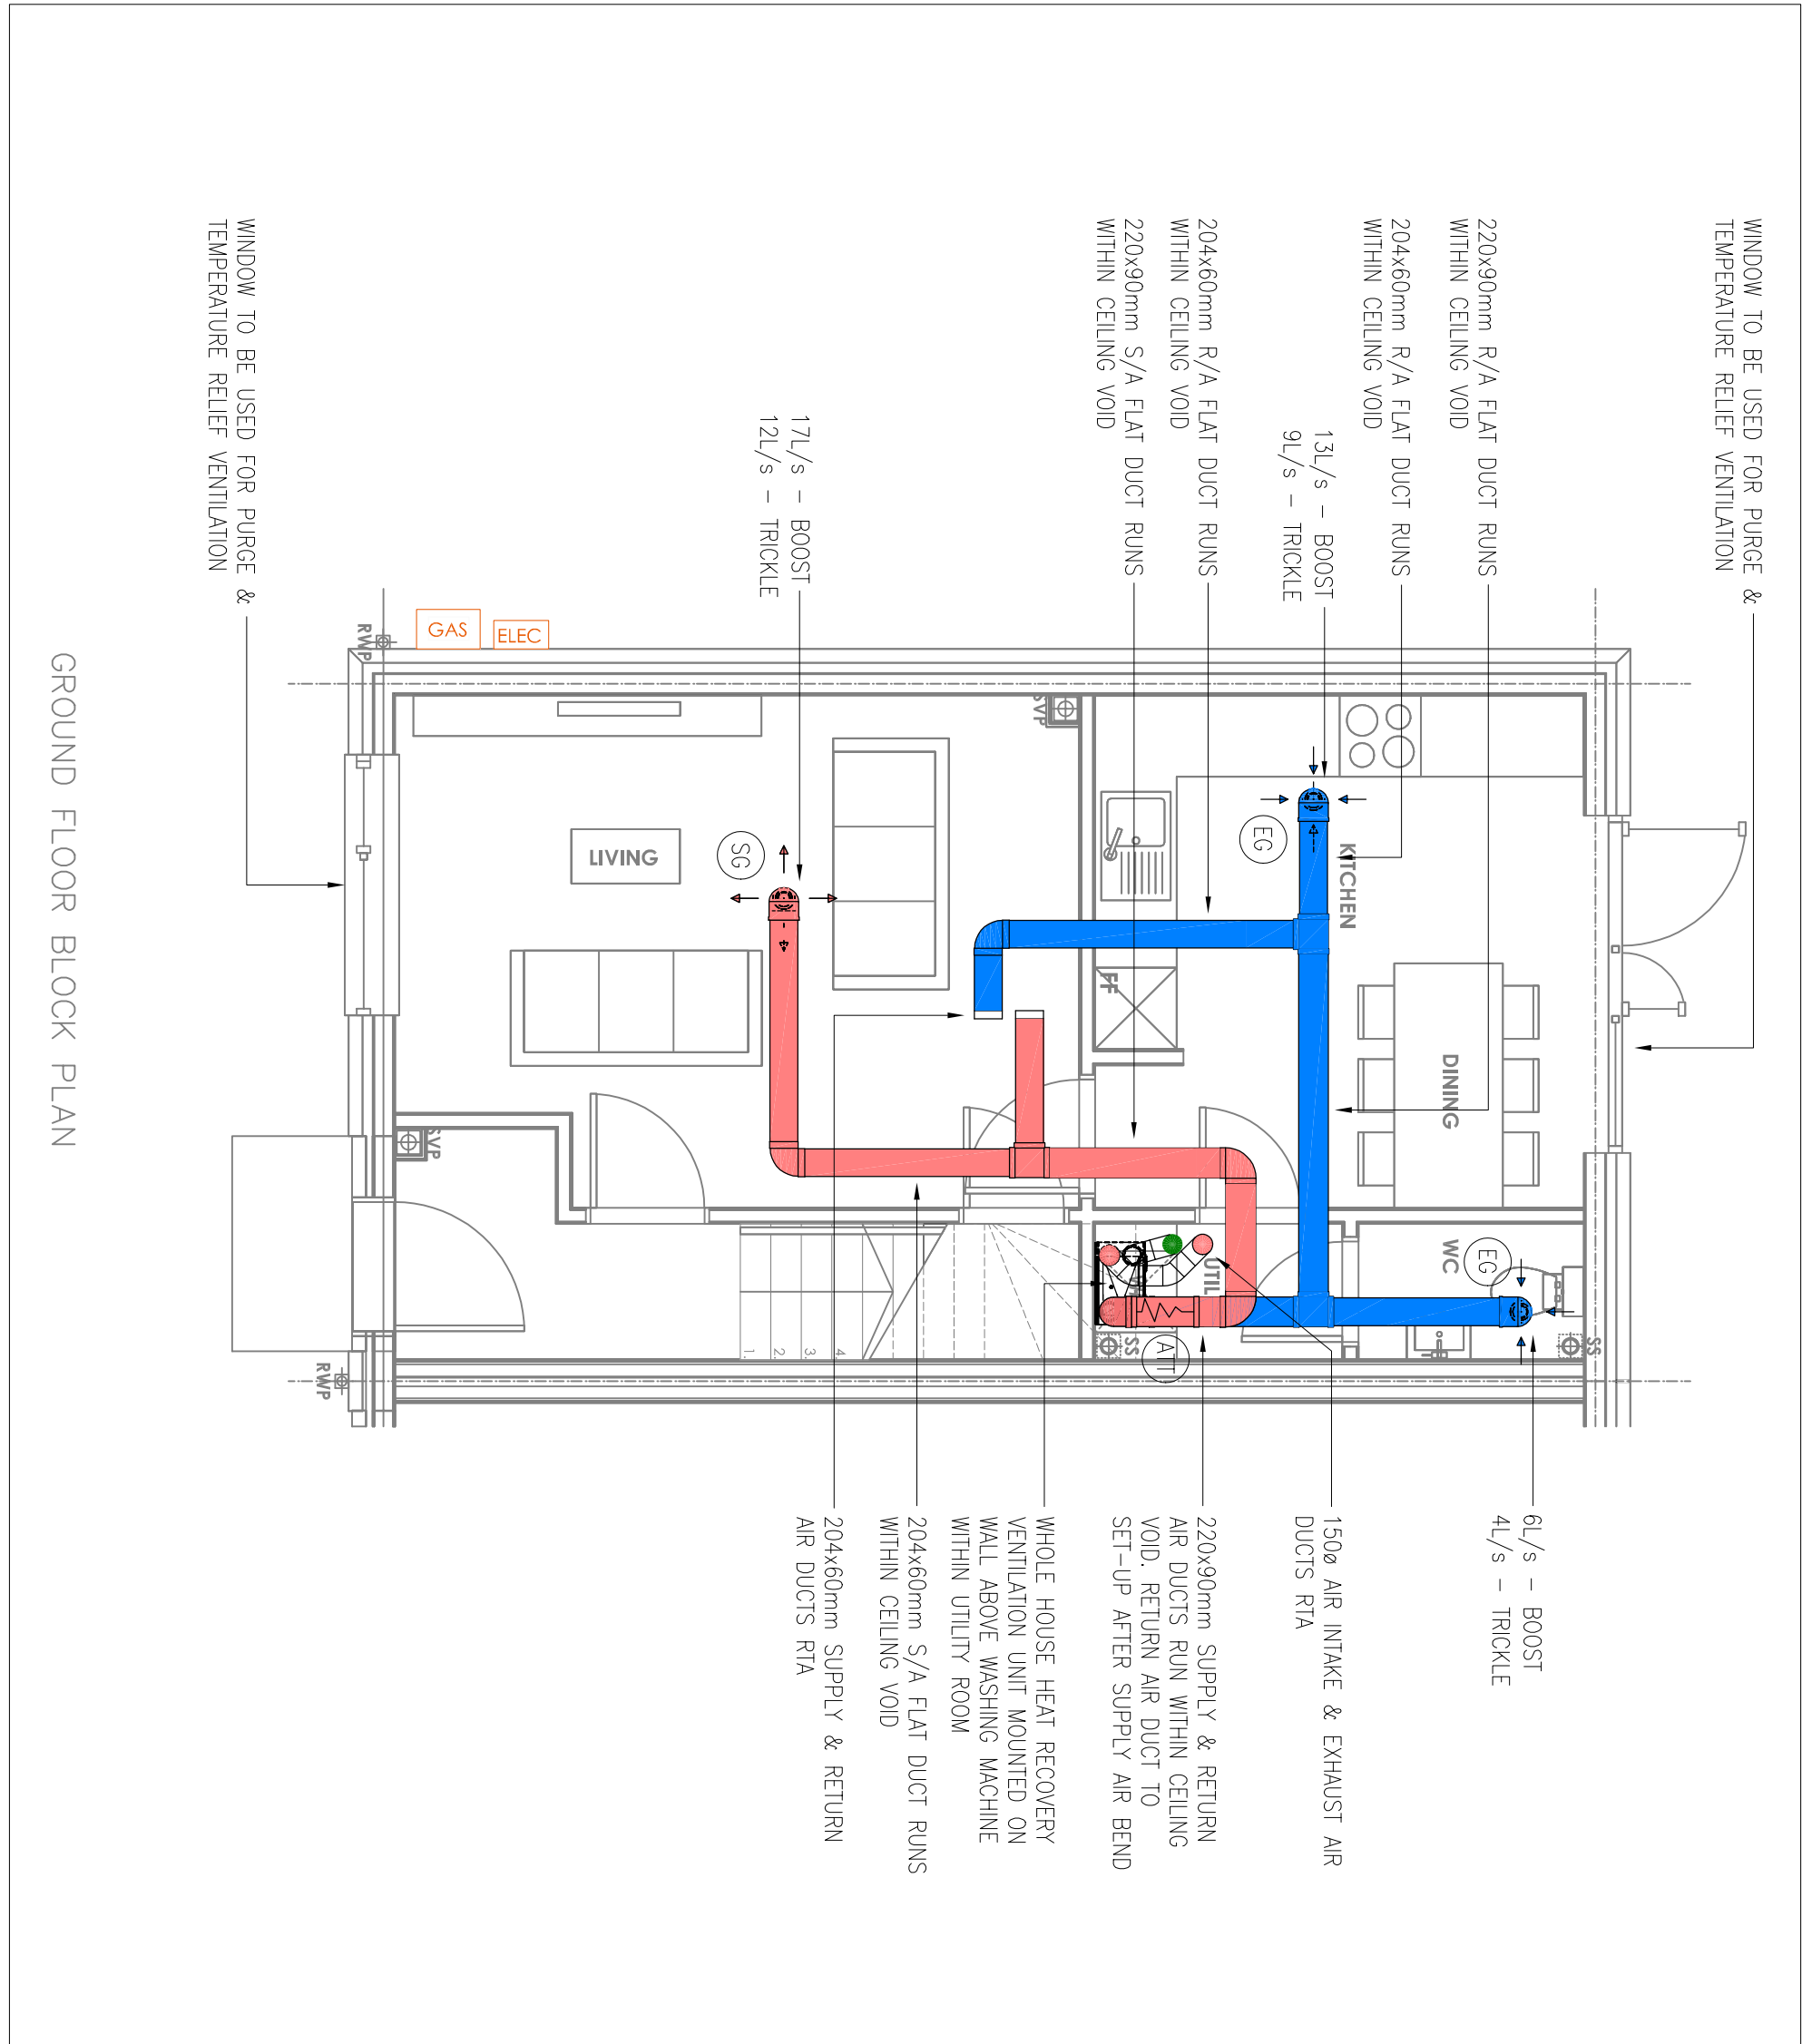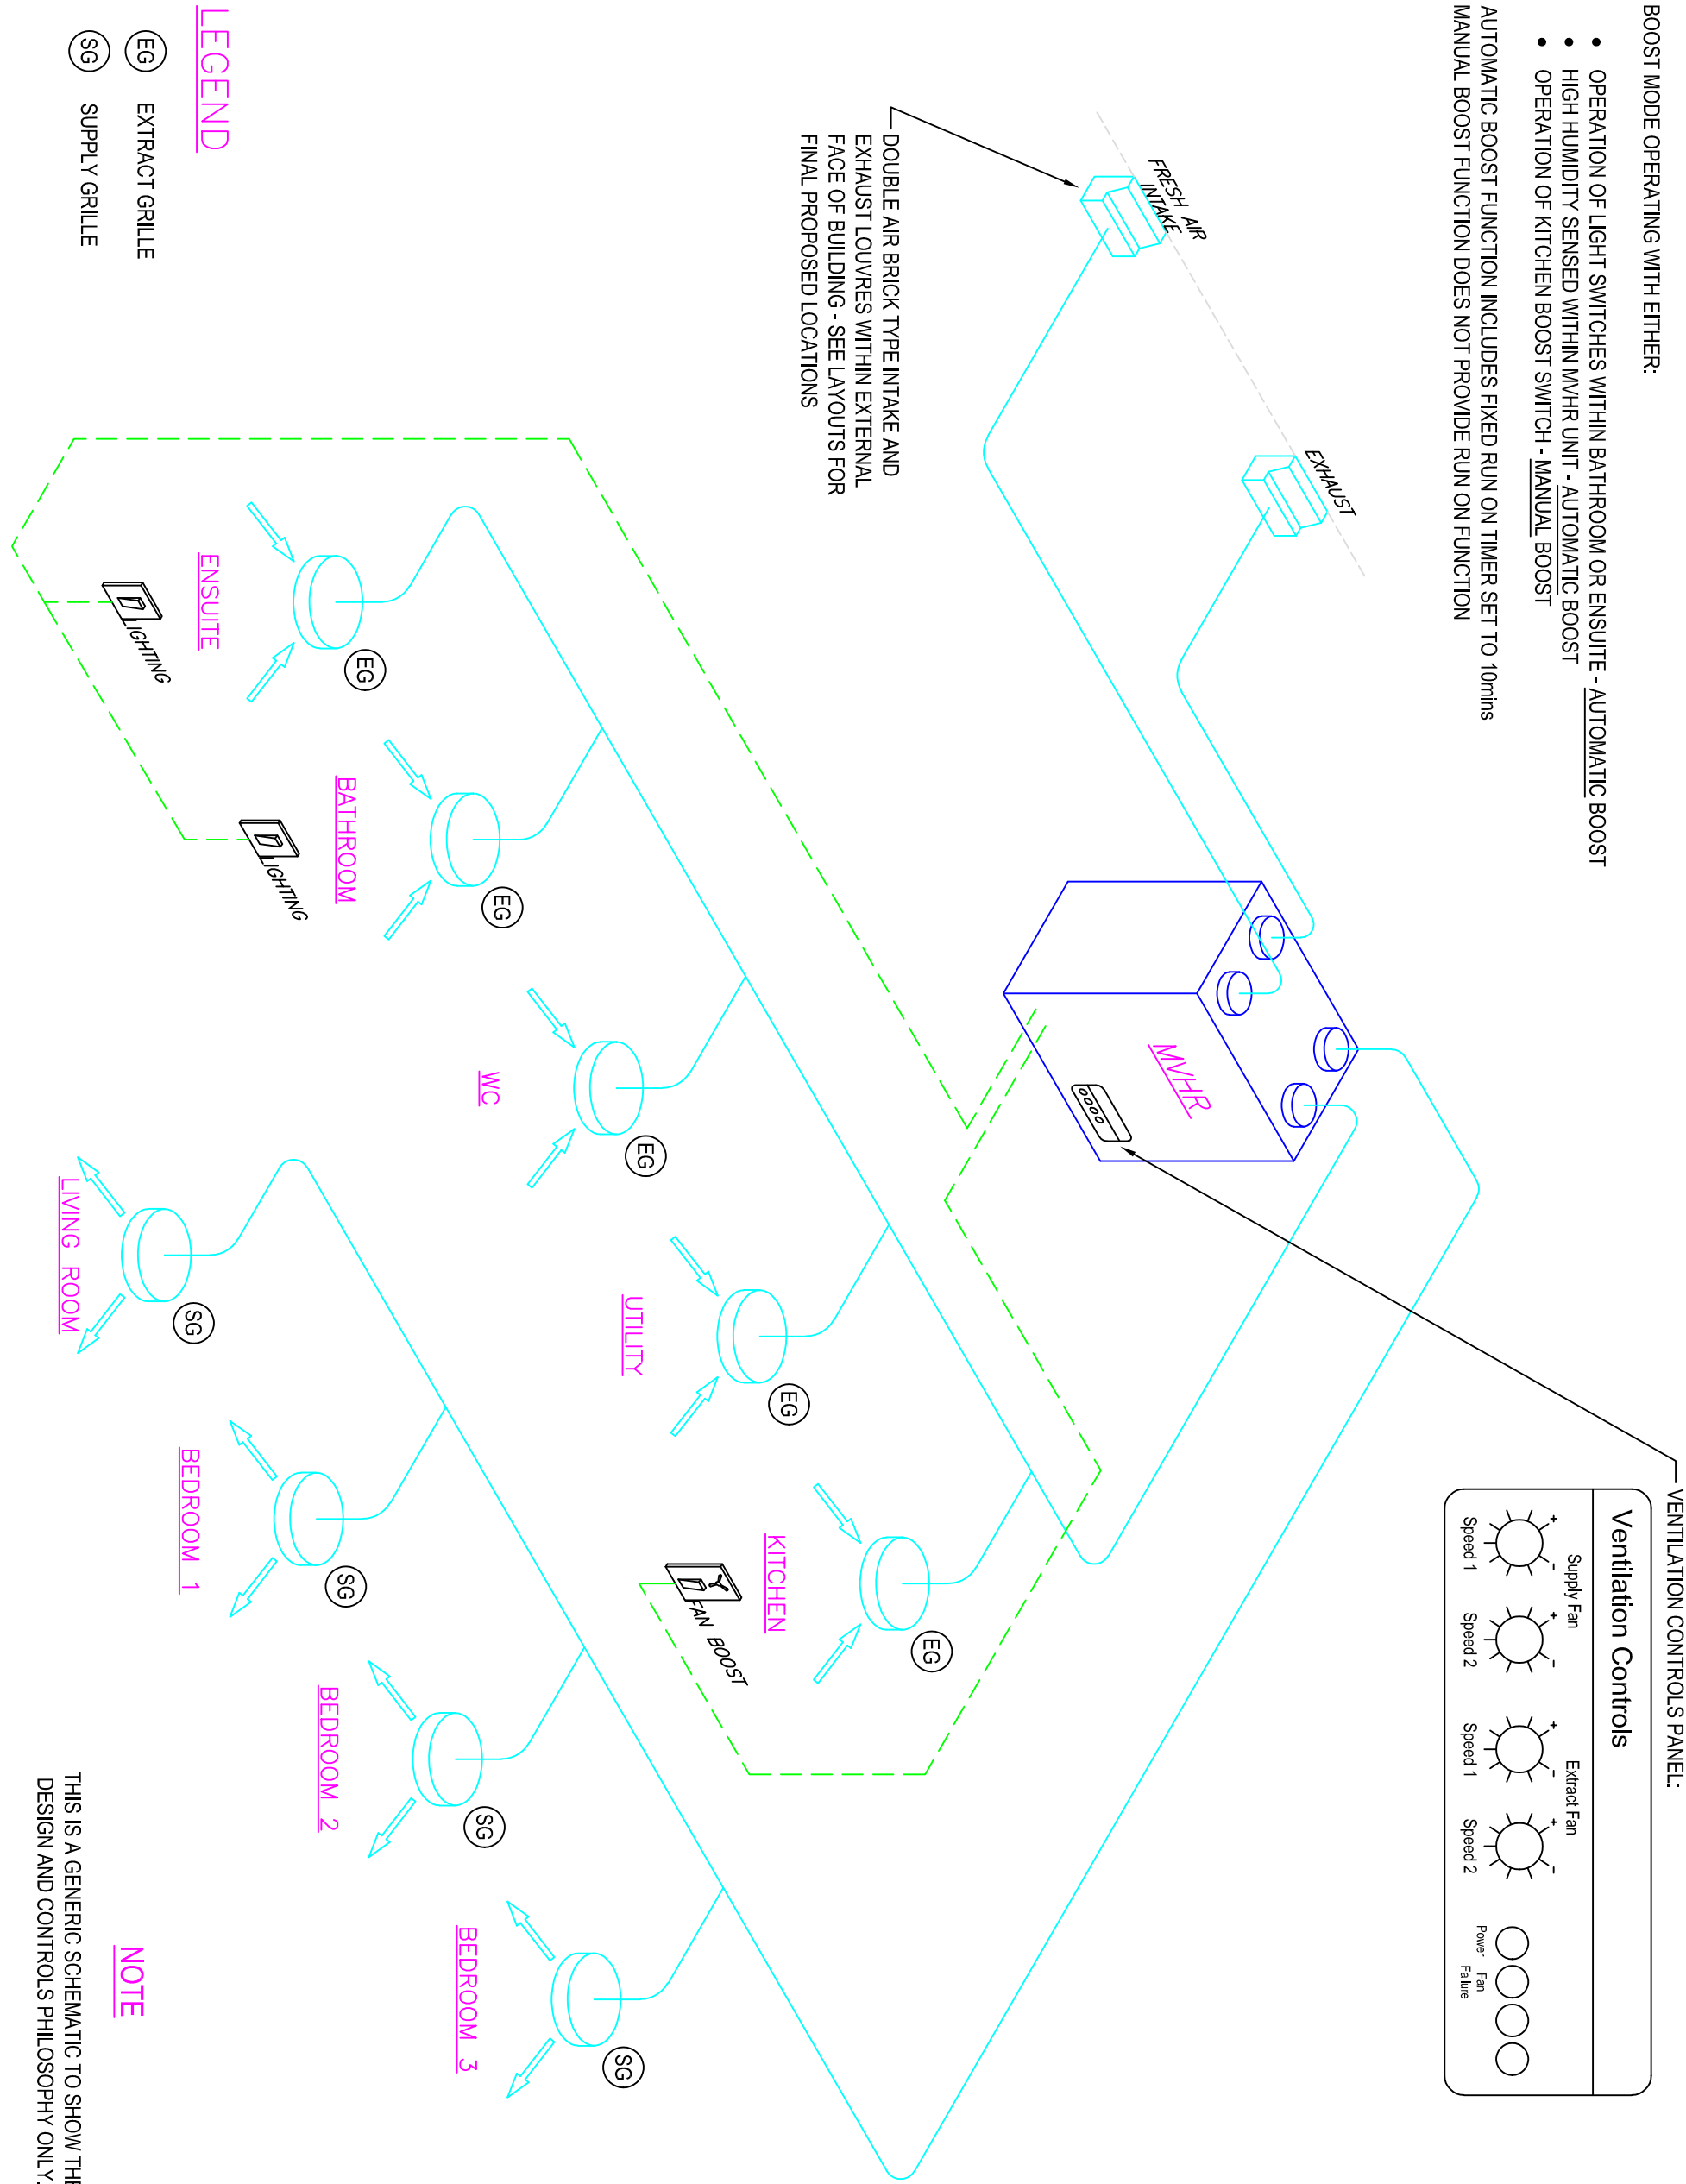

NOTES:

1. ALL FINAL LOCATIONS AND BAL FINISH OF ALL GRILLES TO BE APPROVED BY ARCHITECT.
2. ROOM SUPPLY AND EXTRACT GRILLES TO BE FULLY ADJUSTABLE
3. ALL DUCTWORK TO BE FULLY INSULATED.
4. ALL DUCTWORK TO BE SEALED FOR AIR LEAKAGE.
5. ALL FLEXIBLE DUCTWORK TO BE KEPT TO MINIMUM LENGTH, PULLED TIGHT AND SAGGING MUST BE REDUCED.
6. ALL DUCTWORK TO BE INSTALLED 200x80 & 204x60 FLAT PLASTIC DUCTWORK, UNLESS NOTED OTHERWISE.
7. ALL AIR BRICK ARE TO BE OF DOUBLE TYPE.
8. ALL SUPPLY AND EXTRACT GRILLES TO BE Ø175 AIR VALVE TYPE TO ENSURE GOOD AIR TRANSFER ALL INTERNAL DOORS TO PROVIDED WITH A MINIMUM 750mm² UNDERCUT.
- 9.

ABBREVIATIONS:

- FD - FIRE DAMPER
- SG - SUPPLY GRILLE
- EG - EXTRACT GRILLE
- ATT - ATTENUATOR
- R/A - RISES TO ABOVE
- R/B - RISES FROM BELOW

CD1	Construction Issue	12.10.21
PD1	Permitted Issue	17.05.21
Rev	Revised Description	1206

Client



Site
GORTON LANE
MANCHESTER

Drawing Title
VENTILATION SERVICES LAYOUTS
384P HOUSE

DRAYTON BEAUMONT SERVICES LTD
SPECIALISTS IN MECHANICAL AND ELECTRICAL ENGINEERING

DRAYTON BEAUMONT BUILDING
MERIAL STREET
NEWCASTLE UNDER LYME
ST12 2AE
Tel : 44 (0)1782 645170
Fax : 44 (0)1782 645171



www.draytonbeaumontservices.com

CONSTRUCTION

Drawn	CDG	Date	APRIL 2021
Checked	NB	Scale	1:50 @ A1
Approved	SB	Revision	

Drawing Number
8790-DBS-H2-ZZ-DR-M-5002

Revision
C01