

Schematic


CABLING	CODE	DESCRIPTION	RATING	SIZE	CORES	FIRE RATING
	P	Power 230-400 Vac	LV	See Cable Schedule		
	C	Power 24 VDC	ELV	2.5mm²	2 & E	PH120
	L	Loop	ELV	1.5mm²	2 & E	PH120
	C	Smoke Control	ELV	1.5mm²	2 & E	PH120
	C	Env Controls	ELV	1.5mm²	4	LSZH
	C	Env Signal & Comms	ELV	Screened twisted pair	2 & E	LSZH
	C	Env Signal & Comms	ELV	Screened twisted pair	4 & E	LSZH

General notes and Legend:

This drawing should be read in conjunction with the Design Specification document and associated schedules.

Symbols shown in grey are for indication only and not provided by The FDS Group.

All cable routes shown are indicative only. Final routes to be determined on site.

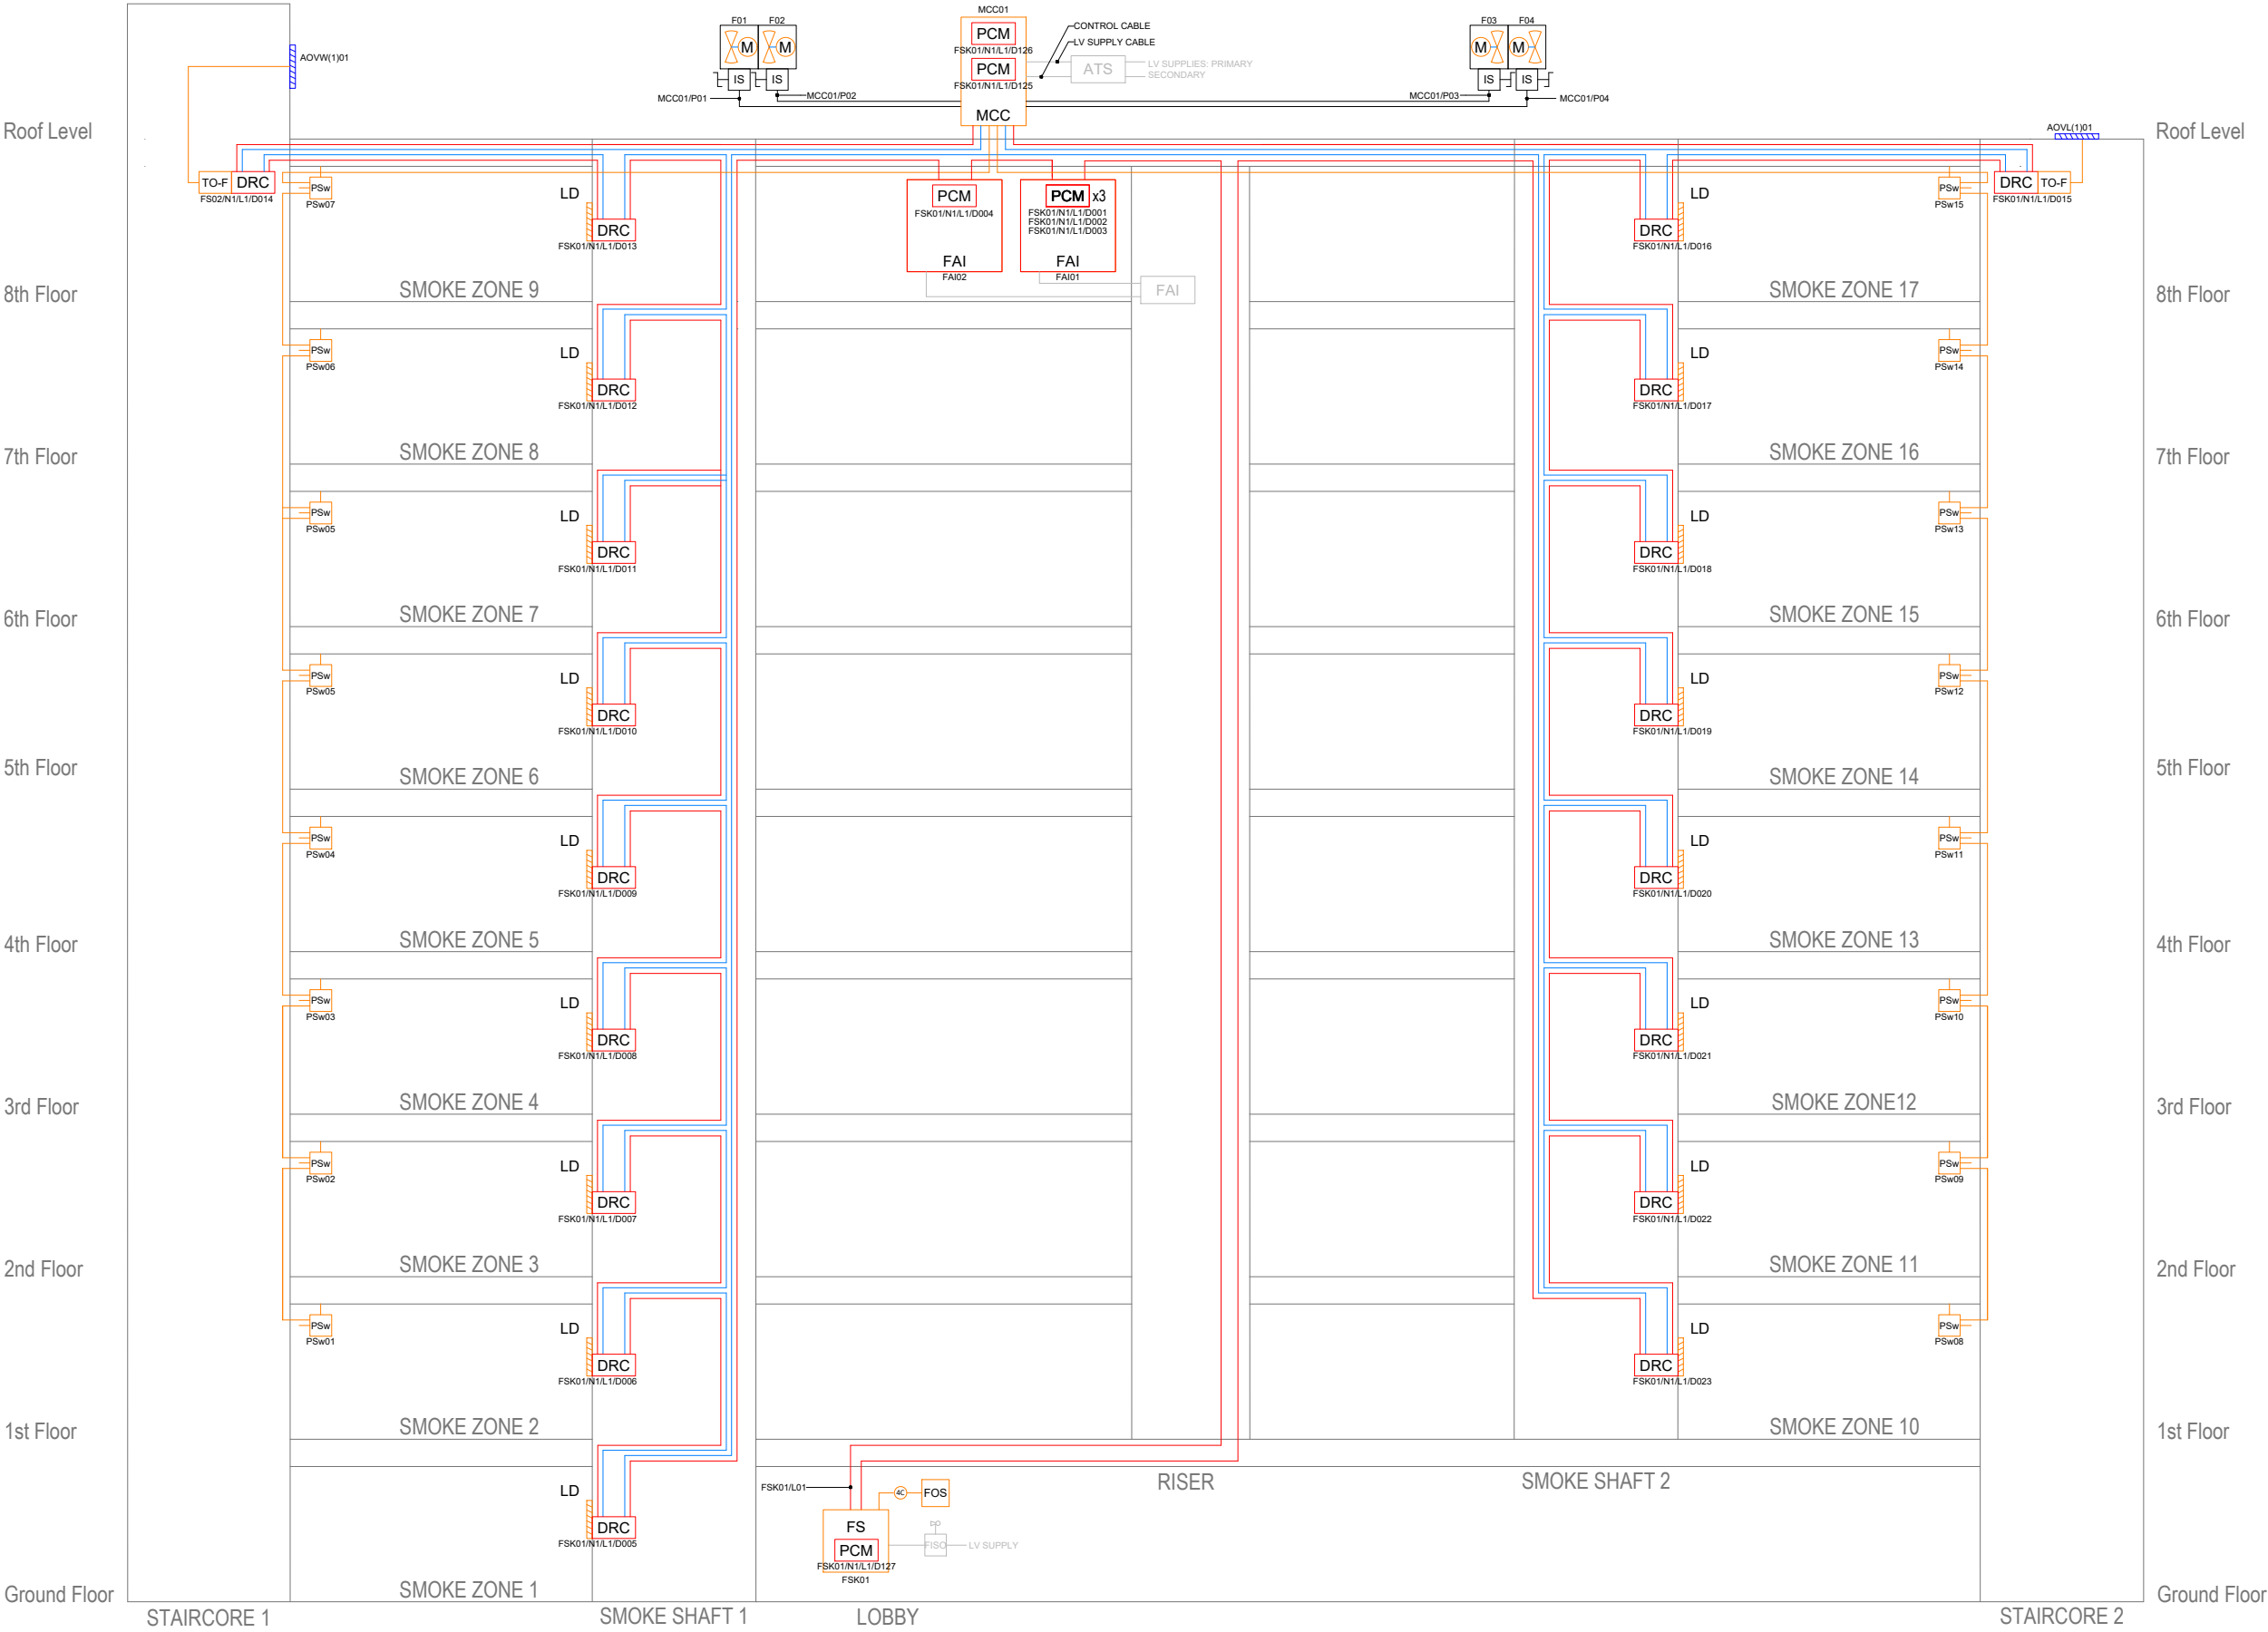

- FireSmart Control Panel
- Mechanical Control Centre
- Fireman's Override Switch
- Damper Interface Card (Smoke)
- Fire Panel Isolator (By Others)
- Extract Fan
- Smoke Control Lobby Damper
- Dual Relay Controller
- Plant Control Module
- Pressure Switch
- Fire Alarm Interface
- Fire Alarm Interface (By Others)

P01	14/03/23	Drawing issued for approval.	NM	SD
Rev	Date	Comment	Drn	Chk

**152/154 London Road
Greenhithe
Dartford
Kent
DA9 9JW
Tel 01322 387411
Email info@fdsuk.com**

Zone/Level: **Smoke Ventilation Schematic**

Project: **Accor Tribe Hotel, Manchester**

Job: 2022186	Drawn: Nick Mattock	Date: November 2022
Scale: NTS	Status: FOR APPROVAL	Code: S3
Dwg: 2022186-FDS-ZZ-SC-X-2001	Rev: P01	