


A0

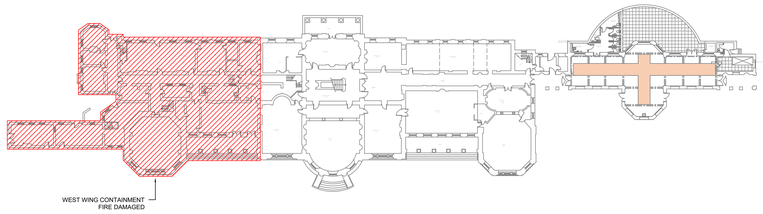


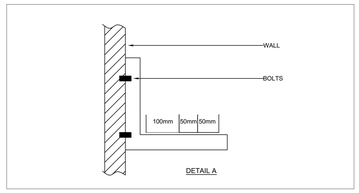

DETAIL A



DETAIL B



DETAIL C

CONTAINMENT LEGEND

SYMBOL	DESCRIPTION
	GALVANISED STEEL TRUNKING
	GALVANISED STEEL "1/2/3/4" COMPARTMENT TRUNKING DROPPER/RISER
	200mm GALVANISED STEEL BASKET WITH 2no DIVIDER
	300mm GALVANISED CABLE BASKET WITH 2no DIVIDER FOR BAND ONE, BAND TWO AND FIRE ALARM CABLES
	VERTICAL RISER FOR CONTAINMENT TO ELECTRICAL DISTRIBUTION BOARDS BETWEEN FLOOR
	"TP&N / SP&N" DISTRIBUTION BOARD *"LP / L / P / D / CCTV"*
	CONSUMER UNIT *"LP / L / P / D / CCTV"*
	SP&N ROTARY ISOLATOR
	200mm GALVANISED STEEL BASKET WITH 2no DIVIDER IN CEILING VOID
	FISH WIRES THROUGH FLOOR VOID

UTILITIES LEGEND

SYMBOL	DESCRIPTION
M	ELECTRICAL INCOMING MAINS SUPPLY

DRAWING NOTES


SYMBOL	DESCRIPTION
1	THE CONTRACTOR SHALL NOTE THAT THEY SHALL BE RESPONSIBLE FOR THE FINAL CO-ORDINATION OF THE PRIMARY CONTAINMENT INSTALLATION AND POSITIONING WITH REGARDS TO THE EXISTING STRUCTURAL ELEMENTS AND OTHER BUILDING SERVICES.
2	THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE DESIGN, SUPPLY AND INSTALLATION OF ALL SECONDARY CONTAINMENT FROM THE PRIMARY CONTAINMENT SYSTEM.
3	THE CONTRACTOR SHALL NOTE THAT THEY SHALL INCLUDE TO ISSUE TO THE PRINCIPAL CONTRACTOR A DETAILED BUILDERS WORK SCHEDULE FOR THE FORMING OF OPENINGS THROUGH THE STRUCTURE, OR FOR THE FORMING OF BOXING IN, TO ALLOW FOR CONTINUATION OF THE ELECTRICAL CONTAINMENT.
4	THE CONTRACTOR SHALL INCLUDE TO PASS THE CABLE CONTAINMENT UNDER THE EXISTING ARCHWAYS OR SUPPLY AND INSTALL BOXING IN. TO ALLOW FOR THE CONTINUATION OF THE ELECTRICAL CONTAINMENT SYSTEM.
5	THE CONTRACTOR SHALL INCLUDE TO DESIGN, SUPPLY AND INSTALL ADDITIONAL SECONDARY CABLE CONTAINMENT ROUTES TO FURTHER ENHANCE THE CABLE INSTALLATION. THIS SHALL BE IN KEEPING WITH THE THE PROPOSED INSTALLATION.
6	THE CONTRACTOR SHALL INCLUDE TO SUPPLY AND INSTALL NEW UNISTRUT AND HOUR FIRE RATED PLYWOOD PANEL ACROSS THE FULL LENGTH AND HEIGHT OF THE WALL.

GENERAL NOTES

1	THIS DRAWING SHALL BE READ IN CONJUNCTION WITH THE ECS ELECTRICAL ENGINEERING SPECIFICATIONS.
2	THIS DRAWING IS INDICATIVE AND IS INTENDED TO HIGHLIGHT THE PROPOSED LOCATION FOR ELECTRICAL SERVICES. THE CONTRACTOR SHALL NOTE THESE DRAWINGS SHALL NOT BE USED FOR CONSTRUCTION PURPOSES.
3	THE CONTRACTOR SHALL NOTE THIS DRAWING HAS BEEN PRODUCED USING LIMITED SITE SURVEY INFORMATION. THE CONTRACTOR SHALL INCLUDE TO CARRY OUT AN INTRUSIVE SURVEY AND TO PRODUCE DRAWINGS THAT REFLECT THE INSTALLATION.
4	ALL EQUIPMENT SHALL BE INSTALLED & LOCATED TO MAINTAIN SPATIAL REQUIREMENTS TO FACILITATE ACCESS & MAINTENANCE IN LINE WITH MANUFACTURERS RECOMMENDATIONS AND GOOD PRACTICE GUIDES.
5	ALL EQUIPMENT SHALL BE INSTALLED IN ACCORDANCE WITH MANUFACTURERS GUIDELINES.
6	DO NOT SCALE FROM THIS DRAWING.
7	ALL DETAILS ARE APPLICABLE TO EVERY DRAWING UNLESS INDICATED OTHERWISE.
8	THE CONTRACTOR SHALL INCLUDE TO IDENTIFY THE COMPLETE EXISTING ELECTRICAL INSTALLATION, EXTEND AND ADAPT TO FACILITATE THE PROPOSED WORKS

NOTE: THE CONTRACTOR SHALL INCLUDE TO MARK UP ALL PENETRATIONS (NEW/EXISTING) ON SITE AND SEEK APPROVAL FROM CONTRACTOR ADMINISTRATOR & MCC HERITAGE ARCHITECTS BEFORE PENETRATION WORKS COMMENCE.

NOTE: CONTRACTOR TO CHECK DRAWING No. 24/100/E/04 TO ASCERTAIN SERVICES. THEN CAN BE INSTALLED UNDER GROUND FLOOR BOARD INCLUDING ACCESS TO BASEMENT & FIRST FLOOR ROOMS.

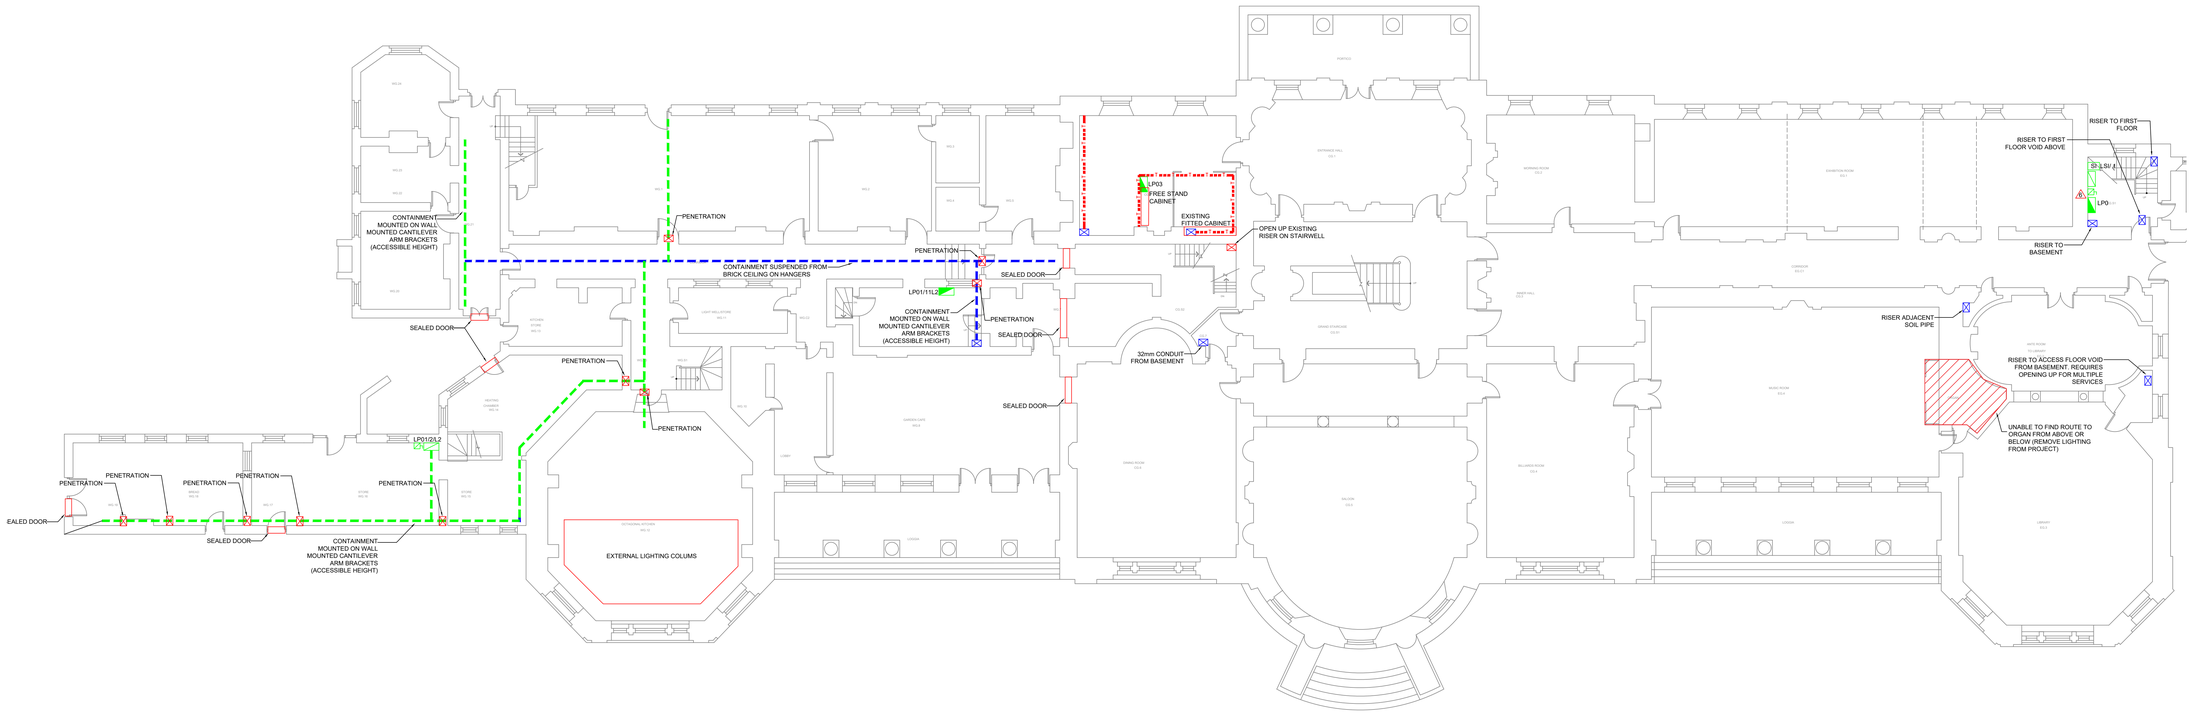

GROUND FLOOR PLAN

T3	TENDER ISSUE.	G.M.	May. 24
T2	TENDER ISSUE.	G.M.	Jan. 24
T1	TENDER ISSUE.	G.M.	Nov. 22
Rev.	Description	Revised By	Date

STATUS

TENDER

ecs CONSULTANTS
Building Services Consulting Engineers
148 Stockport Road
Cheadle, Cheshire. SK8 2DP
Tel: 0161 283 2862 Fax: 0161 282 8825
Web Site: www.ecs-ecs.co.uk Email: sales@ecs-ecs.co.uk

JOB NO.	DRAWING NO.	COMPUTER FILE	REVISION
24/100	24/100/E/27	24_100_E_27	T3
DATE	SCALE	DRAWN	CHECKED
Dec. 2021	1:100 @ A0	J.P.	G.M.

JOB TITLE
Heaton Park Hall

DRAWING TITLE
Ground Floor
Containment Layout

CfA ISO 9001

CAD original - not to be modified by hand