


SW26 HYDROBRAKE

For hydrobrake details, refer to manufacturers' specification.

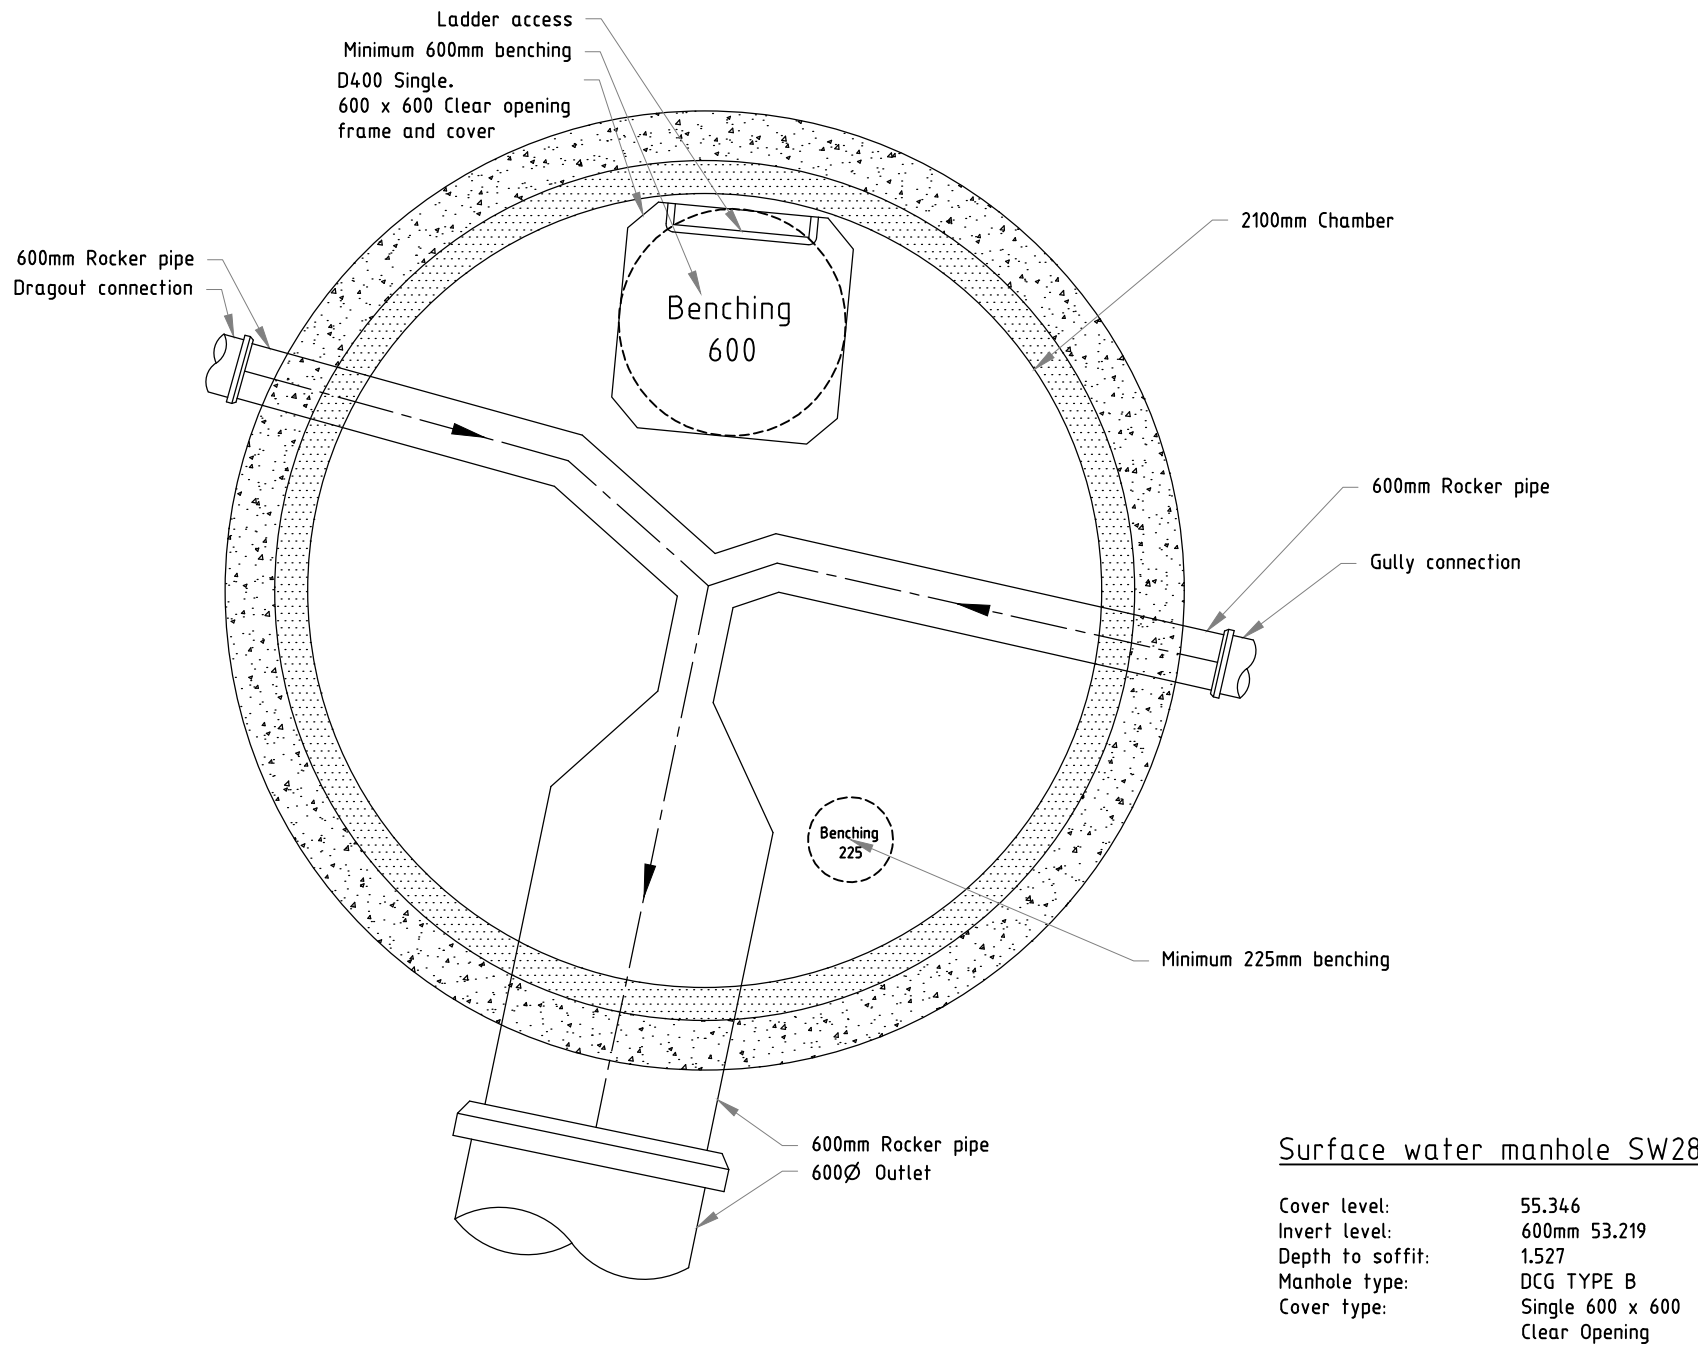

NOTES:

1. ALL SEWERS ARE DESIGNED IN ACCORDANCE WITH THE DESIGN AND CONSTRUCTION GUIDANCE (DCG) AND ICOSA GUIDELINES AND STANDARD DETAILS.
2. ALL CO-ORDINATES AND LEVELS SHOWN ARE RELATIVE TO THE TOPOGRAPHIC SURVEY.
3. IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO ENSURE THE LINE AND LOCATION OF ANY EXISTING SEWERS, AS WELL AS ANY EXISTING GROUND AND INVERT LEVELS SHOWN ON THE DRAWING ARE CORRECT PRIOR TO THE COMMENCEMENT OF ANY WORKS. ANY DISCREPANCIES MUST BE REPORTED IMMEDIATELY.
4. PRIOR TO THE COMMENCEMENT OF ANY ON SITE WORKS THE CONTRACTOR MUST CONTACT THE STATUTORY UNDERTAKER AND BE IN POSSESSION OF THE LATEST DRAWINGS SHOWING THEIR APPARATUS.
5. IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO ALLOW FOR THE SUPERVISION OF THE CONSTRUCTION WORKS BY ICOSA AND/OR THE HIGHWAYS AUTHORITY. THE CONTRACTOR WILL NOTIFY THE SUPERVISING OFFICER GIVING NOTICE WHICH WILL BE IN ACCORDANCE WITH THE AUTHORITIES REQUIREMENTS.
6. THE PROPOSED SEWERS WILL BE CLAY PIPE WORK AND SHALL BE EXTRA STRENGTH TO BS EN 295:1991 PART 1.
7. ANY PRE CAST CONCRETE PIPE WORK WILL BE IN ACCORDANCE WITH BS EN 1916:2002.
8. IT IS THE CONTRACTORS RESPONSIBILITY TO ENSURE THE CORRECT BEDDING, SURROUND AND BACKFILLING PROCEDURES ARE FOLLOWED FOR PVC PIPES. FOR DETAILS OF EMBEDMENT AND SURROUND FOR FLEXIBLE PIPES REFER TO DR-C-2117_DRAINAGE CONSTRUCTION DETAILS.
9. ALL MANHOLES AND CHAMBERS SHALL BE IN ACCORDANCE WITH BS EN 1917:2002.
10. SEWERS WITH COVER TO SOFFIT GREATER THAN 1.2m IN ROADS AND 0.9m IN FIELDS SHALL HAVE BED AND SURROUND AS FOLLOWS: RIGID PIPE EMBEDMENT SHALL BE CLASS S, SEMI RIGID PIPE EMBEDMENT SHALL BE CLASS S ALL IN ACCORDANCE WITH DR-C-2117_DRAINAGE CONSTRUCTION DETAILS.
11. ANY SEWER FOR ADOPTION WITH A COVER OF LESS THAN 1.2M TO PIPE SOFFIT IN ROADS OR 0.9m TO PIPE SOFFIT IN FIELDS WILL REQUIRE A REINFORCED CONCRETE PROTECTION SLAB.
12. PRIVATE DRAINAGE CONNECTIONS TO THE SEWER WILL BE 150MM DIAMETER AND LAID TO THE SPECIFIED INVERT.
13. THE INVERT LEVELS SPECIFIED AT THE DRAG OUT CHAMBER ARE INCOMING LEVELS.
14. WHEREVER POSSIBLE PRIVATE DRAINAGE RUNS WILL REMAIN WITHIN THE CURTILAGE OF THE DWELLING FOR WHICH THEY SERVE.
15. THE CONNECTION TO THE ADOPTABLE SEWER SHALL BE MANUFACTURED JUNCTION PIPES A SADDLE CONNECTION IS NOT PERMITTED UNLESS IT IS CLEARLY SPECIFIED.
16. CONNECTIONS TO THE EXISTING SEWER WILL BE IN ACCORDANCE WITH SECTION 104 APPROVAL GRANTED BY ICOSA.
17. CONNECTIONS TO THE EXISTING WATERCOURSE WILL BE IN ACCORDANCE WITH APPROVAL GRANTED BY THE EA.

ALL LATERAL CONNECTIONS WILL BE MADE SOFFIT TO SOFFIT

ALL PIPE LENGTHS ARE IN LINE WITH VARIABLE FEATURES STND/19/010

P01 13.06.23 PRELIMINARY - Issued for Information		J.W. R.A.	
Rev	Date	Description	By Chk
		Manchester . UK 3rd Floor, Cornavan Court, 12 Blackfriars Street, Manchester, M3 9BQ, United Kingdom T: +44 (0) 161 834 1938 E: manchester@edgece.com	
The concepts + information contained in this document are the copyright of EDGE Consulting Engineers. Use or copying of this document in whole or in part without the written permission of EDGE Consulting Engineers constitutes an infringement of copyright. DO NOT SCALE DRAWINGS. IF IN DOUBT, ASK!			
Project Name: COLLYHURST VILLAGE			
Client: DEX CONSTRUCTION			
Designed	Drawn	Checked	Scale @/ A1
J.W.	J.W.	R.A.	1:20
Drawing Title: SW 1 TO 20S SHEET 3			
Project No. 221625		PRELIMINARY NOT FOR CONSTRUCTION	
Drawing No. 221625-EDGE-XX-XX-DR-C-2115		Revision P01	

FILENAME

PLOT DATE

0 mm 10 20 30 40 50