
A0

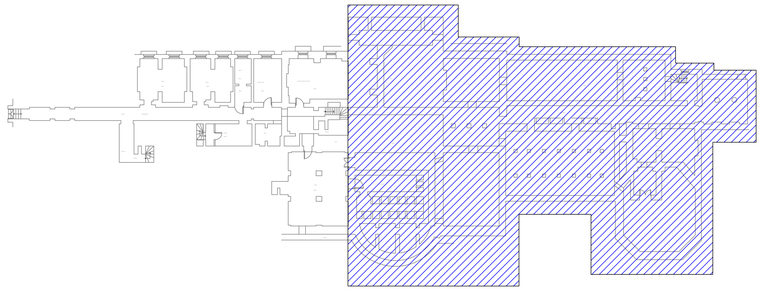

BASEMENT PLAN

## FIRE ALARM LEGEND

| SYMBOL | DESCRIPTION |
|---|---|
| M | COMBINED OPTICAL HEAT DETECTOR |
| M VAD | COMBINED OPTICAL HEAT DETECTOR C/W SOUNDER & VAD |
| M SND | COMBINED OPTICAL HEAT DETECTOR C/W SOUNDER |
| M VAD | COMBINED OPTICAL HEAT DETECTOR C/W VAD |
| H SND | HEAT DETECTOR WITH SOUNDER AND STROBE BASE |
| | MANUAL CALL POINT |
| I | INTERFACE UNIT - GAS (BOILER PLANT ROOM) |


## CONTAINMENT LEGEND

| SYMBOL | DESCRIPTION |
|---|---|
| | GALVANISED STEEL TRUNKING |
| | GALVANISED STEEL "1/2/3/4" COMPARTMENT TRUNKING DROPPER/RISER |
| | 200mm GALVANISED STEEL BASKET WITH 2no DIVIDER (POSSIBLE CLIPPED DIRECT FOLLOWING CONTRACTOR ADMINISTRATORS APPROVAL) |
| | 300mm GALVANISED CABLE BASKET WITH 2no DIVIDER FOR BAND ONE, BAND TWO AND FIRE ALARM CABLES |
| | VERTICAL RISER FOR CONTAINMENT TO ELECTRICAL DISTRIBUTION BOARDS BETWEEN FLOOR |
| | "7P&N / SP&N" DISTRIBUTION BOARD "LP / L / P / D / CCTV" |
| | CONSUMER UNIT "LP / L / P / D / CCTV" |
| | SP&N ROTARY ISOLATOR |
| | 200mm GALVANISED STEEL BASKET WITH 2no DIVIDER IN CEILING VOID |
| | FISH WIRES THROUGH FLOOR VOID (CLIPPED DIRECT IN WEST WING) |

## GENERAL NOTES

1. THIS DRAWING SHALL BE READ IN CONJUNCTION WITH THE ECS ELECTRICAL ENGINEERING SPECIFICATIONS.
2. THIS DRAWING IS INDICATIVE AND IS INTENDED TO HIGHLIGHT THE PROPOSED LOCATION FOR ELECTRICAL SERVICES.
THE CONTRACTOR SHALL NOTE THESE DRAWINGS SHALL NOT BE USED FOR CONSTRUCTION PURPOSES.
THE CONTRACTOR SHALL INCLUDE TO PRODUCE THEIR OWN WORKING DRAWINGS, TAKE DETAILED SITE MEASUREMENTS, INDICATE THE PROVISION OF BUILDERS WORKS AND COORDINATE THE INSTALLATION OF ALL SERVICES.
3. THE CONTRACTOR SHALL NOTE THIS DRAWING HAS BEEN PRODUCED USING LIMITED SITE SURVEY INFORMATION.
THE CONTRACTOR SHALL INCLUDE TO CARRY OUT AN INTRUSIVE SURVEY AND TO PRODUCE DRAWINGS THAT REFLECT THE INSTALLATION.
4. ALL EQUIPMENT SHALL BE INSTALLED & LOCATED TO MAINTAIN SPATIAL REQUIREMENTS TO FACILITATE ACCESS & MAINTENANCE IN LINE WITH MANUFACTURERS RECOMMENDATIONS AND GOOD PRACTICE GUIDES.
5. ALL EQUIPMENT SHALL BE INSTALLED IN ACCORDANCE WITH MANUFACTURERS GUIDELINES.
6. DO NOT SCALE FROM THIS DRAWING.
7. ALL DETAILS ARE APPLICABLE TO EVERY DRAWING UNLESS INDICATED OTHERWISE.
8. THE CONTRACTOR SHALL INCLUDE TO IDENTIFY THE COMPLETE EXISTING ELECTRICAL INSTALLATION, EXTEND AND ADAPT TO FACILITATE THE PROPOSED WORKS

NOTE: THE CONTRACTOR SHALL BE RESPONSIBLE TO MAINTAIN THE EXISTING FIRE ALARM SYSTEM THROUGHOUT THE PROJECT AT ALL POINTS UNTIL THE NEW FIRE ALARM IS INSTALLED, COMMISSIONED, TESTED AND INSPECTED BY PROTEC AND WITNESSED BY ECS CONSULTANTS.

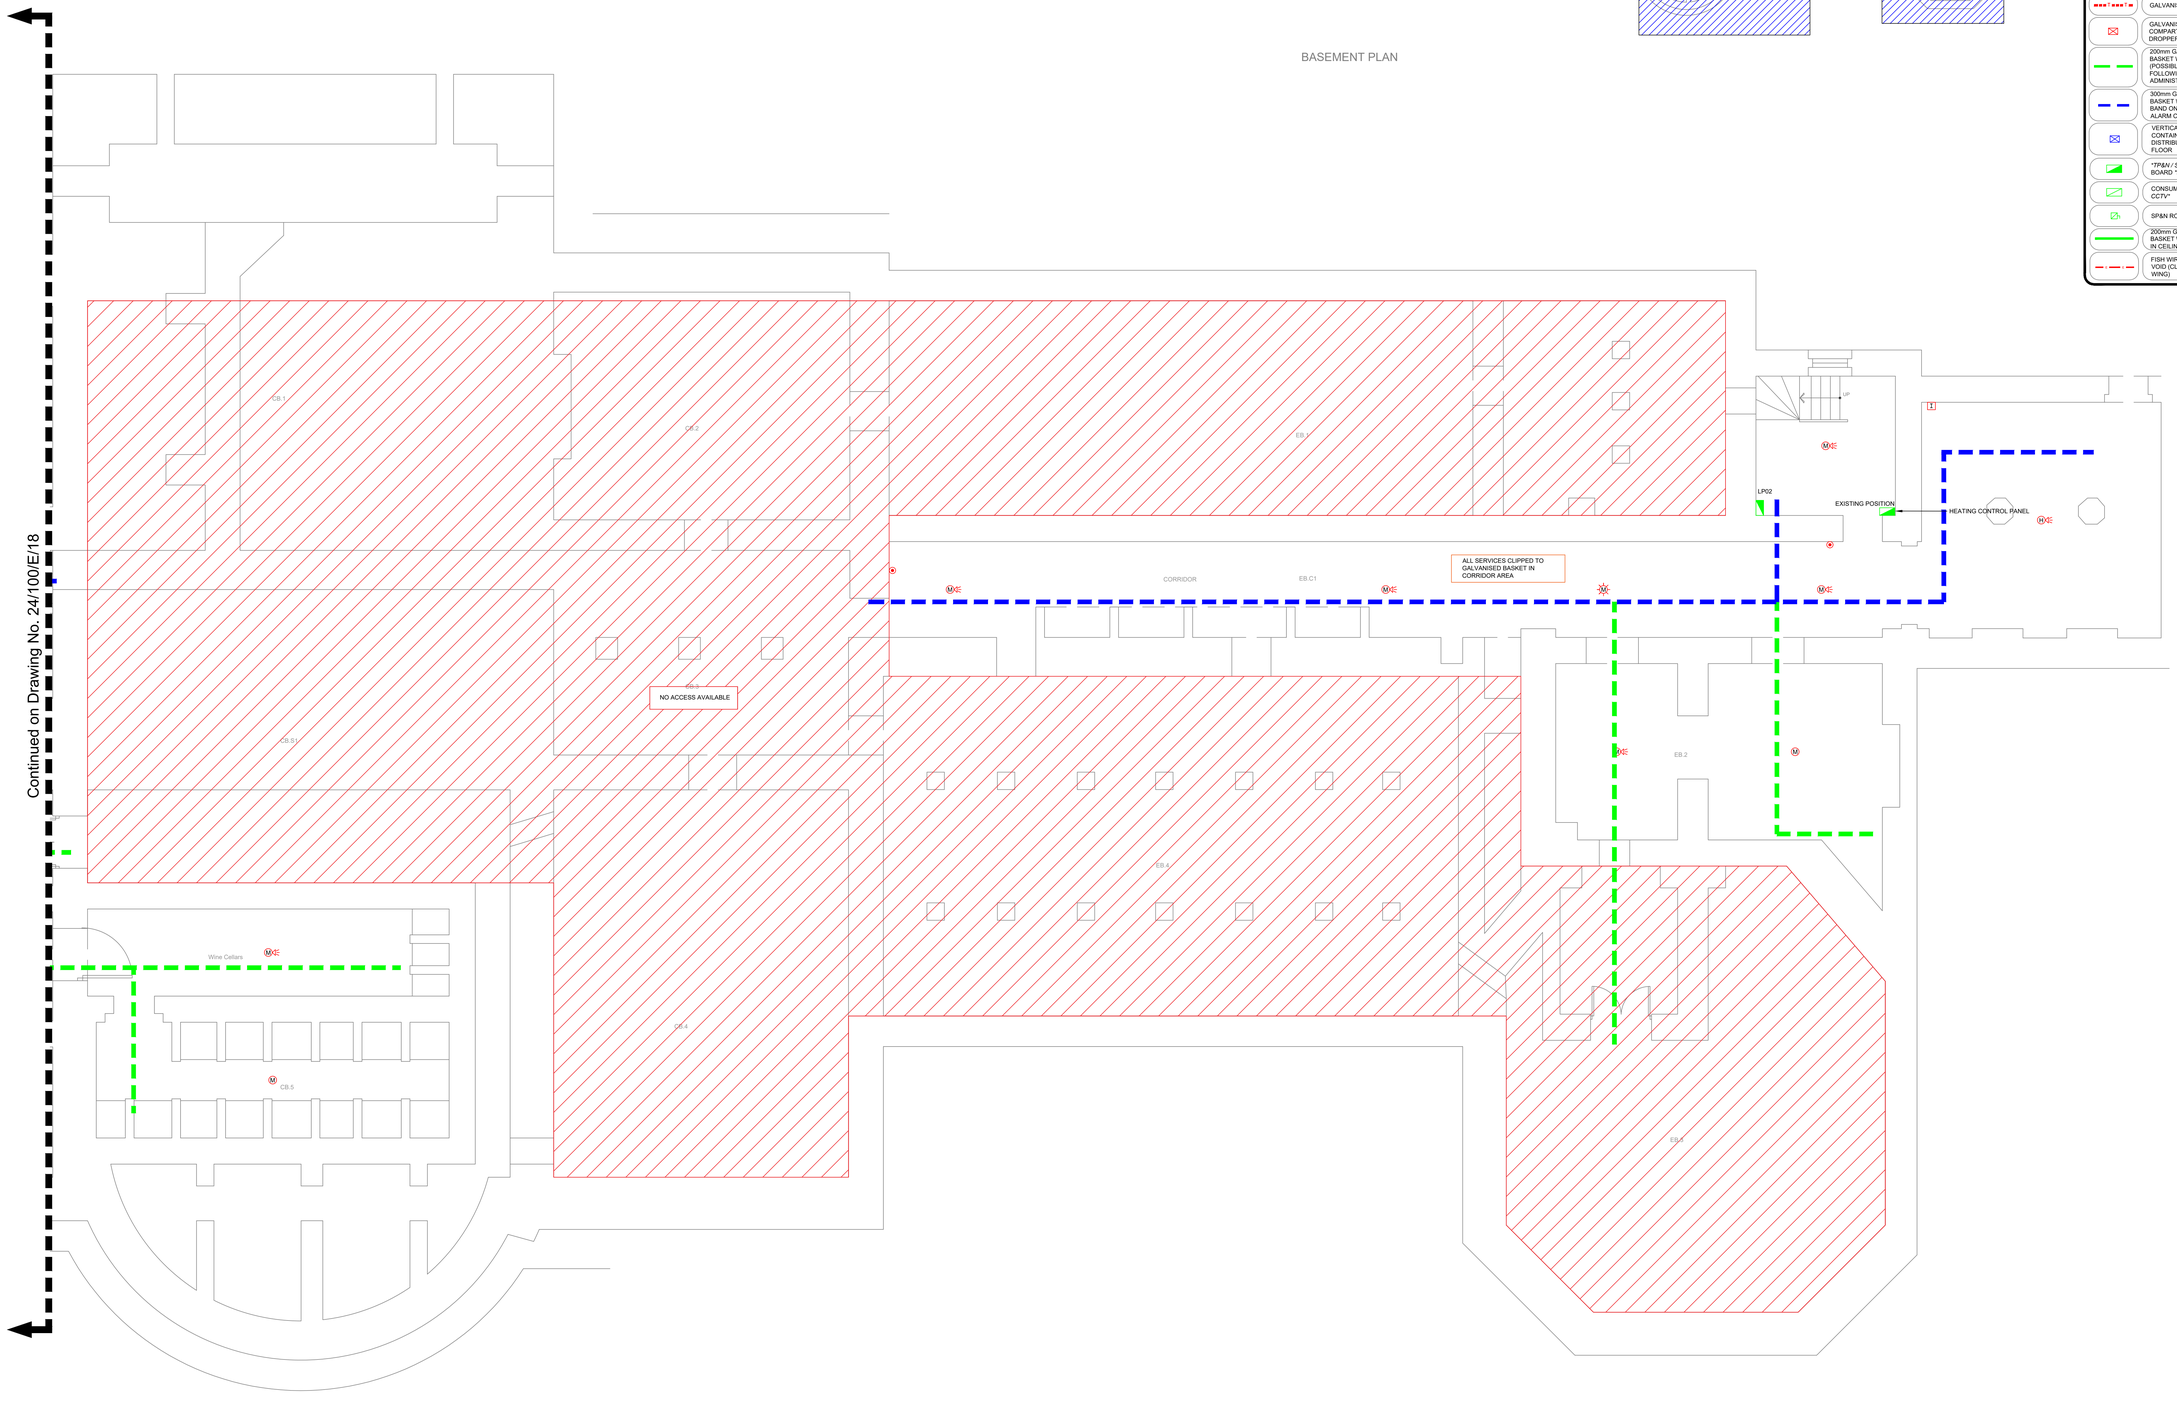


| Rev. | Description | Revised By | Date |
|---|---|---|---|
| T3 | TENDER ISSUE. | G.M. | May. 2024 |
| T2 | TENDER ISSUE. | G.M. | Jan. 2024 |
| T1 | TENDER ISSUE. | G.M. | Nov. 2021 |

STATUS: INFORMATION


ecs CONSULTANTS
Building Services Consulting Engineers
148 Stockport Road
Cheadle, Cheshire, SK8 2DP
Tel: 0161 283 2882 Fax: 0161 282 8825
Web Site: www.ecs-ecs.co.uk Email: sales@ecs-ecs.co.uk


| JOB NO. | DRAWING NO. | COMPUTER FILE | REVISION |
|---|---|---|---|
| 24/100 | 24/100/E/19 | 24_100_E_19 | T3 |
| DATE | SCALE | DRAWN | CHECKED |
| Feb. 2021 | 1:50 @ A0 | J.P. | G.M. |

JOB TITLE: Heaton Park Hall

DRAWING TITLE: Basement East Wing Fire Alarm Layout

CAD original - not to be modified by hand