ESCAPE WINDOWS
Provide emergency egress windows to any newly created first floor habitable rooms and ground floor inner rooms.
The window should have an unobstructed clear openable area that is at least 0.33m² and have no clear dimension less than 450mm high or 450mm wide.
The bottom of the openable area should be not more than 1100mm above the floor.
The window should enable the person to reach a place free from danger from fire.

ROOF LIGHTS
Min U-value of 2.2 W/m²K.
Roof-lights to be double glazed with16mm argon gap and soft low-E glass. Roof lights to be fitted in accordance with manufacturer's instructions, with rafters doubled up to sides and suitable flashings provided.

SAFETY GLAZING
All glazing in critical locations to be toughened or laminated safety glass to BS EN 12600:2002, BS EN 14179 or BS EN ISO 12543-1 and Part K of the current Building Regulations, i.e. within 1500mm above floor level in doors and side panels within 300mm of door opening and within 800mm above floor level in windows.

NEW AND REPLACEMENT WINDOWS
New and replacement windows to be double glazed with 16-20mm argon gap and soft coat low-E glass. Window Energy Rating to be Band B or better and to achieve U-value of 1.4 W/m²K. The door and window openings should be limited to 25% of the extension floor area plus the area of any existing openings covered by the extension.
Insulated plasterboard to be used in reveals to abut jambs and to be considered within reveal soffits. Fully insulated and continuous cavity closers to be used around reveals.
Windows and door frames to be taped to surrounding openings using air sealing tape.
Windows to be fitted with trickle vents to provide adequate background ventilation in accordance with Approved Document F.

NEW AND REPLACEMENT DOORS
New and replacement doors to achieve a U-Value of 1.4W/m²K. Glazed areas to be double glazed with 16-20mm argon gap and soft low-E glass. Glass to be toughened or laminated safety glass to BS 6206, BS EN 14179 or BS EN ISO 12543-1 and Part K of the current Building Regulations.
Insulated plasterboard to be used in reveals to abut jambs and to be considered within reveal soffits. Fully insulated and continuous cavity closers to be used around reveals.
Windows and door frames to be taped to surrounding openings using air sealing tape.


EXTRACT TO UTILITY ROOM
To utility room provide mechanical ventilation ducted to external air capable of extracting at a rate of 30 l/s. Internal doors should be provided with a 10mm gap below the door to aid air circulation. Ventilation provision in accordance with the Domestic Ventilation Compliance Guide. Intermittent extract fans to BS EN 13141-4. All fixed mechanical ventilation systems, where they can be tested and adjusted, shall be commissioned and a commissioning notice given to the Building Control Body.

EXTRACT TO KITCHEN
Kitchen to have mechanical ventilation with an extract rating of 60 l/s, or 30 l/s if adjacent to hob to external air. Internal doors should be provided with a 10mm gap below the door to aid air circulation. Ventilation provision in accordance with the Domestic Ventilation Compliance Guide. Intermittent extract fans to BS EN 13141-4. Cooker hoods to BS EN 13141-3. All fixed mechanical ventilation systems, where they can be tested and adjusted, shall be commissioned and a commissioning notice given to the Building Control Body.

PURGE VENTILATION
Minimum total area of opening in accordance with Table 1.4 Approved Document F1.
Hinged or pivot windows with an opening angle of 15 to 30 degrees to have an openable area in excess 1/10 of the floor area of the room.
External doors and sash, hinged or pivot windows with an opening angle of equal to or greater than 30 degrees to have an openable area in excess of 1/20 of the floor area of the room.
Purge ventilation should be capable of extracting at least 4 air changes per hour per room directly to the outside.
Internal doors should be provided with a 10mm gap below the door to aid air circulation.

PITCHED ROOF VENTILATION
Maintain a 50mm air gap above insulation in the roof pitch to ventilate roof. Provide opening at eaves level at least equal to continuous strip 25mm wide and opening at ridge equal to continuous strip 5mm wide to promote ventilation.

C2. CONDENSATION
Walls, floors and roof of the building to be designed and constructed so that their structural and thermal performance will not be adversely affected by interstitial condensation, surface condensation or mould growth. Account to be taken of the building's form and orientation in relation to topography, prevailing winds, sunlight and over-shadowing, and the rate at which humidity is generated.
Materials with the highest vapour resistance should be located on the warm side of a thermal element. VCLs to be provided where necessary.
The junctions between elements are designed to Accredited Construction Details or guidance of BRE IP17/01] and BS 5250:2021 Management of moisture in buildings to be followed.

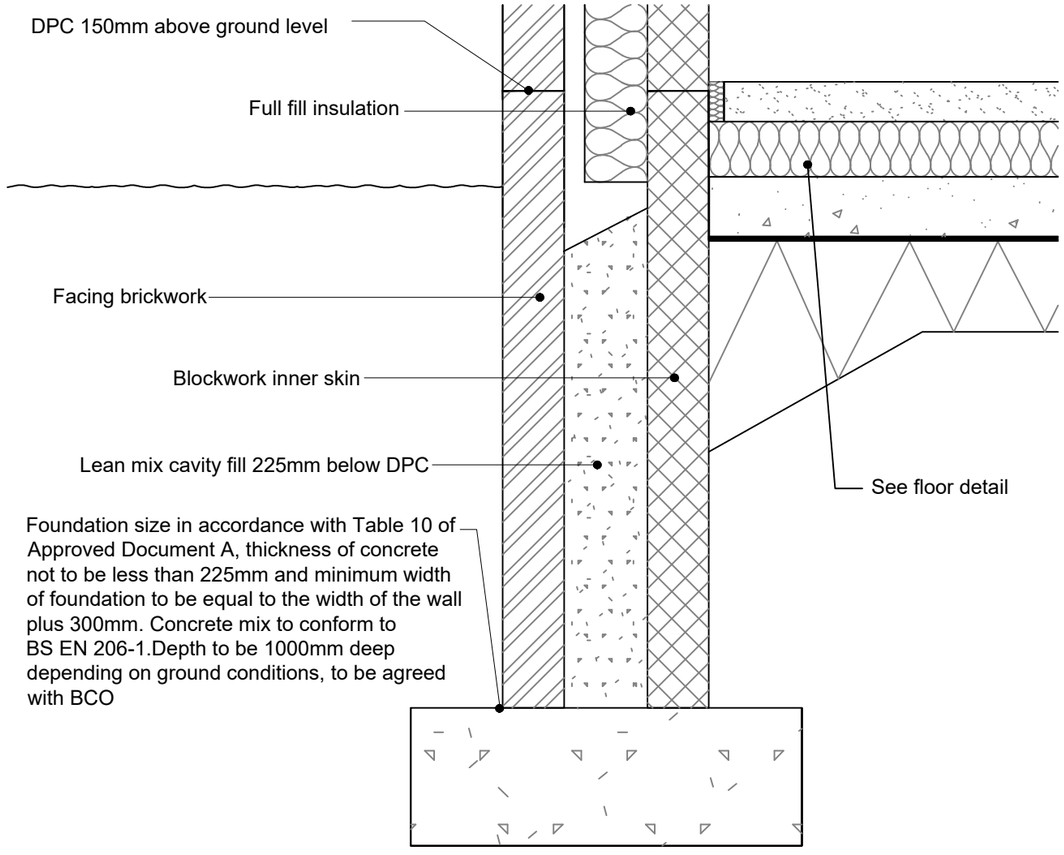

Typical Foundation Detail
Scale 1:10

THE EXTENSION GUYS
Office: Ash 3-4 Centrix House, Newton Le Willows, WA12 9UY
Telephone: +44 (0) 1625 326 777
Email: garry@theextensionguys.co.uk

Client:
The Extension Guys
Ash 3-4 Centrix House,
Newton Le Willows, WA12 9UY

Project / Title:
Proposed Single Storey Side / Rear Extension at 17 Red Cedar Close
Blackley, M9 7GS

AutoCAD Location	D:\BentleyP&PM\Planning Apps\		
Drawn: MJD	Scale: As Shown @ A3	Date: 23.04.24	

No. SSSE-17RCC-007 Rev. A