

A0

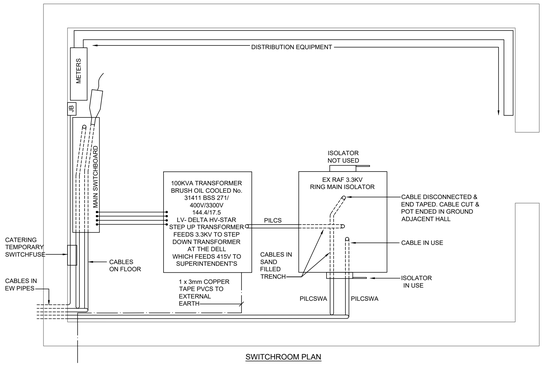

SWITCHROOM PLAN

METERS

1	40A	CAFETERIA LIGHTING & POWER
2	50A	ALL LIGHTING CELLAR, STAIRWAY, PASSAGE, FLAT, GARDEN CAFE
3	25A	CATERING OFFICE POWER
4	50A	ART GALLERY POWER & ALARMS, STORAGE HEATERS
5	20A	ART GALLERY LIGHTING
6	20A	JOHNSON'S FLAT, GOLF LOCKERS, CLUB ROOM
7	40A	ART GALLERY FLOODLIGHTING
8	40A	ART GALLERY FLOODLIGHTING
9	40A	ART GALLERY FLOODLIGHTING
10	80A	ORANGERY (& TOILET) POWER
11	80A	ORANGERY POWER
12	80A	ORANGERY POWER
13	40A	ORANGERY LIGHTING
14	40A	GOLF OFFICE
15	40A	GOLF OFFICE
16	-	GOLF OFFICE (DISCONNECTED)

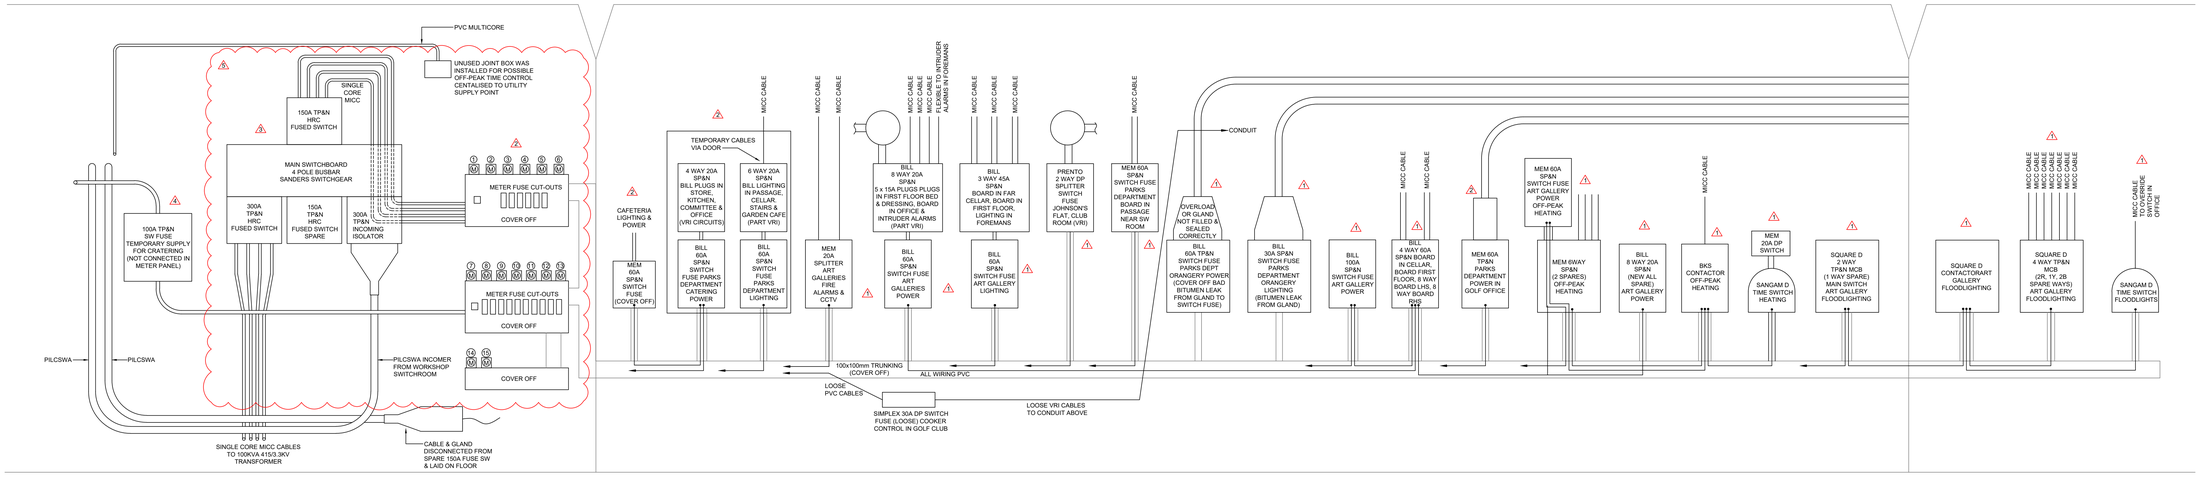

EXISTING ELECTRICAL SCHEMATIC

GENERAL NOTES

1	THIS DRAWING SHALL BE READ IN CONJUNCTION WITH THE ECS MECHANICAL ENGINEERING SPECIFICATIONS.
2	THIS DRAWING IS INDICATIVE & IS INTENDED TO HIGHLIGHT THE PROPOSED LOCATION FOR MECHANICAL SERVICES. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE FINAL DETAILED DESIGN & COORDINATION WITH ARCHITECTURAL, STRUCTURAL & OTHER SERVICE ELEMENTS ASSOCIATED WITH THE INSTALLATION. ALL DIMENSIONS, PIPE/DUCT ROUTES & EQUIPMENT QUANTITIES ARE FOR GUIDANCE ONLY & MUST BE VALIDATED, FINALISED & COORDINATED BY THE CONTRACTOR.
3	THE CONTRACTOR SHALL NOTE THIS DRAWING HAS BEEN PRODUCED USING LIMITED SITE SURVEY INFORMATION. THE CONTRACTOR SHALL INCLUDE TO CARRY OUT AN INTRUSIVE SURVEY & TO PRODUCE DRAWINGS THAT REFLECT THE INSTALLATION.
4	ALL EQUIPMENT SHALL BE INSTALLED & LOCATED TO MAINTAIN SPATIAL REQUIREMENTS TO FACILITATE ACCESS & MAINTENANCE IN LINE WITH MANUFACTURERS RECOMMENDATIONS & GOOD PRACTICE GUIDES.
5	ALL EQUIPMENT SHALL BE INSTALLED IN ACCORDANCE WITH MANUFACTURERS GUIDELINES.
6	DO NOT SCALE FROM THIS DRAWING.
7	ALL DETAILS ARE APPLICABLE TO EVERY DRAWING UNLESS INDICATED OTHERWISE.
8	THE CONTRACTOR SHALL INCLUDE TO IDENTIFY THE COMPLETE EXISTING MECHANICAL INSTALLATION, EXTEND & ADAPT TO FACILITATE THE PROPOSED WORKS.

DRAWING NOTES

SYMBOL	DESCRIPTION
1	THE CONTRACTOR SHALL INCLUDE TO DISCONNECT, REMOVE AND REMOVE FROM SITE ALL ELECTRICAL DISTRIBUTION EQUIPMENT, CONTAINMENT AND ASSOCIATED WIRING DURING TIME PROGRAMME OF WORKS.
2	THE CONTRACTOR SHALL INCLUDE TO TEST THE INCOMING CIRCUIT TO ASCERTAIN IF THE EXISTING CIRCUIT IS STILL IN OPERATION AND FEEDING GOLF OFFICE, JOHNSON CAFETERIA CONTRACTOR SHALL INCLUDE IN HIS TENDER COSTS THE COMPLETE REMOVAL OF INSTALLATION.
3	CONTRACTOR SHALL INCLUDE TO REMOVE THE BUSBAR CHAMBER AND ASSOCIATED FUSE SWITCHES.
4	CONTRACTOR SHALL INCLUDE IN HIS TENDER COST OF CONSULTING WITH ELECTRICITY NORTHWEST ON THE DISCONNECTION OF THE EXISTING INCOMING SUPPLY AND ALL RECONNECTIONS.
5	CONTRACTOR SHALL NOTE A PC SUM IS INCLUDED WITHIN THE TENDER FOR THE TESTING AND REMOVAL OF OLD TRANSFORMER WHICH IS NOT IN USE WITHIN THE ELECTRIC SWITCH ROOM IN THE BASEMENT.

Rev.	Description	Revised By	Date
T1	TENDER ISSUE.	G.M.	Jan. 24

STATUS
TENDER

CONSULTANTS
Building Services Consulting Engineers
148 Stockport Road
Cheadle, Cheshire. SK8 2DP
Tel. 0161 283 2882 Fax 0161 282 8825
Web Site: www.ecs-ecs.co.uk Email: sales@ecs-ecs.co.uk

JOB NO.	DRAWING NO.	COMPUTER FILE	REVISION
24/100	24/100/E/30	24_100_E_30	T1
DATE	SCALE	DRAWN	CHECKED
Apr. 2022	1:50 @ A0	P.H.	G.M.

JOB TITLE
Heaton Park Hall

DRAWING TITLE
Existing
Electrical Schematic

CAD original - not to be modified by hand