




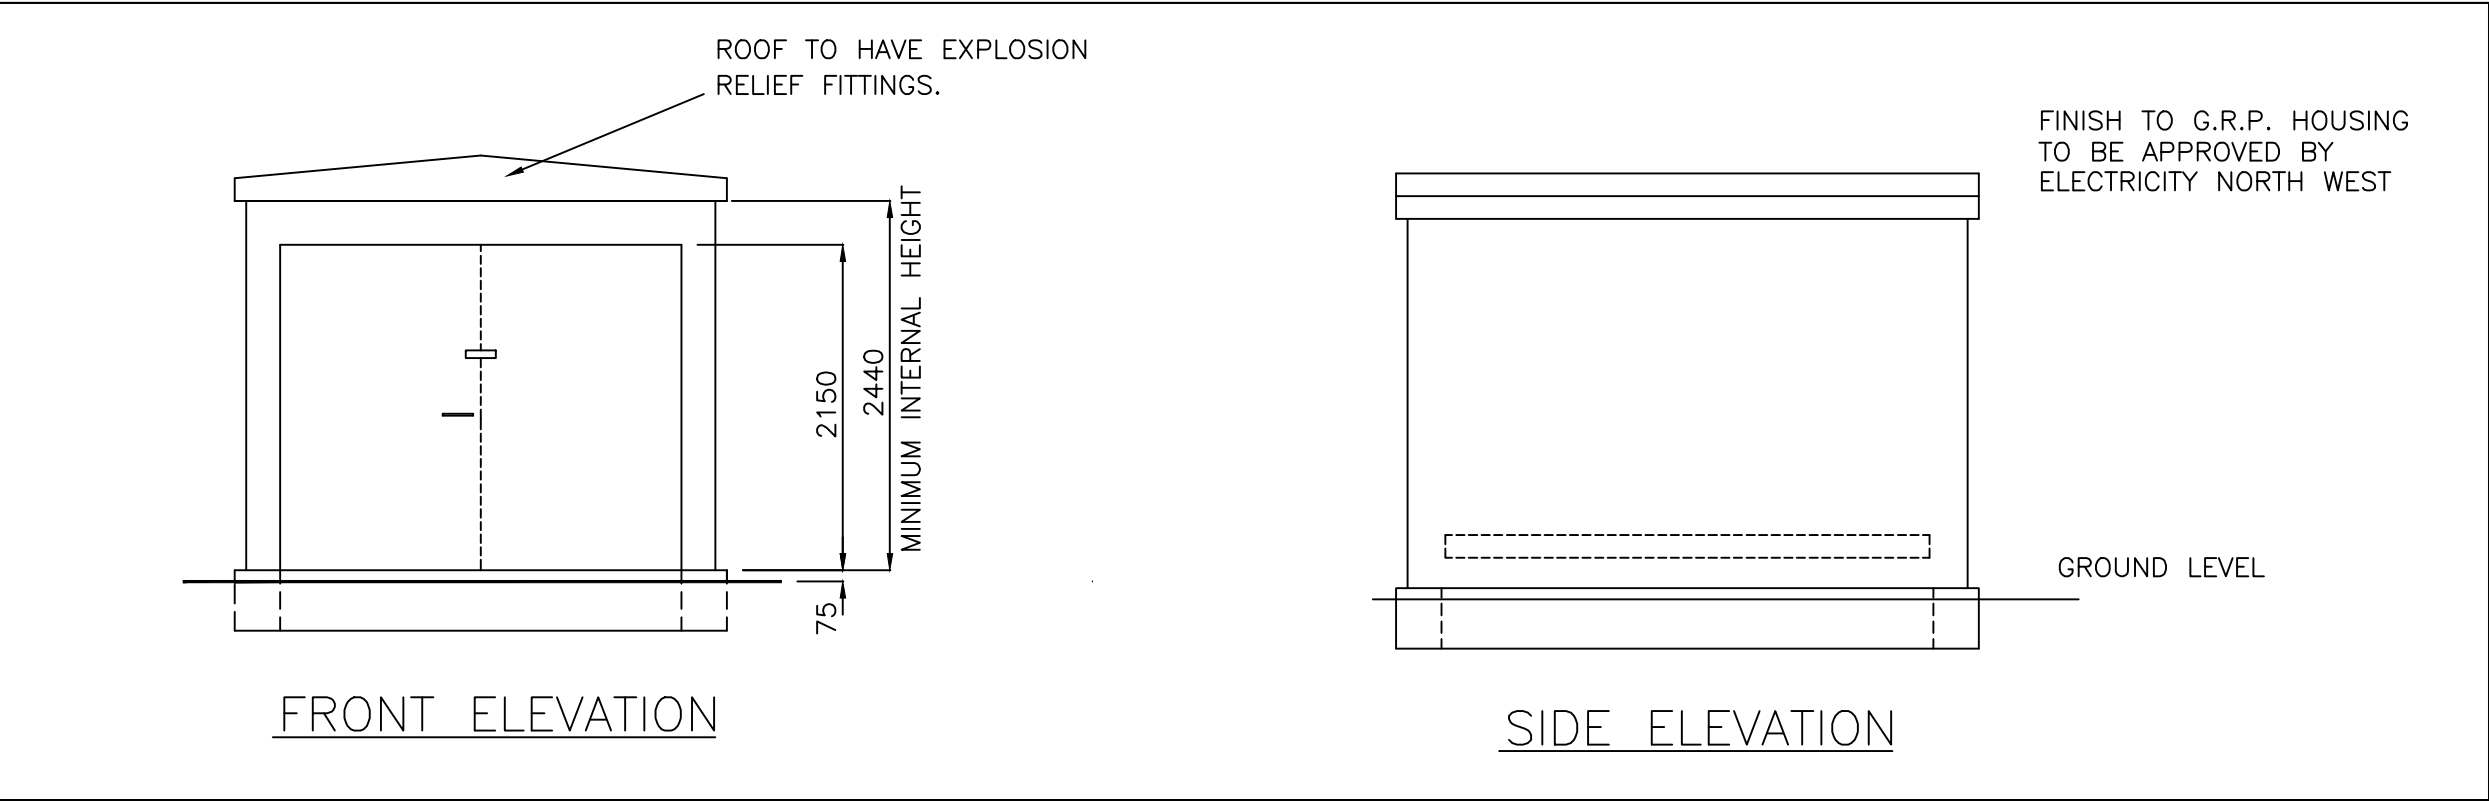


GRP KIOSK – ELEVATION VIEW – FRONT AND SIDE – SCALE 1:50

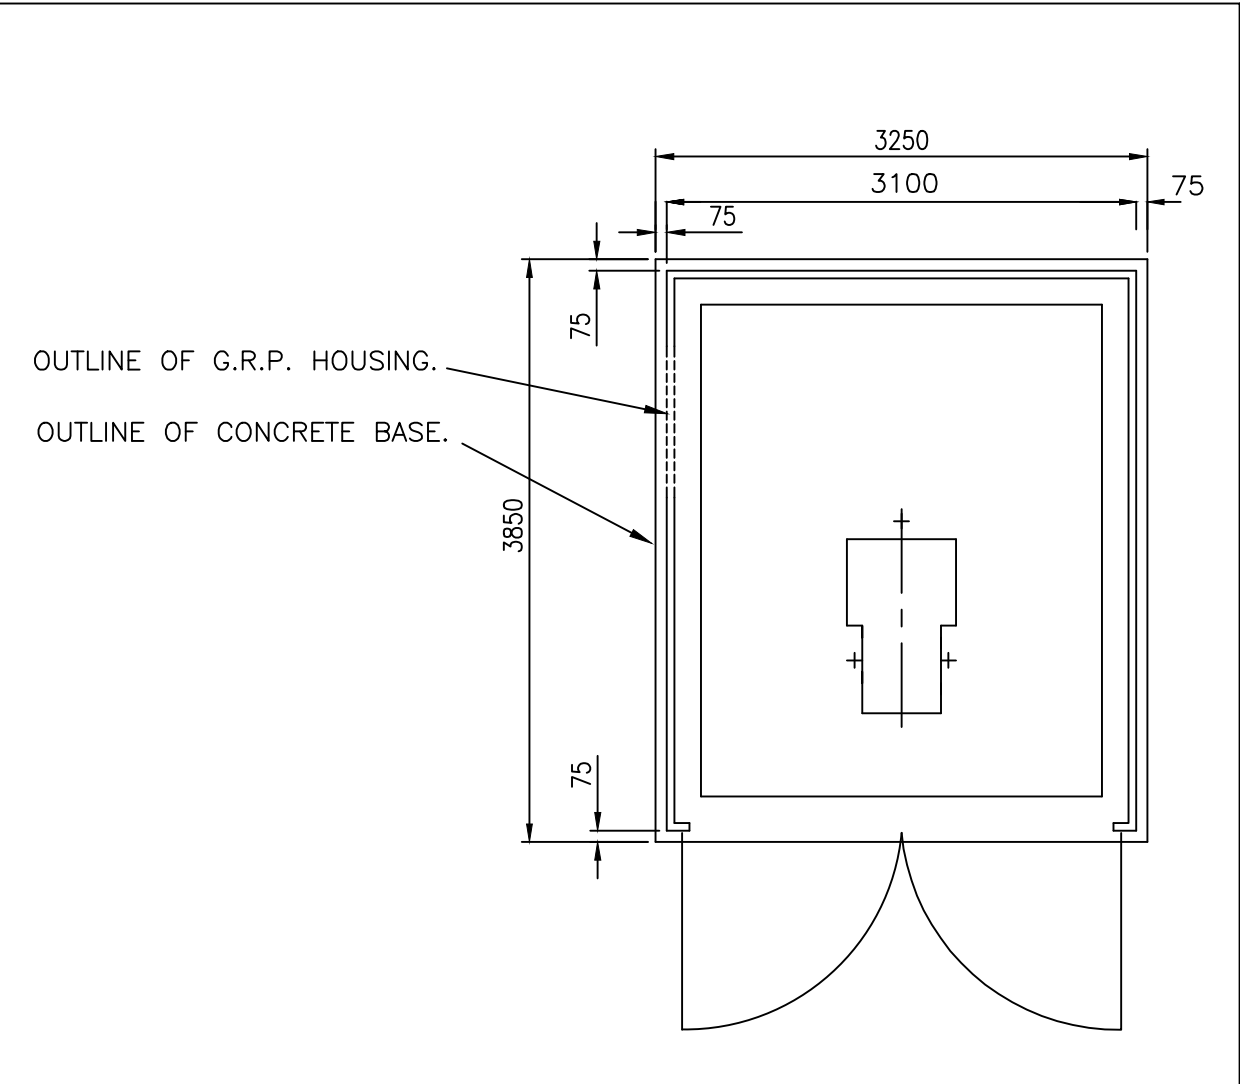


GRP KIOSK – PLAN VIEW – GENERAL ARRANGEMENT – SCALE 1:50

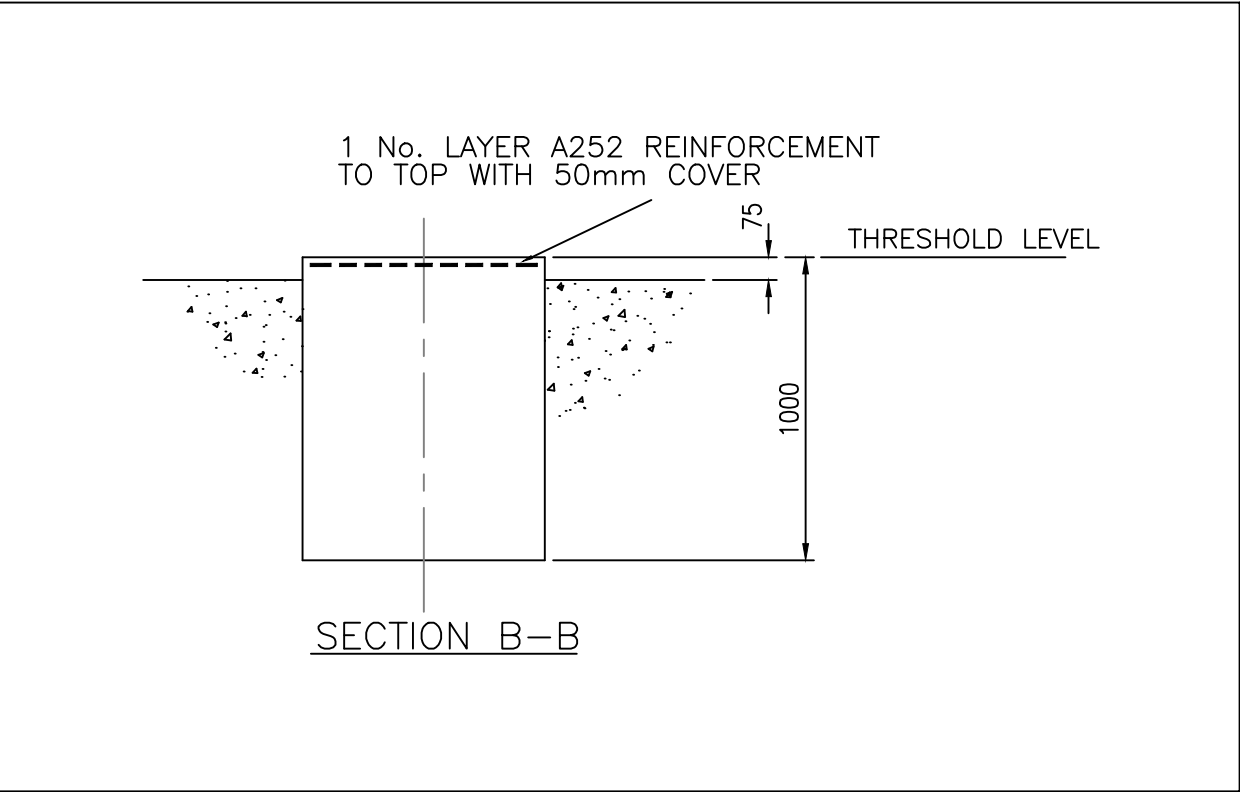


PLINTH DETAIL – SECTION VIEW 'A-A' – SCALE 1:25

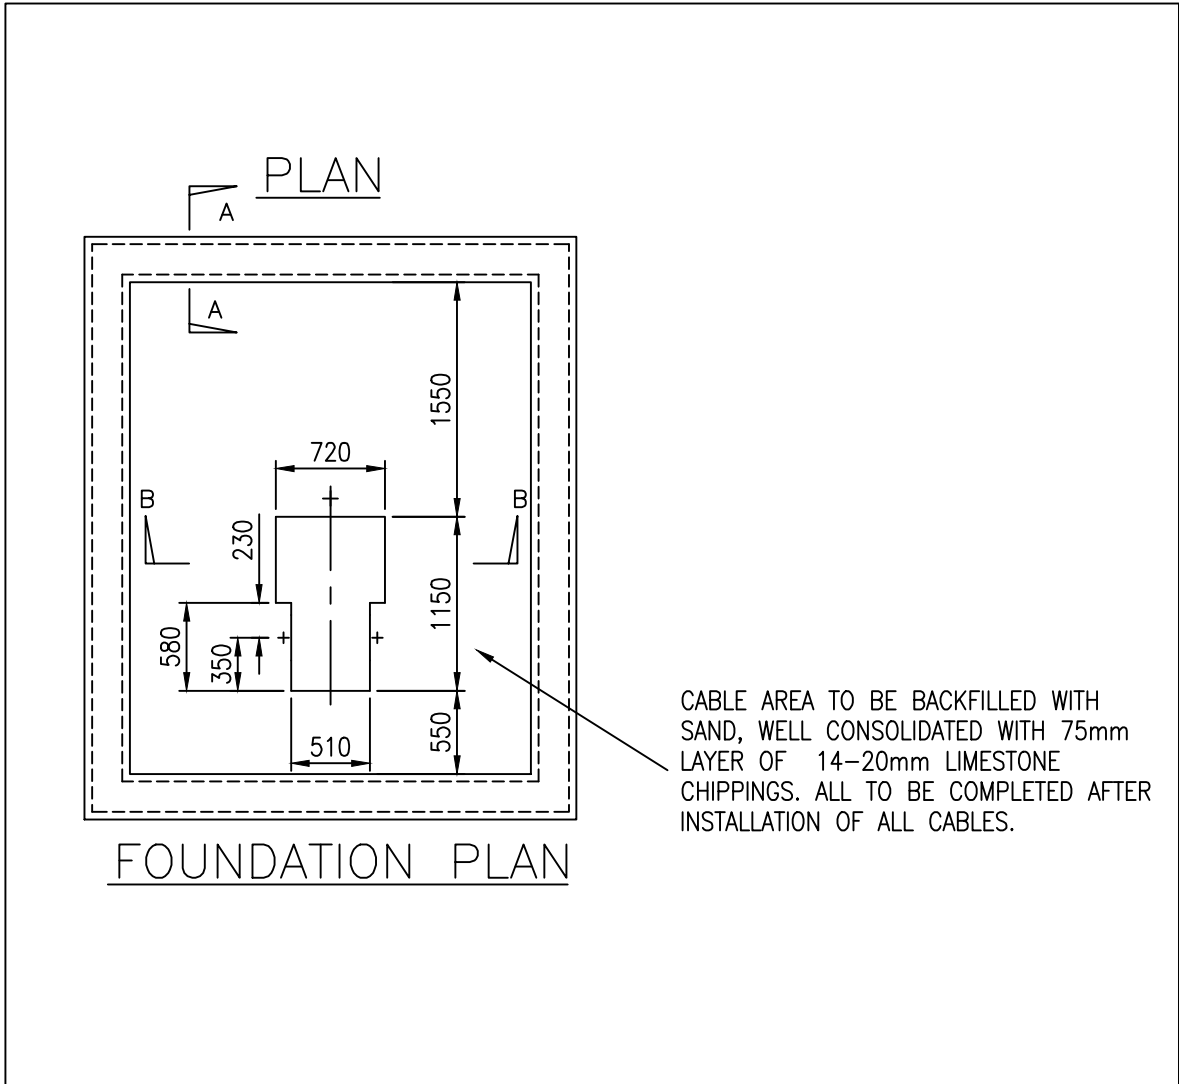


RING BEAM AND PLINTH DETAILS – PLAN VIEW – SCALE 1:50

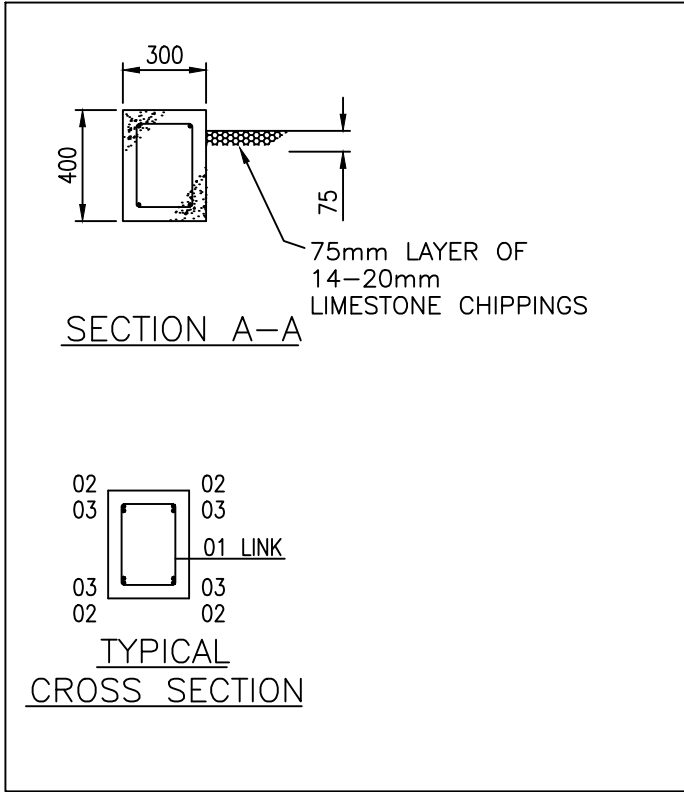

PLINTH DETAIL – SECTION VIEW 'B-B' – SCALE 1:50

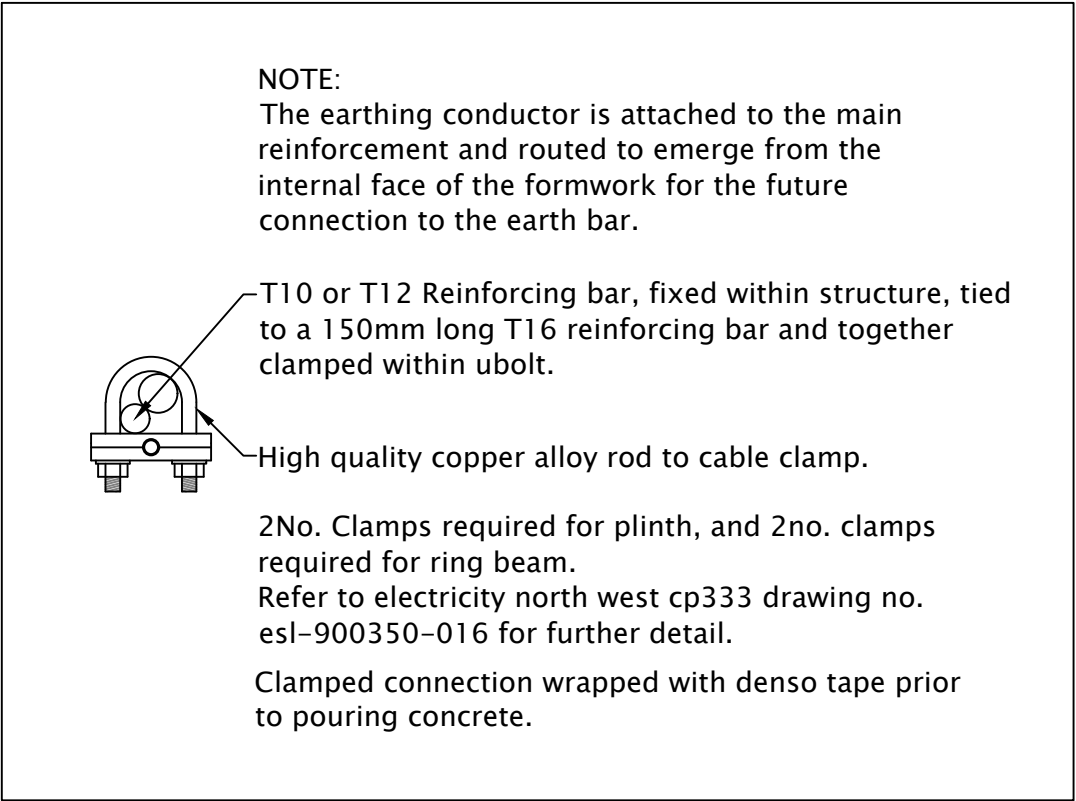

EARTH CLAMP DETAIL – NTS

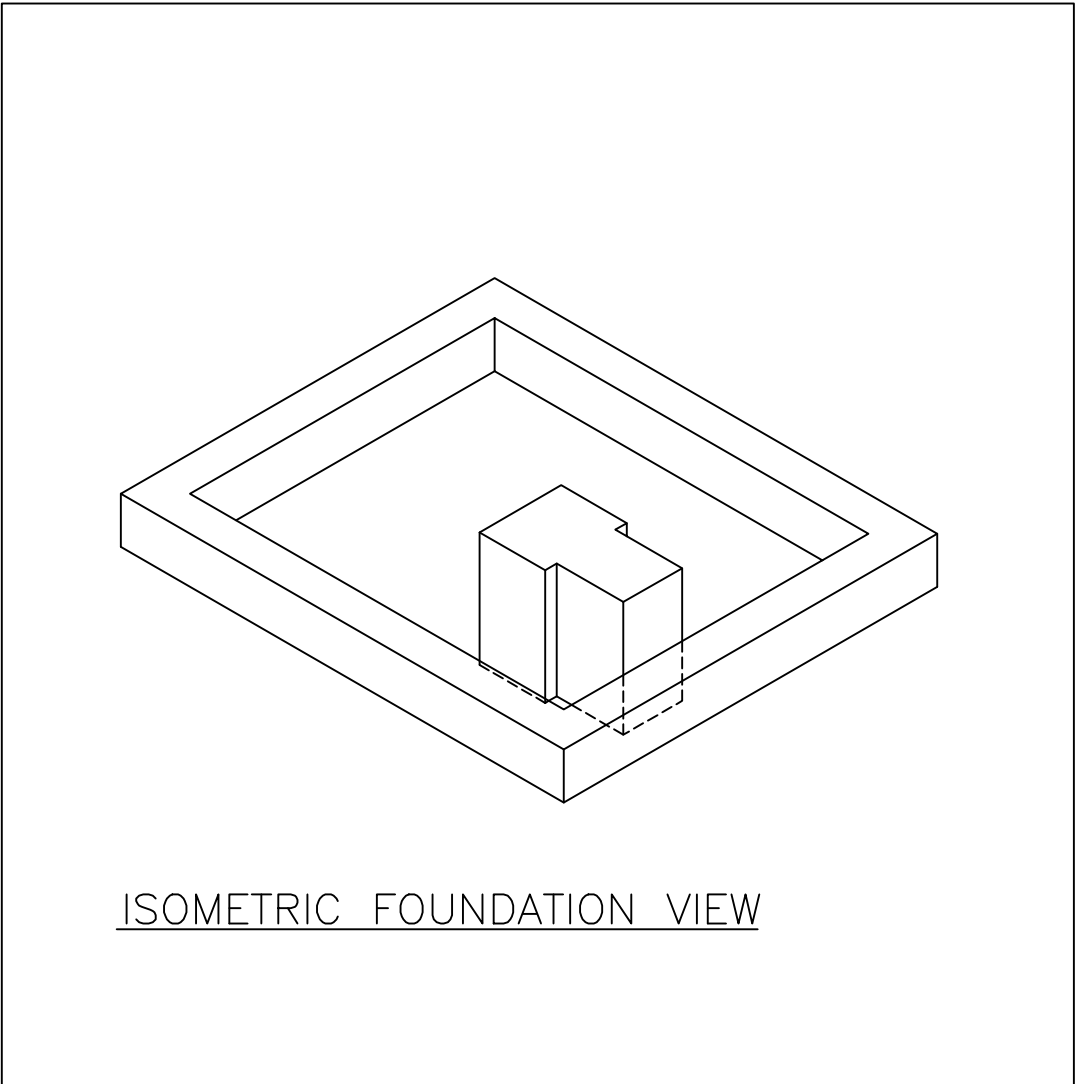

RING BEAM AND PLINTH – ISOMETRIC VIEW – SCALE 1:50

NOTES:

CONCRETE:
For plinth and ring beam to be 1:2:4 mix of ordinary portland cement concrete 35n/mm² (28 day strength). 20mm aggregate shall be placed & compacted within adequate formwork to ensure that the top surfaces are true to plane with floor to have steel float finish to close tolerance of +/-3mm in 3m.

No drilling to take place within 28 days of casting. no percussion drills to be used only rotary drills.

Do not over-tighten bolts. typical max weight of plant = 600kg. plinth shall have typical min depth of 1000mm. however, the plinth must be suitable with respect to ground conditions and loading. the level of the ring beam to be agreed on site with the engineer in charge prior to constructing shuttering.

COMPOUND:
To be back-filled after installation of cables with sand and 150mm top layer of 14–20mm limestone chippings.

GRP HOUSING:
To be from electricity north west approved supplier. doors to have hasp & staple to accept electricity north west padlocks. left hand door to be first opening leaf.

FOUNDATIONS:
To be taken down to ground that is sufficiently firm to provide physical support to the structure. site photo's to be taken indicating evidence of foundation depth where increased dig is greater than 400mm. these will be provided for payment and audit purposes.

This drawing should be read in conjunction with electricity north west electrical specification ref. 400 d 5 and all associated works must comply with this information and detail in full.

This drawing should be read in conjunction with electricity north west es 301 & es 352 and all associated works must comply with this information and detail in full.

Rev/NOTES	Date	Rev
REVISIONS		
SCHEME No:		
DRAWING No:		
REVISION:		
Electricity North West (Construction & Maintenance) Ltd Whitebirk Depot, Whitebirk Drive Blackburn, BB1 3HT Tel. 0845 070 2520 Email. constructionandmaintenance@enwl.co.uk		
Electricity North West (Construction and Maintenance) Limited, Registered in England & Wales No: 07262137 Registered office: Broom Street, Putney, Stockport, Cheshire, SK1 2AB		