



EXTERNAL LEGEND

	IP66 CCTV
	UNDERGROUND POWER DUCT
	UNDERGROUND DATA DUCT
	INCOMING LV SUPPLY
	INCOMING TELECOMMS
	ELECTRIC VEHICLE CHARGING POINT
	POST TOP LIGHTING (A)
	POST TOP LIGHTING
	WALL MOUNTED SURFACE LIGHTING
	SPOTLIGHT
	FLOODLIGHT

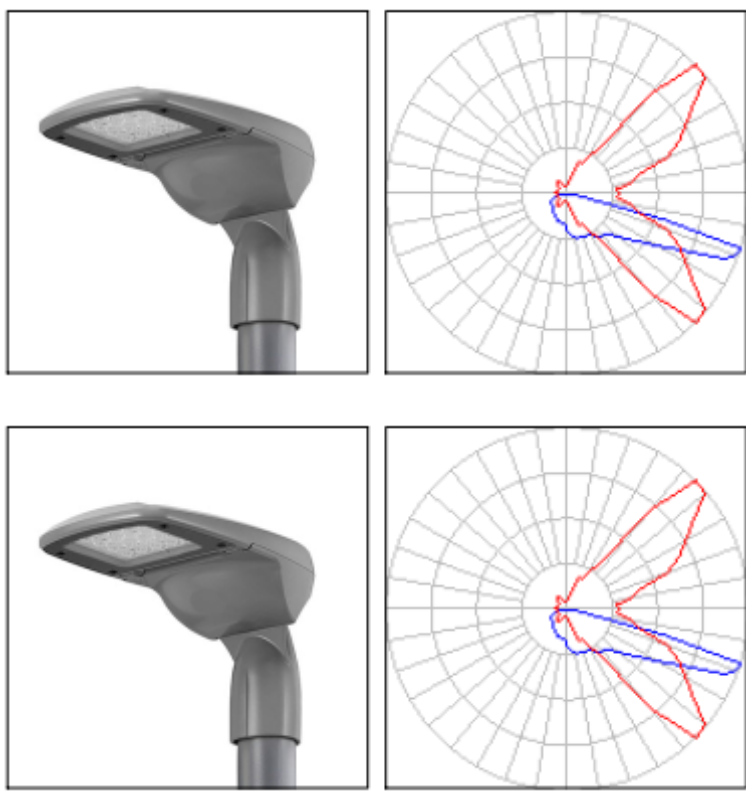

Kirium Pro Mini, 16LED, 4000K, C2 Optic, 700mA, Painted in Grey Ral 7046, 6M TLS Tubular Steel Column. Painted in Grey Ral 7046.

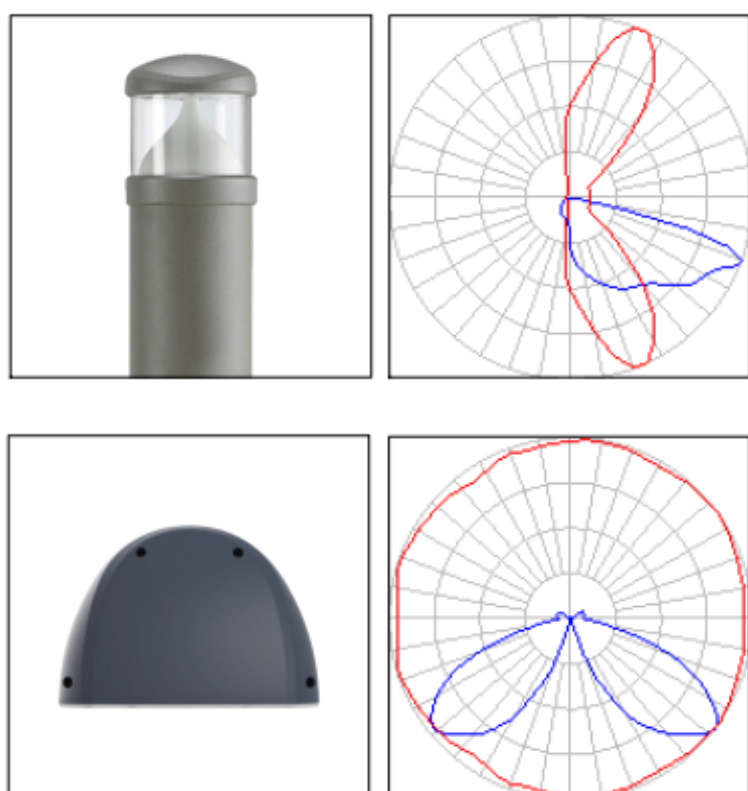

Kirium Bollard 160mm, 1M, Curved, Symmetrical Optic, 4000K, 300mA, Painted in Grey Ral 7046.



Sky Post Top Luminaire 5M, 4000K, 38W, 4300 lux, IP66, IK10 class I/II, YW355F Graphite Grey.




Fira Spotlight, 700mA, 9 LED, 3000K, 27W Low Glare Optic, Die cast Aluminium Body, Black RAL 900J, IP66 / IK09

Kirium Pro Mini, 16LED, 4000K, A2 Optic, 700mA, Painted in Grey Ral 7046, 6M TLS Tubular Steel Column. Painted in Grey Ral 7046.

Kirium Wall, 8LED, 4000K, 300mA, 6W, Clear Glass, Narrow Optic, Complete with emergency pack, Painted in Grey Ral 7046.

Nikon I, 1 Led 4000K, 13W, 753 lux, Ceiling - Recessed Exterior Downlight, IP65

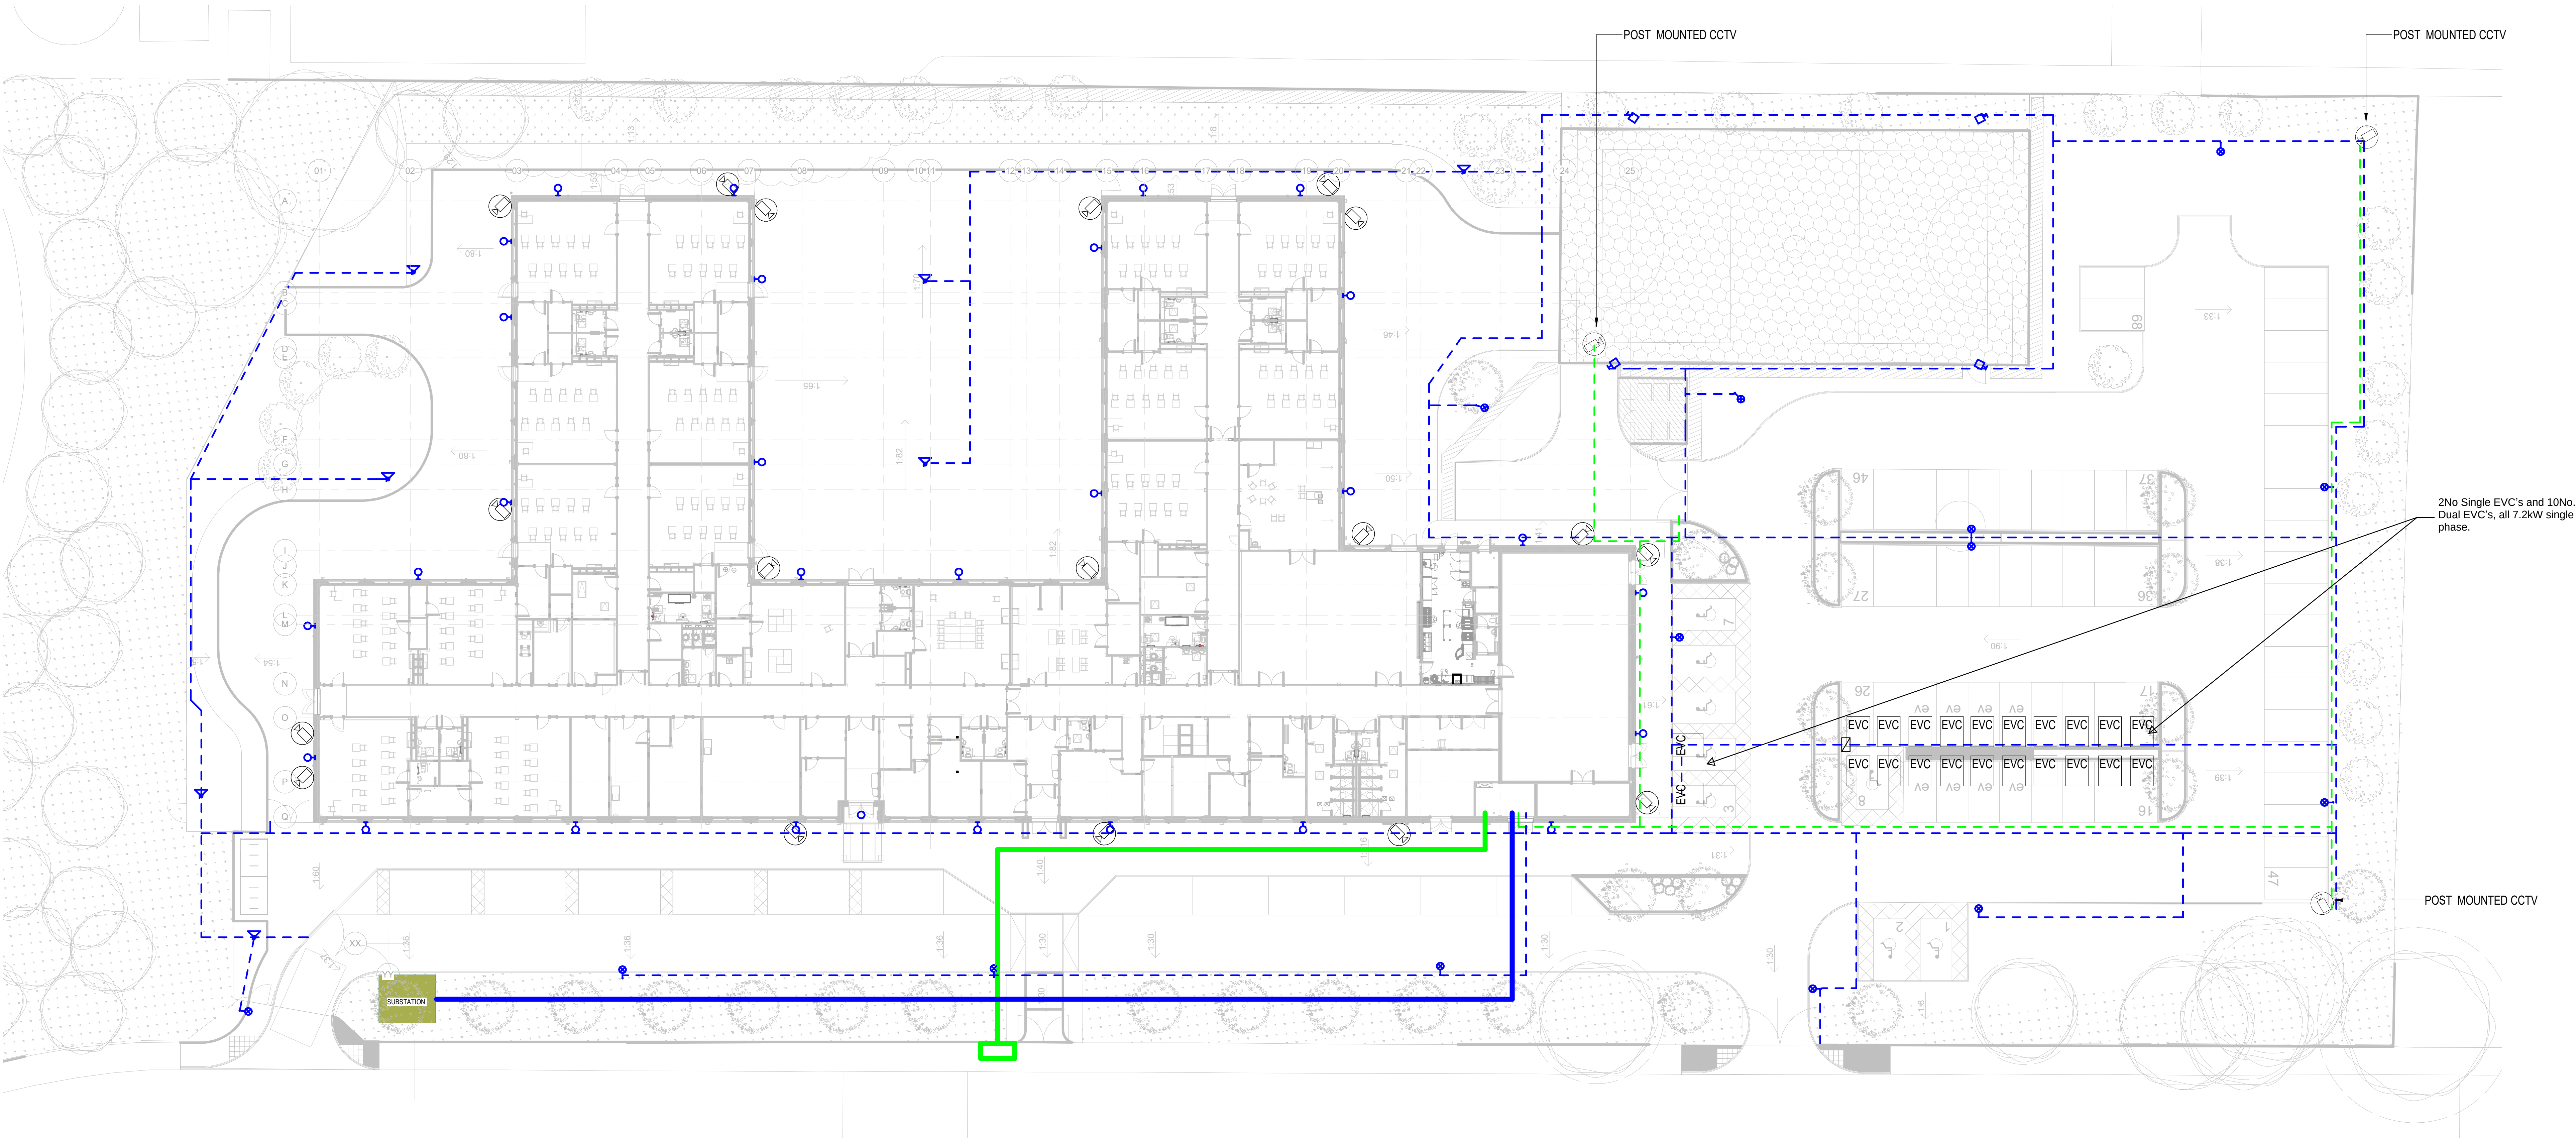

2No Single EVC's and 10No. Dual EVC's, all 7.2kW single phase.

DISCLAIMER NOTES:	DRAWING NOTES:
<ul style="list-style-type: none">THIS DOCUMENT IS COPYRIGHT OF THE ORIGINATOR AND MUST BE TREATED AS CONFIDENTIAL.THIS DOCUMENT MUST NOT BE ALTERED, REPRODUCED OR DISTRIBUTED WITHOUT PRIOR WRITTEN CONSENT OF THE ORIGINATOR.THIS DOCUMENT IS AVAILABLE IN BOTH CONTROLLED (eg. pdf) AND UNCONTROLLED (eg. png) FORMATS - UNCONTROLLED FORMATS MUST NOT BE ALTERED - THE ORIGINATOR ACCEPTS NO RESPONSIBILITY FOR ANY DISCREPANCIES ARISING AS A RESULT OF THE ORIGINATOR'S INFORMATION BEING ALTERED BY OTHERS.ANY DISCREPANCY MUST BE REPORTED TO THE ORIGINATOR.DO NOT SCALE THIS DOCUMENT - USE PROVIDED DIMENSIONS ONLY.ALL DIMENSIONS MUST BE CHECKED ON SITE PRIOR TO COMMENCEMENT OF ANY RELATED WORKS.THIS DOCUMENT MUST BE READ IN CONJUNCTION WITH ALL SUPPORTING DOCUMENTS PRODUCED BY THE ORIGINATOR AND OTHER PROJECT DISCIPLINES.THE ORIGINATOR ACCEPTS NO RESPONSIBILITY FOR THE ACCURACY OF BACKGROUND INFORMATION PRODUCED BY THIRD PARTIES - THIS MUST BE TREATED AS INDICATIVE ONLY.USERS OF THIS DOCUMENT ARE RESPONSIBLE FOR CHECKING WHICH REVISION IS CURRENT.THE DOCUMENT STATUS "INFORMATION" OR "PRELIMINARY" INDICATES THAT THIS DRAWING IS FOR REFERENCE PURPOSES ONLY - THE ORIGINATOR WILL ACCEPT NO RESPONSIBILITY FOR THE COMPLETENESS OF INFORMATION UNDER THIS STATUS.THE DOCUMENT STATUS "RECORD" OR "AS BUILT" HAS BEEN PREPARED, IN PART, BASED UPON INFORMATION FURNISHED BY OTHERS. WHILE THIS INFORMATION IS BELIEVED TO BE RELIABLE, THE ORIGINATOR ASSUMES NO RESPONSIBILITY FOR THE ACCURACY OF THIS "RECORD" OR "AS BUILT" DOCUMENT OR FOR ANY ERRORS OR OMISSIONS THAT MAY HAVE BEEN INCORPORATED INTO IT AS A RESULT OF INCORRECT INFORMATION PROVIDED TO THE ORIGINATOR. THOSE RELYING ON THE "RECORD" OR "AS BUILT" DOCUMENT ARE ADVISED TO OBTAIN INDEPENDENT VERIFICATION OF ITS ACCURACY.	<ul style="list-style-type: none">COM REGULATIONS 2015SIGNIFICANT OR NON-OVIOUS RISKS AND RISKS WHICH ARE DIFFICULT TO MANAGE ARE IDENTIFIED ON THIS DRAWING USING THE FOLLOWING SYMBOL, IDENTIFIED TO THE RIGHT WITH BRIEF ACCOMPANYING TEXT. FOR FURTHER DETAILS OF THE RISKS IDENTIFIED BY DESIGNERS, REFERENCE SHOULD BE MADE TO COM HAZARD REGISTER.

CLIENT: MANCHESTER CITY COUNCIL

PROJECT: VARLEY STREET SEND

ORIGINATOR:

RIDGE

IN ASSOCIATION WITH: ISG

TITLE: ELECTRICAL SERVICES EXTERNAL LAYOUT

PROJECT No: S4
STATUS: STAGE APPROVAL

PD Stage 4a Update	14/05/23	MG	MH
PD Stage 4 Update	05/05/23	MG	MH
PD Stage 3 Issue	03/03/23	RB	MH
REV DESCRIPTION	DATE	BY	CHKD
DRAWN BY: RB	CHECKED BY: MH	APPROVED BY: ST	
SCALE: 1:200 @ A0	DATE: 03/03/23		
VAR	RDG	XX	00 DR E 60102 P03