



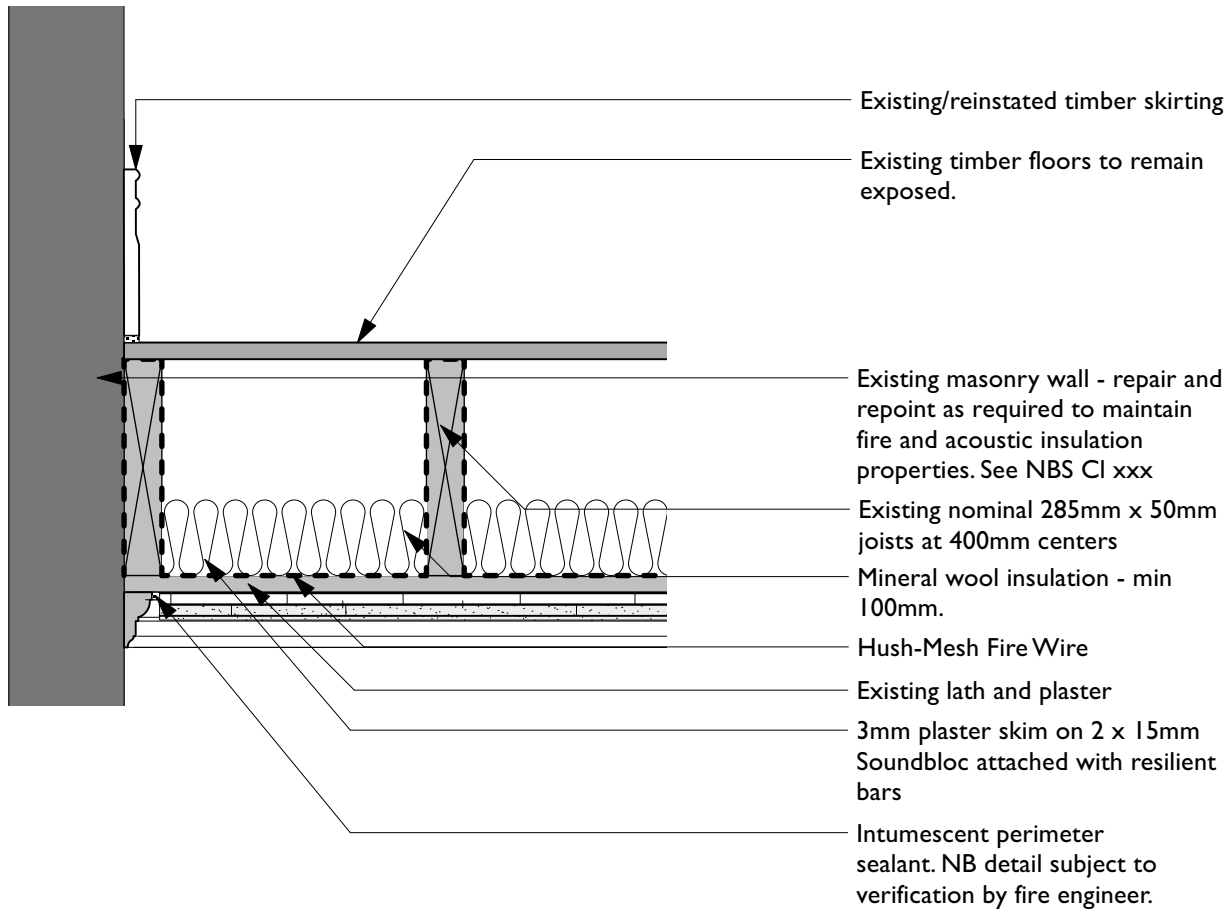


1

Typical Floor Upgrade Detail - Fire Only
Scale: 1:10

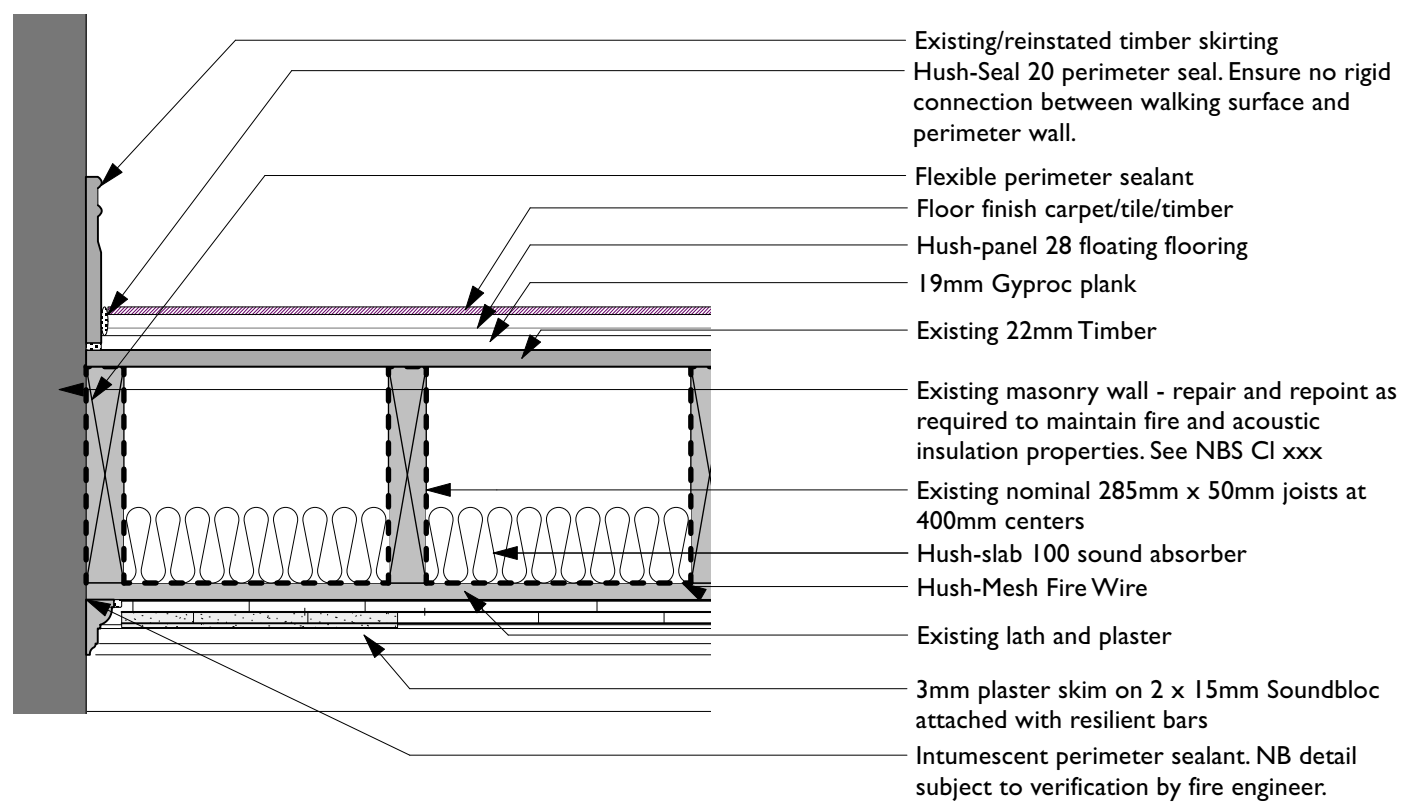

2

Typical Floor Upgrade Detail - Fire and Acoustics
Scale: 1:10

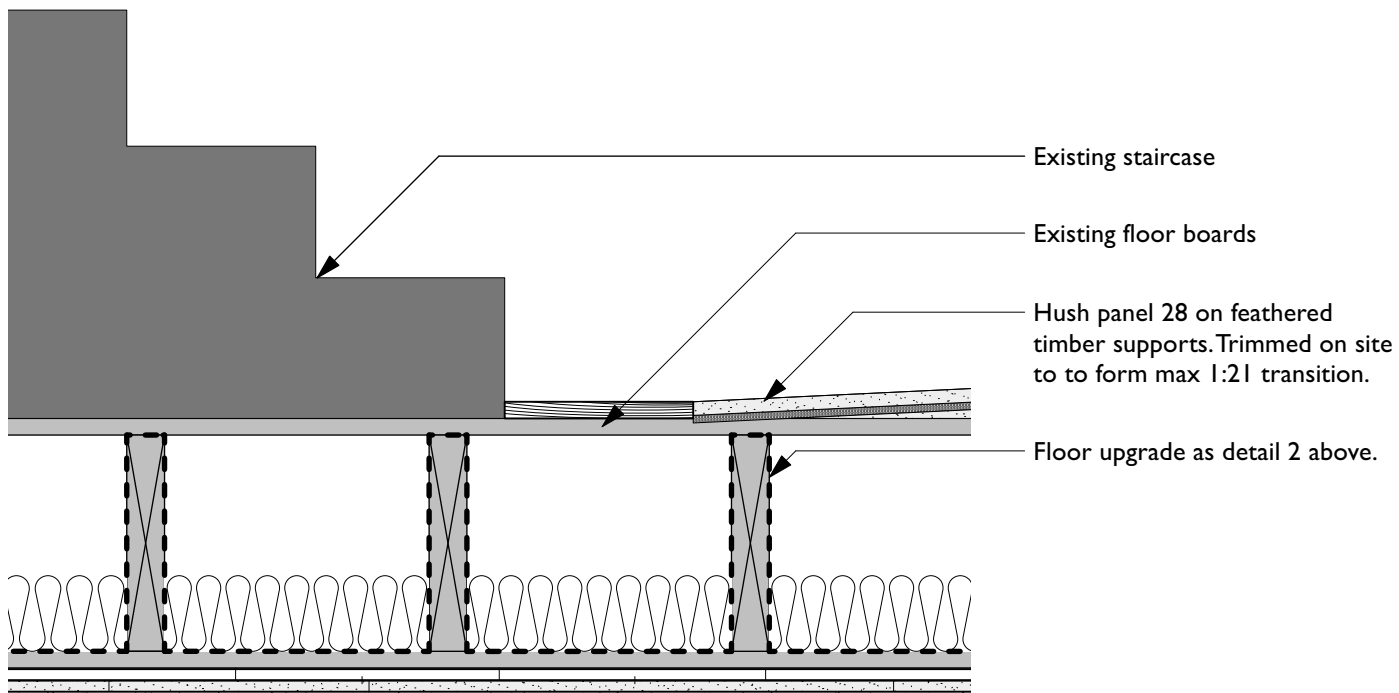

3

Floor transition at existing stair
Scale: 1:10

COPYRIGHT OF ATELIER MB LTD
DO NOT SCALE FROM THIS DRAWING
DIMENSIONS TO BE CHECKED ON SITE

NB

To maintain 60mins REI fire protection between floors, the insulation and wire mesh **MUST** be installed fully across full floorplate (even where acoustic separation is not required) - in accordance with Hush manufacturer recommendations.

Any damage to lath and plaster ceiling is to be repaired on a like for like basis to ensure acoustic separation continuity. Prior to floor upgrade, floorboards to be repaired as required or replaced to match existing.

All gaps and holes between adjacent boards and at the room perimeters should be made good and sealed; where reasonable gaps occur they should be stuffed with mineral wool and sealed with flexible mastic sealant.

Any double lining boards should be staggered to ensure an overlap of joints.

The floating floors should be stopped short of the perimeter wall lining with the resilient layer turned up to ensure no rigid connection between the walking surface and perimeter wall.

The floating floor should not be continuous across separating partitions i.e. the separating walls should be built off the floor structure, not the floating deck. Lightweight internal partitions within individual apartments may be build off the floating deck.

C 13/06/2024	Details updated to suit fire/acoustic separation requirements. Drawing name revised.	HW	HW
B 05.03.24	Detail updated to include Hush-panel floating flooring	RG	
A 30/01/2024	Detail updated	RG	
Rev	Note	DRN	CHK

77-79 Mosley Street

Floor Upgrade Details

scheme	1995
drwg no.	P(400)
revision	C
scale	1:10 @ A3
date first drawn	March 23
drawn	RG

SK sketch E existing P proposed T tender C construction FI final issue

www.ateliermb.co.uk
t 0161 236 0051
e architect@ateliermb.co.uk