



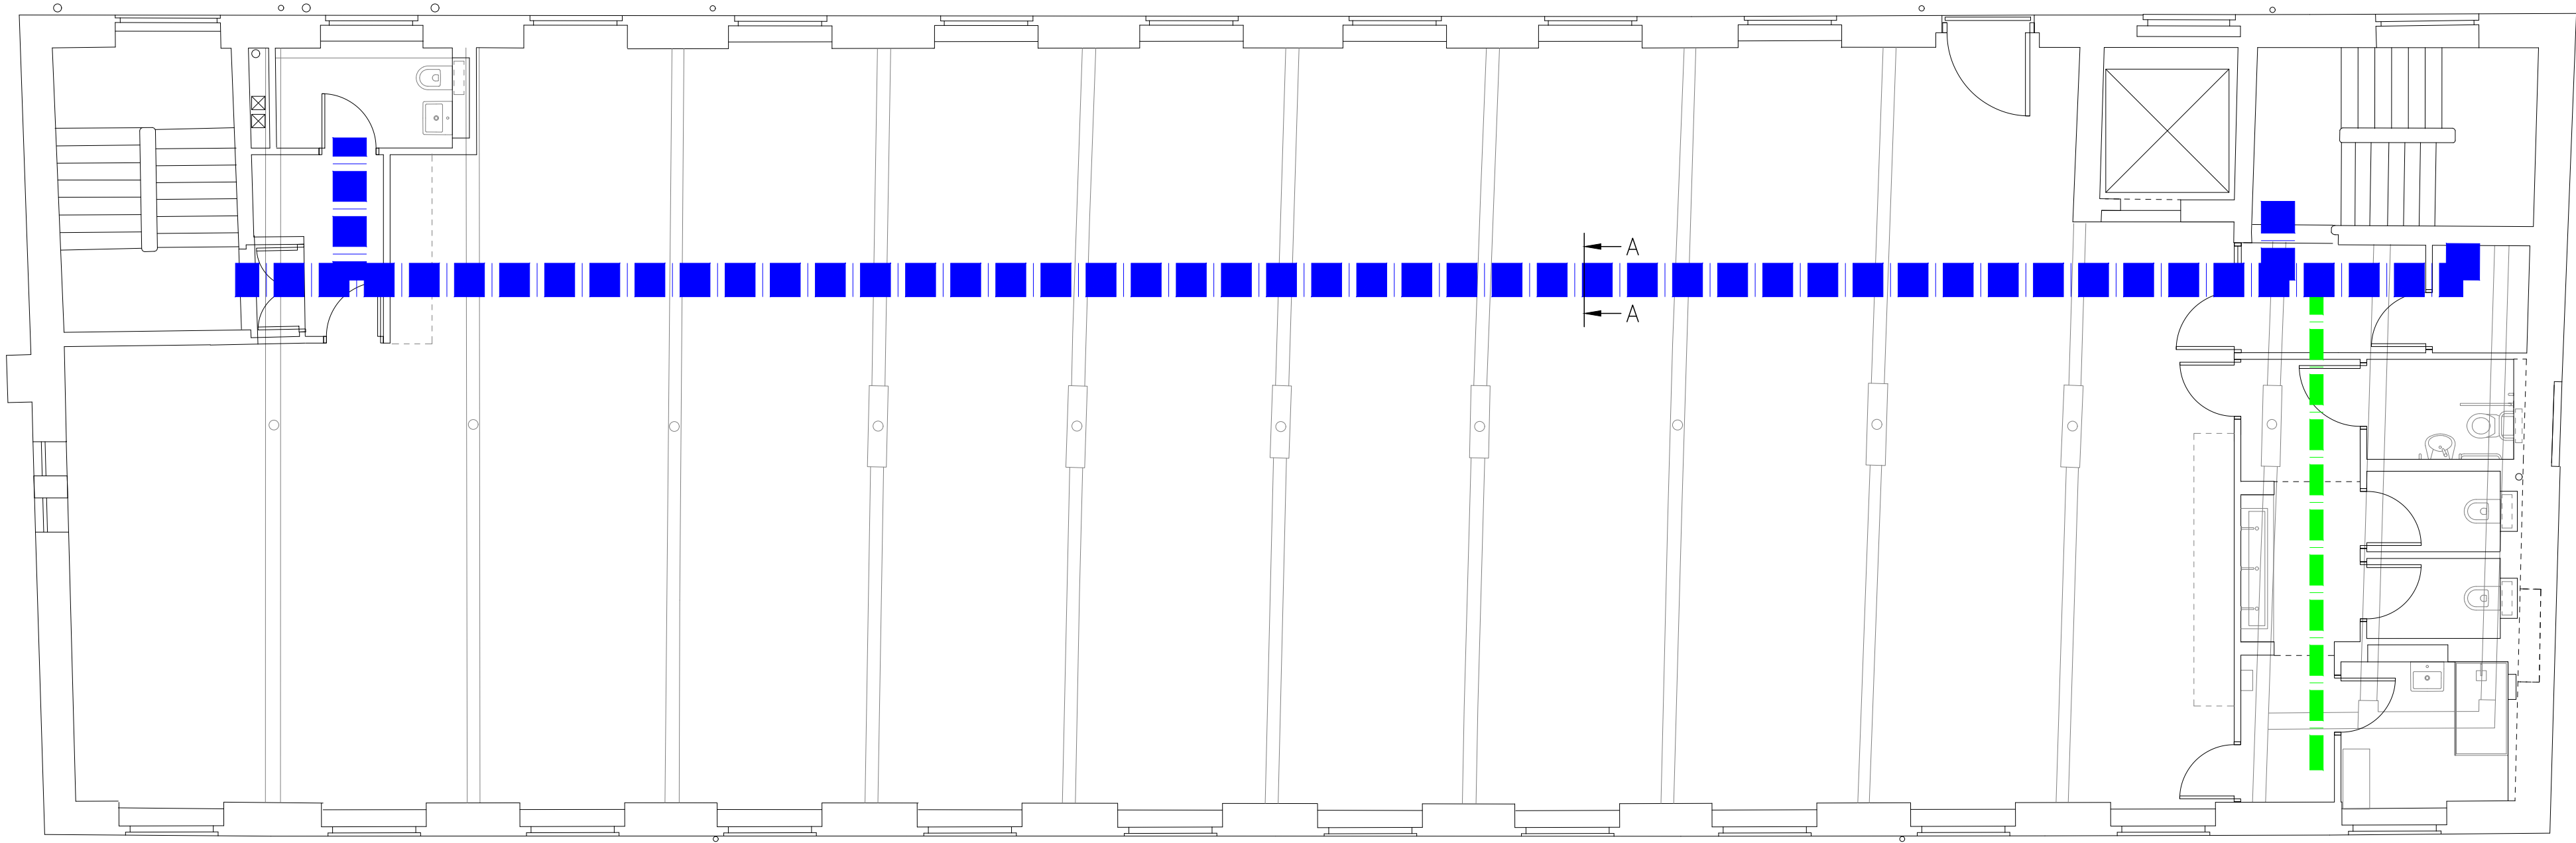

- LEGEND – CONTAINMENT
- 100mm POWER & LIGHTING TRAY
 - 100mm COMMS & SECURITY TRAY
 - 50mm FIRE ALARM TRAY
 - 100mm SUBMAIN TRAY
 - 100mm POWER & LIGHTING TRAY
 - 100mm COMMS & SECURITY TRAY
 - 50mm FIRE ALARM TRAY
 - 100mm POWER & LIGHTING TRAY
 - 50mm FIRE ALARM TRAY
 - 150x50mm GALV CABLE TRUNKING
 - LOW LEVEL CABLE TRUNKING (POWER & FUTURE DATA)

NOTES – CONTAINMENT

- ALL CONTAINMENT RUNS ARE TO BE STRICTLY INSTALLED AS SHOWN ON THIS DRAWING TO AVOID CLASHES WITH OTHER SERVICES.
- ALL CONTAINMENT TO BE SUSPENDED FROM BUILDING STRUCTURE VIA THREADED ROD AND UNISTRUT ARRANGEMENT.
- ALL CONTAINMENT HAS BEEN SIZED WITH A MINIMUM 25% SPARE CAPACITY.
- ALL CABLING LEAVING PRIMARY ELECTRICAL CONTAINMENT WILL BE INSTALLED IN SECONDARY GALVANISED CONDUIT TO FINAL OUTLET LOCATIONS.
- ALL PRIMARY CONTAINMENT TO BE INSTALLED ABOVE EXISTING JOISTS WITHIN VOID SPACE.
- ALL SECONDARY CONTAINMENT WITHIN EXPOSED SOFFIT AREAS WILL BE GALVANISED FINISH.
- WHERE CONTAINMENT PASSES THROUGH FIRE COMPARTMENTS, SUITABLE FIRE STOPPING/FIRE PILLOWS WILL BE INSTALLED.
- ALL ELECTRICAL INSTALLATION AND ALTERATIONS ARE TO BE INSTALLED IN ACCORDANCE WITH BS7671 18th EDITION.

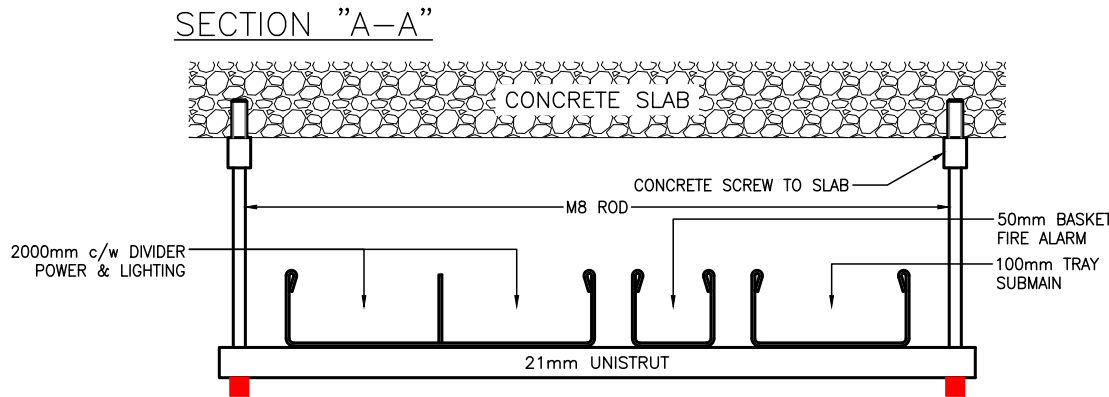

A	PRELIMINARY ISSUED FOR COMMENT	25.10.23
Revision	Description	Date



Drawing Status
PROPOSED



Client
WORKSPACE DESIGN & BUILD

Project
NEPTUNE MILL

Title
SECOND FLOOR
HIGH LEVEL CONTAINMENT
LAYOUT

Drawn LY Date 25.10.23

Sheet A1

Scale 1:75

Drawing Number
H&O-J369-C02-A