


1. EXISTING RADIATORS TO BE RETAINED.
2. EXISTING SYSTEM TO BE DRAINED DOWN & FLUSHED THROUGH.
3. SYSTEM TO BE DOSED / WATER TREATED AFTER REFILL.
4. SYSTEM TO BE CHECKED FOR HEAT TO ALL RADIATORS BEFORE & AFTER DRAIN DOWN & REFILL TO AREAS.
5. WHOLE HEATING SYSTEM TO BE LEFT IN FULL WORKING ORDER FOLLOWING STRIPOUT / INSTALLATION COMPLETION.

HEATING NOTES:

1. THIS DRAWING IS TO BE READ IN CONJUNCTION WITH ALL ME, BIDDING SCHEDULES & SPECIFICATIONS.
2. ALLOW A DOUBLE PIPE SET WHEREVER PIPES PASS THROUGH WALLS, CEILINGS OR FLOORS TO ALLOW FOR POSSIBLE SETTLEMENT, CONSTRUCTION TOLERANCES.
3. DRAIN COCKS TO BE INSTALLED AT LOW POINTS & AIR VENTS AT ALL HIGH POINTS.
4. ALL NEW PIPEWORK SHALL BE PAINTED PRIOR TO INSULATION.
5. CONTRACTOR TO INCLUDE FOR COORDINATING HIS WORK WITH ALL OTHER TRADES.
6. ALL PIPEWORK PASSING THROUGH FIRE BARRIERS & WALLS TO PASS THROUGH FIRE SLEEVES.
7. CONTRACTOR SHALL PASSING THROUGH WALLS, FLOORS, STRUCTURE SHALL BE SLEEVED.
8. CONTRACTOR TO INCLUDE, IN THEIR TENDER, FOR ALL NECESSARY DRAINING OF ALL CEILING OF ALL TRADES IN ORDER TO COMPLETE THE WORK.
9. CONTRACTOR SHALL ALLOW FOR ALL ADDITIONAL BENDS & FITTINGS NECESSARY FOR COORDINATION WITH OTHER TRADES, BUILDING STRUCTURE, ETC.
10. ALL PIPEWORK, VALVES & FITTINGS CONCEALED IN VOIDS, BOXED IN OR NOT EXPOSED TO VIEW SHALL BE THERMALLY INSULATED.
11. ALLOWANCE TO BE MADE FOR THERMAL EXPANSION, REFER TO SPECIFICATION.

HEATING & COOLING LEGEND:

	DX PIPEWORK
HL	HIGH LEVEL
LL	LOW LEVEL
DTB	DROP TO BELOW
RTA	RISE TO ABOVE
DFA	DROP FROM ABOVE
RFB	RISE FROM BELOW
VRF	VARIABLE REFRIGERANT FLOW
AC	WALL MOUNTED AC CONTROLLER REFER TO SCHEDULE FOR DETAILS
T	WALL MOUNTED LOSSNAY CONTROLLER REFER TO SCHEDULE FOR DETAILS

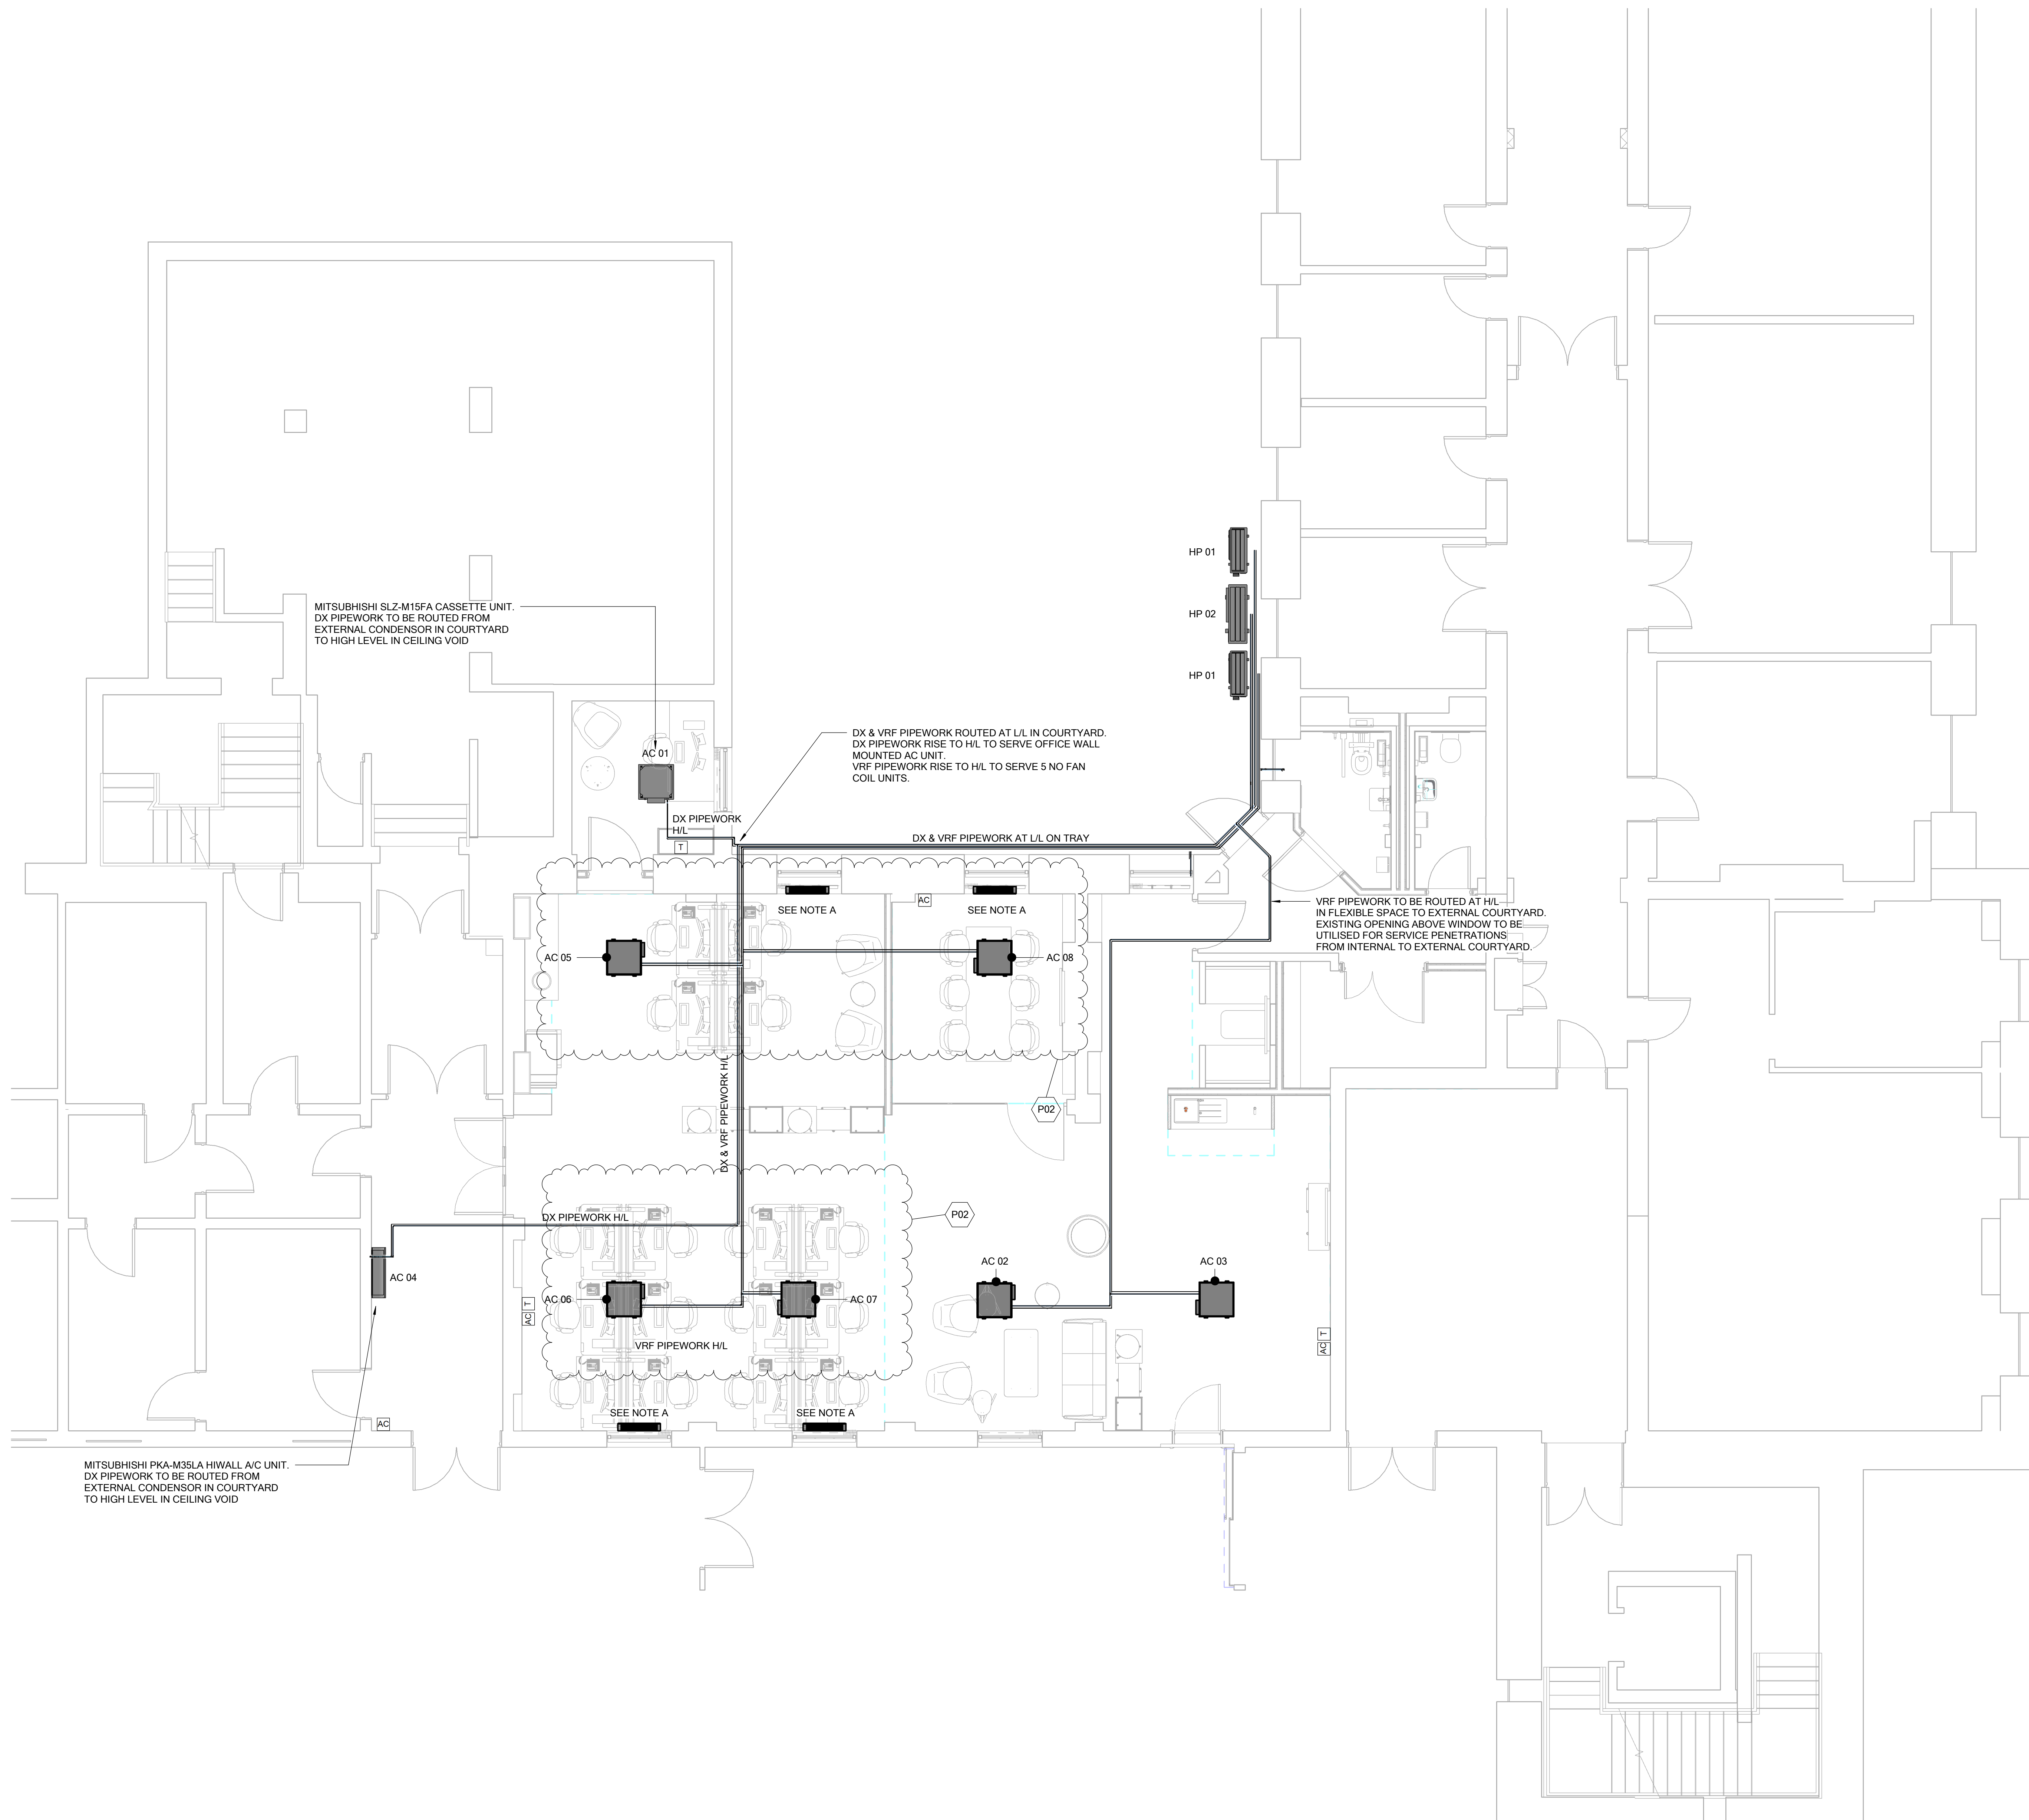

P02	REVISED SCOPE FOLLOWING VE	19/12/23	LP	DM
P01	ISSUE FOR COMMENT	13/09/23	LP	DM
REV.	DESCRIPTION	DATE	DRW.	CHK.

STATUS	PURPOSE OF ISSUE
S0	WORK IN PROGRESS

DRAWN BY LP	CHECKED BY DM	DATE 12/09/2023
----------------	------------------	--------------------

SCALE (@A0) 1:50	PROJECT NUMBER 13392
---------------------	-------------------------

FILE DRAWING NUMBER	REV.
13392-SIS-XX-00-DR-M-5501	P02