
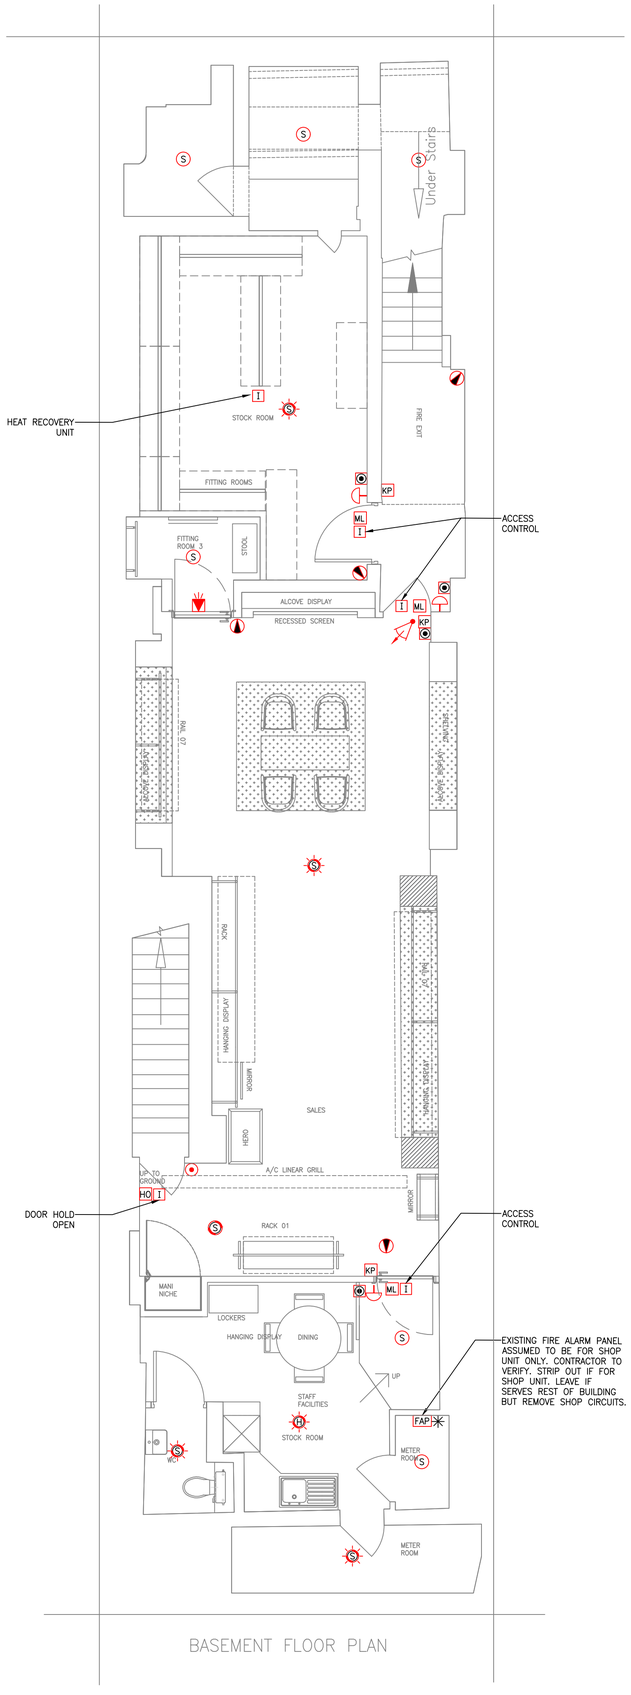


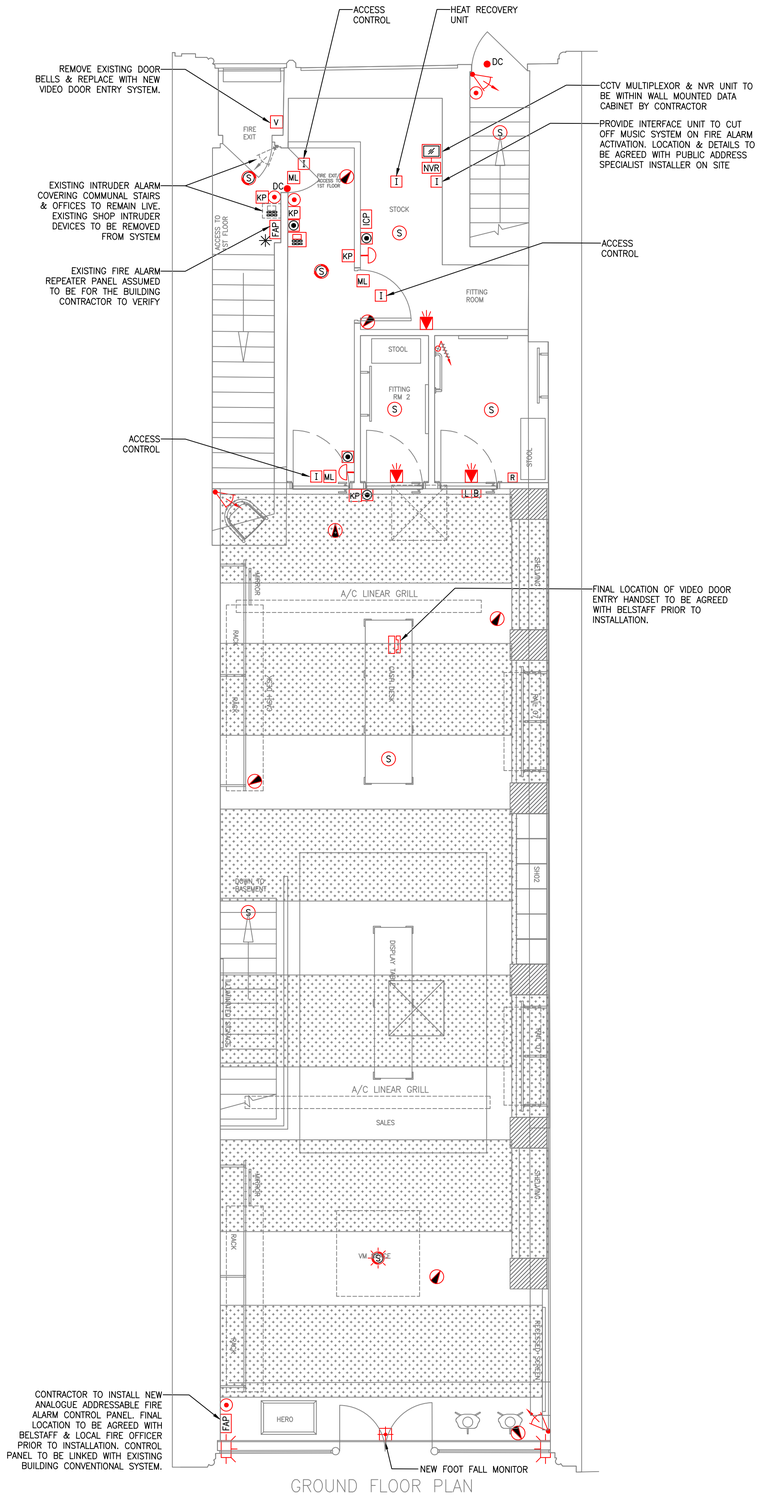

LEGEND

FIRE ALARM

NOTES:–
1. STRIP OUT EXISTING CONVENTIONAL FIRE ALARM SYSTEM TO SHOP UNIT & REPLACE WITH NEW ANALOGUE ADDRESSABLE SYSTEM COMPLYING WITH BS 5839–PT 1 CATEGORY L(M).
2. LOCATION OF NEW FIRE ALARM PANEL TO BE AGREED WITH FIRE OFFICER & BUILDING CONTROL PRIOR TO INSTALLATION.
3. LINK NEW FIRE ALARM SYSTEM TO EXISTING BUILDING CONVENTIONAL FIRE ALARM SYSTEM.

- FAP — FIRE ALARM CONTROL PANEL. ✳ DENOTES EXISTING CONVENTIONAL CONTROL PANEL
- S — SMOKE DETECTOR
- S — SMOKE DETECTOR C/W SOUNDER
- S — SMOKE DETECTOR C/W SOUNDER & BEACON BASE
- MANUAL CALL POINT
- I — FIRE ALARM INTERFACE UNIT
- VISUAL ALARM DEVICE
- HO — DOOR HOLD OPEN TO FAIL SAFE ON FIRE ALARM

ACCESS CONTROL

STRIP OUT ALL EXISTING ACCESS CONTROL WITHIN SHOP UNIT DEMISE & INSTALL NEW.

- KP — ACCESS CONTROL KEYPAD
- ML — MAGLOCK
- GREEN EMERGENCY BREAK GLASS (DOOR RELEASE)
- HANDS FREE SENSOR OPERATED PUSH TO EXIT

DISABLED ALARM CALL

- CEILING MOUNTED PULL CORD WITH RE–ASSURANCE LAMP
- R — WALL MOUNTED CALL/RESET UNIT FLUSH FINISH
- LTB — OVERDOOR LAMP TONE UNIT

CCTV

STRIP OUT ALL EXISTING CCTV CAMERAS WITHIN SHOP UNIT DEMISE & INSTALL NEW.

- DOME CAMERA
- CCTV MONITOR
- NVR — NVR RECORDER

INTRUDER ALARM

STRIP OUT ALL INTRUDER DETECTION WITHIN SHOP UNIT DEMISE & INSTALL NEW.

- PIR DETECTOR
- DC — DOOR CONTACT
- INTRUDER ALARM KEYPAD
- WINDOW SENSOR
- ICP — INTRUDER ALARM CONTROL PANEL

FOOTFALL MONITOR

- NEW FOOT FALL MONITOR

VIDEO DOOR ENTRY

- V — STAINLESS STEEL VIDEO DOOR ENTRY CALL STATION C/W 3 CALL BUTTONS FOR SHOP/FIRST FLOOR/SECOND FLOOR OFFICE
- VIDEO INTERCOM HANDSET. LOCATION TO BE AGREED WITH BELSTAFF.

THIS DRAWING IS NOT A WORKING DRAWING FOR INSTALLATION. WORKING DRAWINGS MUST BE PREPARED BY THE INSTALLATION CONTRACTOR WITH REFERENCE TO THE "CONSTRUCTION (DESIGN & MANAGEMENT) REGULATIONS" FOR THE PURPOSES OF INSTALLATION. FIGURED DIMENSIONS TO BE USED IN PREFERENCE TO SCALED SIZES. ALL DIMENSIONS MUST BE CHECKED BEFORE COMMENCING WORK ON SITE. THE COPYRIGHT OF THIS DRAWING REMAINS WITH THE ENGINEERING PRACTICE AND MAY NOT BE REPRODUCED IN ANY FORM WITHOUT PRIOR WRITTEN CONSENT.

GENERAL NOTES

1. DO NOT SCALE THIS DRAWING.
2. THIS DRAWING IS FOR TENDER PURPOSES ONLY. THE CONTRACTOR SHALL PROVIDE HIS OWN FULLY DETAILED AND CO–ORDINATED DESIGN AND INSTALLATION DRAWINGS.
3. THIS DRAWING IS TO BE READ IN CONJUNCTION WITH THE ENGINEERING SPECIFICATION.
4. THE CONTRACTOR SHALL REFER TO THE ARCHITECTURAL, STRUCTURAL ENGINEERING AND SPECIALIST DRAWINGS.
5. ALL SIZES, POSITIONS, QUANTITIES ETC OF PLANT AND EQUIPMENT IS INDICATIVE ONLY AND SUBJECT TO FINAL DESIGN BY THE CONTRACTOR AND APPROVAL BY THE ENGINEER.

REV	DESCRIPTION	BY	DATE
Ø	TENDER ISSUE	MJW	20/02/2024

THE ENGINEERING PRACTICE
Chartered Mechanical and Electrical Consultants
GUNNERY HOUSE
GUNNERY TERRACE
LEAMINGTON SPA
CV32 5PE
TEL: 01926 436010
www.theengineeringpractice.co.uk

CLIENT:
BELSTAFF

PROJECT:
BELSTAFF STORE RELOCATION
KING STREET, MANCHESTER

DRAWING TITLE:
PROPOSED CONCEPT
FIRE ALARM, SECURITY &
ACCESS CONTROL
LAYOUT

DRAWING NO.:
2533/E03

SCALE: 1:50 @A1
REVISION: Ø

xref based on architects drawing

ENG/CAD:	MJW/CWO	13/02/24
CHECKED:	MJW	19/02/24

TEP