

- Cavity Barrier/Firestopping**
Firestopping (Internal) to match the fire resistance of the associated wall/floor
Cavity Barriers (External) to achieve a fire resistance of 30 minutes integrity and insulation
- Cavity Barrier Around Openings**
Acceptable materials include 0.5mm steel, 12mm gypsum based board, or mineral wool slab under compression

These Fire Strategy drawings are to be read in conjunction with the Fire Strategy Report and the Access Strategy drawings.
Structural elements including roofs supporting plant to have 90 minutes fire resistance on New Build and 120 minutes on Link Bridge. For additional requirements refer to the Fire Strategy Report.

For location and extent of external wall cavity barriers around openings, compartment wall junctions, other cavity barrier junctions, protected escape routes, subdivisions, etc. refer to the 2003 fire elevations and to the Facade Designer drawings.
Roof covering materials to be rated minimum of BA, BB, BC.
For escape stairs widths to existing and new staircases refer to the Fire Strategy Report.
Existing building elements with 'no works' are retained as existing.
Fire resistance of existing elements has not been verified. Further investigations to be undertaken.
These drawings do not show the position of loose firefighting equipment. Positions for this equipment to be provided by Client and agreed with BC.
Cavity barriers to be installed in accordance with section 33 of BS 9999.
All concealed voids in excess of 20m and around all window openings to be provided with cavity barriers and where external cavity crosses over compartment line of all fire resisting walls.
Provide cavity barriers at all compartment walls and in cavities at every 20m (Vertically & horizontally). All in accordance with Building Regulations and Fire Strategy.
All Ductwork & Services that pass through Protected Escape Routes to be 120min fire rated construction & be fully fire stopped to achieve 120min.
Ductwork & services that do not pass through Protected Escape Routes, but pass through fire separating elements are to be of a fire rated construction & fire stopped to achieve the same rating as the element it passes through.

REVIEWED

By Darren Smethurst at 2:57 pm, Feb 03, 2023


P01 - First Issue




**BOWMER
+ KIRKLAND**
5plus architects

Manchester: 0161 228 0211
Fourth Floor, The Hive, 47 Lever Street,
Manchester M1 1FN
London: 0207 253 7644
Third Floor, 25 Chart Street,
London N1 6FA
www.5plusarchitects.com

PROJECT:
Science and Engineering
Building
TITLE:
North Elevation - Fire Strategy
New Build
SCALE: As indicated@A1
ORIGIN DATE: 24/01/23
DRAWN: JC
CHECKED: AP
STATUS:
Preliminary
PROJECT: 05894 - 1338B-5PA-NB-ZZ-DR-A-290300
DRAWING NO:
REV: P01

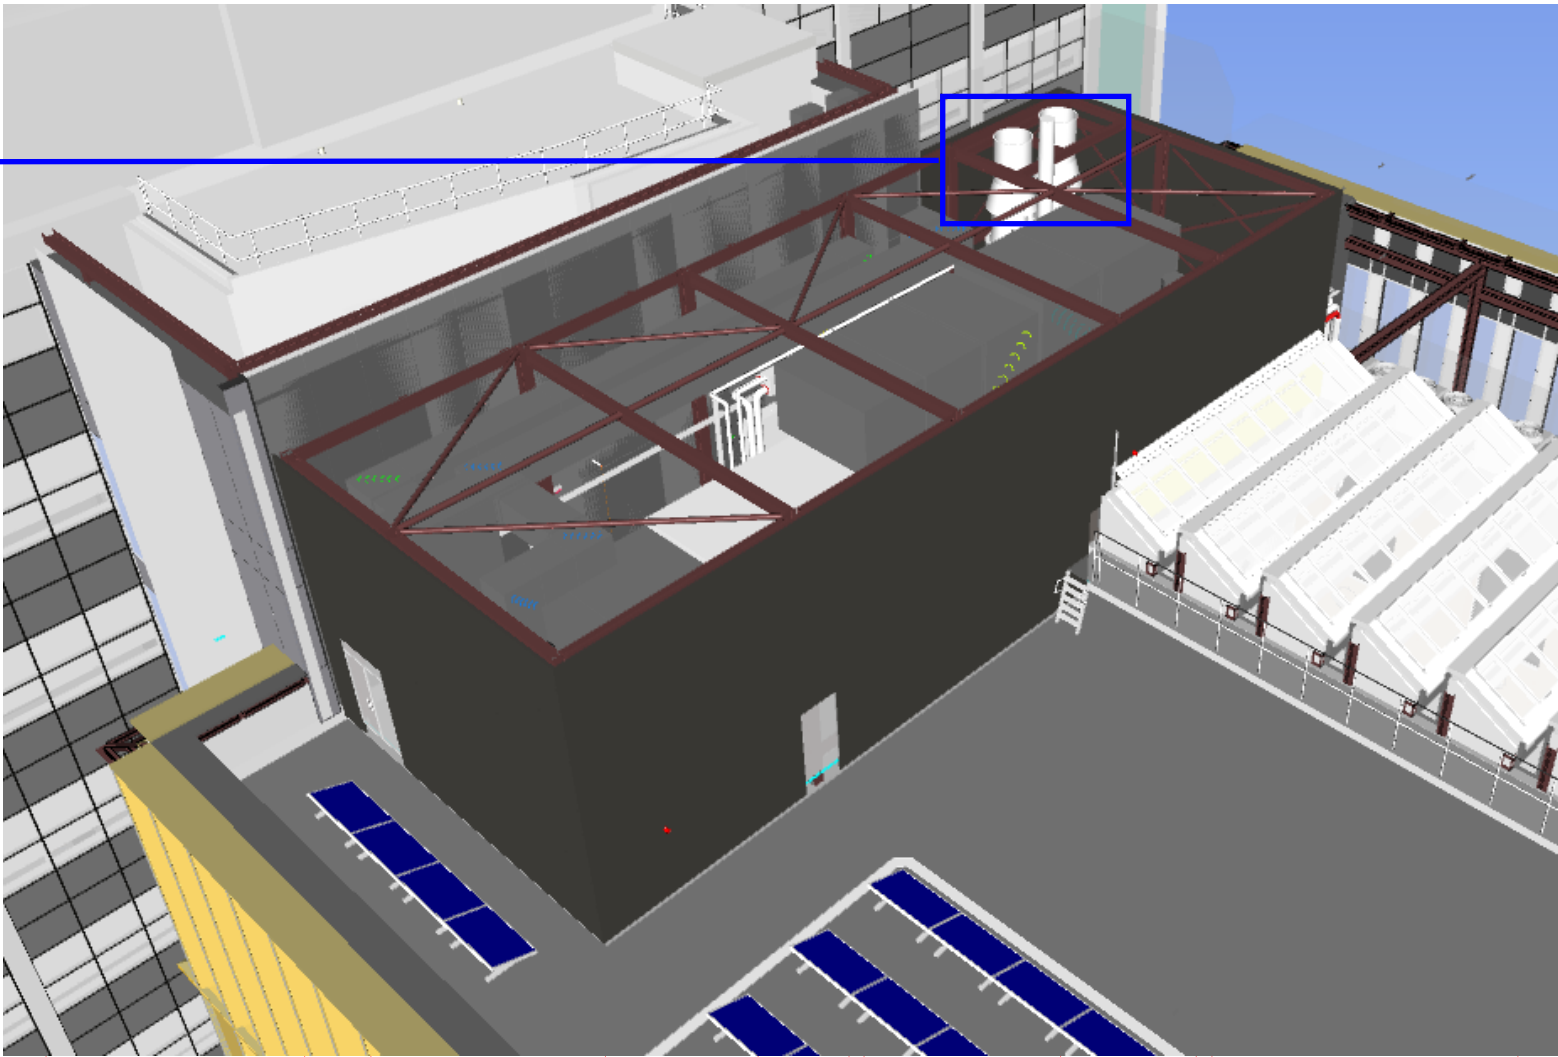


Process Ventilation Extract Flues
Within plant screen but will vent to atmosphere.
Chemical waste from fume cupboards.

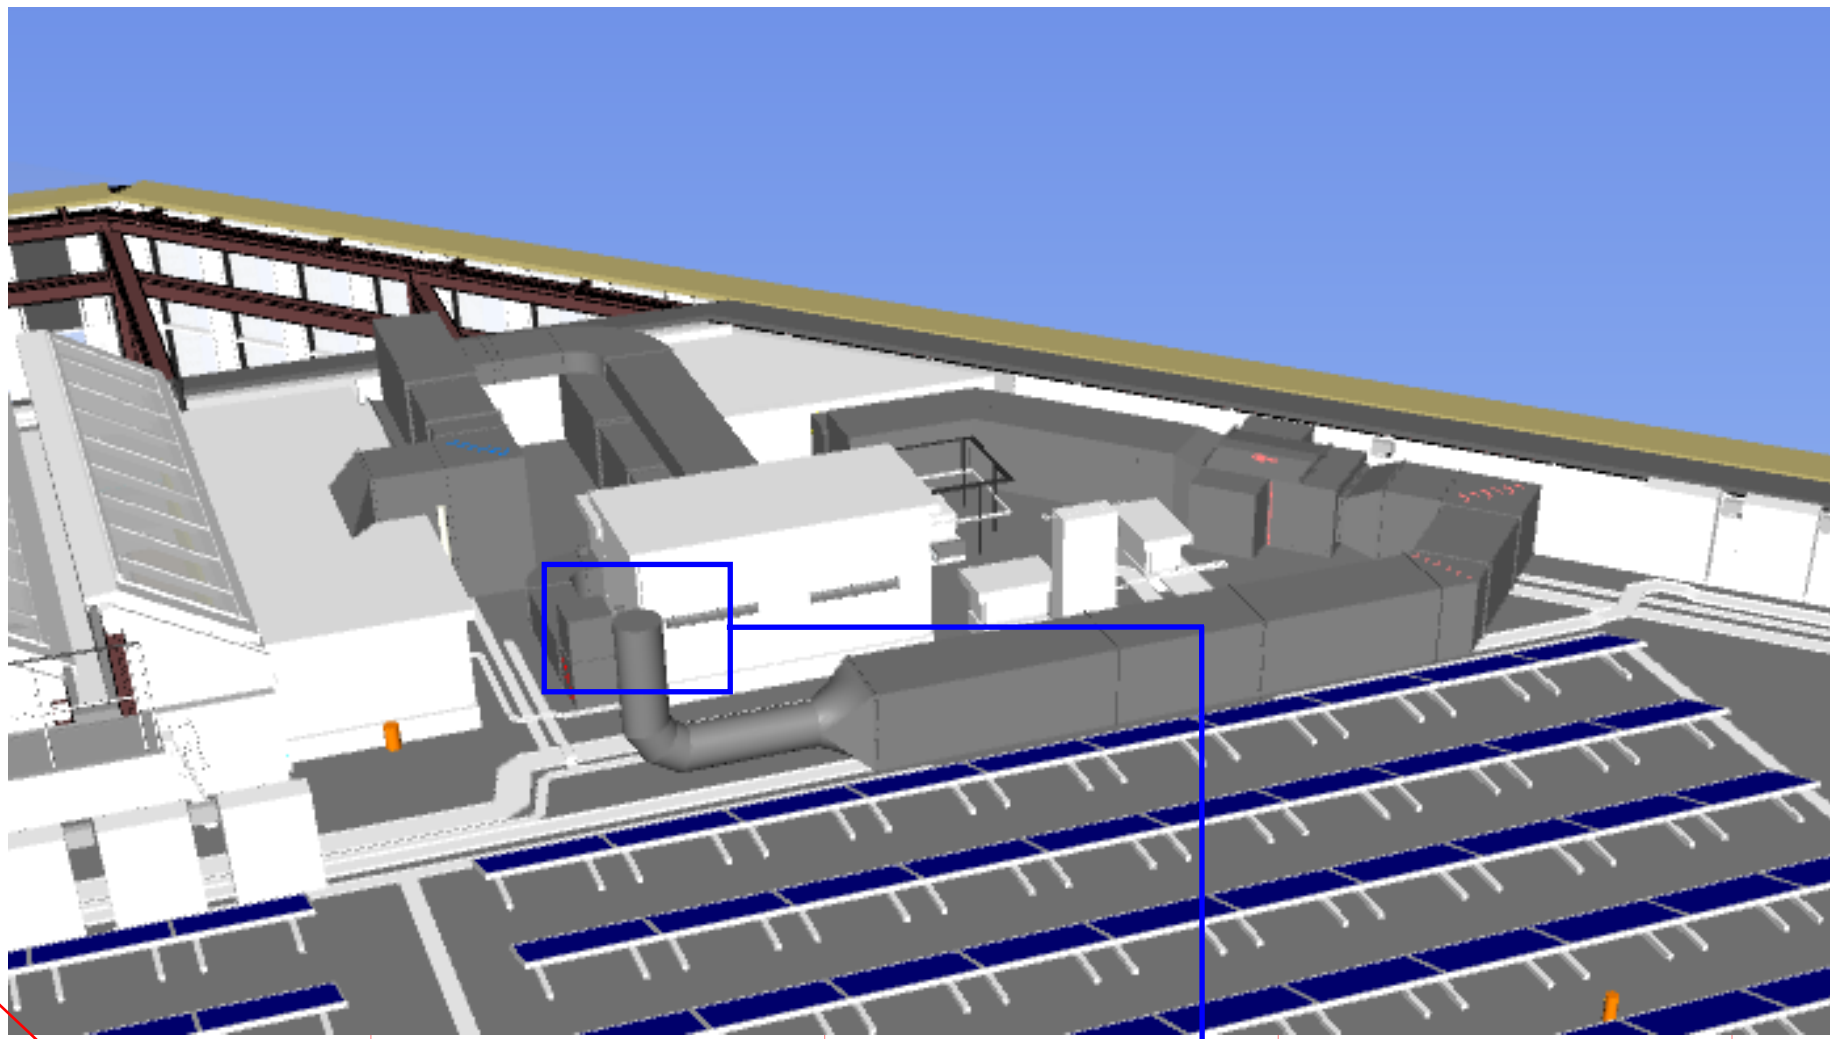

Smoke Ventilation System
Smoke clearance system from lift lobbies within the building.
Emergency Only / Smoke from a burning event within the building.

Initial fins should be rated by steel plate (m) at the corner of the elevations

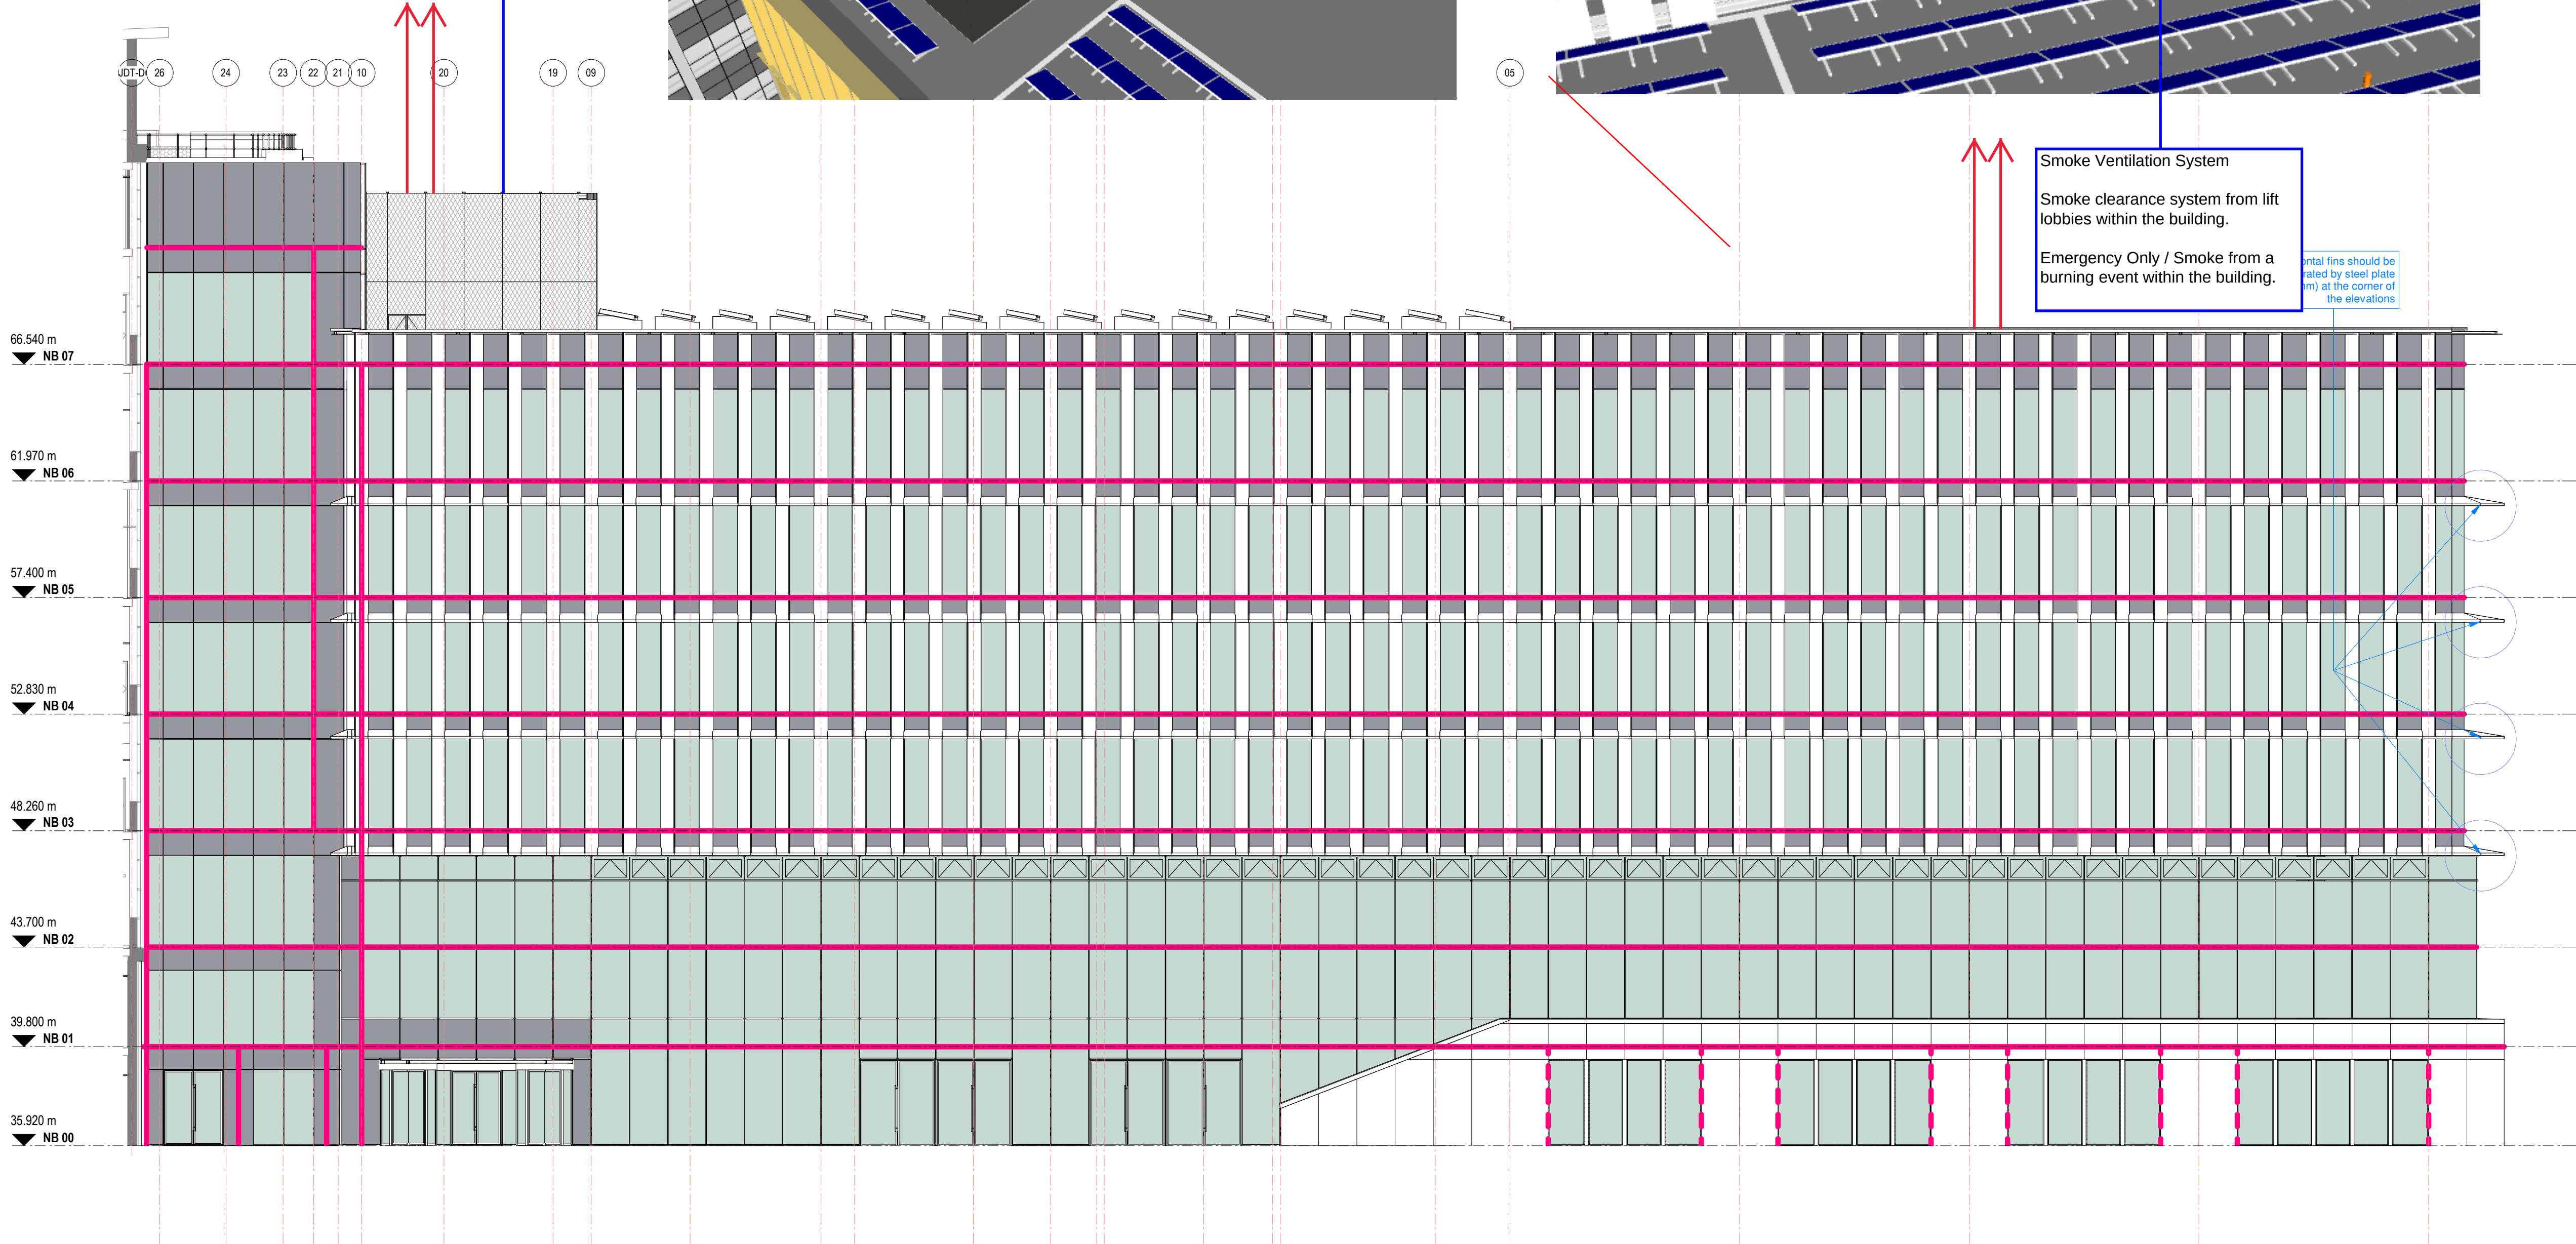

1 North Elevation Fire Strategy

1: 150