A0

DRAWING NOTES

SYMBOL	DESCRIPTION
	BLUE RING HIGHLIGHTS THE INTRODUCTION OF IMPROVED FIRE DETECTION DEVICES LOCATION ALONGSIDE THE NEW DEVICES WHICH ARE LOCATED IN EXISTING POSITION. THERE ARE A NUMBER OF CALL POINTS THAT ARE WIRELESS DEVICES THAT DO NOT REQUIRE ANY CABLING.

CONTAINMENT LEGEND

SYMBOL	DESCRIPTION
	GALVANISED STEEL TRUNKING
	GALVANISED STEEL "1/2/3/4" COMPARTMENT TRUNKING DROPPER/RISER
	200mm GALVANISED STEEL BASKET WITH 2no DIVIDER (POSSIBLE CLIPPED DIRECT FOLOWING CONTRACTOR ADMINISTRATORS APPROVAL)
	300mm GALVANISED CABLE BASKET WITH 2no DIVIDER FOR BAND ONE, BAND TWO AND FIRE ALARM CABLES
	VERTICAL RISER FOR CONTAINMENT TO ELECTRICAL DISTRIBUTION BOARDS BETWEEN FLOOR
	"TP&N / SP&N" DISTRIBUTION BOARD *"LP / L / P / D / CCTV"*
	CONSUMER UNIT *"LP / L / P / D / CCTV"*
	SP&N ROTARY ISOLATOR
	200mm GALVANISED STEEL BASKET WITH 2no DIVIDER IN CEILING VOID
	FISH WIRES THROUGH FLOOR VOID (CLIPPED DIRECT IN WEST WING)

POWER NOTES

SYMBOL	DESCRIPTION
1	THE CONTRACTOR SHALL NOTE THAT THE EXISTING LOCATION OF THE SOCKET OUTLET IN THE DECORATIVE SKIRTING BOARD MUST BE RE-USED.
2	THE CONTRACTOR SHALL NOTE THAT ANY NEW LOCATIONS OF SOCKET OUTLETS SHALL BE APPROVED BY THE CONTRACT ADMINISTRATOR & WIRES TO BE BARE MICC CABLE CLIPPED ONTO THE SKIRTING BOARD OR TOP OF SKIRTING, PAINTED TO THE WALL & SKIRTING COLOUR RANGE.
3	THE CONTRACTOR SHALL INCLUDE TO SUPPLY & INSTALL UNISTRUT STRUCTURE AND HOUR FIRE RATED 18mm PLYWOOD - EURO CLASS B FULL HEIGHT, WIDTH OF WALL.

LIGHTING NOTES

SYMBOL	DESCRIPTION
1	THE CONTRACTOR SHALL INCLUDE TO TAKE DOWN EXISTING FITTINGS, TAKE TO CHELSOM, CLEAN REWIRE, RE-LAMP WITH LED, RETURN TO HEATON HALLAND INSTALL.
2	THE CONTRACTOR SHALL INCLUDE TO TAKE DOWN EXISTING FITTING FROM ROOM, TAKE TO CHELSOM, CLEAN, REWIRE, RE-LAMP WITH LED, RETURN TO HEATON HALL AND INSTALL TO ANOTHER ROOM.
3	THE CONTRACTOR SHALL INCLUDE TO SUPPLY AND INSTALL NEW LED LUMINAIRE AS PER CHELSOM SCHEDULE AND REMOVE & HAND OVER ALL EXISTING TO HEATON HALL.
4	DETAILS OF DECORATIVE LIGHTING, PENDANTS & CHANDELIERS ARE DETAILED IN THE LIGHTING SCHEDULE WITHIN THE SPECIFICATION BOTH NEW & REFURBISHED LUMINAIRES.

SMALL POWER LEGEND

SYMBOL	DESCRIPTION
	13 AMP SWITCHED FUSED SPUR CONNECTION UNIT
	30 mA RCD SINGLE SWITCHED SOCKET OUTLET
	30 mA RCD TWIN SWITCHED SOCKET OUTLET

PLANT CONTROL LEGEND

SYMBOL	DESCRIPTION
PCP	PLANT CONTROL PANEL

DRAWING NOTES

1	THE CONTRACTOR SHALL INCLUDE TO SUPPLY AND INSTALL NEW UNISTRUT AND HOUR FIRE RATED PLYWOOD PANEL ACROSS THE FULL LENGTH AND HEIGHT OF THE WALL.

FIRE ALARM LEGEND

SYMBOL	DESCRIPTION
	20A SECRET KEY SWITCHED FUSED CONNECTION UNIT METAL CLAD FINISHED IN RED
FAP	FIRE ALARM PANEL
T	WIRELESS TRANSMITER

INTRUDER ALARM LEGEND

SYMBOL	DESCRIPTION
	CONTROL PANEL
IA PSU	POWER SUPPLY UNIT
IAXP	REMOTE ZONE EXPANDER

INTRUDER ALARM LEGEND

SYMBOL	DESCRIPTION
IA PSU	INTRUDER ALARM POWER SUPPLY UNIT

LIGHTING LEGEND

SYMBOL	DESCRIPTION
	DECORATIVE SQUARE BULKHEAD
	ARCHITECTURAL CHANDELIER
	ARCHITECTURAL DECORATIVE PENDANT
	ARCHITECTURAL STAIRWELL BANISTER LIGHT
	PENDANT LUMINAIRE (SUPPLIED BY CLIENT)
	SURFACE WALL MOUNTED LUMINAIRE
	DEXTRA SURFACE MOUNTED DALI TRACK 3 CIRCUIT TRACK LIGHTING (WHITE)
	EXISTING RECESSED SQUARE SPOTS
	ARCHITECTURAL CIRCULAR DECORATIVE BULKHEAD
AP	ACCESS PANEL

LIGHTING CONTROLS LEGEND

SYMBOL	DESCRIPTION
IP65	ONE WAY GRID SWITCH
	TWO WAY GRID SWITCH
	INTERMEDIATE GRID SWITCH
SM	360° SURFACE MOUNTED PIR
LT	DEXTRA LONG THROW SENSOR

FIXED EQUIPMENT LEGEND

SYMBOL	DESCRIPTION
	DIMPLEX 1.5KW PANEL HEATER C/W TIMECLOCK & THERMOSTAT PLYE RANGE. REF: PLY 150 E (SUPPLY NOT INCLUDED IN PANEL HEATER PROTECT)

UTILITIES LEGEND

SYMBOL	DESCRIPTION
M	ELECTRICITY METER
G	GAS METER

FIXED EQUIPMENT LEGEND

SYMBOL	DESCRIPTION
	SUPPLY / EXTRACT FAN

MAINS DISTRIBUTION LEGEND

SYMBOL	DESCRIPTION
	MAIN SWITCHBOARD
	TP&N DISTRIBUTION BOARD
C	CONTACTOR
	TRANSFORMER
	CONSUMER UNIT
	SP&N ROTARY ISOLATOR

GENERAL NOTES


1. THIS DRAWING SHALL BE READ IN CONJUNCTION WITH THE ECS ELECTRICAL ENGINEERING SPECIFICATIONS.
2. THIS DRAWING IS INDICATIVE AND IS INTENDED TO HIGHLIGHT THE PROPOSED LOCATION FOR ELECTRICAL SERVICES. THE CONTRACTOR SHALL NOTE THESE DRAWINGS SHALL NOT BE USED FOR CONSTRUCTION PURPOSES. THE CONTRACTOR SHALL INCLUDE TO PRODUCE THEIR OWN WORKING DRAWINGS, TAKE DETAILED SITE MEASUREMENTS, INDICATE THE PROVISION OF BUILDERS WORKS AND COORDINATE THE INSTALLATION OF ALL SERVICES.
3. THE CONTRACTOR SHALL NOTE THIS DRAWING HAS BEEN PRODUCED USING LIMITED SITE SURVEY INFORMATION. THE CONTRACTOR SHALL INCLUDE TO CARRY OUT AN INTRUSIVE SURVEY AND TO PRODUCE DRAWINGS THAT REFLECT THE INSTALLATION.
4. ALL EQUIPMENT SHALL BE INSTALLED & LOCATED TO MAINTAIN SPATIAL REQUIREMENTS TO FACILITATE ACCESS & MAINTENANCE IN LINE WITH MANUFACTURERS RECOMMENDATIONS AND GOOD PRACTICE GUIDES.
5. ALL EQUIPMENT SHALL BE INSTALLED IN ACCORDANCE WITH MANUFACTURERS GUIDELINES.
6. DO NOT SCALE FROM THIS DRAWING.
7. ALL DETAILS ARE APPLICABLE TO EVERY DRAWING UNLESS INDICATED OTHERWISE.
8. THE CONTRACTOR SHALL INCLUDE TO IDENTIFY THE COMPLETE EXISTING ELECTRICAL INSTALLATION, EXTEND AND ADAPT TO FACILITATE THE PROPOSED WORKS

ABBREVIATIONS

/E	INTEGRATED EMERGENCY
IP**	DENOTES PROTECTION RATING
MC	METAL CLAD
RCD	RESIDUAL CURRENT DEVICE

LIGHTING LEGEND

SYMBOL	DESCRIPTION
A1	DEXTRA LIGHTING AMENITY PLUS IP65 LED BULKHEAD OPEN WHITE OPAL 1.947m (22.3W) REF: AMEX L30 - O/W
A1/E	AS ABOVE C/W 3 HOUR EMERGENCY LIGHTING FACILITY REF: AMEX L30 - O/W - LE3
A2	DEXTRA LIGHTING AMENITY EXTERIOR IP65 LED BULKHEAD C/W INTEGRAL PRESENCE SENSOR OPEN WHITE OPALL1.947m REF: AMEX L30 - O/W - R25E
A2/E	AS ABOVE C/W 3 HOUR EMERGENCY LIGHTING FACILITY REF: AMEX L30 - O/W - R25E - LE3
B1	DEXTRA LIGHTING TYPHON IP65 LINEAR 31.7W LED LUMINAIRE REF: TYP L54 PC55
B1/E	AS ABOVE WITH 3 HOUR EMERGENCY LIGHTING FACILITY REF: TYP L54 PC55 LE3
B2	DEXTRA LIGHTING TYPHON IP65 LINEAR 31.7W LED LUMINAIRE C/W INTEGRAL PRESENCE SENSOR REF: TYP L63-PC55-R25E
B2/E	AS ABOVE WITH 3 HOUR EMERGENCY LIGHTING FACILITY REF: TYP L63/PC55/R25E/LE3
C1	DEXTRA LIGHTING AMENITY DECORATIVE HALO RANGE 19.7W/119LM/W C/W INTEGRAL PRESENCE DETECTOR. REF: AM/EDH/L30R25E
C1/E	AS ABOVE WITH 3 HOUR EMERGENCY LIGHTING FACILITY REF: AM/EDH/L30R25E/LE3
D1	DEXTRA LIGHTING AMENITY PLUS CIRCULAR WHITE OPA L 14W (115LM/W) REF: AMCL20/WO
D1/E	AS ABOVE WITH 3 HOUR EMERGENCY LIGHTING FACILITY REF: AMCL20/WO/LE3
Y1	DEXTRAL LIGHTING - LED COLOUR CODE: 130WATT RGBW C64/4IN/RDM/40°/IP65/RAL 9006/ 410 x 310 x 60. REFERENCE CGE L130 - 4040-RGBW INCLUDING ALL CABLE POLES, PINS, CONTROLS ETC AS HIGHLIGHTED IN SPECIFICATION SECTION FOR EXTERNAL LIGHTING.
X1	CONTRACTOR TO INCLUDE £200 PER LUMINAIRE (SUPPLY ONE), INCLUDE FOR INSTALLATION AND FINAL CONNECTIONS.
E1	EMERGENCY EXIT LUMINAIRE
E2	BRASS ESCAPE ROUTE SIGNAGE
E3	LED4S NM3 LE3 LED4S SURFACE, NON-MAINTAINED, STANDARD EMERGENCY 3 HOUR, 217LLM

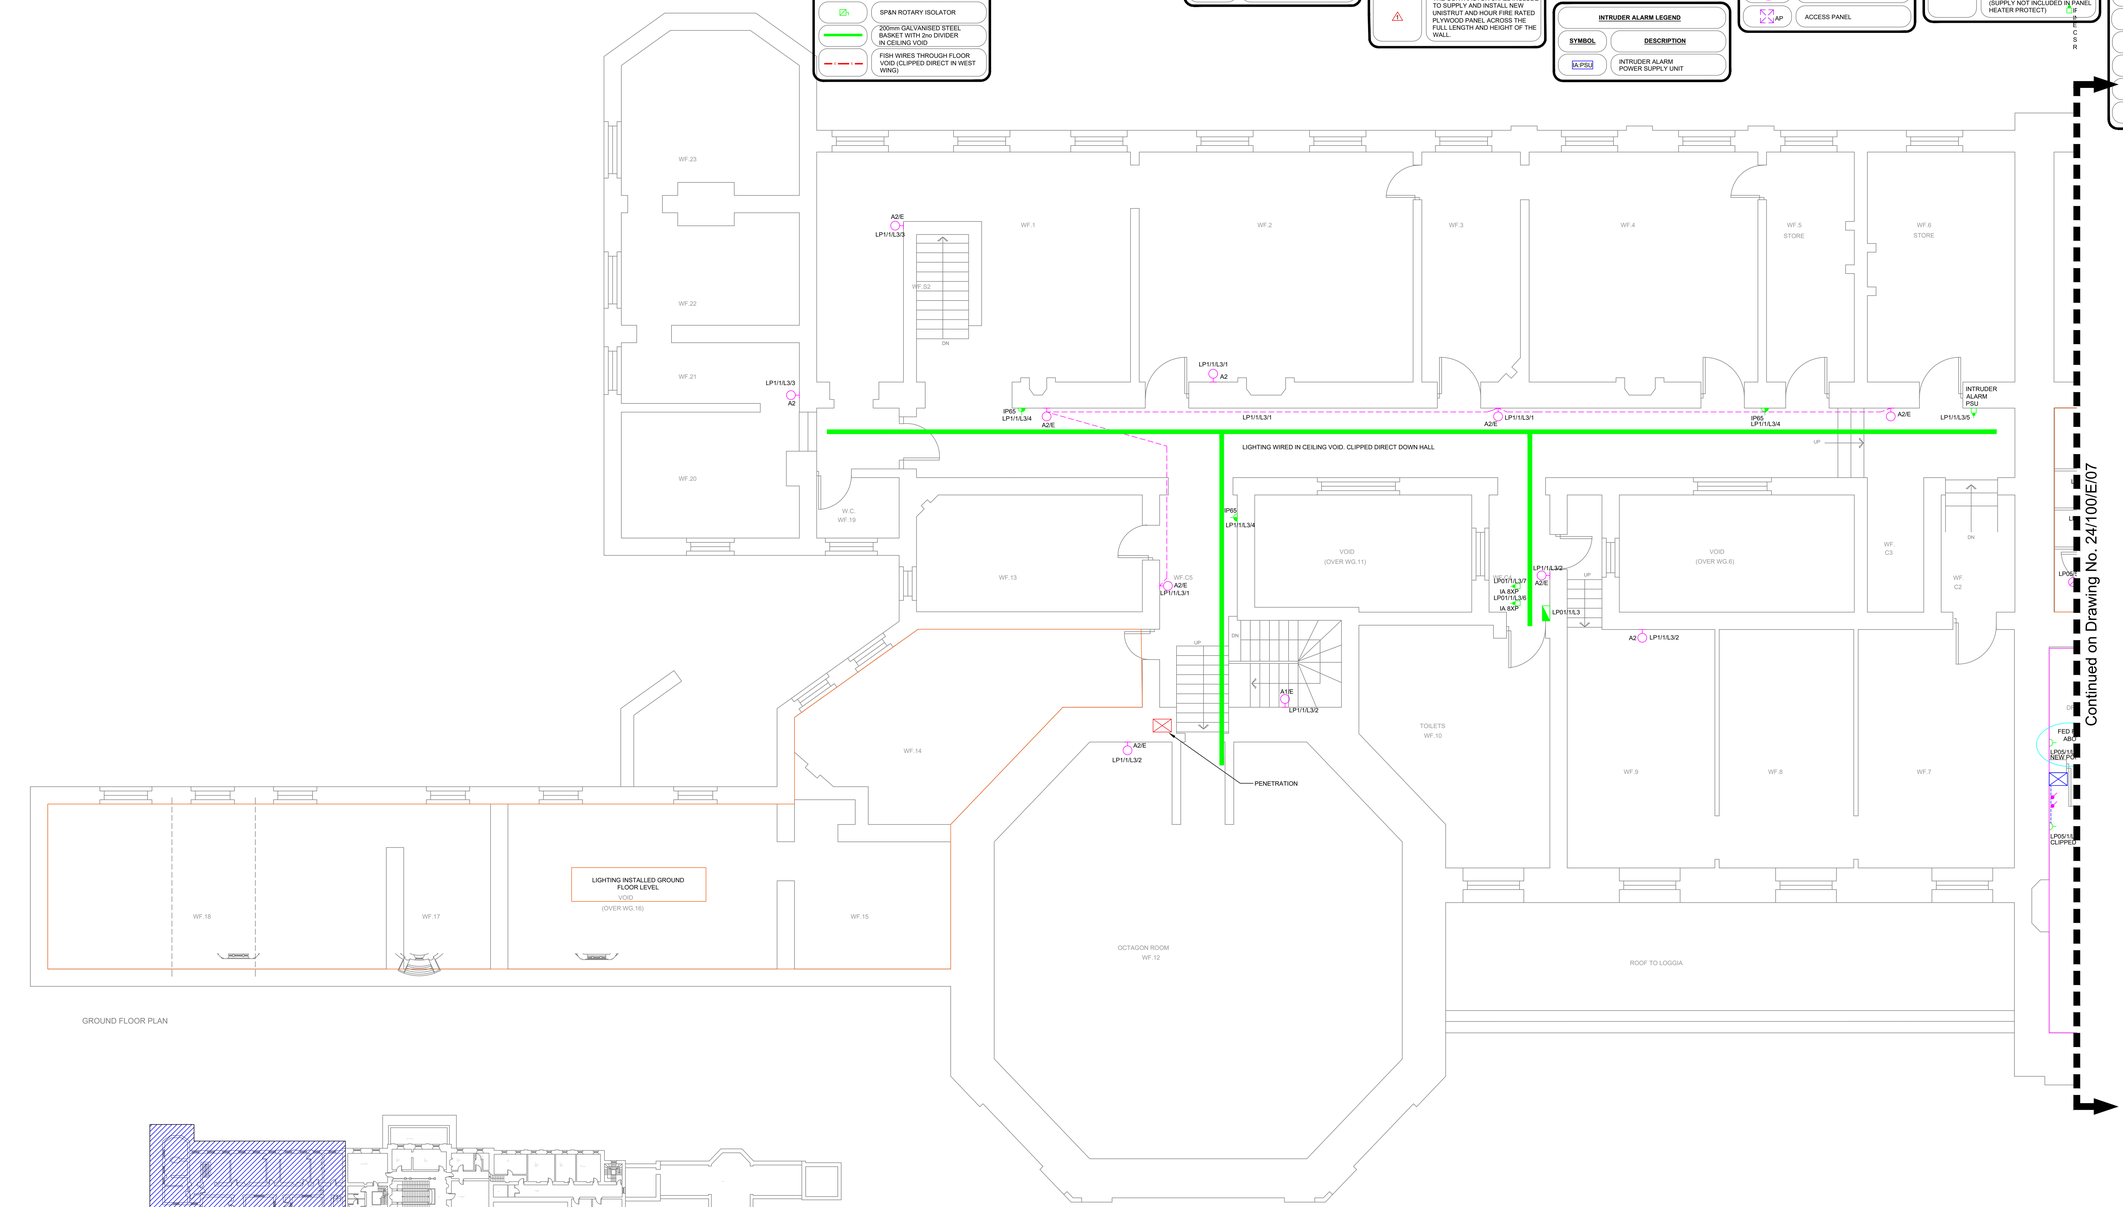

GROUND FLOOR PLAN

FIRST FLOOR PLAN

CAD original - not to be modified by hand

Rev.	Description		Date
T3	TENDER ISSUE.	G.M.	May. 24
T2	TENDER ISSUE.	G.M.	Jan. 24
T1	TENDER ISSUE.	G.M.	Nov. 23

STATUS: TENDER

CONSULTANTS
Building Services Consulting Engineers
148 Stockport Road
Cheadle, Cheshire. SK8 2DP
Tel. 0161 283 2882 Fax 0161 282 8825
Web Site: www.ecs-ecs.co.uk Email: sales@ecs-ecs.co.uk

JOB NO.	DRAWING NO.	COMPUTER FILE	REVISION
24/100	24/100/E/06	24_100_E_06	T3
DATE	SCALE	DRAWN	CHECKED
Feb. 2022	1:50 @ A0	J.P.	G.M.

JOB TITLE: Heaton Park Hall

DRAWING TITLE: First Floor West Wing Lighting & Power