
THIS DRAWING IS INDICATIVE AND REPRESENTS ONLY THE DESIGN INTENT, THE CONTRACTOR MUST PRODUCE FULLY CO-ORDINATED WORKING / INSTALLATION DRAWINGS AS REFERRED TO IN THE CONTRACT DOCUMENTATION

Luminaire Schedule						
Symbol	Qty	Label	Arrangement	Total Lamp Lumens	LLF	Description
	2	EX1S	SINGLE	14002	0.900	120w LED 4000k Viva City Flood 780mA with FW70 Optic and spill shield column mounted at 6m.
	4	EX1W	SINGLE	14002	0.900	120w LED 4000k Viva City Flood 780mA with FW70 Optic building mounted at 6m.
	2	EX2	SINGLE	8990	0.900	76w LED 4000k (4 module) 700mA Italo 1 with S05 Optic column mounted at 6m.
	4	EX3	SINGLE	3400	0.900	24w 4000k 1540mm (5ft) Climate Extra Single LED Array (Standard) mounted under canopy at 5.4m.
	2	EX4	SINGLE	819	0.900	6w LED 4000k Semita Urban bulkhead with cycle optic building mounted at 3m.
	3	EX4E	SINGLE	819	0.900	6w LED 4000k Semita Urban Emergency bulkhead with cycle optic building mounted at 3m.

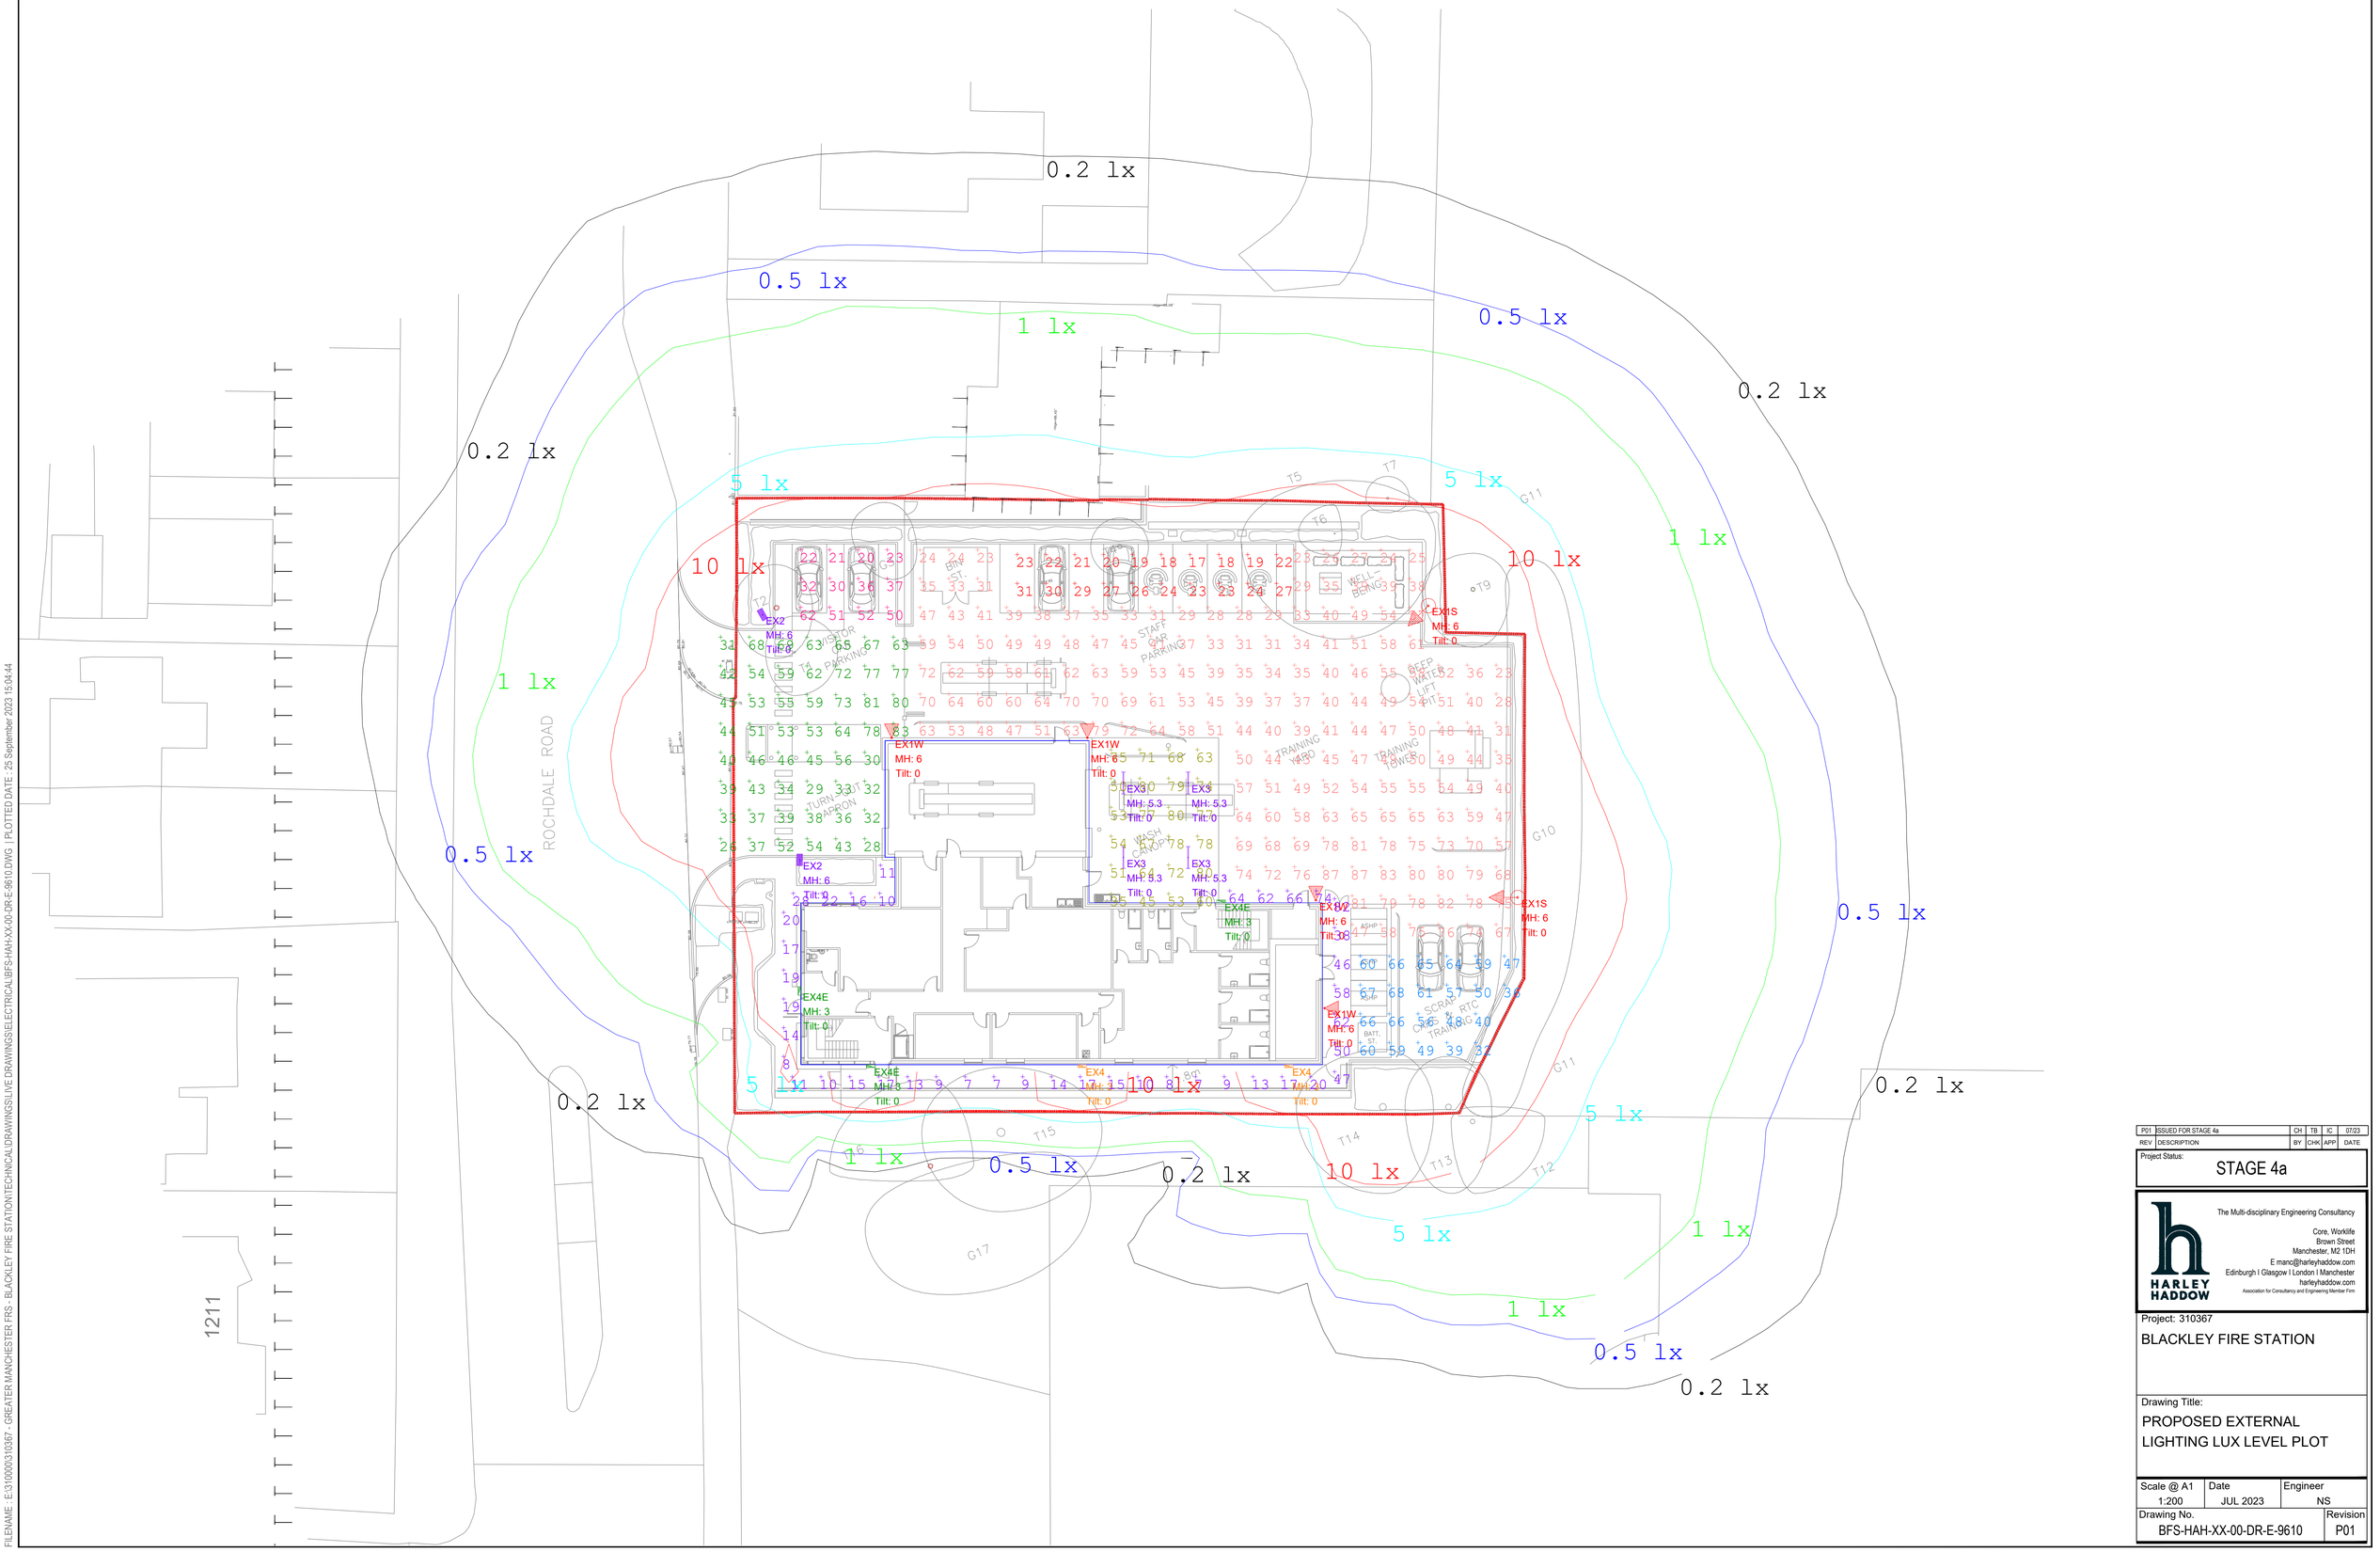

REV	DESCRIPTION	BY	CHK	APP	DATE
P01	ISSUED FOR STAGE 4a	CH	TB	IC	07/23

Project Status:
STAGE 4a

HARLEY HADDOW
The Multi-disciplinary Engineering Consultancy
Core, Worklife
Brown Street
Manchester, M2 1DH
E manc@harleyhaddow.com
Edinburgh I Glasgow I London I Manchester
harleyhaddow.com
Association for Consultancy and Engineering Member Firm

Project: 310367

BLACKLEY FIRE STATION

Drawing Title:
PROPOSED EXTERNAL LIGHTING LUX LEVEL PLOT

Scale @ A1	Date	Engineer
1:200	JUL 2023	NS

Drawing No.	Revision
BFS-HAH-XX-00-DR-E-9610	P01

FILENAME - E:\310000\310367 - GREATER MANCHESTER FRS - BLACKLEY FIRE STATION\TECHNICAL\DRAWINGS\LIVE DRAWINGS\ELECTRICAL\BFS-HAH-XX-00-DR-E-9610.DWG | PLOTTED DATE: 25 September 2023 15:04:44