



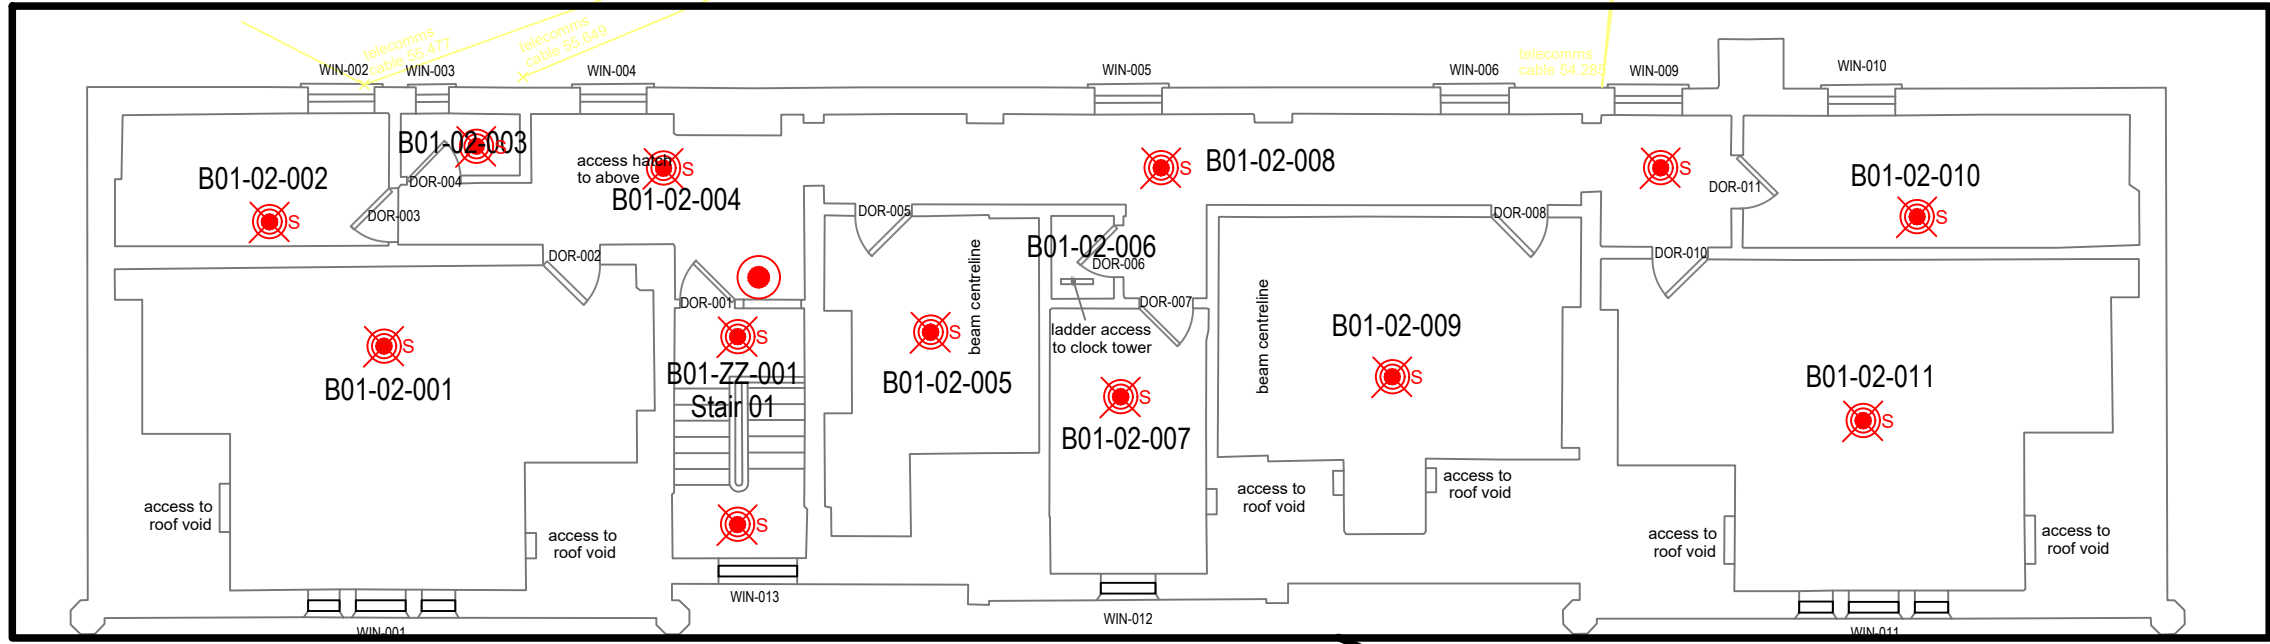

VICTORIA BATHS
B01
SECOND FLOOR

All cabling in this area to be P-Clipped surface mount in loft area above

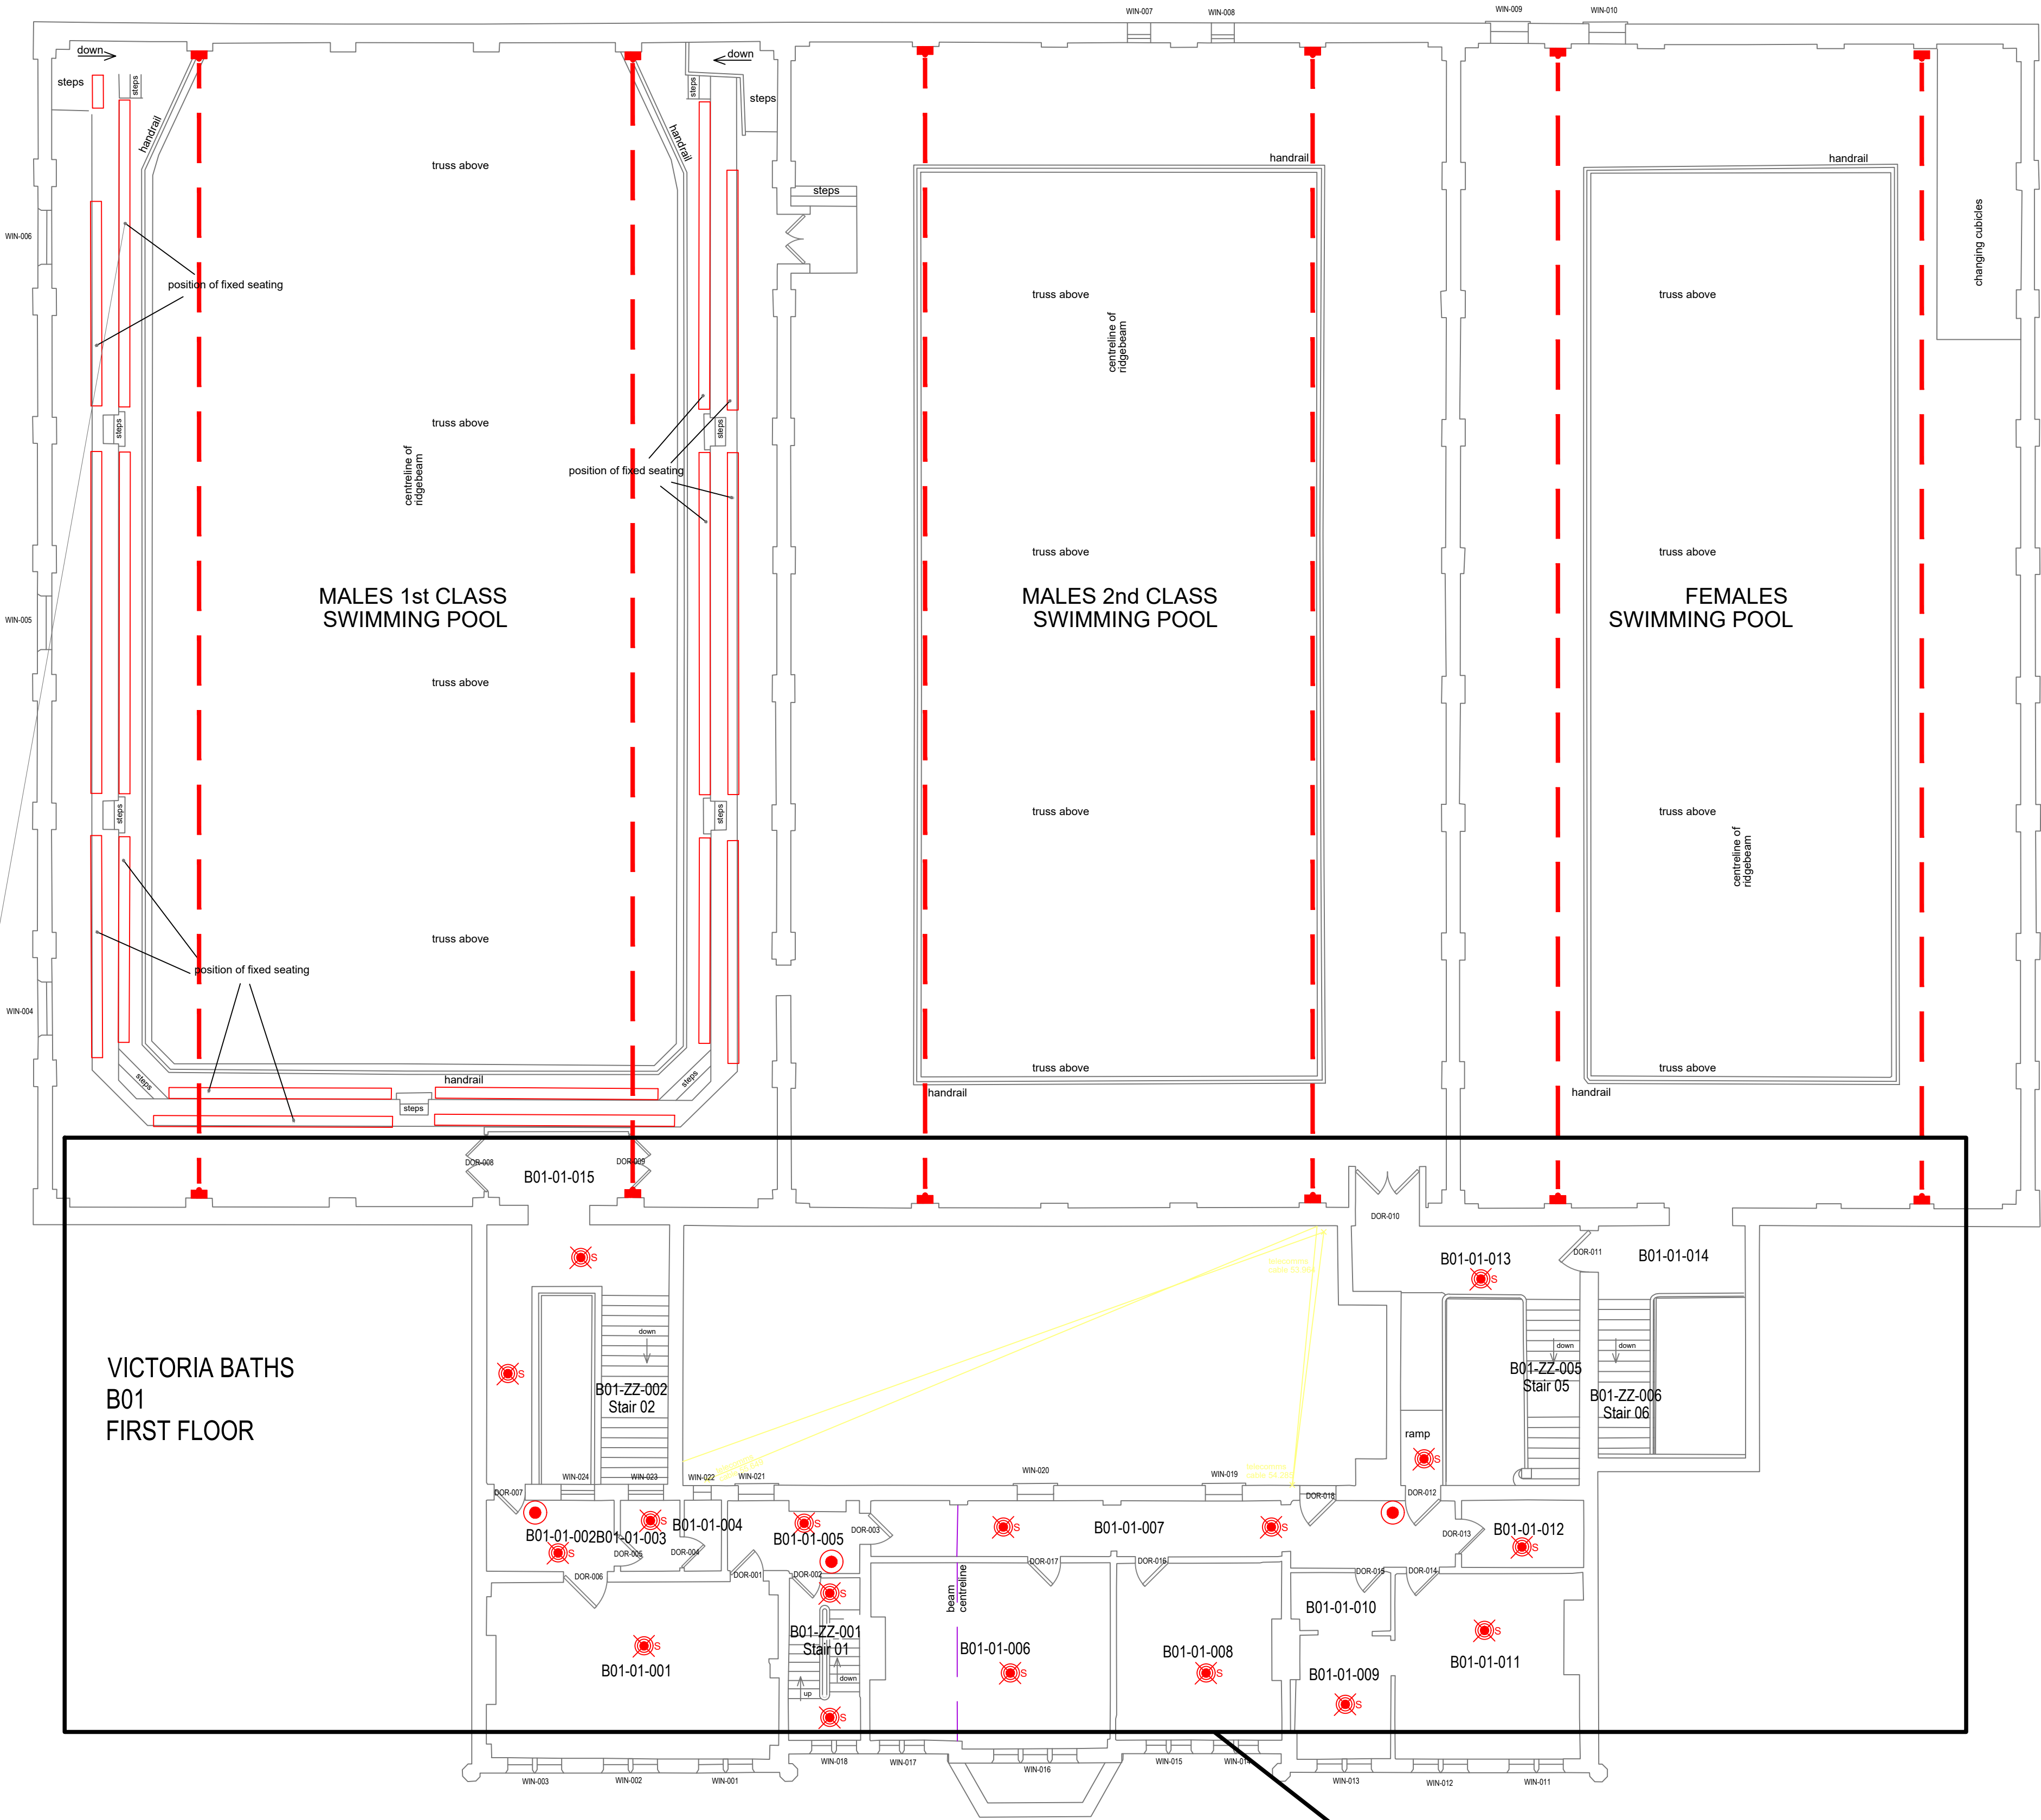

VICTORIA BATHS
B01
FIRST FLOOR

All cabling in this area to be P-Clipped surface mount under floor joists from above where possible. Surface runs will be carried out using plastic white PVC tube. Beam detection will be cabled from behind with PSU's to be mounted in an agreed location.