




All External Lighting is Controlled via a Photocell & Time Clock Control Operation c/w Manual Override Switch

K - Column Downlighter's (6,000mm AFFL U/S)

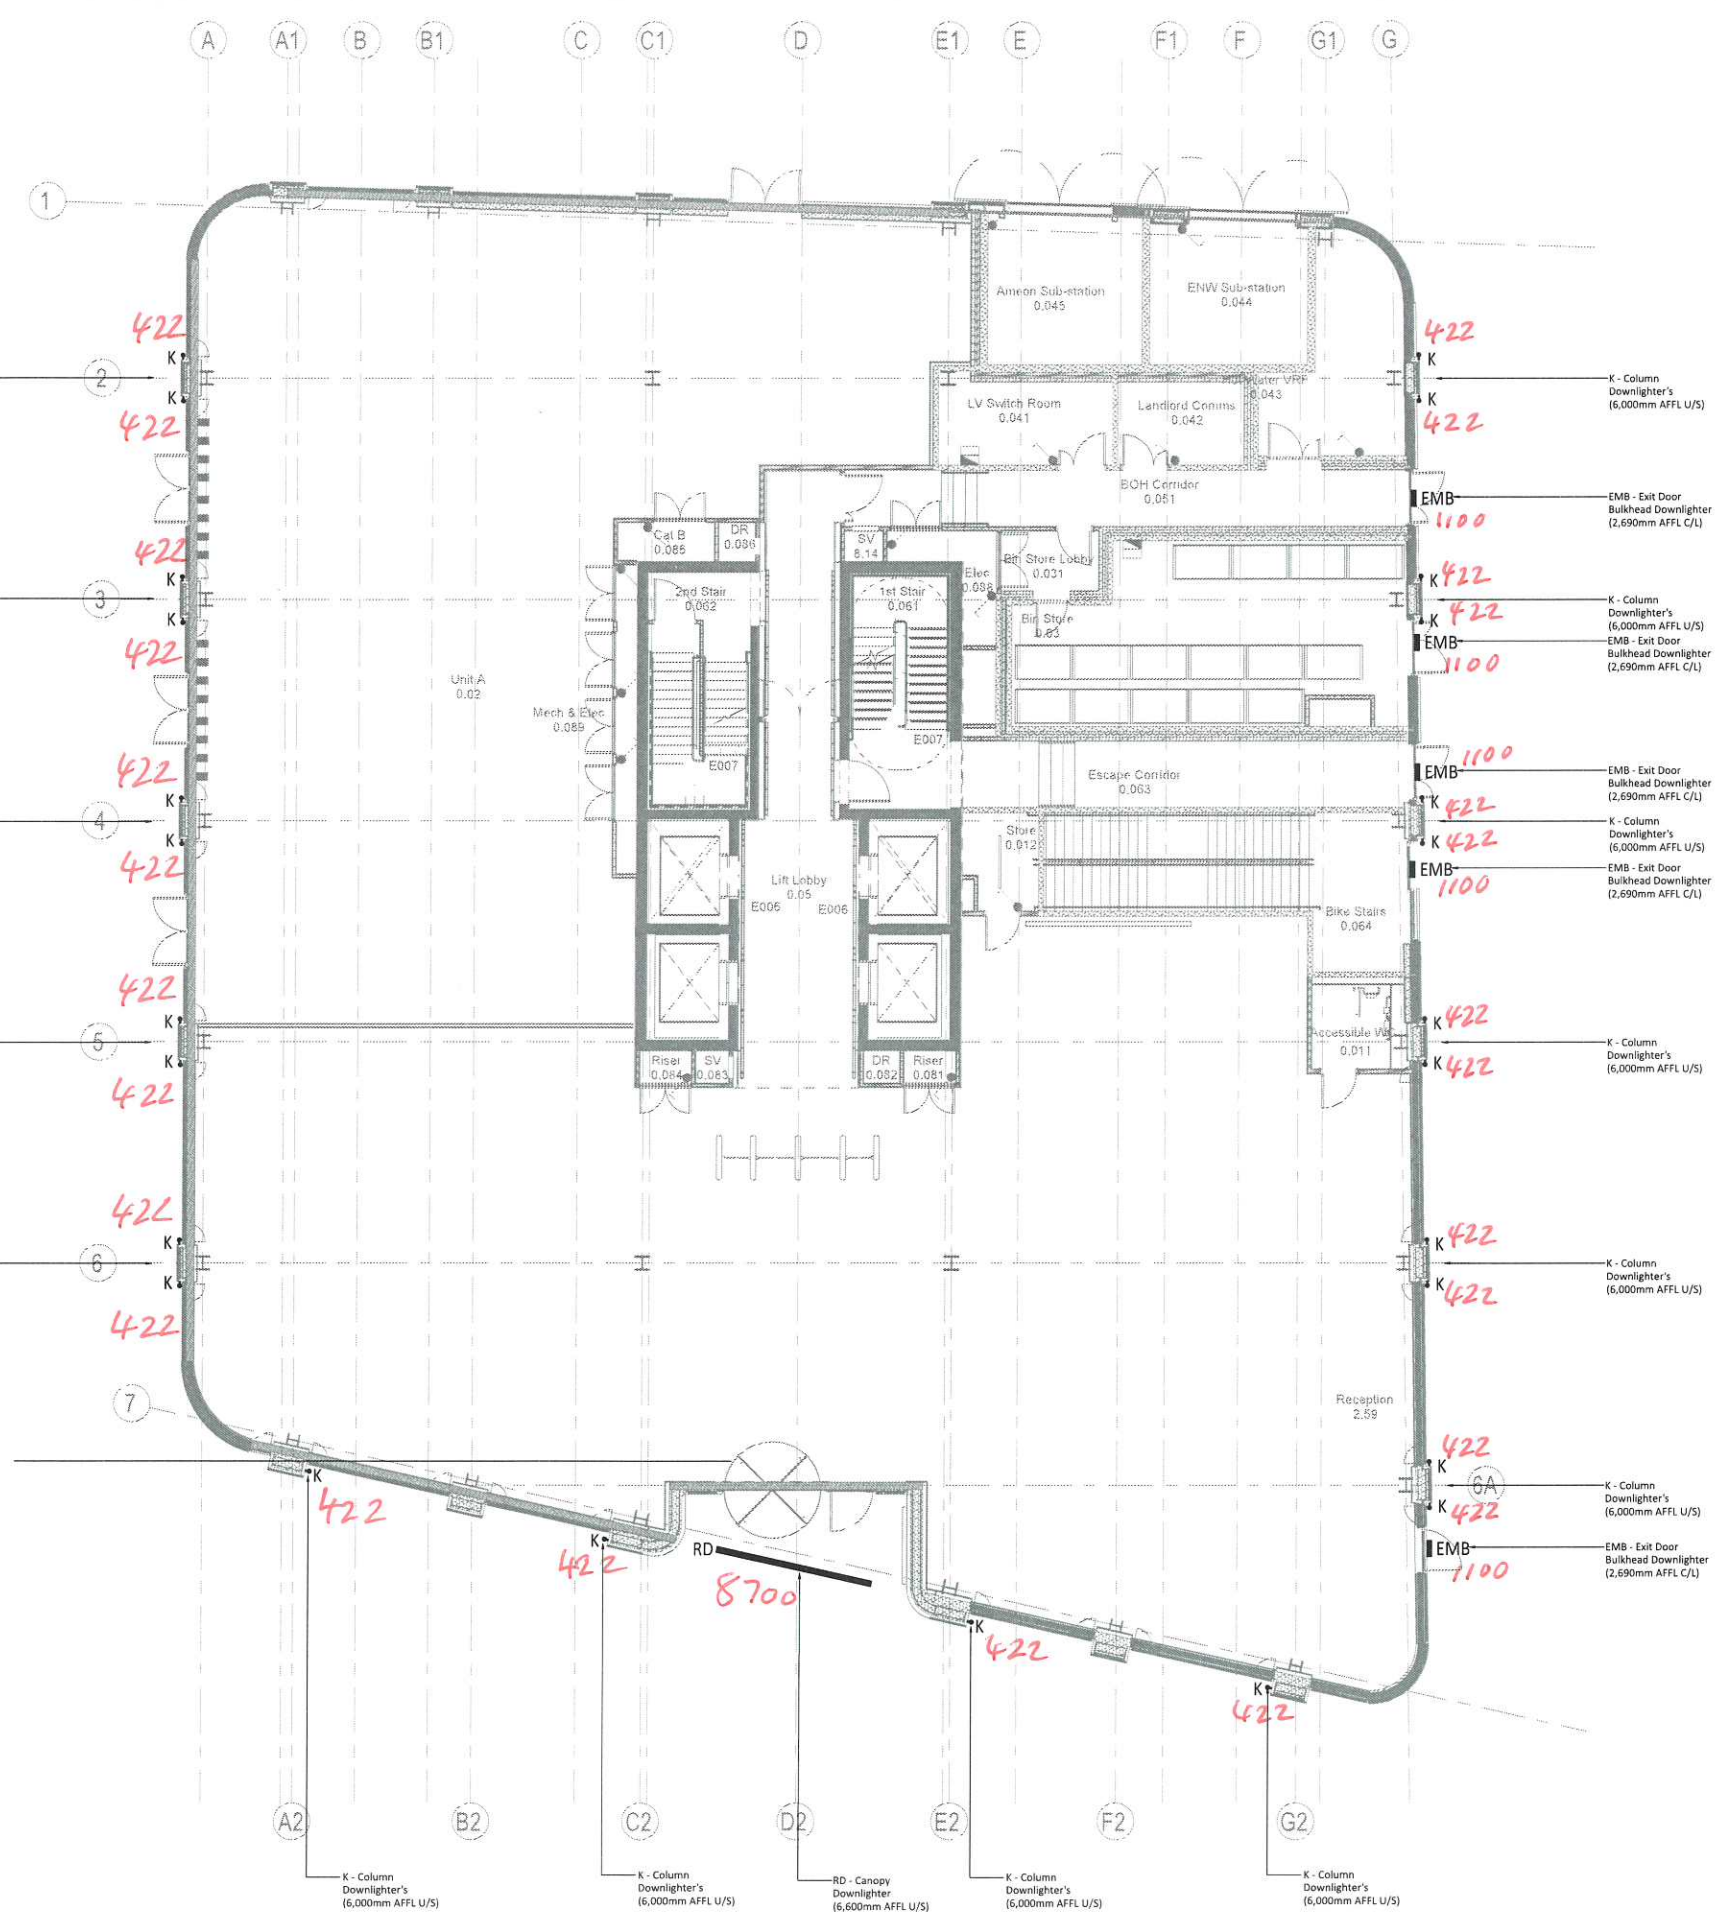

- LUMEN OUTPUT - 422 lumens

RD - Canopy Downlighter (6,600mm AFFL U/S)



- LUMEN OUTPUT - 8700 lumens

EMB - Exit Door Bulkhead Downlighter (2,690mm AFFL C/L)



- LUMEN OUTPUT - 1100 lumens



SAFETY, HEALTH & ENVIRONMENTAL INFORMATION

For details of site wide and general risks to be read in conjunction with these notes, refer to the following documents:

In addition to the hazards/risks normally associated with the types of work detailed on this drawing, note the following:  
Construction and Manufacture

Maintenance, Cleaning and Operation

Decommissioning and Demolition

It is assumed that all works associated with this drawing will be carried out by competent operatives working, where appropriate, to an approved method statement.



**NG Bailey**

7 Brown Lane West, Leeds LS12 6EH  
Tel: 0113 234 3443

Client:  
THE ISLAND SITE (General Partner) LIMITED

Contract:  
The Island Site

Design Manager:  
J Hall

Checked By:  
C McGrath

Title:  
External Lighting  
Level 00

Drawn By:  
T Marwood

Issue Date:  
24/07/23

Status:  
A1 - Approved & Accepted

Scale:  
1:100

Sheet Size:  
A1

Rev:  
C01



Drawing No:  
**TIS-NGB-ZZ-00-DR-E-6313**