FALLOWFIELD, UNIT 4 & UNIT 4A

ENERGY USAGE & SUSTAINABILITY STATEMENT

Client:

Lidl GB Ltd

Architect:

SMR

Revision	0	A	B	C
Remarks	First Issue.			
Date	28-09-2022			
Prepared by	A. Parry			
Signature				
Checked by	S. Ogden			
Signature				
Authorised by	S. Ogden			
Signature				
Project number	21-3761			
File Location	P:\Lidl - Stores\Construction\00 - Lidl TAS Models\Q TAS Fallowfield - T1500			

TABLE OF CONTENTS

1.00 EXECUTIVE SUMMARY 6

2.00 INTRODUCTION 10

2.01 Energy Statement Requirements 10

3.00 SITE LOCATION AND DESCRIPTION 11

4.00 PLANNING POLICIES & REFERENCE DOCUMENTS 12

4.01 National Planning Policy Framework (NPPF 2021) 12

4.02 Manchester's Local Development Framework, Core Strategy Development Plan Document, Adopted 11th July 2012 12

4.03 Building Regulations Approved Document Part L: 2021 14

5.00 ENERGY HIERACHY 16

6.00 ASSESSMENT METHODOLOGY & DYNAMIC SIMULATION SOFTWARE 17

6.01 Calculation Process 17

6.02 TAS Software 17

6.03 National Calculation Methodology 17

6.04 Building Geometry 19

7.00 'PART L' – BASELINE PREDICTED ENERGY USAGE 20

8.00 'BE LEAN' – PASSIVE & ACTIVE DESIGN STRATEGIES 21

8.01 Orientation and Site Location 21

8.02 Fabric Performance and Thermal Mass 22

8.03 Thermal Mass 22

8.04 Natural Ventilation 23

8.05 Mechanical Ventilation 23

8.06 Sub-Metering 23

8.07 Low Energy Lighting and Controls 23

8.08 Building Energy Performance 24

9.00 'BE CLEAN' – DECENTRALISED LOW CARBON TECHNOLOGIES 25

9.01 Combined Heat and Power (CHP) 25

9.02 Decentralised Energy Networks (DEN) 26

10.00 'BE GREEN' – LOW OR ZERO CARBON TECHNOLOGIES 28

10.01 Biomass Boiler 28

10.02 Solar Thermal 29

10.03 Air Source Heat Pump (ASHP) 30

10.04 Photovoltaics (PV) 31

11.00 'BE LEAN', 'BE CLEAN' AND 'BE GREEN' – PREDICTED ENERGY USAGE 32

12.00 CONCLUSION 33

APPENDIX A – PART L 2 SBEM INPUT SUMMARY 35

APPENDIX B – 'BE GREEN' BRUKL OUTPUT DOCUMENT 36

TABLE OF FIGURES

Figure 1 - Proposed P.V. Requirements.....7

Figure 2 - Notional Carbon Dioxide Emissions and Energy Consumption 8

Figure 3 - Actual Carbon Dioxide Emissions & Energy Consumption 8

Figure 4 - Site Context 11

Figure 5 - Energy Hierarchy 16

Figure 6 – Unit4 & Unit 4A Images Details Relationship with Wider Development..... 19

Figure 7 - Notion Carbon Dioxide Emissions & Energy Consumption 20

Figure 8 - Orientation & Sun Path Image..... 21

Figure 9 - U-value Comparison 22

Figure 10 -The Department for Business, Energy & Industrial Strategy Heat Density Map..... 26

Figure 11 - The Department for Business, Energy & Industrial Strategy Current District Heating Schemes 27

Figure 12 - Proposed P.V. Details 31

Figure 13 - Actual Carbon Dioxide Emissions & Energy Consumption 32

1.00 EXECUTIVE SUMMARY

DDA Consultant Engineers Ltd has been commissioned by Lidl GB Ltd to prepare an energy statement in support of the planning application for the proposed two number shell only lettable units located in Fallowfield. The anticipated use of each lettable units will be food and café units. These will be designed on a shell only basis.

The development is required to demonstrate:

- How the incorporation of passive design and energy efficient measures can contribute towards mitigating and adapting to climate change and reducing the development's carbon emissions and energy consumption.
- How the incorporation of good building design with a holistic approach to sustainability can enhance the development's sustainable credentials.
- How the incorporation of good building design with a holistic approach to sustainability can reduce the energy demand, carbon emissions and running costs.
- How the incorporation of passive and active design strategies can reduce the development's regulated emissions to the highest of standards, exceeding the minimum requirements of Part L Volume 2 2021 Building Regulations. Thus ensuring the minimum standards of Manchester's Local Development Framework, Core Strategy Development Plan Document, Policy EN 6 are met. Policy EN6 requires a 10% betterment over Part L 2010, or, where updates to part L exceeds this, then the relevant reduction under building regulations would apply.
- That carbon dioxide emissions associated with energy demand can be reduced in accordance with the energy hierarchy:

    a) Minimising energy requirements.
    b) Incorporating high efficiency systems and controls.
    c) Incorporating low or zero carbon energy sources.

This energy statement shows that:

- The developments incorporation of 'passive' design strategies will take advantage of:
    a) Natural daylighting thus, reducing dependency on electric lighting and the associated running costs and carbon emissions through natural contribution towards internal lighting requirements.
    b) Enhanced fabric efficiencies and thermal mass stabilise any temperature fluctuations within the building reducing heat gains and/or losses.

The incorporation of 'active' design strategies will take advantage of:

- Separate sub-metering to allow for all energy consumed to be monitored and any discrepancies to be easily identified and fixed thus minimising wasted energy.
- Low energy lighting with suitable controls provided.
- High efficiency HVAC systems with low specific fan powers and reduced energy consumption through suitable local control strategies.

Combined Heat and Power (CHP) and De-centralised Energy Network (DEN) solutions have been reviewed and considered unviable for this development due to:

- Unsuitable energy consumption profiles for CHP (require high domestic hot water (DWS) consumption). CHP systems are well suited for buildings that have all year demand for heat. They require predictable and relatively constant base load for optimum performance, which can be found in applications with high domestic hot water loads. The lettable units are expected to have a low hot water demand requirement with a limited number of hot water outlets, therefore, connection to CHP plant would not be deemed viable, due to the lack of thermal demand.
- No suitable DEN within the vicinity of the proposed development.

Alternative Low or Zero Carbon (LZC) technologies have been reviewed for each unit with the following deemed to be both viable and advisable:

- Air Source Heat Pumps, or Aero-thermal Heat Pumps.
- Photovoltaic Panels

Unit	Panel Array (m^2)	Panel Efficiency (%)	Incline (°)	Orientation (° from North)	Annual Output (kWh/Annum)
Unit 4	$10m^2$	21.3%	3.3°	105°	1,553.28kWh/annum
Unit 4a	$10m^2$	21.3%	3.3°	105°	1,553.28kWh/annum

Figure 1 - Proposed P.V. Requirements

The 'Baseline' site wide annual carbon emissions and energy consumption has been calculated as follows:

	Unit 4	Unit 4a
Unregulated Carbon Dioxide Emissions (kgCO2/annum)	2,117.97	1,990.08
Site Wide Total (kgCO2/annum)	**4,108.05 kgCO2/annum**	
Unregulated Energy Consumption (kWh/annum)	15,710.55	14,775.36
Site Wide Total (kWh/annum	**30,485.91 kWh/annum**	

Figure 2 - Notional Carbon Dioxide Emissions and Energy Consumption

The site wide 'Be Lean', 'Be Clean', 'Be Green' actual building annual carbon emissions and energy consumption has been calculated as follows:

	Unit 4	Unit 4a	Betterment over Baseline (%)
Unregulated Carbon Dioxide Emissions (kgCO2/annum)	2,066.46	1,986.24	**1.35%**
Site Wide Total (kgCO2/annum)	**4,052.70 kgCO2/annum**		
Unregulated Energy Consumption (kWh/annum)	14,738.93	14,124.48	**5.32%**
Site Wide Total (kWh/annum	**28,863.41 kWh/annum**		

Figure 3 - Actual Carbon Dioxide Emissions & Energy Consumption

The results show a **1.35%** carbon dioxide reduction and a **5.32%** energy reduction, when assessed to Part L Volume 2 2021 Building Regulations and accounting for the proposed passive, active and LZC strategies. Policy EN6 of Manchester's Core Strategy requires a 10% betterment over Part L 2010, or, where updates to part L exceeds this, then the relevant reduction under building regulations would apply. This development has been assessed under Part L 2021 which represents a 34.2% betterment over Part L 2010 Building Regulations. This being the case, provided the development achieves compliance with current Part L 2021, which this has, Policy EN6 can be deemed to have been met.

Furthermore, the introduction of roof mounted photovoltaic panels will provide an expected combined annual generation of 3,106.56kWh/annum. This represents >9% of the developments combined regulated energy consumption. It should be noted that the P.V. electrical generation may not correlate with the actual energy consumption profile, therefore, some of the on-site electrical energy generation may be exported back to the grid.

Note: This assessment is based on a 'Shell Only' development, therefore, the actual building services strategy and internal architectural layout is unknown. The inputs allowed for within the SBEM calculation, of which the results of this report are based, are made on realistic assumptions (refer to Appendix A for input assumptions). It will be the responsibility of the Fit-out team to ensure the actual development complies with all relevant national and regional planning requirements, building regulations and any other relevant standards. The actual performance of the Fit-out building will be subject to change as the detailed design stages progress.

2.00 INTRODUCTION

DDA Consultant Engineers Ltd has been commissioned by Lidl GB Ltd to prepare an energy statement in support of the planning application for the proposed two number shell only lettable units proposed for the new Fallowfield development.

The energy statement will demonstrate how the development will provide heating and power and meet the energy / carbon emission target set by national and local policy. The energy statement will demonstrate the design teams commitments to sustainable development and how they intend to reduce their annual carbon emissions and energy consumption through the utilisation of; good practice engineering, passive, and active strategies and Low or Zero Carbon (LZC) technologies.

The energy statement will demonstrate the design team's commitment to go above and beyond the requirements of Part L (Volume 2) 2021 minimum standards to ensure a high carbon reduction/off-set is achieved, as well as supply LZC technologies to contribute towards the annual regulated energy consumption.

2.01 Energy Statement Requirements

The objective of this report is to define and outline how the incorporation of sustainable building design, coupled with the incorporation of LZC technologies at an early stage of the design process can ensure compliance with relevant local and national planning policies, achieve building regulation compliance to a high standard and reduce the energy consumption, associated carbon emissions and running costs of a new build. The core design principals to be outlined within this report will be to:

- Reduce energy demand through the implementation of the energy hierarchy.
- Meet end-use energy demands efficiently and effectively.
- Supply LZC technologies to further reduce the development's energy demand, associated carbon emissions and utility costs.
- Enable effective energy management to ensure installed systems work to their maximum efficiencies.

The report will compare the energy usage and CO_2 emissions from a Notional Building (Building Regulation Part L Volume 2 2021 compliant) to that of the proposed building including energy efficiency measures, decentralised energy, and renewable energy systems (where appropriate).

3.00 SITE LOCATION AND DESCRIPTION

The site is located to the east of Birchfield Road and is surrounded by residential housing and commercial units.

As shown in Fig 1, the lettable units Unit 4 and Unit 4A is orientated with a heavily glazed façade facing north- and east. The emphasis on these orientations offer the advantage of natural daylighting contributions, whilst ensuring solar gains are managed, thus reducing both lighting loads and mechanical cooling loads. Further more, overheating risk is significantly reduced.

The site receives little over shading or overlooking, offering privacy to the development and maintained privacy to residential houses and commercial units surrounding the site.

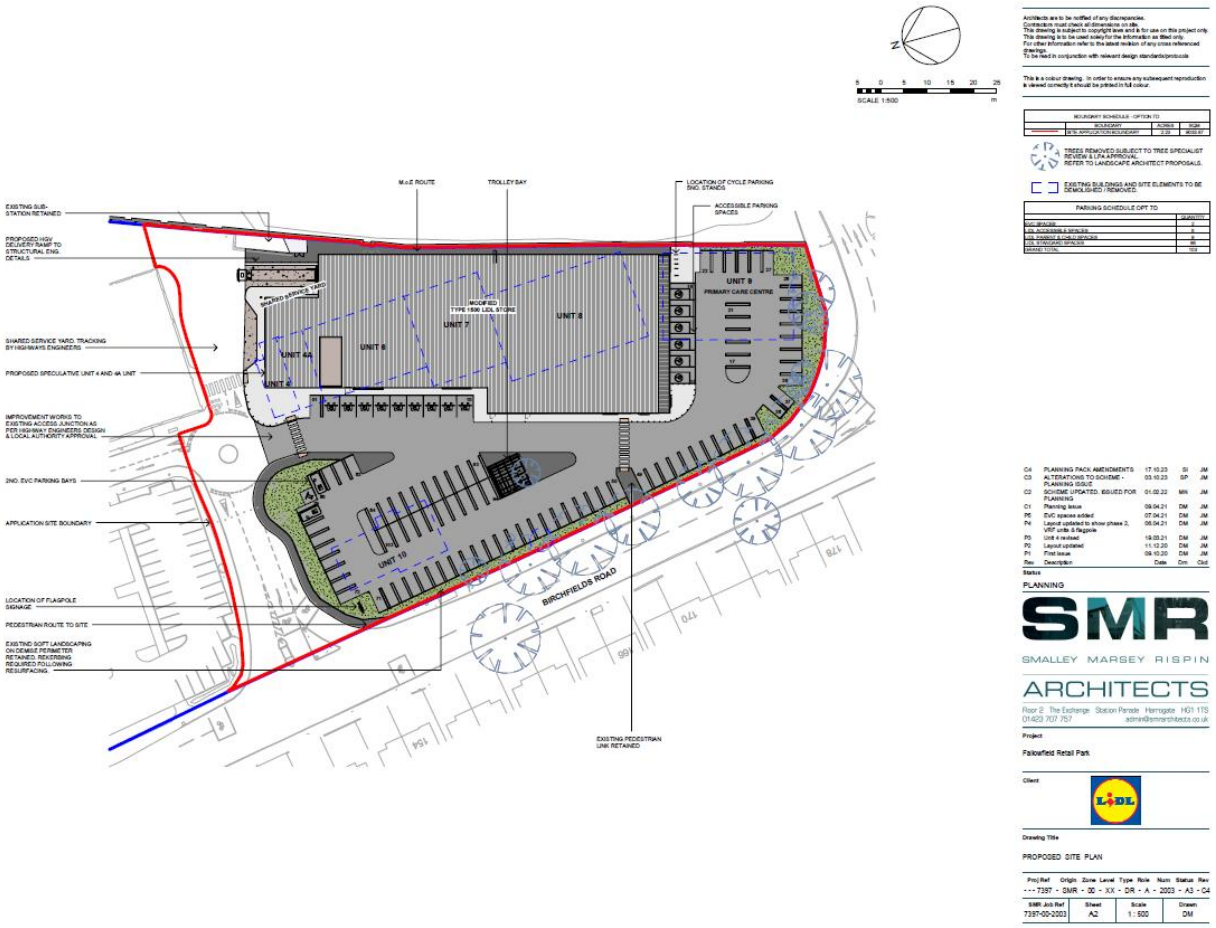

Figure 4 - Site Context

4.00 PLANNING POLICIES & REFERENCE DOCUMENTS

The following documents offer a review of the necessary planning policies and requirements to be adhered to, to ensure sustainable design standards are met and the relevant targets set by local and national authorities understood.

4.01 National Planning Policy Framework (NPPF 2021)

The National Planning Policy Framework (NPPF) sets out the Government's planning policies for England and how these are expected to be applied. Taken together, these policies articulate the Government's vision of sustainable development, which should be interpreted and applied locally to meet local aspirations. The ministerial foreword of this NPPF highlights that 'the purpose of planning is to contribute to the achievement of sustainable development' and that at the heart of the framework is a presumption in favour of sustainable development.

Sustainable development is defined in the NPPF as comprising developments "meeting the needs of the present without compromising the ability of future generations to meet their own needs" in line with the definition of the Brundtland Commission ('Our Common Future', 1987). The NPPF also refers to the three overarching objectives, which are interdependent and need to be pursued in mutually supportive ways – an economic objective, a social objective and an environmental objective.

4.02 Manchester's Local Development Framework, Core Strategy Development Plan Document, Adopted 11th July 2012

Policy EN 6

Target Framework for CO_2 reductions from low or zero carbon energy supplies

Applications for residential development of 10 or more units and all other development over 1,000 sq m will be expected as a minimum to meet the target shown in Tables 12.1 or 12.2, unless this can be shown not to be viable. This should be demonstrated through an energy statement, submitted as part of the Design and Access Statement. Such a statement will be expected to set out the projected regulated energy demand and associated CO_2 emissions for all phases of the development.

Developments smaller than the above threshold, but involving the erection of a building or substantial improvement to an existing building will also be expected to meet the minimum target, where viable, but will not be expected to submit an energy statement.

The target framework relates to three broad development locations and their potential for low and zero carbon, decentralised energy. The areas are defined as follows

- Target 1 Network development areas: Locations where the proximity of new and existing buildings, the mix of uses and density of development provide the right conditions to support district heating (and cooling).
- Target 2 Electricity intense areas: Locations where the predominant building type has an all electric fit-out such as retail units and leisure complexes.
- Target 3 Micro-generation areas: Locations where lower densities and a fragmented mix of uses tend to mean that only building scale solutions are practical.

Domestic CO_2 emissions reduction targets

Table 12.1

Target	% Minimum requirement
Target 1: Network development area	CHP/district heating anchor or connection or where not feasible a 15% increase on Part L 2010
Target 2: Electricity intense buildings	+15% increase on Part L 2010
Target 3: Micro generation area	+15%increase on Part L 2010

Non-domestic CO_2 emissions reduction targets

Table 12.2

Target	% Minimum requirement
Target 1: Network development area	CHP/district heating anchor or connection or where not feasible, a 15% increase on Part L 2010
Target 2: Electricity intense buildings (Applies to commercial uses with a high proportion of emissions from electricity use (>45 kg CO2/m2))	+10%increase on Part L 2010
Target 3: Micro generation area	+15% increase on Part L 2010

Where the CO_2 emissions reduction required under any future revision to Part L of the building regulations becomes greater than the '% Minimum requirement', the reduction required under building regulations would apply.

Where the Council identifies an 'allowable solution', for example within an energy proposals plan, that would produce higher carbon reductions at no extra cost than that of achieving the '% Minimum requirement' (or required under building regulations if greater) the higher percentage reduction will be required. The cost comparison is based on the cost of incorporating the 'allowable solution' at design stage.

The energy statement will be required to be submitted at the outset of any proposed development (outline application or before). Developers will be permitted to use green infrastructure elements such as green roofs, green walls, street trees and waterways to contribute to compliance with CO_2 mitigation, subject to the energy statement incorporating evidence such as modelling to demonstrate compliance.

Guidance on what the energy statement should contain and how to decide which target applies to a development proposal is given in Appendix A.

Policy EN6 of Manchester's Core Strategy requires a 10% betterment over Part L 2010, or, where updates to part L exceeds this, then the relevant reduction under building regulations would apply. This development has been assessed under Part L 2021 which represents a 34.2% betterment over Part L 2010 Building Regulations. This being the case, provided the development achieves compliance with current Part L 2021, Policy EN6 can be deemed to have been met.

4.03 Building Regulations Approved Document Part L: 2021

Part L of the current Building Regulations (2021) considers the reduction of carbon emissions in new and existing buildings. As the proposal consist of the creation of new non-domestic space it falls under Part L Volume 2 of the Regulations.

The overall structure of compliance with the 2021 Building Regulations for new buildings includes five criteria to comply with:

- Criterion 1 – The Building Emission Rate (BER) should be better than the Target Emission Rate (TER) and the Building Primary Energy Rate (BPER) should be better than the Target Primary Energy Rate (TPER).
- Criterion 2 - Limit on design flexibility.
- Criterion 3 - Limiting effects of heat gain in summer.

The energy strategy for the scheme has been developed to ensure the scheme meets the relevant requirements of the Building Regulations.

5.00 ENERGY HIERACHY

The Energy Statement has been prepared using the "fabric first" approach of the 'Be Lean', 'Be Clean', 'Be Green' Governmental energy hierarchy:

- **Be Lean** – reduce the need for energy.
- **Be Clean** – supply and use energy in the most efficient manner.
- **Be Green** – supply energy from renewable sources.

Figure 5 - Energy Hierarchy

Adhering to the principles of the Energy Hierarchy has several benefits:

- By reducing the energy requirement of the building, the potential renewable requirement shrinks in proportion. This has obvious cost benefits and will help reduce the building's energy requirements and carbon emissions for the lifespan of the development.
- The sustainable credentials of each development are enhanced and are not validated by simply bolting on expensive renewable equipment. By focusing on fabric performance and the provision of efficient heating systems each building is intrinsically "green".
- Provides reassurance to the end user the building is performing to its highest potential and all systems are working to their maximum efficiencies with minimal energy waste, thus reducing dependencies on natural resources (gas & electric) as well as minimising running costs.
- The incorporation of energy efficiency measures and a holistic approach to building design will ensure that the carbon emission from the building will be kept to a minimum.

6.00 ASSESSMENT METHODOLOGY & DYNAMIC SIMULATION SOFTWARE

6.01 Calculation Process

To detail the benefits of adhering to the energy hierarchy, we must first create a baseline to compare against. This is done using a Dynamic Simulation Modelling software tool which follows a set methodology for calculating the buildings carbon emissions and associated energy use. Dynamic Simulation Modelling (DSM), as used for Part L Building Regulations compliance, has been carried out using the EDSL TAS software, Version 9.5.5, in accordance with CIBSE AM11.

The TAS software has been deemed appropriate for this project, as it allows a single model to be used for all required analysis relating to the building energy performance regarding passive and active strategies, energy efficient mechanical and electrical systems, and LZC technologies.

6.02 TAS Software

TAS is a governmentally approved software capable of analysing multiple environmental credentials of a building. By creating a virtual environment where, geometric form, thermal mass, interaction with local weather & climate, fabric performance, energy consumption and carbon emissions are analysed, different design strategy characteristics and benefits can be assessed and discounted (where necessary).

The TAS software analyses two buildings in parallel with each other, the first representing the notional building as defined by the National Calculation Method (NCM), and the second the building as proposed. The difference in CO_2 emissions and energy consumption between the models represents the CO_2 reduction achieved by the proposed low energy and low carbon design.

By modelling each area to be analysed, and inputting a series of parameters, the software can give projected annual loadings for heating and cooling requirements, carry out Part L2 compliance checks through the SBEM tool as well as multiple other dynamic simulations.

6.03 National Calculation Methodology

The National Calculation Method (NCM) is the methodology used for demonstrating compliance with Part L of the Building Regulations for buildings other than dwellings. Annual energy use and associated emissions for a proposed building are calculated and compared with the energy use and emissions of a comparable notional building. Both calculations make use of standard sets of data for different activity areas (internal conditions) and common databases are used to calculate emission factors, weather data, and set variables of construction and service elements.

The NCM allows the actual calculation to be carried out either by an approved simulation software or by a simplified tool. For this report, the building has been assessed using the Dynamic Simulation Software, TAS.

6.03.1 Weather Data

External weather conditions and variables must be considered within the Dynamic Simulation software.

The UK Meteorological Office (MO) collects and analyses weather data across the UK. They account for multiple climate variables such as wind speed and direction, air pressure, relative humidity, air temperature etc. across 14 locations. The weather data variables are broken into two types of weather files: Design Summer Year (DSY) and Test Reference Year (TRY)

Design Summer Year (DSY): This set of data represents a warmer than typical year and is used when calculating maximum resultant temperatures, cooling loads, TM52 calculations etc. as it will give a worst-case scenario with regards to UK temperatures.

Test Reference Year (TRY): This set of data represents a typical/average year and is used for calculating average energy uses within buildings for steady state calculations and for Part L compliance.

For the purposes of this report, the Test Reference Year (TRY) has been used to calculate the development's energy and carbon emissions and compliance with Part L2.

6.03.2 Internal Conditions

To determine the energy requirement of each zone, internal conditions are assigned to all relevant areas. An internal condition details the conditions to which each zone will be maintained and accounts for parameters such as occupancy gains, equipment gains, lighting, infiltration and ventilation, upper and lower temperatures. The NCM calculation methodology has pre-defined internal conditions which must be used to ensure consistent Part L2 calculations.

6.04 Building Geometry

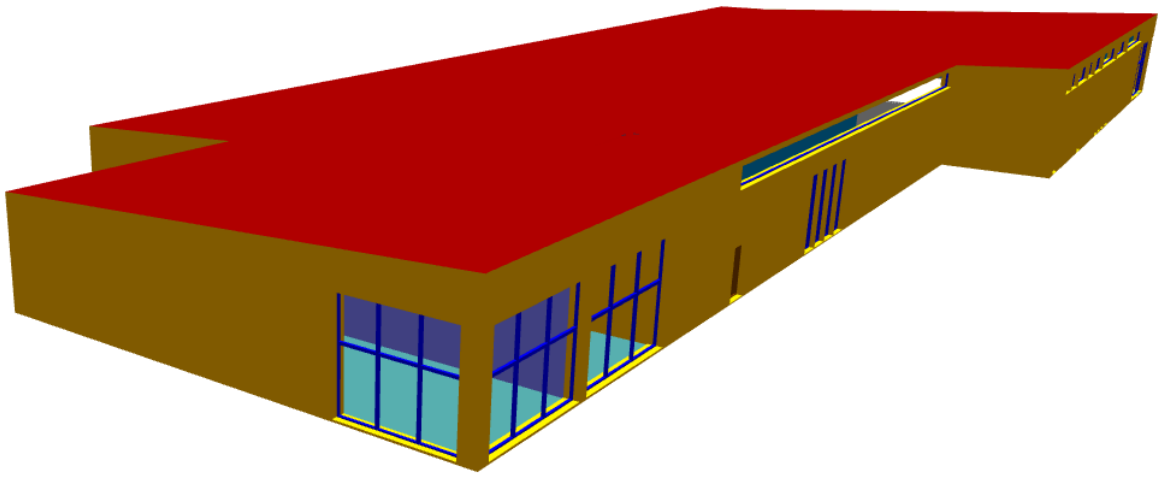

Figure 6 – Unit4 & Unit 4A Images Details Relationship with Wider Development

7.00 'PART L' – BASELINE PREDICTED ENERGY USAGE

The baseline against which each step of the energy hierarchy will be compared is the 'yard stick' determined by the Part L 2021 notional building.

The following section details the carbon emissions and annual energy consumption of the notional building. This offers a baseline for comparison which will be bettered by the actual design proposals put forward in this report.

	Unit 4	Unit 4a
Unregulated Carbon Dioxide Emissions (kgCO2/annum)	2,117.97	1,990.08
Site Wide Total (kgCO2/annum)	**4,108.05 kgCO2/annum**	
Unregulated Energy Consumption (kWh/annum)	15,710.55	14,775.36
Site Wide Total (kWh/annum	**30,485.91 kWh/annum**	

Figure 7 - Notion Carbon Dioxide Emissions & Energy Consumption

8.00 'BE LEAN' – PASSIVE & ACTIVE DESIGN STRATEGIES

This section of the report describes the passive and active energy reduction features which have been considered and incorporated into the design. These constitute the 'Lean' measures.

8.01 Orientation and Site Location

The proposed lettable unit 4 and unit 4a is located to the east of Birchfield Road and is surrounded by residential housing and commercial units.

The lettable units Unit 4 and Unit 4A is orientated with a heavily glazed façade facing north-and east. The emphasis on these orientations offer the advantage of natural daylighting contributions, whilst ensuring solar gains are managed, thus reducing both lighting loads and mechanical cooling loads. Further more, overheating risk is significantly reduced.

The site receives little over shading or overlooking, offering privacy to the development and maintained privacy to residential houses and commercial units surrounding the site.

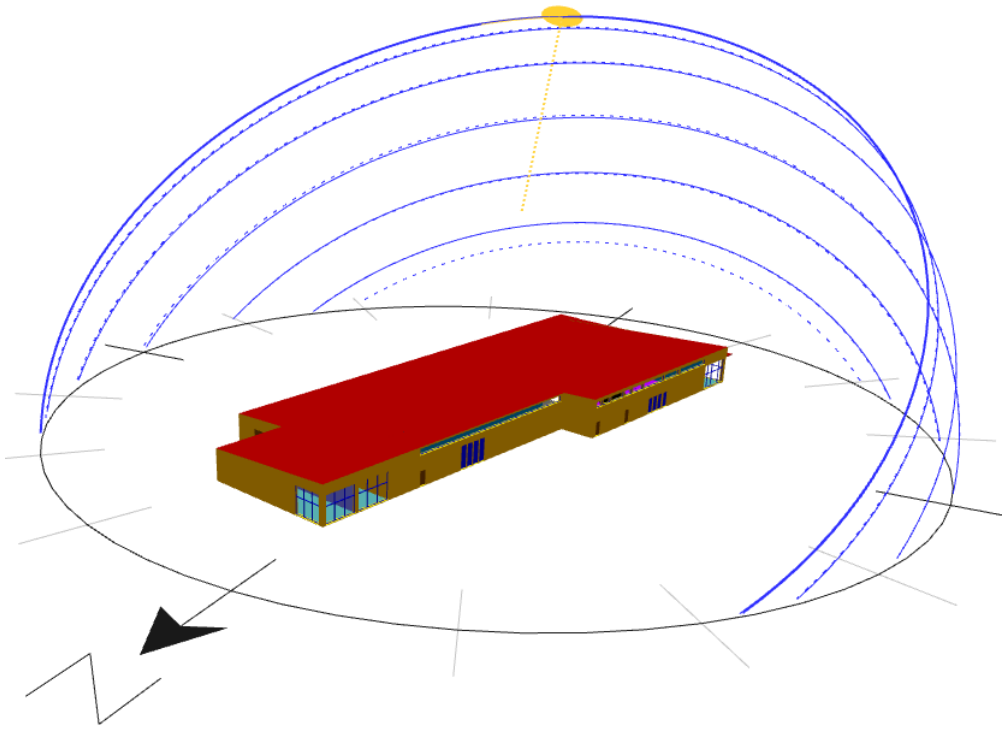

Figure 8 - Orientation & Sun Path Image

8.02 Fabric Performance and Thermal Mass

Focusing on the fabric thermal performance, ensures the building has reduced conductive heat loss during winter months and reduced conductive heat gains during summer months. This allows the internal environmental conditions to be better managed with reduced reliance on mechanical systems. This will in turn reduce energy demand, running cost and emissions whilst offering enhanced occupancy satisfaction.

With enhanced glazing properties, solar penetration is controlled reducing the potential for excess solar gains, as well as excessive levels of heat loss during winter months. The design team will specify a high-performance glazing system which significantly betters the minimum standards of Part L2 to minimise the heat loss and enhance the insulation properties, whilst minimising solar gains to avoid overheating.

The following table details the anticipated fabric efficiency standards to be incorporated into the design. The values are yet to be confirmed by the developer, however, represent the minimum performance standards to be achieved.

Exposed element	New Part L2 2021 Minimum Standards
Roofs	0.16 W/m^{2}K
Walls	0.26 W/m^{2}K
Ground Floors	0.18 W/m^{2}K
Windows	1.36 W/m^{2}K (G-value 0.4)
High usage entrance door	1.60 W/m^{2}K (G-value 0.4)
Air Permeability	4m^3/m^2 Hr @ 50Pa

Figure 9 - U-value Comparison

By ensuring the fabric thermal performance meets the minimum standards required by Part L ensures the development will have reduced heat loss / gains, thus reducing energy consumption. The thermal performance values ensure the optimum building standards with minimal heating / cooling loads. This demonstrates the design team's commitment to going above and beyond to ensure a sustainable development.

8.03 Thermal Mass

The concrete floor slab of the proposed development has been specified to give a relatively high thermal mass which will assist in reducing internal temperature fluctuations due to external temperature variations, to give

a more easily controlled environment inside the building. The building would be considered to have low to medium thermal mass.

8.04 Natural Ventilation

Due to the anticipated function of the development, a natural ventilation strategy is not deemed suitable. A form of mechanical ventilation will be required to ensure occupancy fresh air requirements are met and any moisture created from cooking is removed.

8.05 Mechanical Ventilation

It is expected that a mechanical ventilation with heat recovery system will be provided to each unit. This will provide fresh air into the space at a tempered supply temperature by extracting heat frome the exhaust air. This will reduce mechanical cooling loads whilst maintaining high fresh air standards and occupancy comfort.

8.05.1 Low Energy Fans

Low energy fans will be used with specific fan powers as good as or better than the limiting efficiencies detailed in *Approved Document Part L2, Table 6.9, Maximum specific fan power (SFP) in air distribution systems in new and existing buildings.*

8.05.2 Variable Speed Drives

Variable speed drives will be used to ensure fans operate no faster than required, thereby reducing energy consumption.

8.06 Sub-Metering

Separate sub-metering will be installed. This has obvious financial and sustainable benefits, allowing for financial verification with regards to consumption vs cost as well as allowing for consumption figures to be monitored and any out-of-range values easily identified, and energy wastage eliminated.

8.07 Low Energy Lighting and Controls

A high proportion of glazing will significantly reduce the dependences and output requirements on electric lighting offering reduced energy demand and carbon emissions and enhanced occupancy comfort.

LED lamps will be provided throughout, both for internal spaces and the external car park. LED lamps have a very low energy consumption and have a life expectancy exceeding that of conventional light bulbs. This reduces both energy use and waste.

The main area will be provided with photo electric dimming controls. This ensures internal lux levels are achieved with a reduced reliance on electrical means, thus reducing energy consumption.

8.08 Building Energy Performance

All the above systems will be designed in accordance with the 'Non-Domestic Building Services Compliance Guide', CIBSE recommendations and relevant British Standards. The incorporation of 'Good Practice' engineering design coupled with the provision of renewable systems (described below) will ensure that an energy efficient development is achieved, minimising the energy consumption and associated CO2 emissions through its life cycle.

9.00 'BE CLEAN' – DECENTRALISED LOW CARBON TECHNOLOGIES

A low or zero carbon technology is defined as something which either; produces energy through an endless, renewable source with low or zero carbon emission throughout its operation, or one in which uses a specific energy source i.e., electricity and provides a significantly higher output to input ratio.

Detailed below are the types of low or zero carbon technologies considered for implementation on this development. A series of centralised and decentralised systems have been analysed and viability stated to offer justification for use or omission.

9.01 Combined Heat and Power (CHP)

Combined Heat and Power (CHP) is the on-site generation of electricity and the recovery of the normally wasted heat produced during this process.

- The operation of CHP plant can offer significant CO_2 emission rate reductions when compared to conventional methods of energy generation and use.
- Most large conventional power stations currently generate electricity at 30-50% efficiency (due to waste heat and transmission/distribution loss).
- 'Good quality' CHP schemes achieve overall efficiencies of 70-85% by making use of waste heat and eliminating transmission losses.

The efficient use of CHP typically depends on finding a use for the heat generated by the process. Issues to consider include:

- If heat is not used, then the system is effectively just an electricity generator and electricity will be greener and cheaper if sourced from the national grid.
- If excess electricity is generated on site this can be exported (sold) back to the grid whereas excess heat needs to be rejected (wasted). Exported electricity can count towards reducing the site's CO_2 emissions.
- Exported electricity will typically not be financially attractive as exports tend to coincide with low demand periods on the national grid. The cost of producing the electricity on site can be less than the prices received for the exported electricity.

9.01.1 Viability

The introduction of a CHP unit will reduce running costs and carbon dioxide emissions associated with the operation of the building when compared to employing a conventional generator and/or boiler. However, the CHP plant should always operate as the lead heat source to maximise savings.

CHP systems require steady, constant loads all year round for best performance, with high running hours. This type of running schedule will usually be found in applications with high domestic hot water loads such as hotels, hospitals, care homes etc. These developments are not expected to have a suitable hot water demand due to the size of them and therefore a CHP plant would not be deemed viable due to the lengthy amount of the year where the CHP engine would be sitting idle due to lack of thermal demand.

It can therefore be concluded that the possibility of introducing a combined heat and power system is both un-sustainable and un-economically viable on this project.

9.02 Decentralised Energy Networks (DEN)

9.02.1 Heat Density

Based on the heat density map below from The Department for Business, Energy and Industrial Strategy, the surrounding area has a moderate heat density around the site and associated with the local area. Much of the associated heat density is residential or small scale industrial heat load. The low heat density associated with commercial units renders the possibilities of introducing a district heating network to the area low due to the high cost and low return potential.

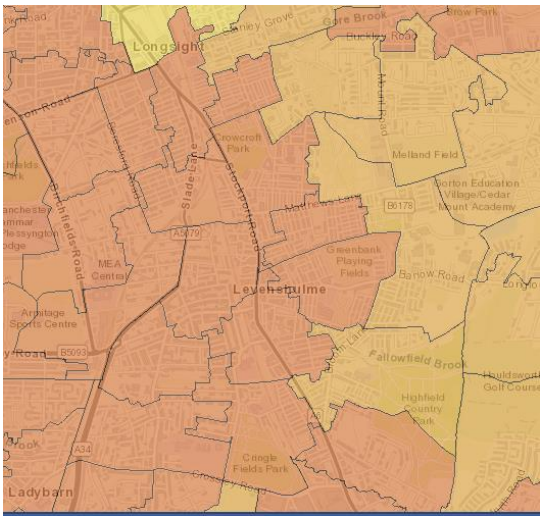

Figure 10 -The Department for Business, Energy & Industrial Strategy Heat Density Map

9.02.2 Existing Networks

The below map from The Department for Business, Energy and Industrial Strategy shows there are no current district heating schemes within the area.

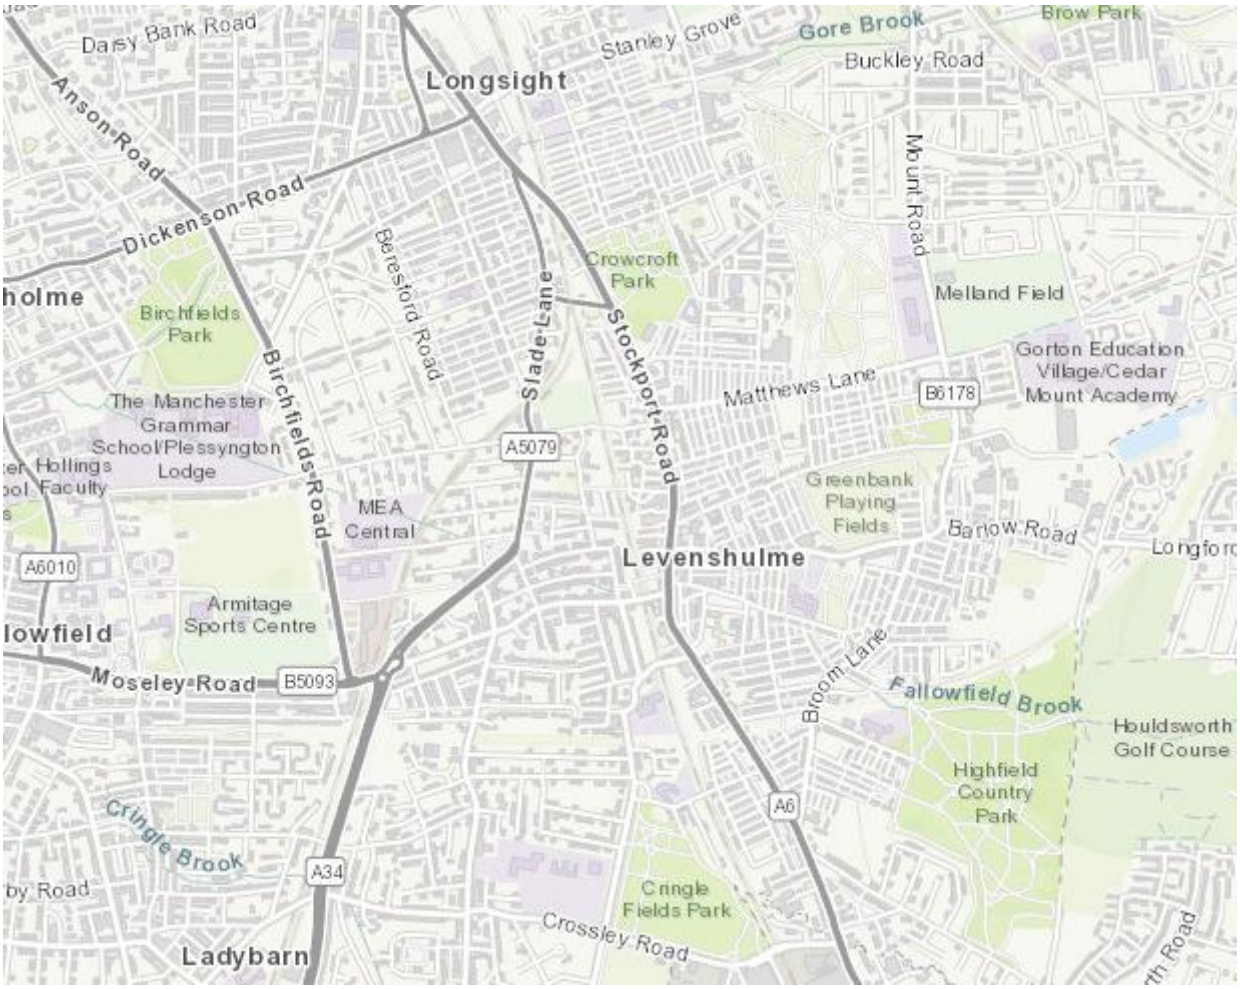

Figure 11 - The Department for Business, Energy & Industrial Strategy Current District Heating Schemes

9.02.3 Viability

As detailed in the above Heat Map, there are no current district heating networks, so the building services design strategy cannot be focused on the connection to a decentralised system.

10.00 'BE GREEN' – LOW OR ZERO CARBON TECHNOLOGIES

A low or zero carbon technology is defined as something which either; produces energy through an endless, renewable source with low or zero carbon emission throughout its operation, or one which uses a specific energy source i.e., electricity and provides a significantly higher output to input ratio.

Due to the unviable incorporation of Combined Heat and Power (CHP), and current lack of existing district heating networks, the development will be required to incorporate "Individual building renewable systems" to ensure compliance with local and national planning requirements.

10.01 Biomass Boiler

Biomass in the form of logs, wood chips and wood pellets are classified as a low carbon source of energy because the carbon dioxide emitted when the biomass is burned has been taken out of the atmosphere by the growing plants, even allowing for emissions of carbon dioxide in planting, harvesting, processing, and transporting the fuel. Replacing fossil fuel with biomass fuel will typically reduce net CO_2 emissions by over 90%.

Wood fuel efficiencies vary enormously due to several factors including the moisture content of the fuel. Fuels with high moisture content requires more energy to be combusted as it must first dry out before it can be converted to energy. This emphasises the need for good quality onsite storage facilities and a good quality fuel supply.

Wood fuels also have varying calorific value. A high calorific value refers to the amount of energy the wood contains compared to waste products such as bark, which can form ash as a by-product.

Biomass boilers are unsuitable for applications that have large fluctuations in thermal loads, unless a large heat sink or buffer vessel is used.

Unlike most other renewable energy sources, biomass can be stored and used on demand to give controllable energy. It is therefore free from the problem of intermittency, which affects both solar and wind technologies. However, unlike wind and solar, biomass energy is not "free" and so a reliable, sustainably managed, and cost-effective source of biomass needs to be secured.

10.01.1 Fuel delivery & fuel storage:

Fuel storage and regular supply is key for efficient running of Biomass boilers. Biomass fuel will absorb moisture if exposed to it and can biodegrade if not kept dry, therefore, the store must be well maintained to prevent contact between moisture and pellets. The storage facility must also allow for easy access to ensure deliveries can be made efficiently. A larger storage facility will allow for less frequent deliveries and more reserve in case of delays. The National Biofuel Supply Database shows there are several suppliers within a reasonable radius of the site.

10.01.2 Viability

This technology can provide the development with significant savings for a relatively low cost however, an overriding reason against using a biomass system is the space restrictions on this site and the lack of available space for the storage and delivery of the fuel. In addition to this, the high NO_x emissions, and particle content of the exhaust gases from typical small-scale biomass units may raise objections from the Environmental Agency and planning department.

Considering this, biomass boilers are considered not to be a viable option for the proposed development.

10.02 Solar Thermal

Solar thermal collectors utilise solar radiation to heat water for use in water heating of a building. The radiation is converted using a solar collector, of which there are two main types available: Flat Plate and Evacuated Tube collectors. Evacuated tube systems occupy a smaller area and are more efficient, but also generally more expensive. Flat plate systems are cheaper to install but generally less efficient.

The solar coverage indicates the percentage of the annual domestic hot water energy requirement that can be covered by a solar water heating system. The higher the solar coverage, the more conventional energy usage can be offset, but this can cause excess heat generation in the peak summer months and generally lower the average collector efficiency. Therefore, solar coverages of 40-70% are recommended for domestic applications and up to 40% in non-domestic buildings.

Solar thermal systems in the UK normally operate with a backup fuel source, such as gas or electricity. The solar system pre-heats the water up to a maximum hot water temperature. If there is not enough solar power available to fully meet the required hot water load, then the backup fuel system fires up to meet this short fall.

The optimum orientation for a solar collector in the UK is a south facing surface, tilted at an angle of 30º from the horizontal.

For the solar water heating system to run safely and efficiently, a series of temperature sensors are connected to a digital solar controller to switch the system on or off according to the solar energy available.

10.02.1 Viability

Solar thermal panels are suited to buildings with a high and consistent hot water demand. This development is expected to have a relatively low hot water demand and therefore, a solar thermal array would not be deemed viable or cost effective.

10.03 Air Source Heat Pump (ASHP)

Air source heat pumps exchange heat between the outside air and a building to provide space heating in winter and cooling in the summer months. The efficiency of these systems is inherently linked to the ambient air temperatures. Air source heat pumps operate best in environments with long, mild, mid-season periods, as the heating efficiency drops at lower ambient temperature in winter.

Unlike some other sources of renewable energy, heat pumps do require electricity to pump and compress refrigerants through the system. However, heat pumps supply more energy than they consume, by extracting heat from their surroundings. Heat pump systems can supply as much as 4kW of thermal energy for just 1kW of electrical energy input, which is why they are recognised as a renewable technology under the Renewable Energy Directive 2009/28/EU.

10.03.1 Viability

ASHP's have been deemed a suitable way of offering space heating and cooling to the development.

Actual units are yet to be selected which will be determined at the detailed design stage. However, for the purposes of this report, the following system efficiencies can be expected:

- Seasonal Coefficient of Performance: 4.50
- Seasonal Energy Efficiency Ratio: 7.00

The efficiencies detailed above exceed minimum national standards, ensuring the heating and cooling provided is of the highest standards available on the market for the selected type of Air Source Heat Pump.

10.04 Photovoltaics (PV)

Photovoltaic solar cells convert solar energy directly into electricity. The cells consist of two layers of silicon with a chemical layer between. The incoming solar energy charges the electrons held within the chemical. The energised electrons move through the cell into a wire creating an electrical current.

A range of Photovoltaic products and colours are available, varying in efficiency and cost. These include Monocrystalline, Polycrystalline, Thin Film and Hybrid Panels. Hybrid Panels are the most energy efficient and Thin Film the least.

All the above technologies can be installed in roof and wall mounted arrays or as integrated building members, giving the additional benefit of offsetting the cost of other construction materials, such as weatherproof roof membranes or integrated into glazed wall constructions.

10.04.1 Viability

Photovoltaic panels have been deemed a suitable way of offering significant on-site energy generation to reduce the requirement for imported electrical energy. P.V. panels will be incorporated into the building services strategy for each unit:

Unit	Panel Array (m^2)	Panel Efficiency (%)	Incline (°)	Orientation (° from North)	Annual Output (kWh/Annum)
Unit 4	$10m^2$	21.3%	3.3°	105°	1,553.28kWh/annum
Unit 4a	$10m^2$	21.3%	3.3°	105°	1,553.28kWh/annum

Figure 12 - Proposed P.V. Details

11.00 'BE LEAN', 'BE CLEAN' AND 'BE GREEN' – PREDICTED ENERGY USAGE

The following section details the predicted annual carbon emissions and energy consumption based on the TAS model of the building once all passive and active design strategies detailed in section 8.00, 9.00 and 10.00 have been allowed for.

	Unit 4	Unit 4a	Betterment over Baseline (%)
Unregulated Carbon Dioxide Emissions (kgCO2/annum)	2,066.46	1,986.24	**1.35%**
Site Wide Total (kgCO2/annum)	**4,052.70 kgCO2/annum**		
Unregulated Energy Consumption (kWh/annum)	14,738.93	14,124.48	**5.32%**
Site Wide Total (kWh/annum	**28,863.41 kWh/annum**		

Figure 13 - Actual Carbon Dioxide Emissions & Energy Consumption

Figure 10 above shows an annual site carbon dioxide emission of 4,052.70kgCO2/annum and a site wide energy consumption requirement of 28,863.417kWh/year of (accounting for P.V. contribution). This shows an annual reduction over the baseline detailed under section 7.0 respectively of 1.35% and 5.32%.

The renewable technology energy generation contribution is expected to be, 3,106.56kWh/annum. This represents more than 9% of the anticipated annual energy consumption. It should be noted, the energy consumption profile may not correlate with the on-site energy generation, therefore, some of the electrical energy generated by the P.V. panels may be sent back to the grid, not used on site.

12.00 CONCLUSION

The energy statement has demonstrated the proposed two lettable units located on the proposed wider multi-use development at Fallowfield will:

Incorporate passive design strategies to take advantage of:

- Natural daylighting through careful building and glazing orientation. This will offer a reduced dependency on electric lighting through the contribution of natural lighting to achieve the required Lux levels.
- Enhanced fabric efficiencies and thermal mass have been allowed for to help stabilise any temperature fluctuations within the building reducing heat gains and/or losses.

Incorporate active design strategies to reduce energy consumption by:

- Introduce separate sub-metering to allow for all energy consumed to be monitored and any discrepancies easily identified and fixed thus minimising wasted energy.
- Low energy lighting will be installed with suitable controls to ensure lights are not left on unnecessarily. Suitable controls will eliminate human error.
- High efficiency HVAC systems with low specific fan powers and reduced energy consumption through suitable local control strategies.

The Part L2 2021 site wide baseline annual carbon emissions and energy consumption has been calculated as follows:

- Regulated Annual Carbon Dioxide Emissions: **4,108.05kgCO_2/annum.**
- Regulated Annual Energy Consumption: **30,485.91kWh/annum.**

Combined Heat and Power and De-centralised Energy Network (DEN) solutions have been reviewed and discounted to be unviable for this development due to:

- Unsuitable energy consumption profiles for CHP (require high DWS consumption).
- No suitable De-centralised Energy Networks (DEN) in the vicinity of the development.

Alternative Low or Zero Carbon (LZC) technologies have been analysed with the following deemed to be both viable and advisable:

- Air Source Heat Pumps, or Aero-thermal Heat Pumps.

- Photovoltaic Panels

Unit	Panel Array (m^2)	Panel Efficiency (%)	Incline (°)	Orientation (° from North)	Annual Output (kWh/Annum)
Unit 4	$12m^2$	21.3%	3.3°	105°	1,819.20kWh/annum
Unit 4a	$12m^2$	21.3%	3.3°	105°	1,819.20kWh/annum

The 'Be Green' actual building annual carbon emissions and energy consumption has been calculated as follows:

- Regulated Annual Carbon Dioxide Emissions: **4,052.70kgCO_2/annum.**
- Regulated Annual Energy Consumption: **28,863.41kWh/annum.**

These show a **1.35%** carbon dioxide saving and a **5.32%** energy saving, when assessed to Part L2 2021 Building Regulations and accounting for the proposed passive, active and LZC strategies. Policy EN6 of Manchester's Core Strategy requires a 10% betterment over Part L 2010, or, where updates to part L exceeds this, then the relevant reduction under building regulations would apply. This development has been assessed under Part L 2021 which represents a 34.2% betterment over Part L 2010 Building Regulations. This being the case, provided the development achieves compliance with current Part L 2021, which this has, Policy EN6 can be deemed to have been met.

The expected annual energy generation through low and / or zero carbon technologies will be 3,106.56kWh/annum. This represents >9% of the anticipated annual energy consumption. It should be noted that the P.V. electrical generation may not correlate with the energy consumption profile, therefore, some of the on-site electrical energy generation may be exported back to the grid.

Note: This assessment is based on a 'Shell Only development, therefore, the actual building services strategy and internal architectural layout is unknown. The inputs allowed for within the SBEM calculation, of which the results of this report are based, are made on realistic assumptions (refer to Appendix A for input assumptions). It will be the responsibility of the Fit-out team to ensure the actual development complies with all relevant national and regional planning requirements, building regulations and any other relevant standards. The actual performance of the Fit-out building will be subject to change as the detailed design stages progress.

APPENDIX A – PART L 2 SBEM INPUT SUMMARY

Unit 4 & Unit 4A, Fallowfield
SBEM Input Summary
Date: 27.10.23
Rev: 0

Drawings

- Floor Plans: 7397-SMR-00-ZZ-DR-A-2004-A3-C3
- Elevations: 7397-SMR-00-ZZ-DR-A-2006-A3-C3 - Proposed Elevations
- Site Plan: 7397-SMR-00-ZZ-DR-A-2003-A3-C4 - Proposed Site Plan

U-values and Fabric Performance

Element	U-value
External Wall	0.22W/m²K
Ground Floor	0.18W/m²K
Roof	0.16W/m²K (Flat Roof)
Glazing	1.34W/m²K (Inc. Frame) – G-value: 0.40
Glazed Doors	1.74W/m²K (Inc. Frame) – G-value: 0.40
Personnel Doors	1.60W/m²K
Air Permeability	54m³/m²Hr @ 50Pa
Thermal Bridging	Accredited

The values detailed above for the assumed fabric performance are based on the limiting values detailed in table 4.1 of Approved Document Part L Volume 2 2021.

Building Services

Is Mains Gas Available?	No
Light Metering with warnings about out-of-range values?	No
Electricity Power Factor	<0.90

Lighting Parameters

Zone	Efficacy (Lumens/Circuit Watt)	Presence Detection	Daylight Control	Back Space Sensor	Photocell Sensor on Time Clock	Maintenance Factor	Design Room Illuminance	Display lighting (Lumens/Circuit Watt)
Unit 4	120	Aon / AOff	PEC - Dim	Yes	Yes	0.8	200	
Unit 4A	120	Aon / AOff	PEC - Dim	Yes	Yes	0.8	200	

HVAC Systems

DX Split with Extract	
System Description	Space heating and cooling via DX split Air Source Heat Pumps. Ventilation via mechanical ventilation with heat recovery.
Heat Exchanger:	Plate - 75%
Specific fan Power	0.75W/l/s – Supply, 0.75W/l/s –Extract
Heating System:	DX Split ASHP
Cooling System:	DX Split ASHP
Domestic Hot Water:	Electric Water Heater
Zones Served:	Unit 4 & Unit 4a

Heating Systems

System	Distribution Efficiency	Fuel Source	Heat Pump	Efficiency / SCOP
DX Split ASHP	100%	Grid Supplied Electricity	Yes	4.50 (SCOP)

Cooling Systems

System	Distribution Efficiency	Fuel Source	Heat Pump	Efficiency / SEER
DX Split ASHP	100%	Grid Supplied Electricity	Yes	7.00 (SEER)

Domestic Hot Water Systems

System	Distribution Efficiency	Storage Tank	Heat Source	Efficiency	Comments
Electric Water Heater	98%	30	Direct Electric	100%	

Renewables

Unit 4

- Incline: 3.3°
- Orientation: 105° (From North)
- Surface Area: 10.00m²
- Panel Efficiency: 21.3%
- Annual Generation: 1553.28kWh/annum

Unit 4a

- Incline: 3.3°
- Orientation: 105° (From North)
- Surface Area: 10.00m²
- Panel Efficiency: 21.3%
- Annual Generation: 1,553.28kWh/annum

APPENDIX B – 'BE GREEN' BRUKL OUTPUT DOCUMENT

BRUKL Output Document

HM Government

Compliance with England Building Regulations Part L 2021

Project name **Shell and Core**

Unit 4 Fallowfield - Be Green

As designed

Date: Fri Oct 27 13:49:00 2023

Administrative information

Building Details

Address:

Certifier details

Name: Andrew Parry

Telephone number: 01925265757

Address: RCM Business Centre, Sandbeds Trading Estate, Dewsbury Road, Ossett, Wakefield, WF5 9ND

Certification tool

Calculation engine: TAS

Calculation engine version: "v9.5.5"

Interface to calculation engine: TAS

Interface to calculation engine version: v9.5.5

BRUKL compliance module version: v6.1.e.0

Foundation area [m^2]: 101.44

The CO_2 emission and primary energy rates of the building must not exceed the targets

Target CO_2 emission rate (TER), $kgCO_2/m^2$.annum	20.98	
Building CO_2 emission rate (BER), $kgCO_2/m^2$.annum	20.47	
Target primary energy rate (TPER), kWh_{PE}/m^2.annum	229.2	
Building primary energy rate (BPER), kWh_{PE}/m^2.annum	221.65	
Do the building's emission and primary energy rates exceed the targets?	BER =< TER	BPER =< TPER

The performance of the building fabric and fixed building services should achieve reasonable overall standards of energy efficiency

Fabric element	$U_{a\text{-}Limit}$	$U_{a\text{-}Calc}$	$U_{i\text{-}Calc}$	First surface with maximum value
Walls*	0.26	0.25	0.25	External Wall
Floors	0.18	0.18	0.18	Ground Floor
Pitched roofs	0.16	-	-	No pitched roofs in project
Flat roofs	0.18	0.16	0.16	Roof
Windows** and roof windows	1.6	1.31	1.31	Over Main Door - Glazing
Rooflights***	2.2	-	-	No rooflights in project
Personnel doors^	1.6	-	-	No personnel doors in project
Vehicle access & similar large doors	1.3	-	-	No vehicle access or similar large doors in project
High usage entrance doors	3	1.7	1.7	Main Entrance Door - Door

$U_{a\text{-}Limit}$ = Limiting area-weighted average U-values [$W/(m^2K)$] $U_{i\text{-}Calc}$ = Calculated maximum individual element U-values [$W/(m^2K)$]

$U_{a\text{-}Calc}$ = Calculated area-weighted average U-values [$W/(m^2K)$]

* Automatic U-value check by the tool does not apply to curtain walls whose limiting standard is similar to that for windows.

** Display windows and similar glazing are excluded from the U-value check. *** Values for rooflights refer to the horizontal position.

^ For fire doors, limiting U-value is 1.8 W/m^2K

NB: Neither roof ventilators (inc. smoke vents) nor swimming pool basins are modelled or checked against the limiting standards by the tool.

Air permeability	Limiting standard	This building
$m^3/(h.m^2)$ at 50 Pa	8	4

Building services

For details on the standard values listed below, system-specific guidance, and additional regulatory requirements, refer to the Approved Documents.

Whole building lighting automatic monitoring & targeting with alarms for out-of-range values	YES
Whole building electric power factor achieved by power factor correction	<0.9

1- VRF with Mech. Vent. (Unit 4)

	Heating efficiency	**Cooling efficiency**	**Radiant efficiency**	**SFP [W/(l/s)]**	**HR efficiency**
This system	4.5	7	-	1.5	0.75
Standard value	2.5*	5	N/A	2^	N/A
Automatic monitoring & targeting with alarms for out-of-range values for this HVAC system					YES

* Standard shown is for all types >12 kW output, except absorption and gas engine heat pumps.

^ Limiting SFP may be increased by the amounts specified in the Approved Documents if the installation includes particular components.

1- Direct Electric

	Water heating efficiency	**Storage loss factor [kWh/litre per day]**
This building	1	0.03
Standard value	1	N/A

Zone-level mechanical ventilation, exhaust, and terminal units

ID	**System type in the Approved Documents**
A	Local supply or extract ventilation units
B	Zonal supply system where the fan is remote from the zone
C	Zonal extract system where the fan is remote from the zone
D	Zonal balanced supply and extract ventilation system
E	Local balanced supply and extract ventilation units
F	Other local ventilation units
G	Fan assisted terminal variable air volume units
H	Fan coil units
I	Kitchen extract with the fan remote from the zone and a grease filter

NB: Limiting SFP may be increased by the amounts specified in the Approved Documents if the installation includes particular components.

Zone name	**SFP [W/(l/s)]**									**HR efficiency**	
ID of system type	**A**	**B**	**C**	**D**	**E**	**F**	**G**	**H**	**I**		
Standard value	0.3	1.1	0.5	2.3	2	0.5	0.5	0.4	1	**Zone**	**Standard**
Unit 4	-	-	-	1.5	-	-	-	-	-	-	N/A

Shell and core configuration

Zone	**Assumed shell?**
Unit 4	YES

General lighting and display lighting	**General luminaire**	**Display light source**	
Zone name	**Efficacy [lm/W]**	**Efficacy [lm/W]**	**Power density [W/m²]**
Standard value	95	80	0.3
Unit 4	120	95	-

The spaces in the building should have appropriate passive control measures to limit solar gains in summer

Zone	Solar gain limit exceeded? (%)	Internal blinds used?
Unit 4	YES (+57%)	NO

Regulation 25A: Consideration of high efficiency alternative energy systems

Were alternative energy systems considered and analysed as part of the design process?	YES
Is evidence of such assessment available as a separate submission?	YES
Are any such measures included in the proposed design?	YES

Technical Data Sheet (Actual vs. Notional Building)

Building Global Parameters

	Actual	Notional
Floor area [m^2]	101	101
External area [m^2]	277	277
Weather	MAN	MAN
Infiltration [m^3/hm^2@ 50Pa]	4	3
Average conductance [W/K]	73	64
Average U-value [W/m^2K]	0.26	0.23
Alpha value* [%]	33.97	18.97

* Percentage of the building's average heat transfer coefficient which is due to thermal bridging

Building Use

% Area	Building Type
	Retail/Financial and Professional Services
100	**Restaurants and Cafes/Drinking Establishments/Takeaways**
	Offices and Workshop Businesses
	General Industrial and Special Industrial Groups
	Storage or Distribution
	Hotels
	Residential Institutions: Hospitals and Care Homes
	Residential Institutions: Residential Schools
	Residential Institutions: Universities and Colleges
	Secure Residential Institutions
	Residential Spaces
	Non-residential Institutions: Community/Day Centre
	Non-residential Institutions: Libraries, Museums, and Galleries
	Non-residential Institutions: Education
	Non-residential Institutions: Primary Health Care Building
	Non-residential Institutions: Crown and County Courts
	General Assembly and Leisure, Night Clubs, and Theatres
	Others: Passenger Terminals
	Others: Emergency Services
	Others: Miscellaneous 24hr Activities
	Others: Car Parks 24 hrs
	Others: Stand Alone Utility Block

Energy Consumption by End Use [kWh/m^2]

	Actual	Notional
Heating	1.38	0.88
Cooling	2.31	9.74
Auxiliary	18.72	8.54
Lighting	15.51	21.69
Hot water	123.36	114.7
Equipment*	115.13	115.13
TOTAL**	**161.29**	**155.55**

* Energy used by equipment does not count towards the total for consumption or calculating emissions.
** Total is net of any electrical energy displaced by CHP generators, if applicable.

Energy Production by Technology [kWh/m^2]

	Actual	Notional
Photovoltaic systems	15.35	0
Wind turbines	0	0
CHP generators	0	0
Solar thermal systems	0	0
Displaced electricity	*15.35*	*0*

Energy & CO_2 Emissions Summary

	Actual	Notional
Heating + cooling demand [MJ/m^2]	84.92	171.14
Primary energy [kWh_{PE}/m^2]	221.65	229.2
Total emissions [kg/m^2]	20.47	20.98

HVAC Systems Performance

System Type		Heat dem MJ/m2	Cool dem MJ/m2	Heat con kWh/m2	Cool con kWh/m2	Aux con kWh/m2	Heat SSEEF	Cool SSEER	Heat gen SEFF	Cool gen SEER
[ST] Split or multi-split system, [HS] ASHP, [HFT] Electricity, [CFT] Electricity										
	Actual	23.4	61.3	1.4	2.4	19.7	4.5	7	4.5	7
	Notional	8.8	162.3	0.9	10.3	9	2.64	4.4	----	----

Key to terms

Heat dem [MJ/m2] = Heating energy demand
Cool dem [MJ/m2] = Cooling energy demand
Heat con [kWh/m2] = Heating energy consumption
Cool con [kWh/m2] = Cooling energy consumption
Aux con [kWh/m2] = Auxiliary energy consumption
Heat SSEFF = Heating system seasonal efficiency (for notional building, value depends on activity glazing class)
Cool SSEER = Cooling system seasonal energy efficiency ratio
Heat gen SSEFF = Heating generator seasonal efficiency
Cool gen SSEER = Cooling generator seasonal energy efficiency ratio
ST = System type
HS = Heat source
HFT = Heating fuel type
CFT = Cooling fuel type

BRUKL Output Document

HM Government

Compliance with England Building Regulations Part L 2021

Project name **Shell and Core**

Unit 4A Fallowfield - Be Green

As designed

Date: Fri Oct 27 13:51:52 2023

Administrative information

Building Details

Address:

Certifier details

Name: Andrew Parry

Telephone number: 01925265757

Address: RCM Business Centre, Sandbeds Trading Estate, Dewsbury Road, Ossett, Wakefield, WF5 9ND

Certification tool

Calculation engine: TAS

Calculation engine version: "v9.5.5"

Interface to calculation engine: TAS

Interface to calculation engine version: v9.5.5

BRUKL compliance module version: v6.1.e.0

Foundation area [m^2]: 96.23

The CO_2 emission and primary energy rates of the building must not exceed the targets

Target CO_2 emission rate (TER), $kgCO_2/m^2.annum$	20.74	
Building CO_2 emission rate (BER), $kgCO_2/m^2.annum$	20.69	
Target primary energy rate (TPER), $kWh_{PE}/m^2.annum$	226.73	
Building primary energy rate (BPER), $kWh_{PE}/m^2.annum$	223.68	
Do the building's emission and primary energy rates exceed the targets?	BER =< TER	BPER =< TPER

The performance of the building fabric and fixed building services should achieve reasonable overall standards of energy efficiency

Fabric element	$U_{a\text{-}Limit}$	$U_{a\text{-}Calc}$	$U_{i\text{-}Calc}$	First surface with maximum value
Walls*	0.26	0.25	0.25	External Wall
Floors	0.18	0.18	0.18	Ground Floor
Pitched roofs	0.16	-	-	No pitched roofs in project
Flat roofs	0.18	0.16	0.16	Roof
Windows** and roof windows	1.6	1.36	1.7	Main Entrance Door - Door
Rooflights***	2.2	-	-	No rooflights in project
Personnel doors^	1.6	-	-	No personnel doors in project
Vehicle access & similar large doors	1.3	-	-	No vehicle access or similar large doors in project
High usage entrance doors	3	-	-	No high usage entrance doors in project

$U_{a\text{-}Limit}$ = Limiting area-weighted average U-values [$W/(m^2K)$] $U_{i\text{-}Calc}$ = Calculated maximum individual element U-values [$W/(m^2K)$]

$U_{a\text{-}Calc}$ = Calculated area-weighted average U-values [$W/(m^2K)$]

* Automatic U-value check by the tool does not apply to curtain walls whose limiting standard is similar to that for windows.

** Display windows and similar glazing are excluded from the U-value check. *** Values for rooflights refer to the horizontal position.

^ For fire doors, limiting U-value is 1.8 W/m^2K

NB: Neither roof ventilators (inc. smoke vents) nor swimming pool basins are modelled or checked against the limiting standards by the tool.

Air permeability	Limiting standard	This building
$m^3/(h.m^2)$ at 50 Pa	8	4

Building services

For details on the standard values listed below, system-specific guidance, and additional regulatory requirements, refer to the Approved Documents.

Whole building lighting automatic monitoring & targeting with alarms for out-of-range values	YES
Whole building electric power factor achieved by power factor correction	<0.9

1- VRF with Mech. Vent. (Unit 4A)

	Heating efficiency	**Cooling efficiency**	**Radiant efficiency**	**SFP [W/(l/s)]**	**HR efficiency**
This system	4.5	7	-	1.5	0.75
Standard value	2.5*	5	N/A	2^	N/A
Automatic monitoring & targeting with alarms for out-of-range values for this HVAC system					YES

* Standard shown is for all types >12 kW output, except absorption and gas engine heat pumps.

^ Limiting SFP may be increased by the amounts specified in the Approved Documents if the installation includes particular components.

1- Direct Electric

	Water heating efficiency	**Storage loss factor [kWh/litre per day]**
This building	1	0.03
Standard value	1	N/A

Zone-level mechanical ventilation, exhaust, and terminal units

ID	**System type in the Approved Documents**
A	Local supply or extract ventilation units
B	Zonal supply system where the fan is remote from the zone
C	Zonal extract system where the fan is remote from the zone
D	Zonal balanced supply and extract ventilation system
E	Local balanced supply and extract ventilation units
F	Other local ventilation units
G	Fan assisted terminal variable air volume units
H	Fan coil units
I	Kitchen extract with the fan remote from the zone and a grease filter

NB: Limiting SFP may be increased by the amounts specified in the Approved Documents if the installation includes particular components.

Zone name	**SFP [W/(l/s)]**									**HR efficiency**	
ID of system type	**A**	**B**	**C**	**D**	**E**	**F**	**G**	**H**	**I**		
Standard value	0.3	1.1	0.5	2.3	2	0.5	0.5	0.4	1	**Zone**	**Standard**
Unit 4A	-	-	-	1.5	-	-	-	-	-	-	N/A

Shell and core configuration

Zone	**Assumed shell?**
Unit 4A	YES

General lighting and display lighting	**General luminaire**	**Display light source**	
Zone name	**Efficacy [lm/W]**	**Efficacy [lm/W]**	**Power density [W/m²]**
Standard value	95	80	0.3
Unit 4A	120	95	-

The spaces in the building should have appropriate passive control measures to limit solar gains in summer

Zone	Solar gain limit exceeded? (%)	Internal blinds used?
Unit 4A	NO (-20%)	NO

Regulation 25A: Consideration of high efficiency alternative energy systems

Were alternative energy systems considered and analysed as part of the design process?	YES
Is evidence of such assessment available as a separate submission?	YES
Are any such measures included in the proposed design?	YES

Technical Data Sheet (Actual vs. Notional Building)

Building Global Parameters

	Actual	Notional
Floor area [m^2]	96	96
External area [m^2]	364	364
Weather	MAN	MAN
Infiltration [m^3/hm^2@ 50Pa]	4	3
Average conductance [W/K]	106	107
Average U-value [W/m^2K]	0.29	0.29
Alpha value* [%]	35.34	20.34

* Percentage of the building's average heat transfer coefficient which is due to thermal bridging

Building Use

% Area	Building Type
	Retail/Financial and Professional Services
100	**Restaurants and Cafes/Drinking Establishments/Takeaways**
	Offices and Workshop Businesses
	General Industrial and Special Industrial Groups
	Storage or Distribution
	Hotels
	Residential Institutions: Hospitals and Care Homes
	Residential Institutions: Residential Schools
	Residential Institutions: Universities and Colleges
	Secure Residential Institutions
	Residential Spaces
	Non-residential Institutions: Community/Day Centre
	Non-residential Institutions: Libraries, Museums, and Galleries
	Non-residential Institutions: Education
	Non-residential Institutions: Primary Health Care Building
	Non-residential Institutions: Crown and County Courts
	General Assembly and Leisure, Night Clubs, and Theatres
	Others: Passenger Terminals
	Others: Emergency Services
	Others: Miscellaneous 24hr Activities
	Others: Car Parks 24 hrs
	Others: Stand Alone Utility Block

Energy Consumption by End Use [kWh/m^2]

	Actual	Notional
Heating	4.47	2.37
Cooling	1.93	7.43
Auxiliary	18.72	8.54
Lighting	14.7	20.87
Hot water	123.49	114.7
Equipment*	115.13	115.13
TOTAL**	**163.31**	**153.92**

* Energy used by equipment does not count towards the total for consumption or calculating emissions.
** Total is net of any electrical energy displaced by CHP generators, if applicable.

Energy Production by Technology [kWh/m^2]

	Actual	Notional
Photovoltaic systems	16.18	0
Wind turbines	0	0
CHP generators	0	0
Solar thermal systems	0	0
Displaced electricity	*16.18*	*0*

Energy & CO_2 Emissions Summary

	Actual	Notional
Heating + cooling demand [MJ/m^2]	127.37	147.67
Primary energy [kWh_{PE}/m^2]	223.68	226.73
Total emissions [kg/m^2]	20.69	20.74

HVAC Systems Performance

System Type		Heat dem MJ/m2	Cool dem MJ/m2	Heat con kWh/m2	Cool con kWh/m2	Aux con kWh/m2	Heat SSEEF	Cool SSEER	Heat gen SEFF	Cool gen SEER
[ST] Split or multi-split system, [HS] ASHP, [HFT] Electricity, [CFT] Electricity										
	Actual	76	51.2	4.7	2	19.7	4.5	7	4.5	7
	Notional	23.7	123.9	2.5	7.8	9	2.64	4.4	----	----

Key to terms

Heat dem [MJ/m2] = Heating energy demand
Cool dem [MJ/m2] = Cooling energy demand
Heat con [kWh/m2] = Heating energy consumption
Cool con [kWh/m2] = Cooling energy consumption
Aux con [kWh/m2] = Auxiliary energy consumption
Heat SSEFF = Heating system seasonal efficiency (for notional building, value depends on activity glazing class)
Cool SSEER = Cooling system seasonal energy efficiency ratio
Heat gen SSEFF = Heating generator seasonal efficiency
Cool gen SSEER = Cooling generator seasonal energy efficiency ratio
ST = System type
HS = Heat source
HFT = Heating fuel type
CFT = Cooling fuel type