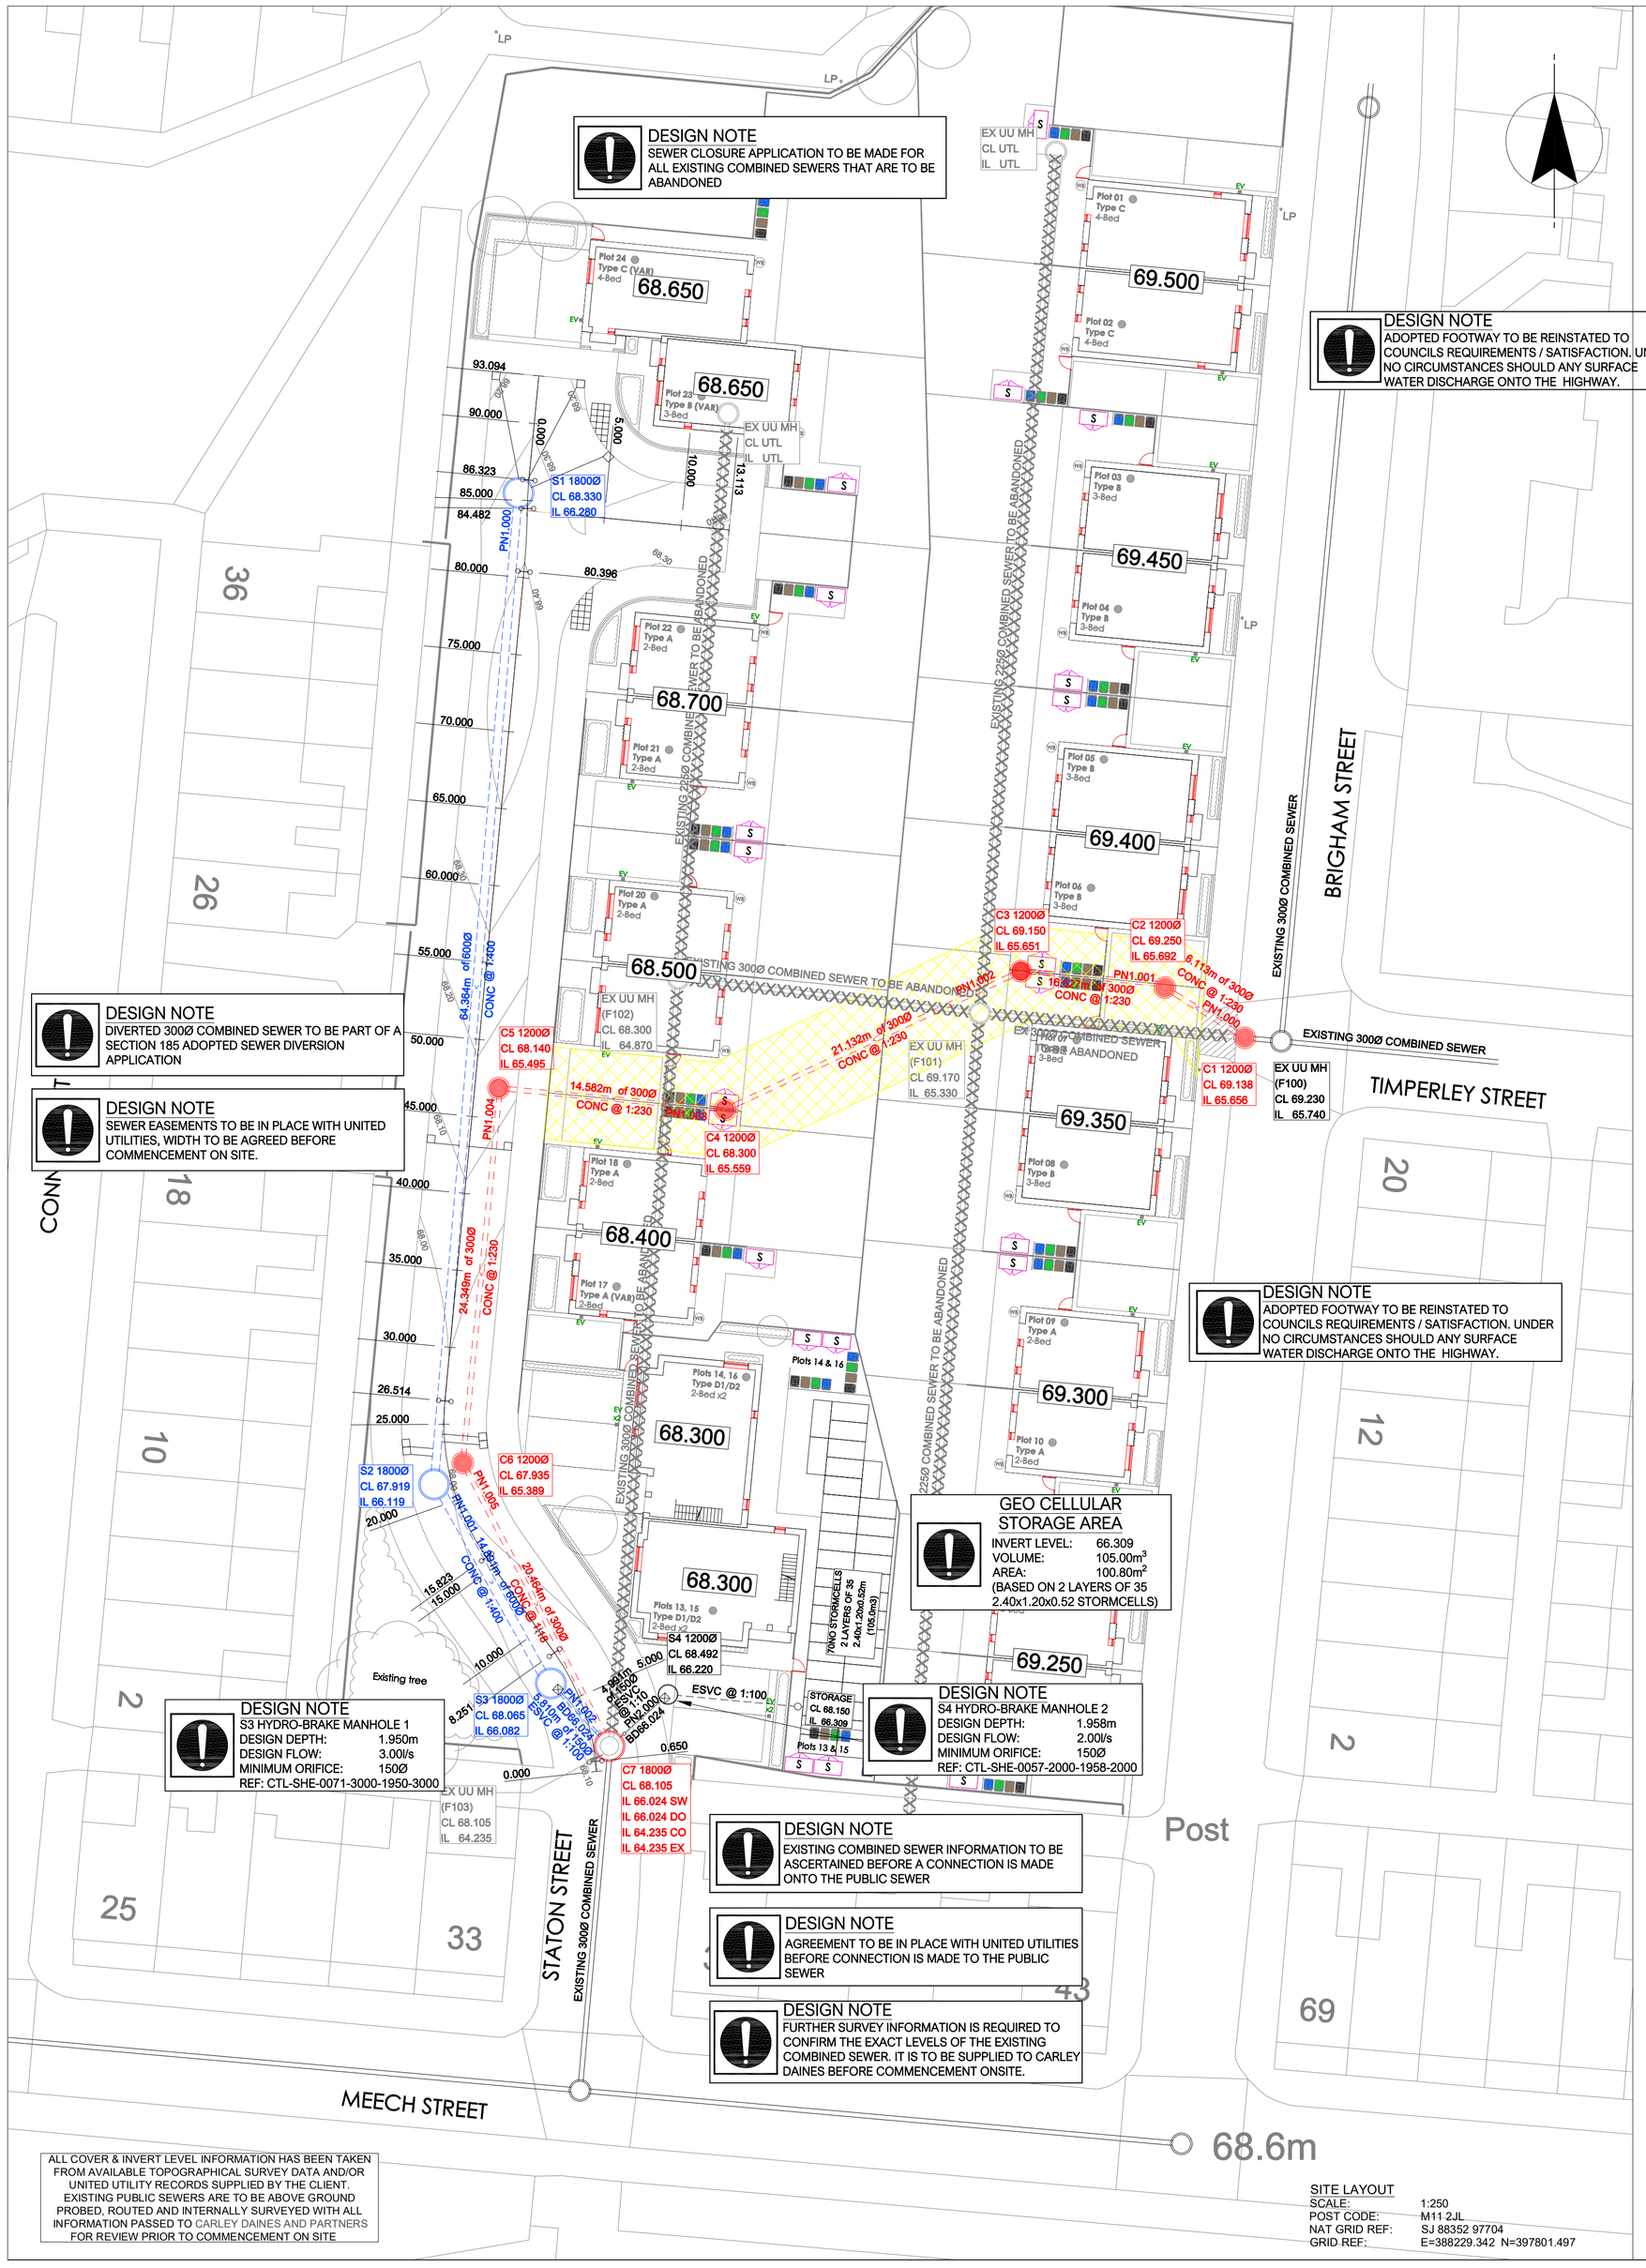


ALL COVER & INVERT LEVEL INFORMATION HAS BEEN TAKEN FROM AVAILABLE TOPOGRAPHICAL SURVEY DATA AND/OR UNITED UTILITY RECORDS SUPPLIED BY THE CLIENT. EXISTING PUBLIC SEWERS ARE TO BE ABOVE GROUND PROBED, ROUTED AND INTERNALLY SURVEYED WITH ALL INFORMATION PASSED TO CARLEY DAINES AND PARTNERS FOR REVIEW PRIOR TO COMMENCEMENT ON SITE

MANHOLE SCHEDULE

Sheet 1 of 1

Manhole Number / Coordinates	Cover Level / Depth To Soffit	Connections	Pipe: Code	Pipe: Inverts	Pipe: Diams	Manhole Size	Types: Manhole	Types: Cover
S1 E. 388206.910 N. 397832.859	68.330 1.450	0	0	1.000 66.280	600	1800	E	D400
S2 E. 388201.237 N. 397768.746	67.919 1.200	1 0	1 0	1.000 66.119 1.001 66.119	600 600	1800	E	D400
S3 FLOW CONTROL MANHOLE MAX DISCHARGE 3.0L/S E. 388208.232 N. 397755.601	68.065 1.833	1 0	1 0	1.001 66.082 1.002 66.082	600 150	1800	E	D400
S4 E. 388216.387 N. 397755.171	68.492 1.808	0	0	2.000 66.534	150	1200	E	D400
C1 E. 388253.704 N. 397797.643	69.105 3.086	EX 0 EX	EX 0	65.719 1.000 65.719	300 300	1200	A1	D400
C2 E. 388248.525 N. 397800.892	69.225 3.233	1 0	1 0	1.000 65.692 1.001 65.692	300 300	1200	A1	D400
C3 E. 388239.220 N. 397801.950	69.150 3.199	1 0	1 0	1.001 65.651 1.002 65.651	300 300	1200	A1	D400
C4 E. 388220.079 N. 397792.994	68.300 2.441	1 0	1 0	1.002 65.559 1.003 65.559	300 300	1200	A1	D400
C5 E. 388205.433 N. 397794.391	68.140 2.345	DO 1 0	1 DO 0	1.003 65.495 1.004 65.495	300 150 300	1200	B	D400
C6 E. 388203.113 N. 397770.152	67.935 2.246	1 0	1 0	1.004 65.389 1.005 65.389	300 300	1200	B	D400
C7 E. 388212.665 N. 397751.846	68.105 2.506	1 EX1 2 DO EX2	1 CO1.005 2 SW1.002 DO 2.000 EX1 Abandoned EX2	64.235 66.024 66.024 64.235 64.235	300 150 150 150 300	1800	B	D400
C8 E. 388210.694 N. 397729.564	68.100 EX	EX EX	1 EX	1.003 64.138 64.138	300 300	EX	EX	EX

DO NOT SCALE OFF THIS DRAWING
IF IN DOUBT - ASK

KEY

- 1.80.0 grad 100 — 100mm Foul drain
- 1.80.0 grad — 100mm Surface Water drain
- 1.80.0 grad 150 — 150mm Foul drain
- 1.80.0 grad 150 — 150mm Surface Water drain
- Foul connection.
- Rainwater downpipe.
- Foul shallow access.
- 100 99.55 (600) — 1.60.0 grad — Storm rodding eye.
- 100 99.4 (600) — 1.80.0 grad — Private foul manhole and drain.
- 100 99.4 (600) — 1.80.0 grad — Private storm manhole and drain.
- 100 99.4 (600) — Foul manhole over 1.2m deep.
- 100 99.4 (600) — Storm manhole over 1.2m deep.
- RG — Road gully (150mm connection).
- Channel drain (ACO)

NOTES

1. ALL ADOPTABLE DRAINAGE WORKS HAVE BEEN DESIGNED AND ARE TO BE CONSTRUCTED IN ACCORDANCE WITH THE DESIGN AND CONSTRUCTION GUIDANCE.
2. ALL CLAY PIPE WORK SHALL BE EXTRA STRENGTH CLAYWARE TO B.S EN 295:1991 PART 1
3. ALL PRECAST CONCRETE PIPEWORK SHALL BE TO THE CLASS STATED ON THE DRAWINGS IN ACCORDANCE WITH B.S EN 1916:2002. ALSO, ALL MANHOLES AND CHAMBERS SHALL BE TO B.S EN 1917:2002
4. THE CONTRACTOR MAY ELECT TO USE REINFORCED PVC PIPES AS COVERED BY B.S 4660:2000 & B.S EN 1401-1, STRUCTURED WALL UPVC PIPES TO COMPLY WITH WIS4-35-01 .(BY PRIOR AGREEMENT WITH ADOPTING AUTHORITY) MAX. PIPE LENGTH TO BE 3.0M
5. ALL LEVELS RELATE TO TOPOGRAPHICAL SURVEY DATUM
6. THIS DRAWING IS TO BE READ IN CONJUNCTION WITH ALL OTHER RELEVANT DRAWINGS
7. PLOT DRAINAGE CONNECTIONS TO SEWERS MUST BE 150MM DIAMETER AND UNLESS OTHERWISE STATED LAID TO THE INVERT SHOWN.
8. ALL INSPECTION CHAMBERS TO BE 450mm DIAMETER POLYPROPYLENE WITH A MAXIMUM DEPTH OF 1200mm FOR THE STANDARD UNIT & A MAXIMUM DEPTH OF 3000mm WHEN A 350mm REDUCING RING IS USED.
9. ALL PLOT DRAINAGE RUNS TO BE 100mm DIAMETER AT A NOMINAL FALL OF 1:70 UNLESS NOTED OTHERWISE.
10. RODDING EYES AT START OF EACH DRAINAGE RUN.
11. ALLOW FOR 5.0M OF 'ACO' DRAINAGE CHANNEL PER PROPERTY AT HIGHWAY BOUNDARY.
12. SURFACE WATER FROM PLOT PARKING AREAS MUST NOT DISCHARGE ONTO THE HIGHWAY.
13. PLOT DRAINAGE RUNS TO BE KEPT WITHIN THE CURTILAGE OF THE PLOT THEY SERVE WHEREVER POSSIBLE.
14. THE CONTRACTOR SHALL BE RESPONSIBLE FOR ENSURING THAT ANY EXISTING INVERT LEVELS INDICATED ON DRAWINGS ARE CORRECT BEFORE THE WORKS ARE COMMENCED
15. ALL CONNECTIONS TO ADOPTABLE SEWERS SHALL BE MANUFACTURED JUNCTION PIPES. SADDLE CONNECTIONS WILL NOT BE PERMITTED UNLESS SPECIFIED.
16. ALL SEWERS FOR ADOPTION WITH GREATER THAN 1.20M COVER IN ROADS OR 0.9M COVER IN FIELDS SHALL HAVE CLASS S GRANULAR BED AND SURROUND.
17. ANY SEWER FOR ADOPTION WITH LESS THAN 1.2M COVER IN ROADS OR 0.9M COVER IN FIELDS SHALL HAVE A MINIMUM OF 150MM ST4 CONCRETE SURROUND. FLEXIBILITY SHALL BE MAINTAINED BY THE PROVISION OF FLEXCELL OR SIMILAR APPROVED JOINT FILLER BREAKS IN THE CONCRETE SURROUND AT EACH PIPE JOINT.
18. IT IS THE RESPONSIBILITY FOR THE CONTRACTOR TO CHECK ALL ONSITE EXISTING GROUND LEVELS PRIOR TO COMMENCING AND IF THERE ARE ANY DISCREPANCIES THE CONTRACTOR MUST REPORT TO THE ENGINEER IMMEDIATELY
19. CONTRACTOR TO CONFIRM THE COVER LEVEL, INVERT LEVEL & MANHOLE SIZE FOR THE EXISTING MANHOLE 5902 PRIOR TO CONTRACT START DATE.
20. THERE ARE A NUMBER OF EXISTING SEWERS & MANHOLES ON THE SITE, WHICH MUST BE ABANDONED BEFORE THE THE FINAL DRAINAGE DESIGN. CONTRACTOR TO PROVIDE ALL NECESSARY INFORMATION IF ANY CHANGES ARE REQUIRED TO THE DRAINAGE LAYOUT.

REV.	DATE	DESCRIPTION
G	04.11.23	MANHOLE TYPES AMENDED
F	21.10.23	AMENDED TO LA COMMENTS
E	12.10.23	C7 AND PN1.005 AMENDED
D	07.10.23	S185 DIVERSION REVISED TO UU COMMENT:
C	08.09.23	PN1.001 AND MANHOLE SCHEDULE REVISED
B	31.08.23	DESIGN REVISED TO CLIENTS COMMENTS
A	23.08.23	DESIGN REVISED TO CLIENTS COMMENTS
-	07.08.23	INITIAL ISSUE

CLIENT

ONE MANCHESTER

Carley Daines and Partners Limited
Consulting Civil and Structural Engineers

11 Bridgewater Road Walkden
Worsley Manchester M28 3JE
Tel 0161 799 2720 Fax 0161 790 3474
E-mail mail@carleydaines.co.uk

TITLE

BRIGHAM STREET
OPENSHAW

ENGINEERING
LAYOUT

Drawn	CLYNCH	Checked	AMULLIGAN
Date	AUG 2023	Date	AUG 2023
Scale	1:250 @ A1		
Drawing No.	21.B.13127-11		G