


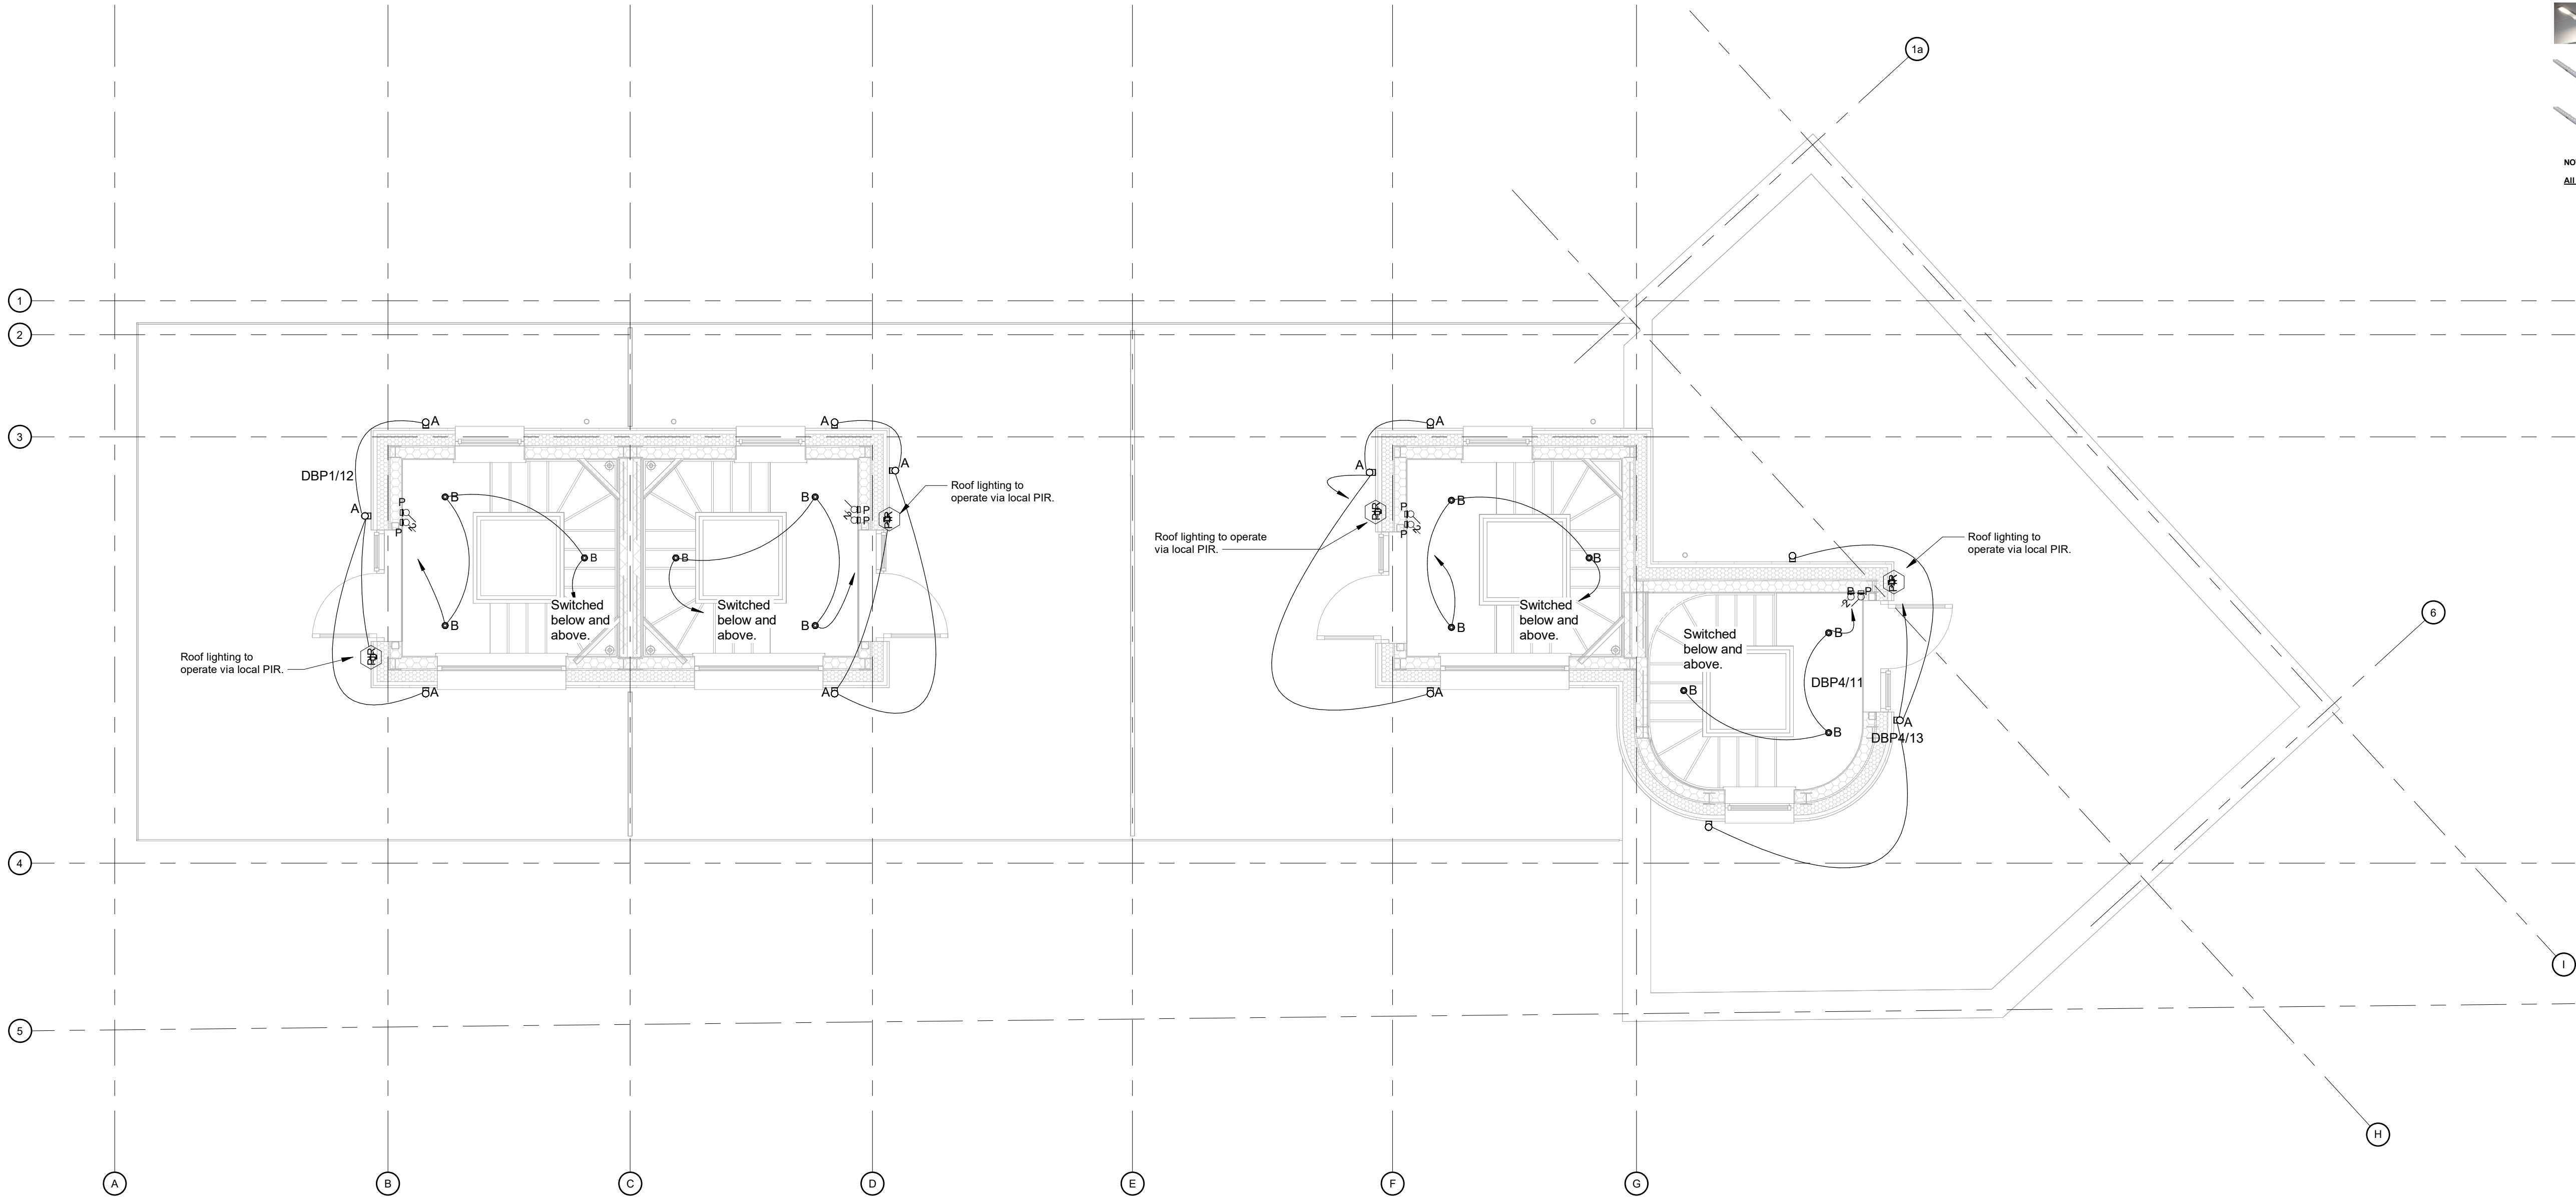

LIGHTING LEGEND

- A** LED DOWNLIGHT ONLY, 400lm, 3000K OR EQUAL AND APPROVED.
- B** LED DOWNLIGHT, WHITECROWN LDR 650lm, 4000K OR EQUAL AND APPROVED.
- C** SURFACE MOUNTED IP44 LED, WHITECROWN ACLN 4200lm, 4000K OR EQUAL AND APPROVED.
- D** RECESSED IP2X LED, 1190lm, 4000K, IP4X ABOVE SHOWERS.
- E** SURFACE FLOOD LIGHT, IP54 LED, xxlm, 3000K OR EQUAL AND APPROVED.
- F** SURFACE FLOOD LIGHT, IP54 LED, xxlm, 3000K OR EQUAL AND APPROVED.
- G** SURFACE LED READING LIGHT, 4000K OR EQUAL AND APPROVED.
- H** SURFACE LED IP44 BATHROOM LIGHT, 4000K OR EQUAL AND APPROVED.
- M** SURFACE LED IP2X UNDERCUPBOARD STRIP LIGHT, 4000K OR EQUAL AND APPROVED.
- N** RECESSED DECORATIVE LED LUMINAIRE / DRIVER OR EQUAL AND APPROVED.
- P** SUSPENDED DECORATIVE LED LUMINAIRE OR EQUAL AND APPROVED.
- Q** SUSPENDED DECORATIVE LED LUMINAIRE OR EQUAL AND APPROVED.
- R** SURFACE IP44 LED, WHITECROWN SPECTRE WR 7777lm, 4000K OR EQUAL AND APPROVED.

NOTE
All luminaires to have a minimum lumen / circuit watt of 75.

P4	30/10/23	Incorporating Architect's comments	JL	RW	SD
P3	10/10/23	Lighting amended to ecologists requirements	JL	RW	SD
P2	09/10/23	Incorporating Architects Comments	JL	RW	SD
P1	15/09/23	Revision 4	JL	RW	SD
Rev	Date	Description	By	Check	App

COPYRIGHT: THE COPYRIGHT OF THIS DRAWING IS VESTED IN CLANCY CONSULTING. IT SHALL NOT BE USED WITHOUT PERMISSION BY ANYONE FOR ANY PURPOSE. DO NOT SCALE THIS DRAWING ELECTRONICALLY OR MANUALLY. WORK TO FIGURED DIMENSIONS ONLY. ALL DIMENSIONS ARE IN MILLIMETRES UNLESS STATED OTHERWISE. THIS DRAWING WAS PRODUCED USING REVIT. IT IS NOT TO BE EXPORTED AND USED IN AUTOCAD. ANY EXPORTED AUTOCAD DRAWINGS PRODUCED FROM THIS SHEET ARE TO BE USED FOR INFORMATION PURPOSES ONLY.

Clancy Project No.	7-8545
Client	VICTOR (M1) Limited
Project	PARADISE MEWS, MANCHESTER
Office	READING
Discipline	ELECTRICAL
Title	Roof level Lighting Services Layout
Scale @ A1	1:50
Status	Preliminary



Project No.	Originator	Zone/Volume	Level
7-8545	CCL	XX	RF
Type	Discipline	Drawing No.	Revision
DR	E	6305	P4

SAFETY HEALTH AND ENVIRONMENTAL INFORMATION BOX
Construction Risks <ul style="list-style-type: none">• Enter text here / Delete text where necessary• Enter text here / Delete text where necessary
Maintenance/Cleaning Risks <ul style="list-style-type: none">• Enter text here / Delete text where necessary
Demolition/Adaption Risks <ul style="list-style-type: none">• Enter text here / Delete text where necessary
In addition to the hazards / risks normally associated with the type of work detailed on this drawing - the contractor is to take note of the above & also the hazards identified in the risk assessment document. It is assumed that all works detailed on this drawing will be performed by a competent contractor working, where appropriate, to an approved method statement.