




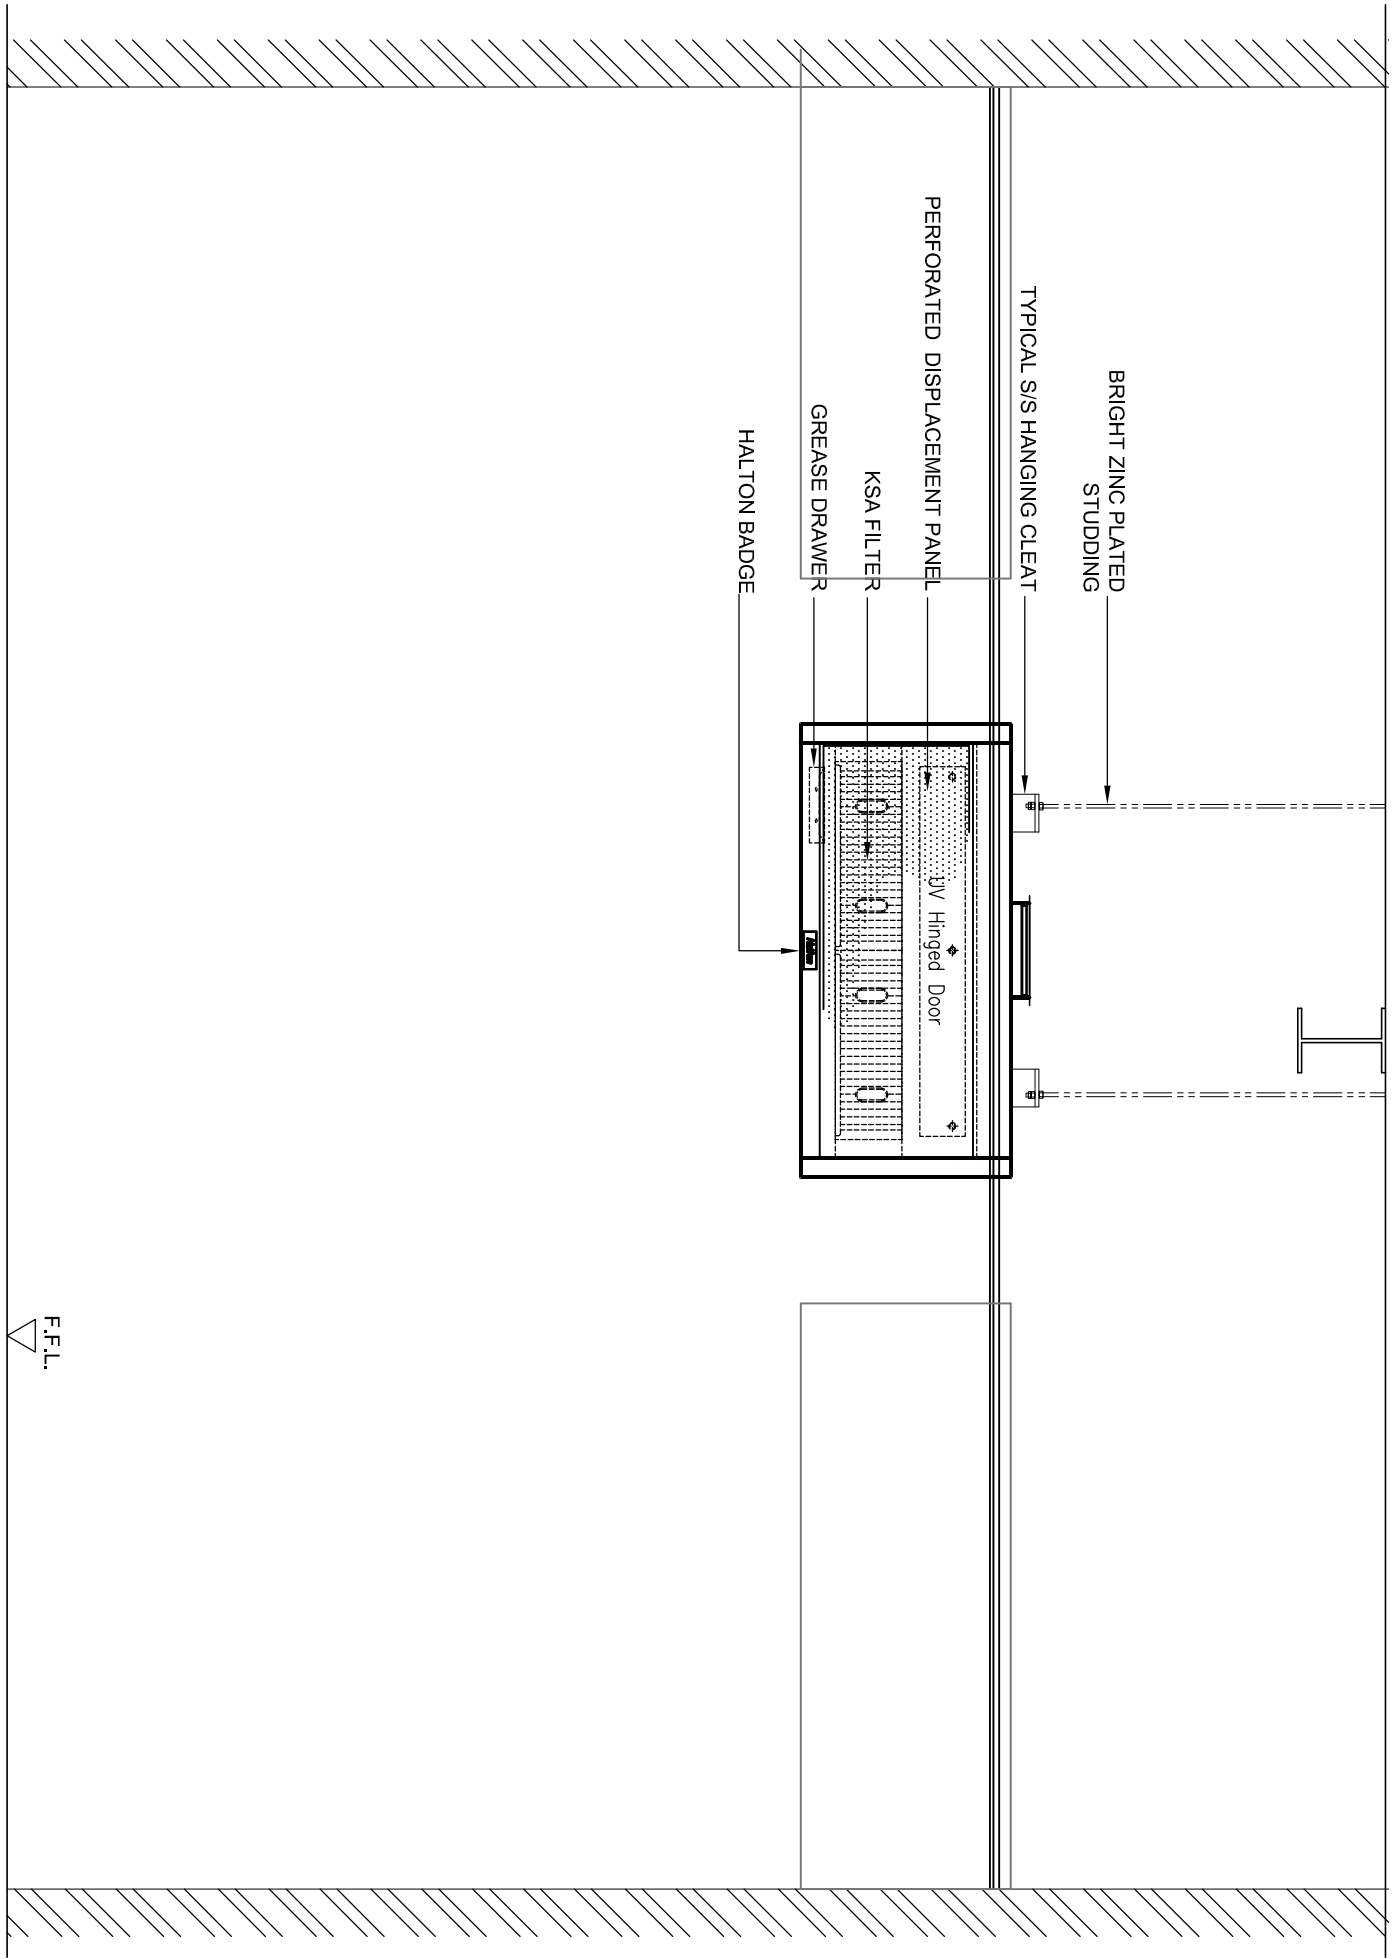


FRONT VIEW

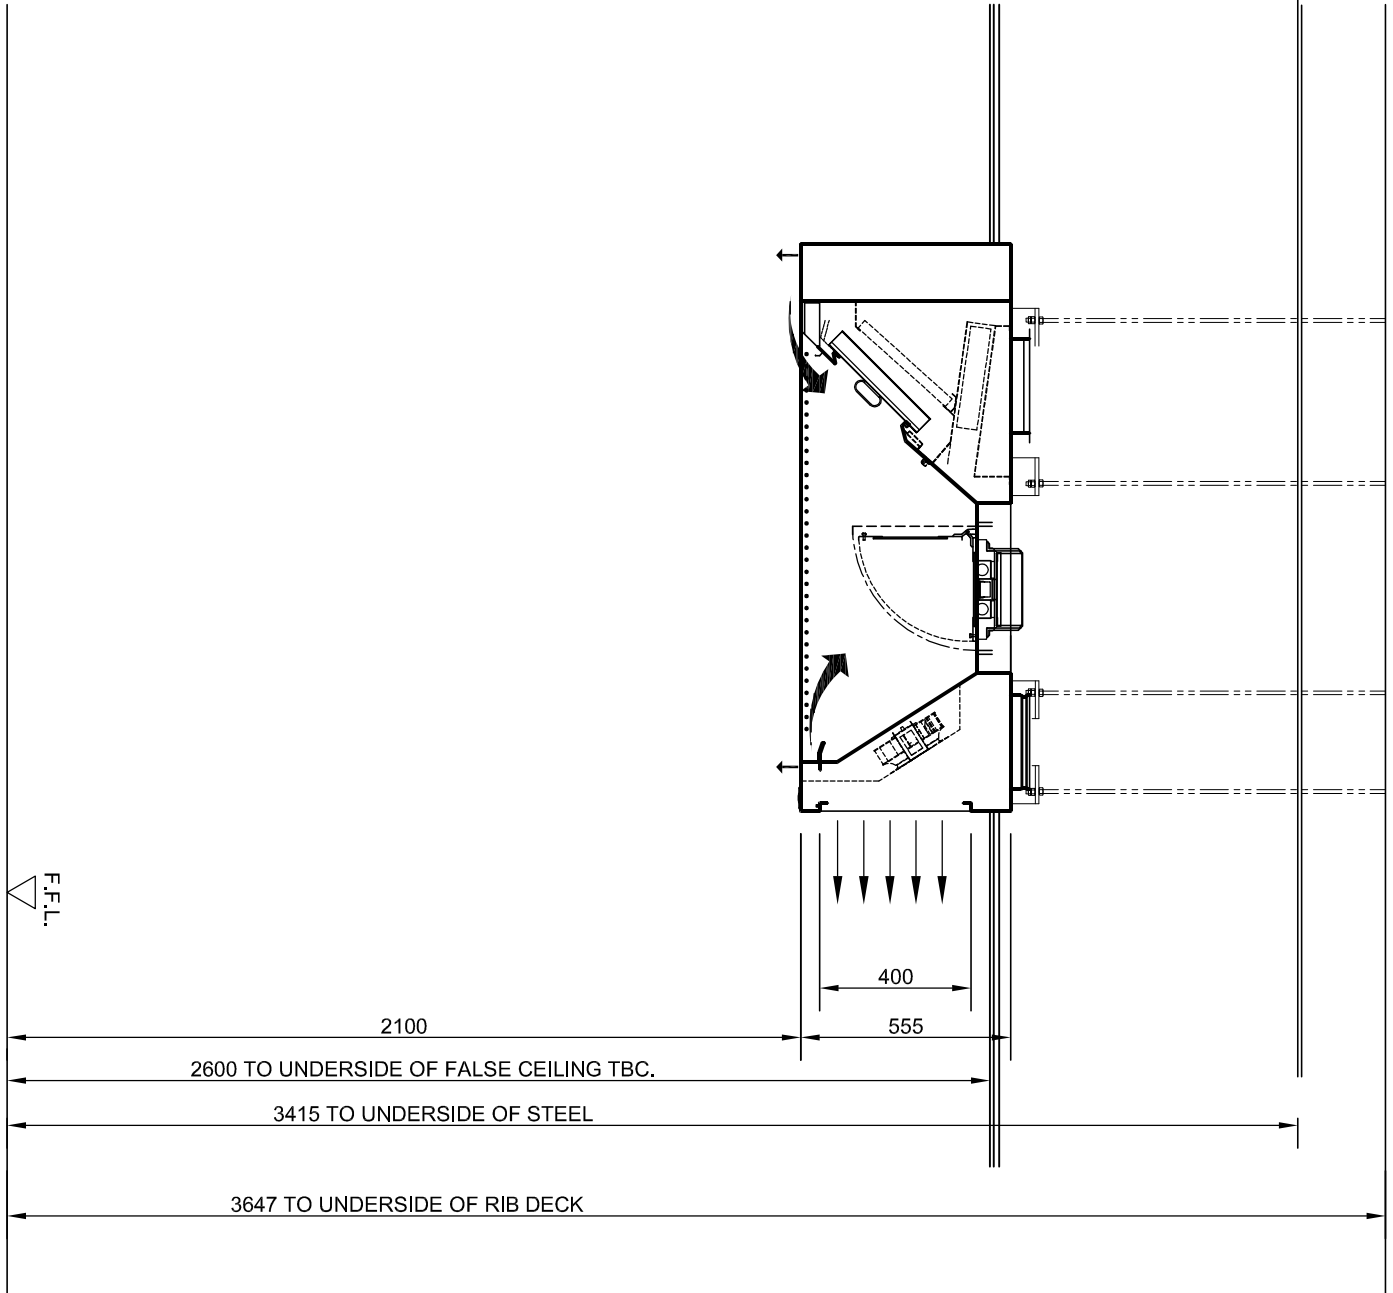

SECTION A-A

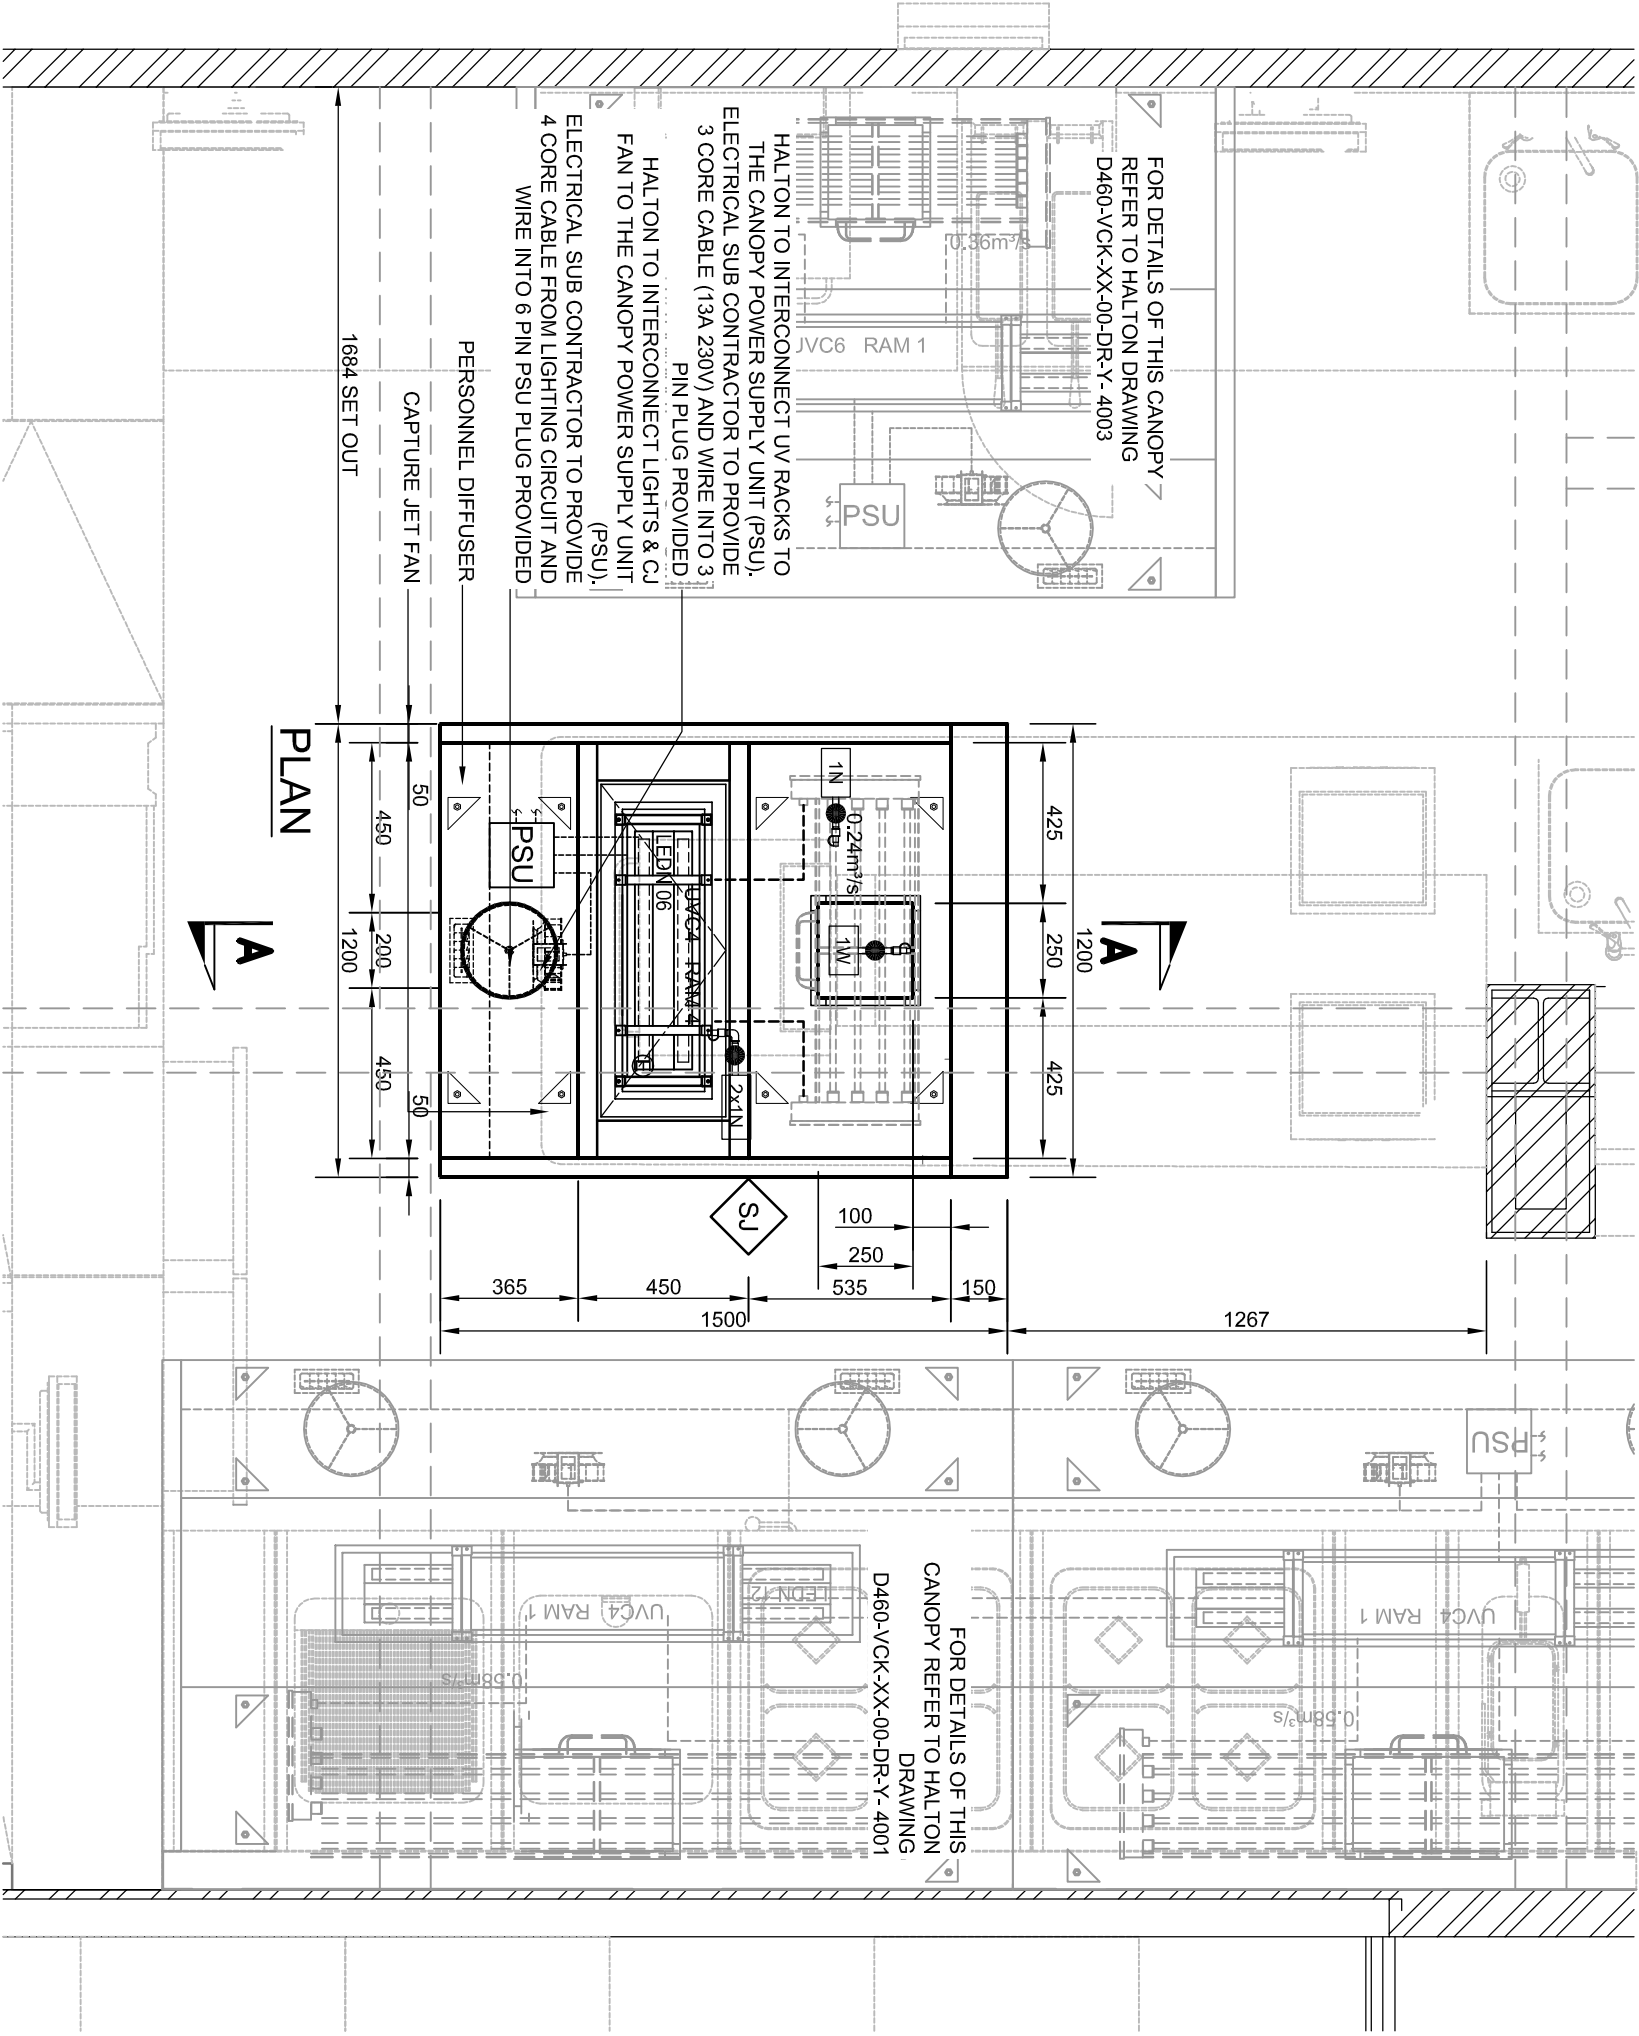

HANGING CLEAT POSITION
(UNLESS OTHERWISE STATED)

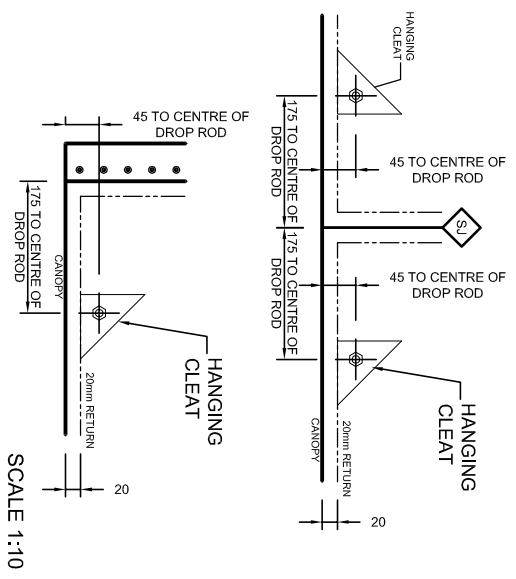

CANOPY DETAILS:

Halton Model: UVF
Canopy Size: 1200 x 1500+150 x 555
Canopy Weight: 0.22m³s
Static Pressure at Exhaust Spigot: 80 Pa
Exhaust Spigots (20 Met): 1No. 250 x 250
Supply Flow Rate: 0.25m³/s
Static Pressure at Supply Spigot: 50 Pa
Supply Spigots: 1No. Ø250
Approx. Hanging Weight: 96 kg
KSA Filters 500X300X50: 2No.
Coarse Filters 500X300X20: 1No.
Coarse Drainers: 1No. LEON6 (15W)
Lighting Type & Number: CMV EMERGENCY PACK 4000 K
UV Rack Size & Number: 1No. UVRA5 (1.6A)


ANSUL:

FOR ANSUL TANK & PULL STATION DETAILS REFER TO DRAWING D460-VCK-XX-00-XDR-Y-4001

Ansul Nozzle Positions to UL300

Diagram showing nozzle positions and dimensions for UL300.

CANOPY LIGHTING CONNECTOR DETAIL:

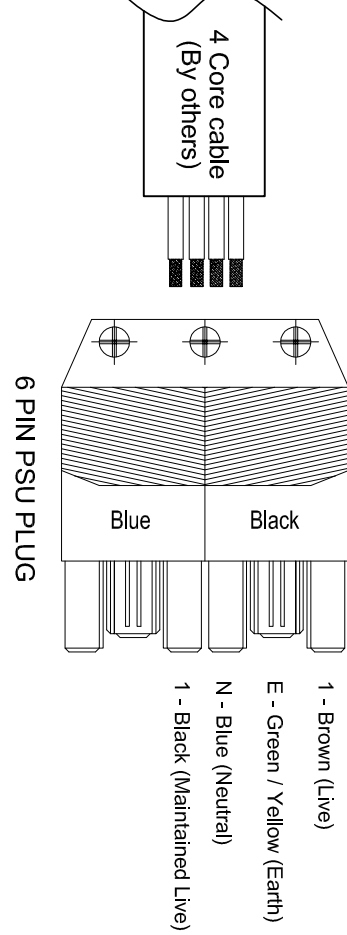

DRAWING NOTE:
DO NOT SCALE.
ALL DIMENSIONS IN MILLIMETRES.
±1mm TOLERANCE
HALTON COMPONENTS FABRICATED FROM R68 (12mm) STAINLESS STEEL.
KSA FILTERS (500X300X50) 2005 (SILICONE FINISH), WELDED FORMED & FOLDED CONSTRUCTION.
THIS DRAWING IS THE COPYRIGHT OF HALTON FOODSERVICE LTD. AND MUST NOT BE COPIED WITHOUT PERMISSION OF HALTON FOODSERVICE LTD.

SAFETY NOTE:
TO COMPLY WITH BS 5735:2008 HANDS OFF INTERLOCKS ARE REQUIRED BETWEEN THE GAS SUPPLY AND THE MECHANICAL VENTILATION SYSTEM (EXTRACT & MAKE UP AIR).
PLEASE ASCERTAIN WHICH CONTRACTOR IS TO SUPPLY THESE INTERLOCKS

NOTES:

--	--

REV	DESCRIPTION	DATE	BY
P03	UPDATED AS PER COMMENTS	05.08.2022	LW
P02	UPDATED AS PER SITE SURVEY	26.07.2022	LW
P01	ISSUE FOR APPROVAL	20.07.2022	LW

CLIENT:



PROJECT:

MALMAISON
PEARL ASSURANCE HOUSE
PRINCESS STREET
MANCHESTER
M2 4ER

DRAWING CONTENT
VENTILATION CANOPY
MODEL: UVF
LEVEL: GROUND FLOOR
AREA: KITCHEN
ITEM: 4.16



TYPE	CONTRACT DRAWING		CHECKED:
SCALE:	1:20 @ A1	DATE:	21.07.2022
DRAWING No:	D460-VCK-XX-00-DR-Y-4006		DRAWN: LW
DATE: 21.07.2022	REVISION:		P03

FOR APPROVAL