


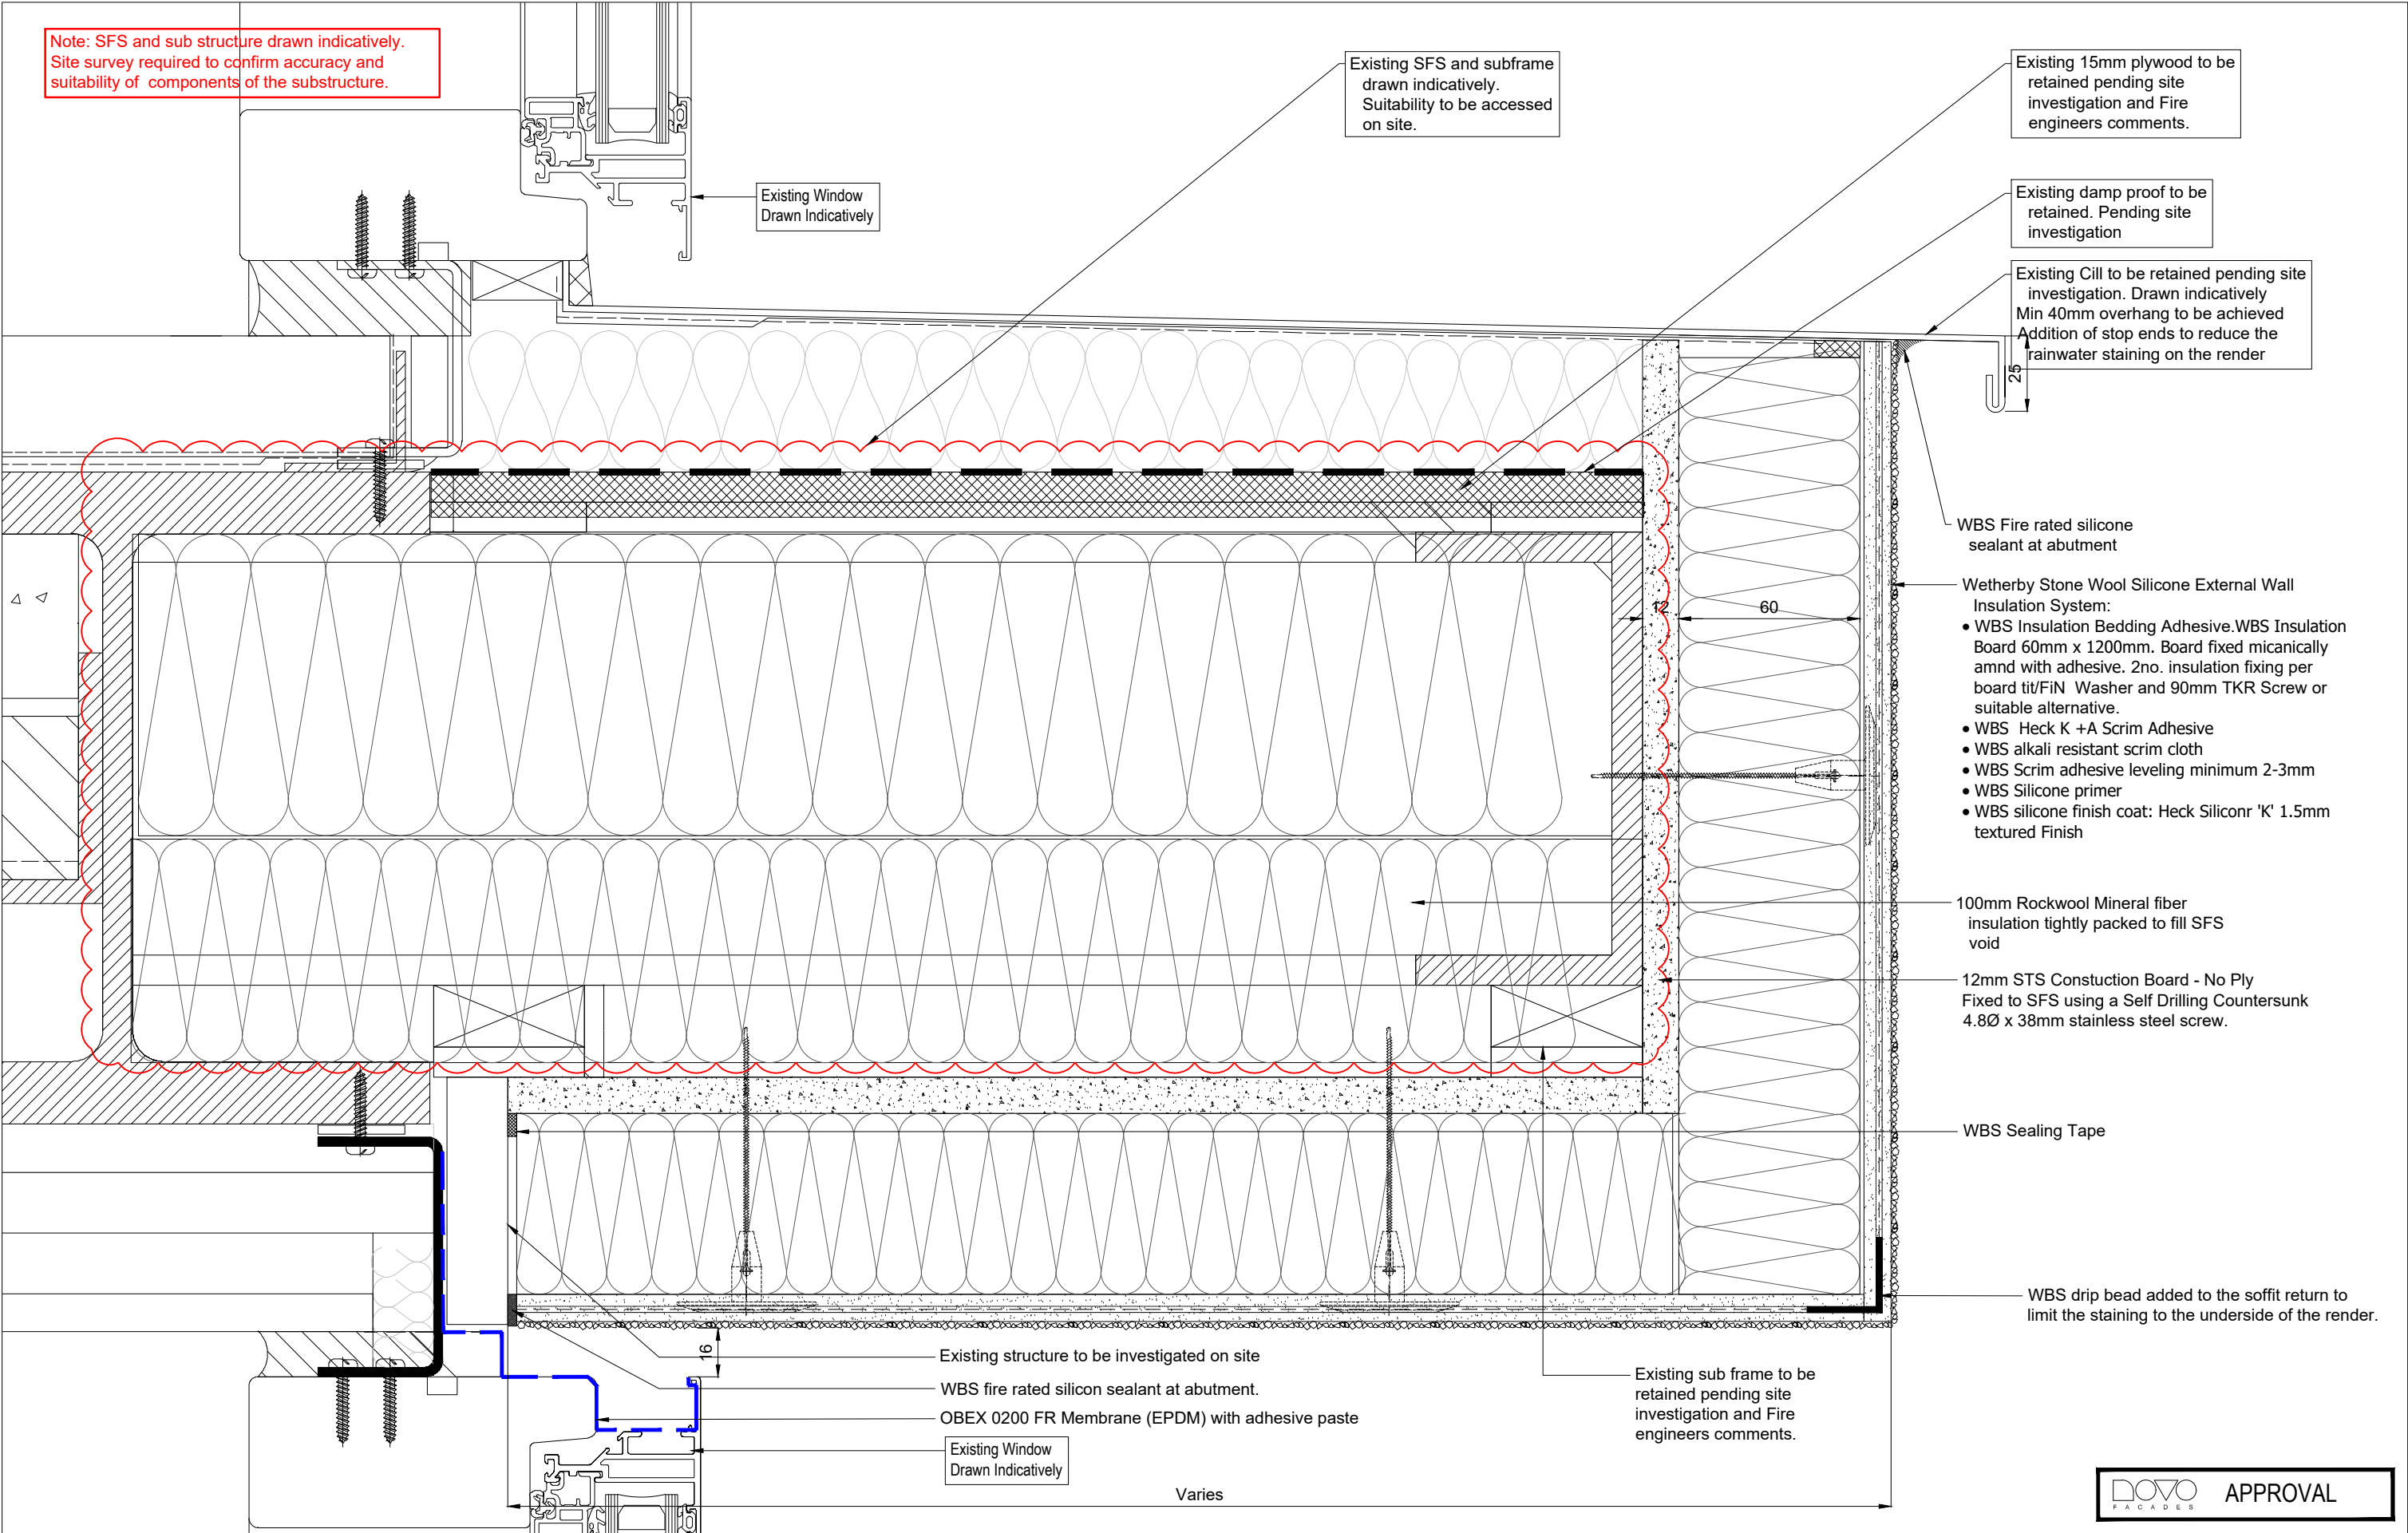

Note: SFS and sub structure drawn indicatively.
Site survey required to confirm accuracy and
suitability of components of the substructure.

Existing SFS and subframe
drawn indicatively.
Suitability to be accessed
on site.

Existing 15mm plywood to be
retained pending site
investigation and Fire
engineers comments.

Existing damp proof to be
retained. Pending site
investigation

Existing Cill to be retained pending site
investigation. Drawn indicatively
Min 40mm overhang to be achieved
Addition of stop ends to reduce the
rainwater staining on the render

Existing Window
Drawn Indicatively

WBS Fire rated silicone
sealant at abutment

- Wetherby Stone Wool Silicone External Wall
Insulation System:
- WBS Insulation Bedding Adhesive. WBS Insulation Board 60mm x 1200mm. Board fixed micanically amnd with adhesive. 2no. insulation fixing per board tit/FiN Washer and 90mm TKR Screw or suitable alternative.
 - WBS Heck K +A Scrim Adhesive
 - WBS alkali resistant scrim cloth
 - WBS Scrim adhesive leveling minimum 2-3mm
 - WBS Silicone primer
 - WBS silicone finish coat: Heck Siliconr 'K' 1.5mm textured Finish

100mm Rockwool Mineral fiber
insulation tightly packed to fill SFS
void

12mm STS Constuction Board - No Ply
Fixed to SFS using a Self Drilling Countersunk
4.8Ø x 38mm stainless steel screw.

WBS Sealing Tape

WBS drip bead added to the soffit return to
limit the staining to the underside of the render.

Existing structure to be investigated on site

WBS fire rated silicon sealant at abutment.


OBEX 0200 FR Membrane (EPDM) with adhesive paste

Existing Window
Drawn Indicatively

Existing sub frame to be
retained pending site
investigation and Fire
engineers comments.

Varies



 F A C A D E S	Novo Facades LTD 74 Broadway Peterborough PE11SU Tel 01733 639020 www.novofacades.co.uk					Project Title	Design House	Drawing Title				Scale		1:2@A3		
						Location	M4 1HS	Typical 1st Floor level Render Soffit detail				Drawn by		NS	Date	30.05.2023
												Checked by		MM	Date	
		Architects Returned Drawing Status				☐ STATUS A	☐ STATUS B	☐ STATUS C	GENERAL NOTES: DIMENSIONS ARE FOR INSTALLATION PURPOSES ONLY. SITE DIMENSIONS MAY VARY. ANY DIMENSIONS ARE TO BE CONFIRMED ON SITE.		Drawing No	NV369-DRG-SUB-D2102		Rev	P2	Sheet 01 of 01

GENERAL NOTES:
DIMENSIONS ARE FOR INSTALLATION PURPOSES ONLY.
SITE DIMENSIONS MAY VARY. ANY DIMENSIONS ARE TO BE CONFIRMED ON SITE.