



EXISTING CONDITION - ASSUMED

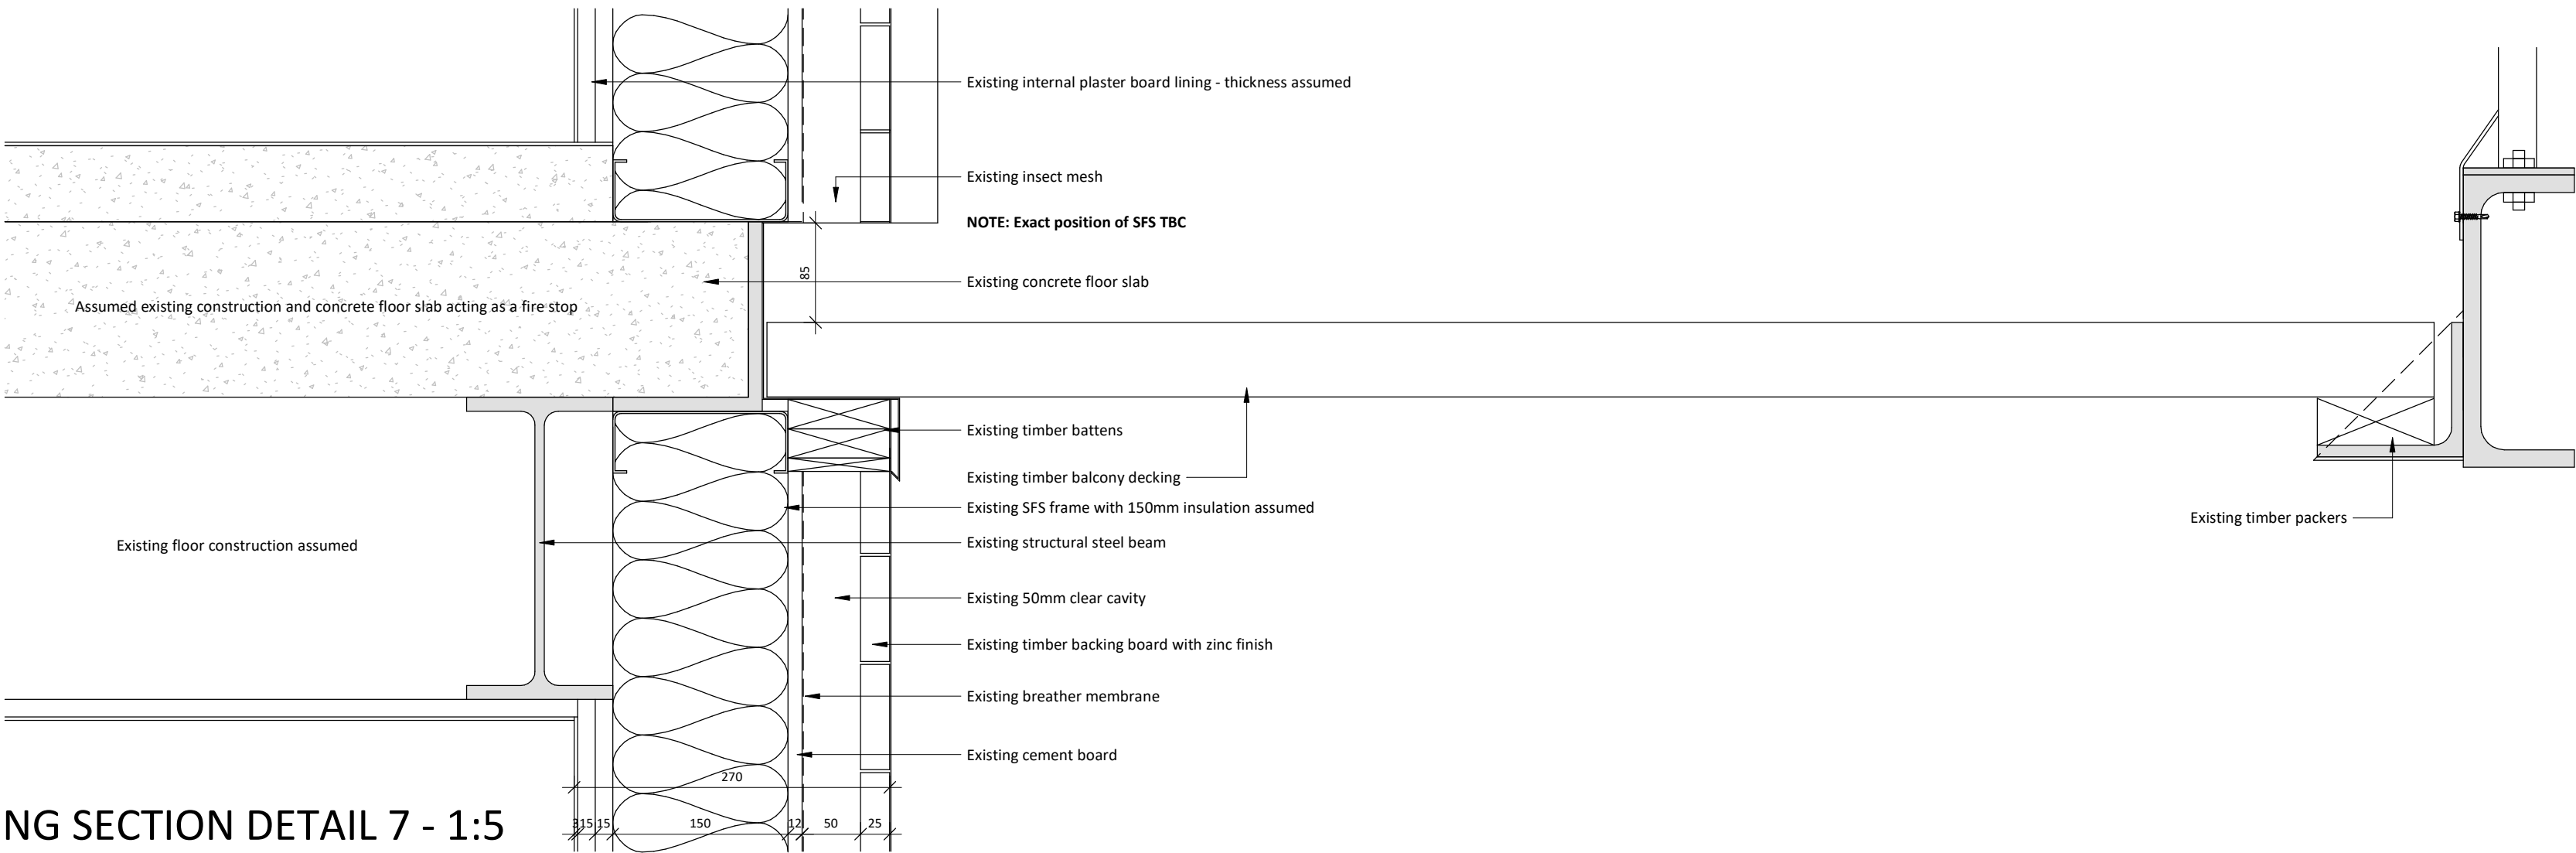


EXISTING SECTION DETAIL 7 - 1:5

REMOVAL

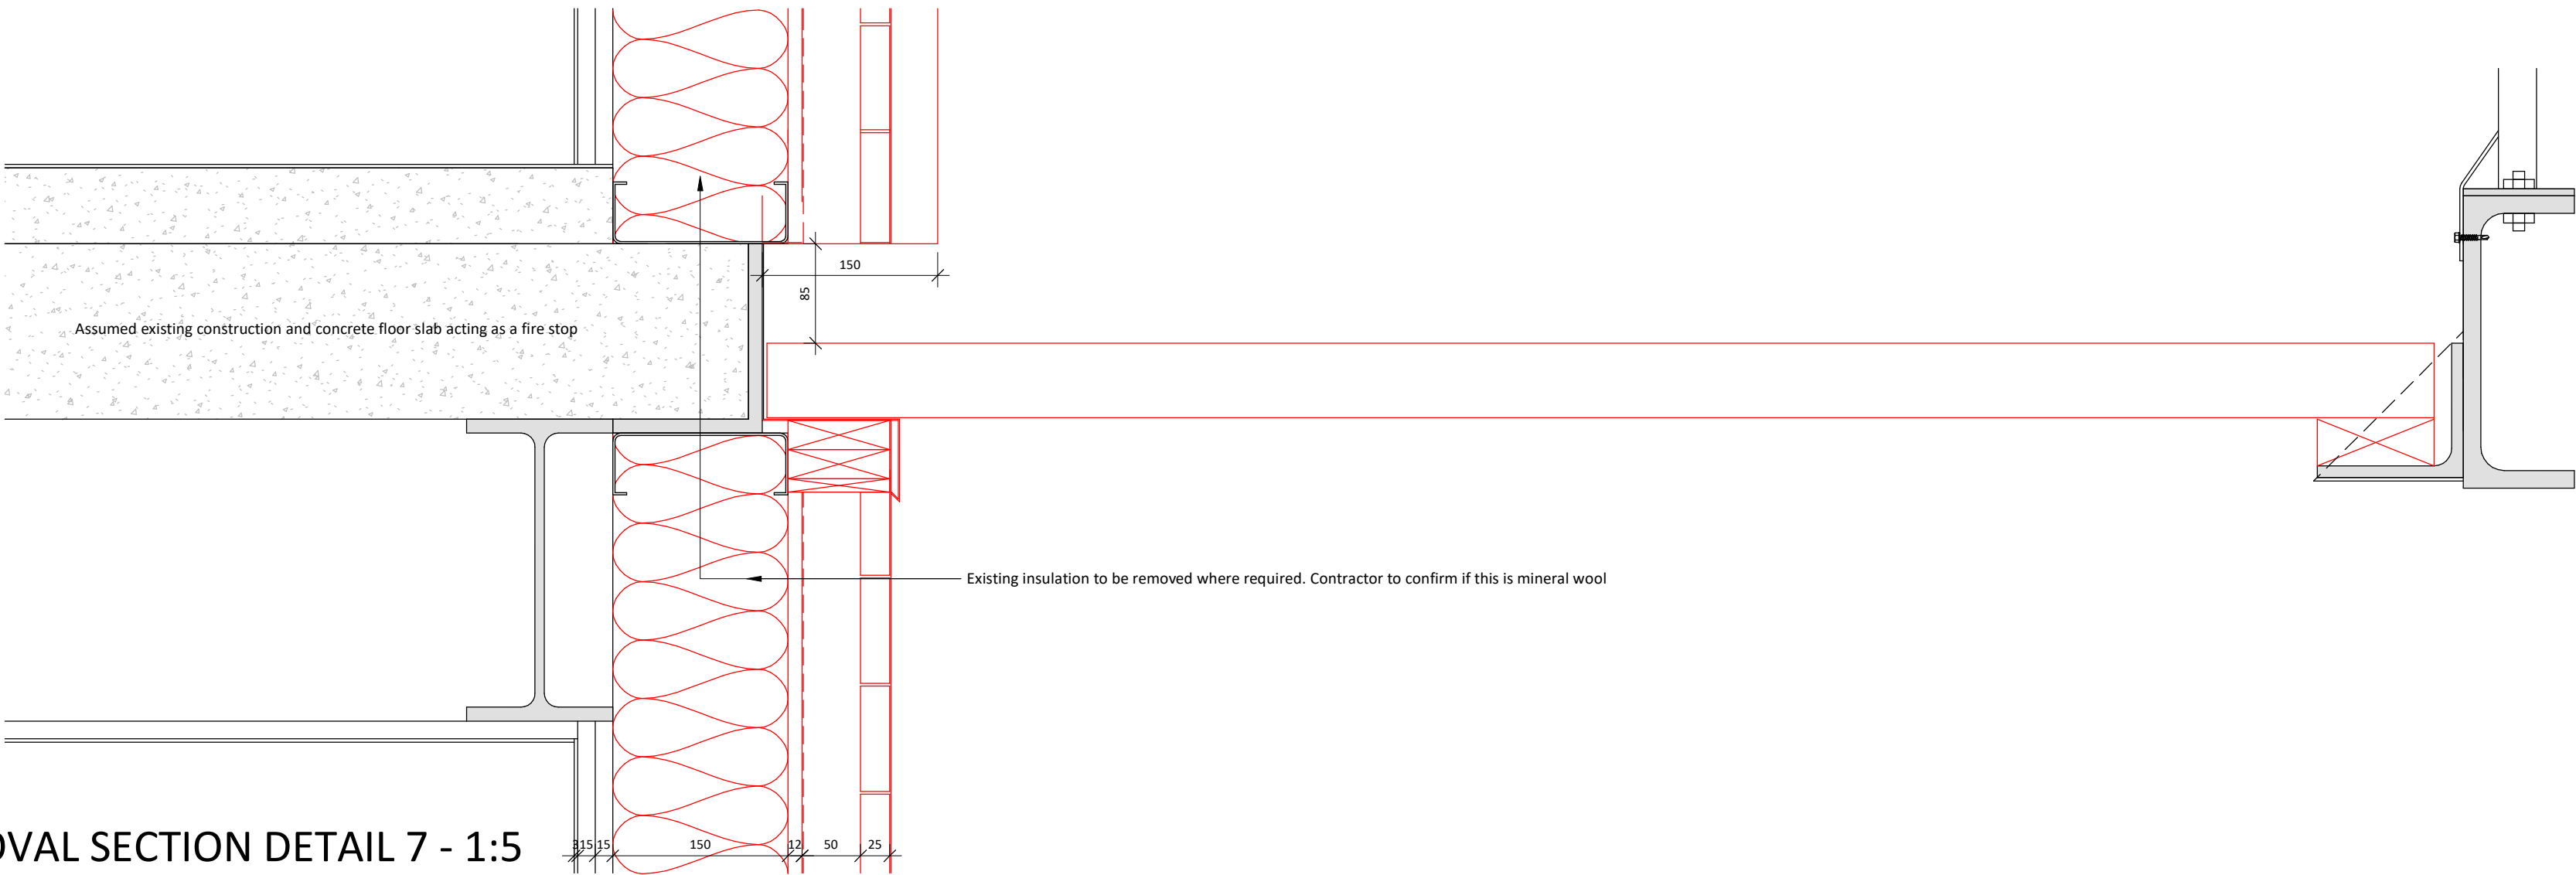

REMOVAL SECTION DETAIL 7 - 1:5

PROPOSED WORKS (CONCEPT ONLY)

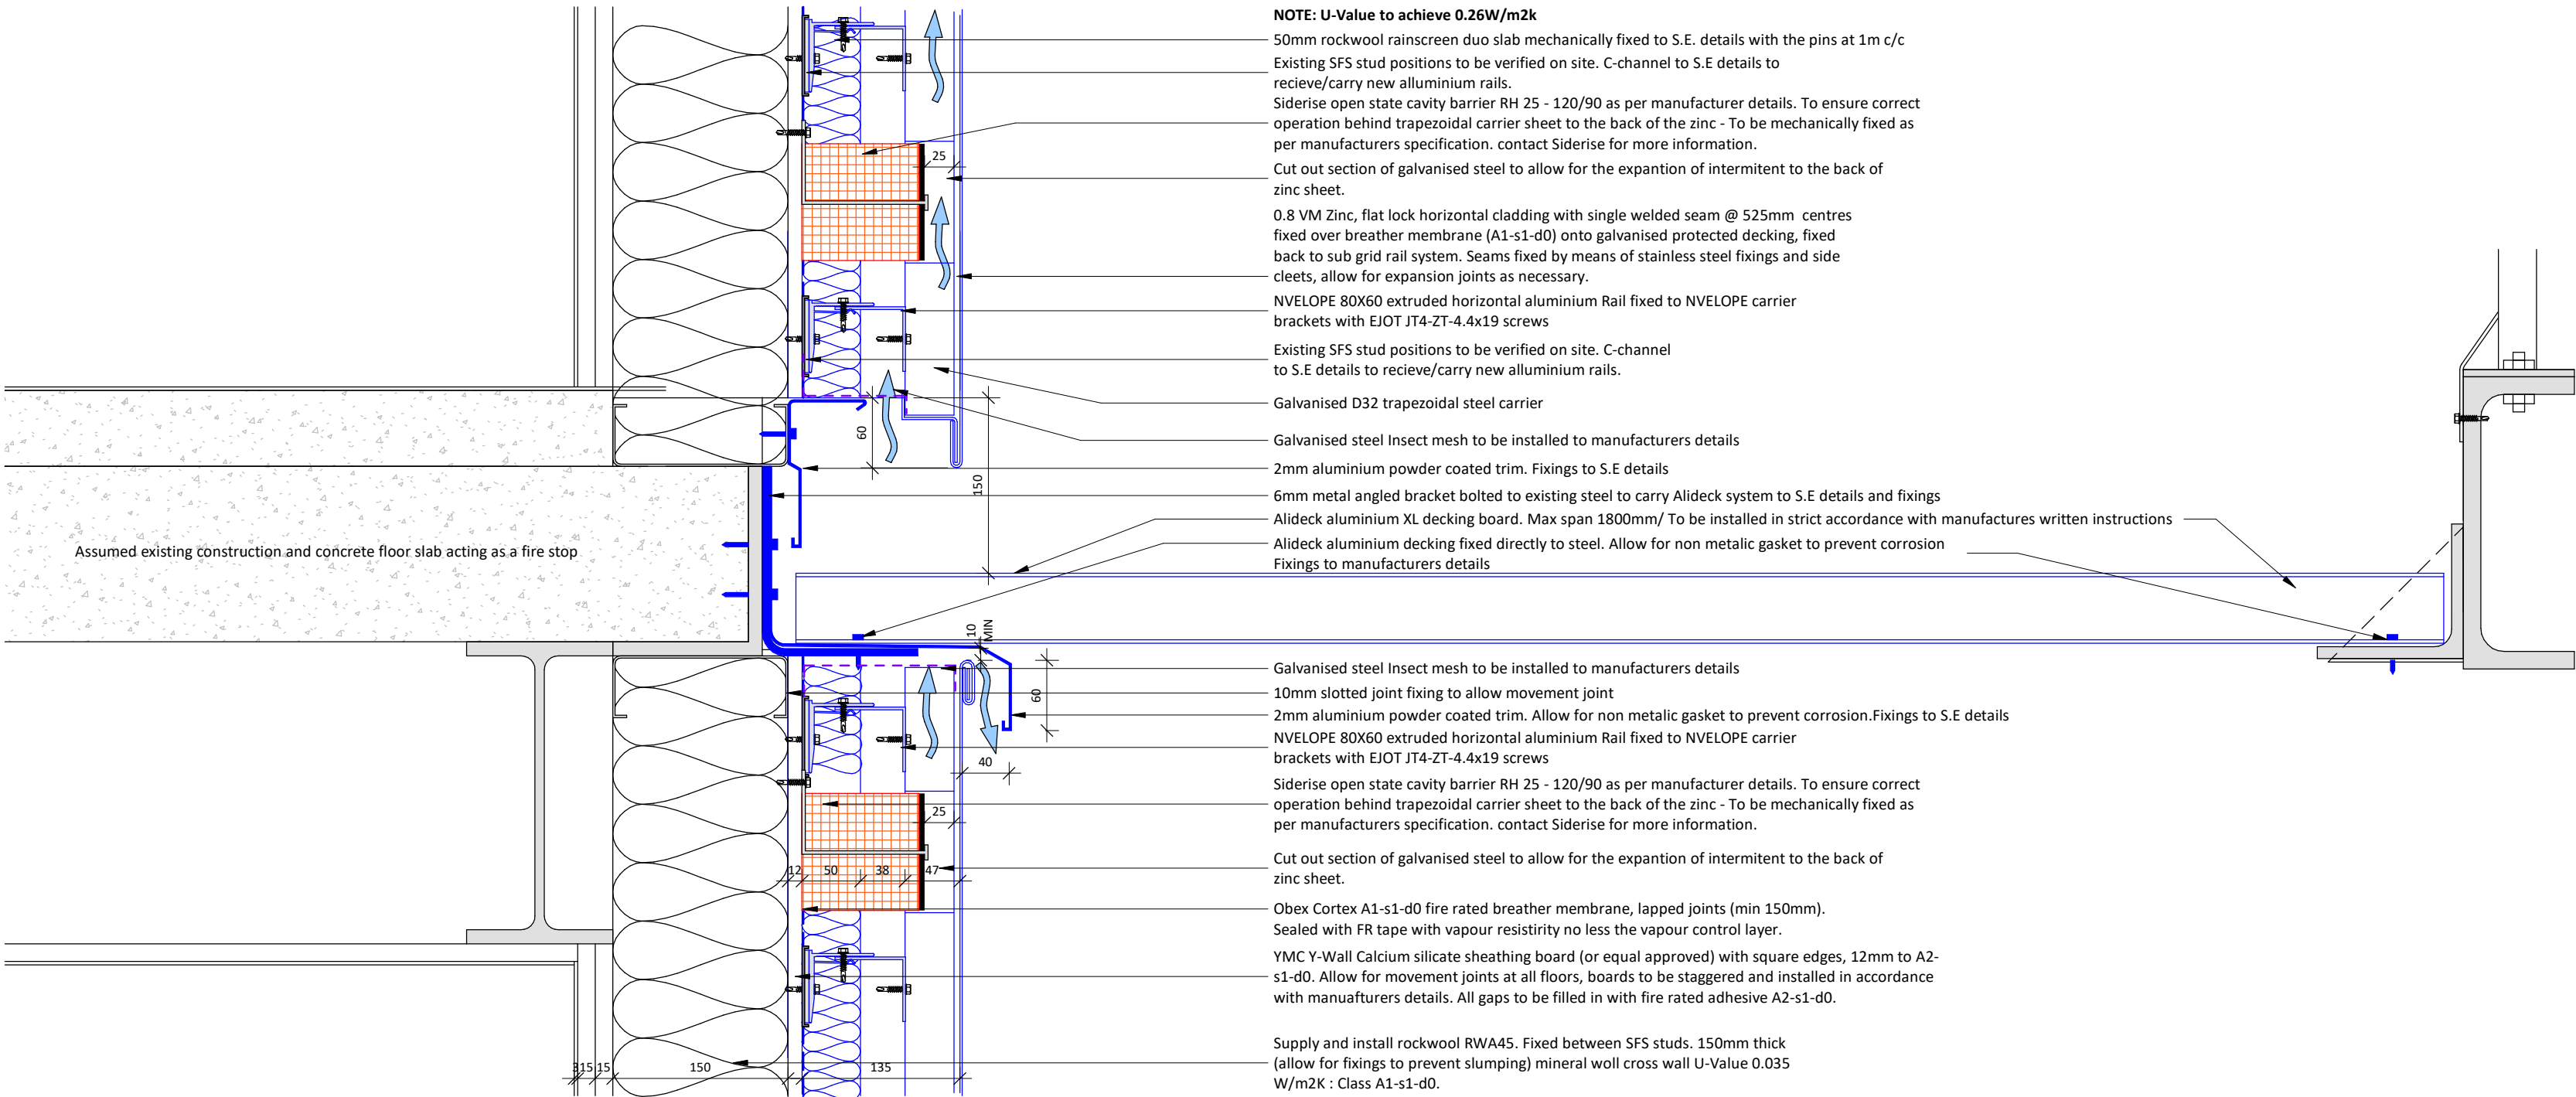

CONCEPT SECTION DETAIL 7 - 1:5

Fire Stopping
Cladding
Sealant at junctions with windows

BS 476 Part 20: 1987 BS EN 1366-4: 2006 and classified to BS EN 13501-2
BS EN 13501-1:2018 Euroclass A2-s1,d0 – non-combustible
Tested to EN 1366-4

EPDM Cortex 0500FR Class B Cortex 0771FR Class B paste around windows, patio doors and balcony supports

Product specification and details to be contractors design.

FIRE SPECIFICATION
ALL CAVITY BARRIERS IN EXTERNAL WALL TO BE INSTALLED IN STRICT ACCORDANCE WITH MANUFACTURER'S WRITTEN INSTRUCTIONS AND DETAILS
ALL EXTERNAL WALL INCLUDING THE CP BOARD TO COMPLY WITH BUILDING REGULATIONS PART B REGULATION 7 MINIMUM STANDARD A2-s1-d0
ALL CAVITY BARRIERS MINIMUM REQUIREMENT TO COMPLY WITH BUILDING REGULATIONS PART B 30min integrity and 15min insulation (30/15 EI) Horizontal barrier along slab edge to achieve 90/90 where a picture framing approach is adopted.
ALL FIRE STOPS MINIMUM REQUIREMENT TO COMPLY WITH BUILDING REGULATIONS PART B 60min INTEGRITY AND 60min INSULATION (60/60 EI)

EXPANSION JOINT AT EVERY FLOOR LEVEL

ALL DIMENSIONS ARE INDICATIVE AND MUST BE CONFIRMED ON SITE BY MANUFACTURER, SUPPLIER OR SPECIALIST PRIOR TO PLACING ORDERS OR COMMENCING WORKS

Ducts
Ducts to be sealed with everflex intumescent fire mate - NOTE: TBC
Rytens non combustible grille as Part of A1 ducting kit - NOTE: TBC

All Service Penetrations
Require inspection specialists to achieve the same fire rating as the structure. Service penetrations to be guaranteed by specialist and certified. Service penetrations will need to considered to the whole wall beyond the CP board

DESIGN PARAMETERS OF FIXING BRACKETS FOR THE ZINC PANELS
BRACKETS AT 750C/C THROUGHOUT
RAILS AT MAX 600MM OR 700MM DEPENDING ON APPLICATION BUILD UP
TO S.E. DETAILS & CALCULATIONS

ALL ZINC PANELS PROPOSALS ARE INDICATIVE AND TO BE DESIGNED BY FACADE SPECIALIST

To include where necessary
• 10mm gap for thermal expansion where necessary

- Hilti S-AD OLS - 5.5 x 1.9 (FxS) Steel Tie
- Thermal Isolating pad
- CS1 Extruded Aluminium angle
- MFT - MF1 095 Extended Aluminium helping hand bracket on thermal pad to steel walkway/wall construction
- 2mm thick Aluminium ceiling/wall panel

Notes & Caveats

- Integrity of fire protection provided by existing floors & separating walls to be reviewed, client to be advised of any remedial works required and instruction sought.
- Existing Fire Protection to structural frame to be retained throughout. Any concerns over the integrity, prior to or during the works are to be raised with the Building Control Approved Inspector and client.
- All proprietary and brand-named elements (eg. Rockwool, Hilti, et al) must be installed in strict accordance with the manufacturer's written instructions. If in any doubt allow for queries to be reviewed with the manufacturer's technical support team
- **All fire doors and fire stopping must be verified and certified by a third party certifier**
- Aluminium and stainless steel components must not come into contact with each other. If unavoidable, the two must be separated by a membrane barrier to avoid corrosion. Fixings of aluminium & stainless steel components (eg. angles, brackets etc) must be at least 7mm from the surface edge
- All fixings and movement joints to be specified by specialist. All details are to be installed in strict accordance with manufacturers' written instructions. All details are indicative and to be confirmed by manufacturer, supplier or specialist. All existing dimensions must be checked on site by contractor.
- Allow for expansion of all metals via slots if necessary and provide S/S fixing or breaks to prevent accelerated corrosion
- Acceptable contact between alternative metals and zinc. Lead, Aluminium, Galvanised steel and stainless steel.
- Unacceptable contact between alternative metals and zinc. Copper and steel (Non galvanised).

Key

- Existing - to remain and/or be made good in accordance with specification
- To be removed
- To be added
- New cavity barrier / fire stop (see annotations)
- New breather membrane
- New vapour control layer
- New EPDM Class B waterproofing membrane

5	19/09/23	TP	Drawing amended in line with SE comments
4	05/09/23	TP	Balcony detail amended, CP board & fire stop note amended
3	31/08/23	TP	Amended following consultant comments
2	14/07/23	TP	Amended following VMZinc & Contractor Comments
1	12/07/23	TP	Amendments following contractor review
Rev	Date	Int	Description



CLIENT:
Intelligent FS

PROJECT:
Worsley Mill, Blantyre St, Manchester

DESCRIPTION:
Detail 07 - Typical Zinc Cladding Termination Detail

PURPOSE OF ISSUE:
Planning

DRAWN BY: CHECKED DATE: SCALE @ A1:
TP LB 04/07/23 As indicated

JOB NO: STATUS CODE: DRAWING NO: REV
4297 S2 126 5

FILE IDENTIFIER:
WM-BTP-00-ZZ-DR-A-4297__126.5

Elizabeth House 486 Didsbury Road Heaton Mersey Stockport SK4 3BS
0161 443 1221 info@bernardtaylor.co.uk www.btparchitects.co.uk

Detail 07
1 : 200

