


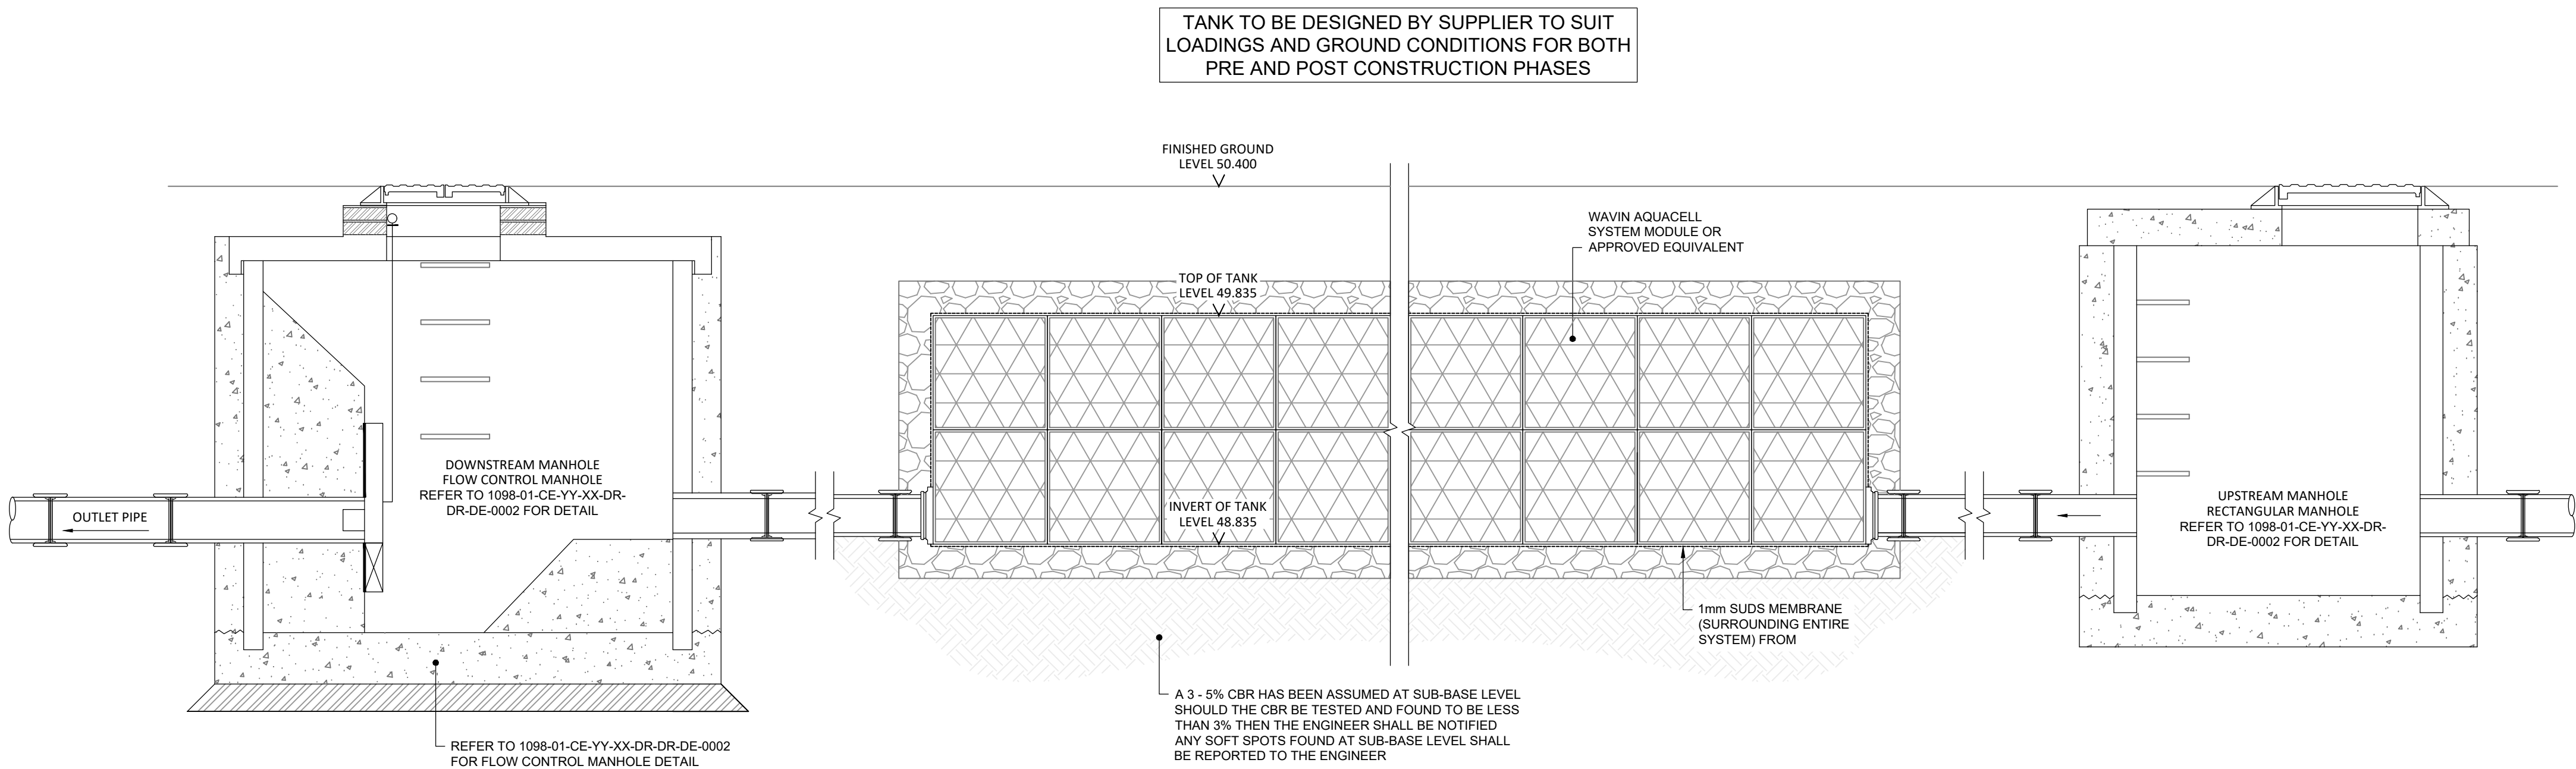


NOTE: THIS DRAWING IS INDICATIVE ONLY
SEE MANUFACTURER'S DRAWINGS AND
SPECIFICATIONS FOR CONSTRUCTION DETAILS

ATTENUATION TANK DETAIL

SCALE 1:20


Note: It is recommended that one vent pipe, 110mm in diameter, is provided per 7,500 square metres of impermeable catchment area on a site.

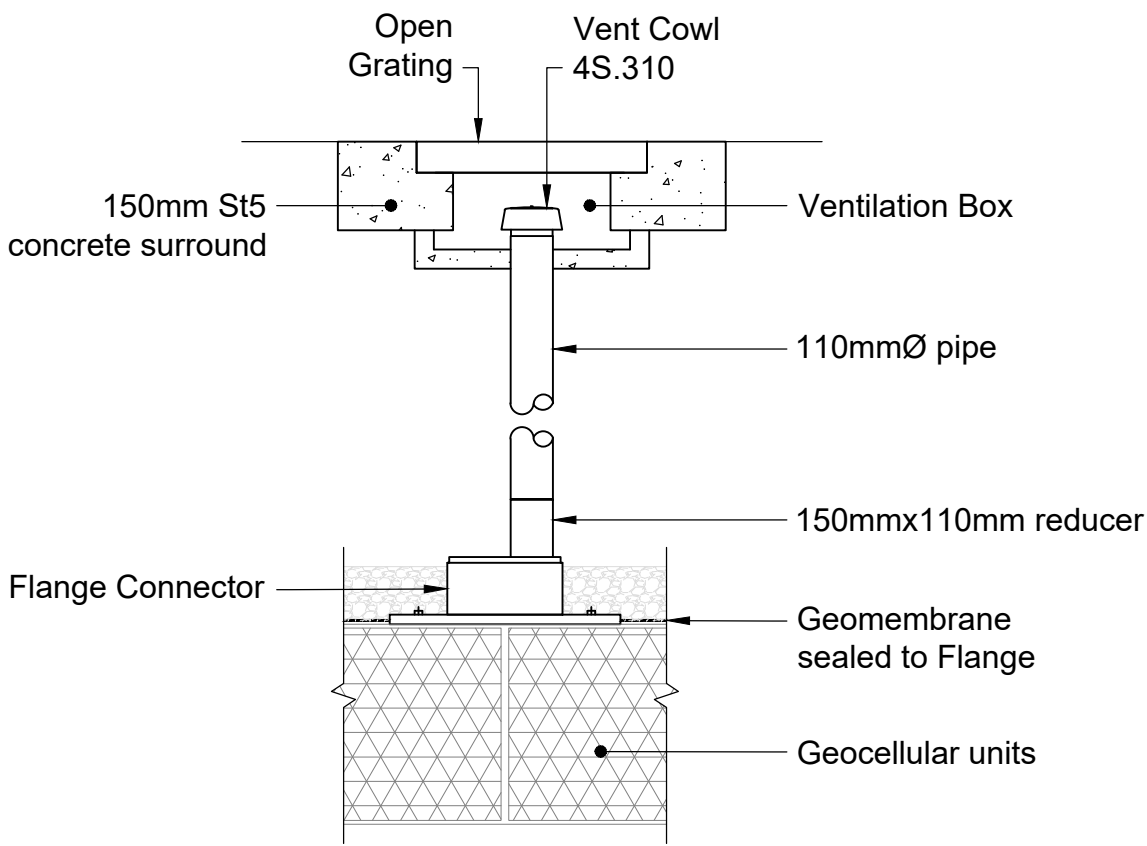

TYPICAL ATTENUATION TANK VENT DETAIL


SCALE 1:20

NOTE: ALL CONNECTIONS THROUGH FOUNDATIONS TO HAVE Z CLASS CONC. SURROUND WITH FLEXIBLE COUPLINGS ON ALL COUPLINGS WHERE COVER LEVEL IS LESS THAN 600mm FOR PEDESTRIAN AREAS AND 900mm FOR VEHICULAR AREAS.

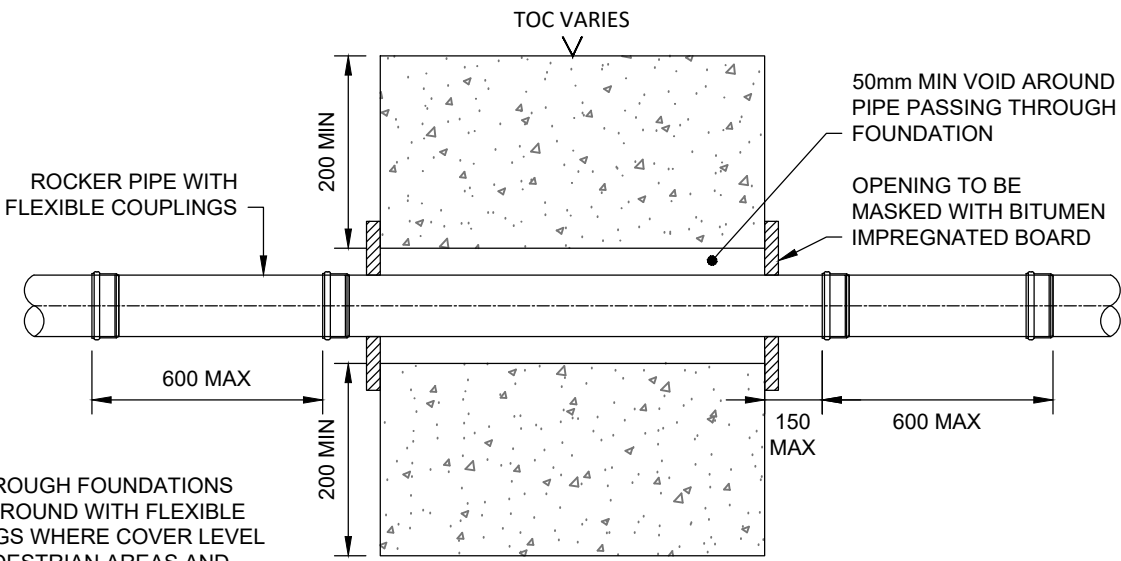

TYPICAL PIPE THROUGH FOUNDATION AND GROUND BEAM DETAIL

SCALE 1:20

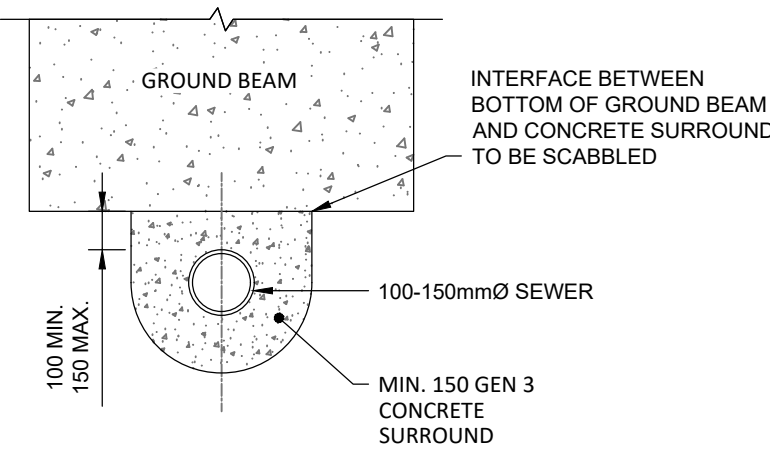


TYPICAL PIPE TO GROUND BEAM CONNECTION DETAIL

SCALE 1:20

APPLIES TO SEWER PIPES WITH 100-150mm COVER TO UNDERSIDE OF GROUND BEAM

NOTE: ALL PIPE TO GROUND BEAM CONNECTION DETAIL TO HAVE FLEXIBLE COUPLINGS WITH ROCKER POPES AT EITHER SIDE

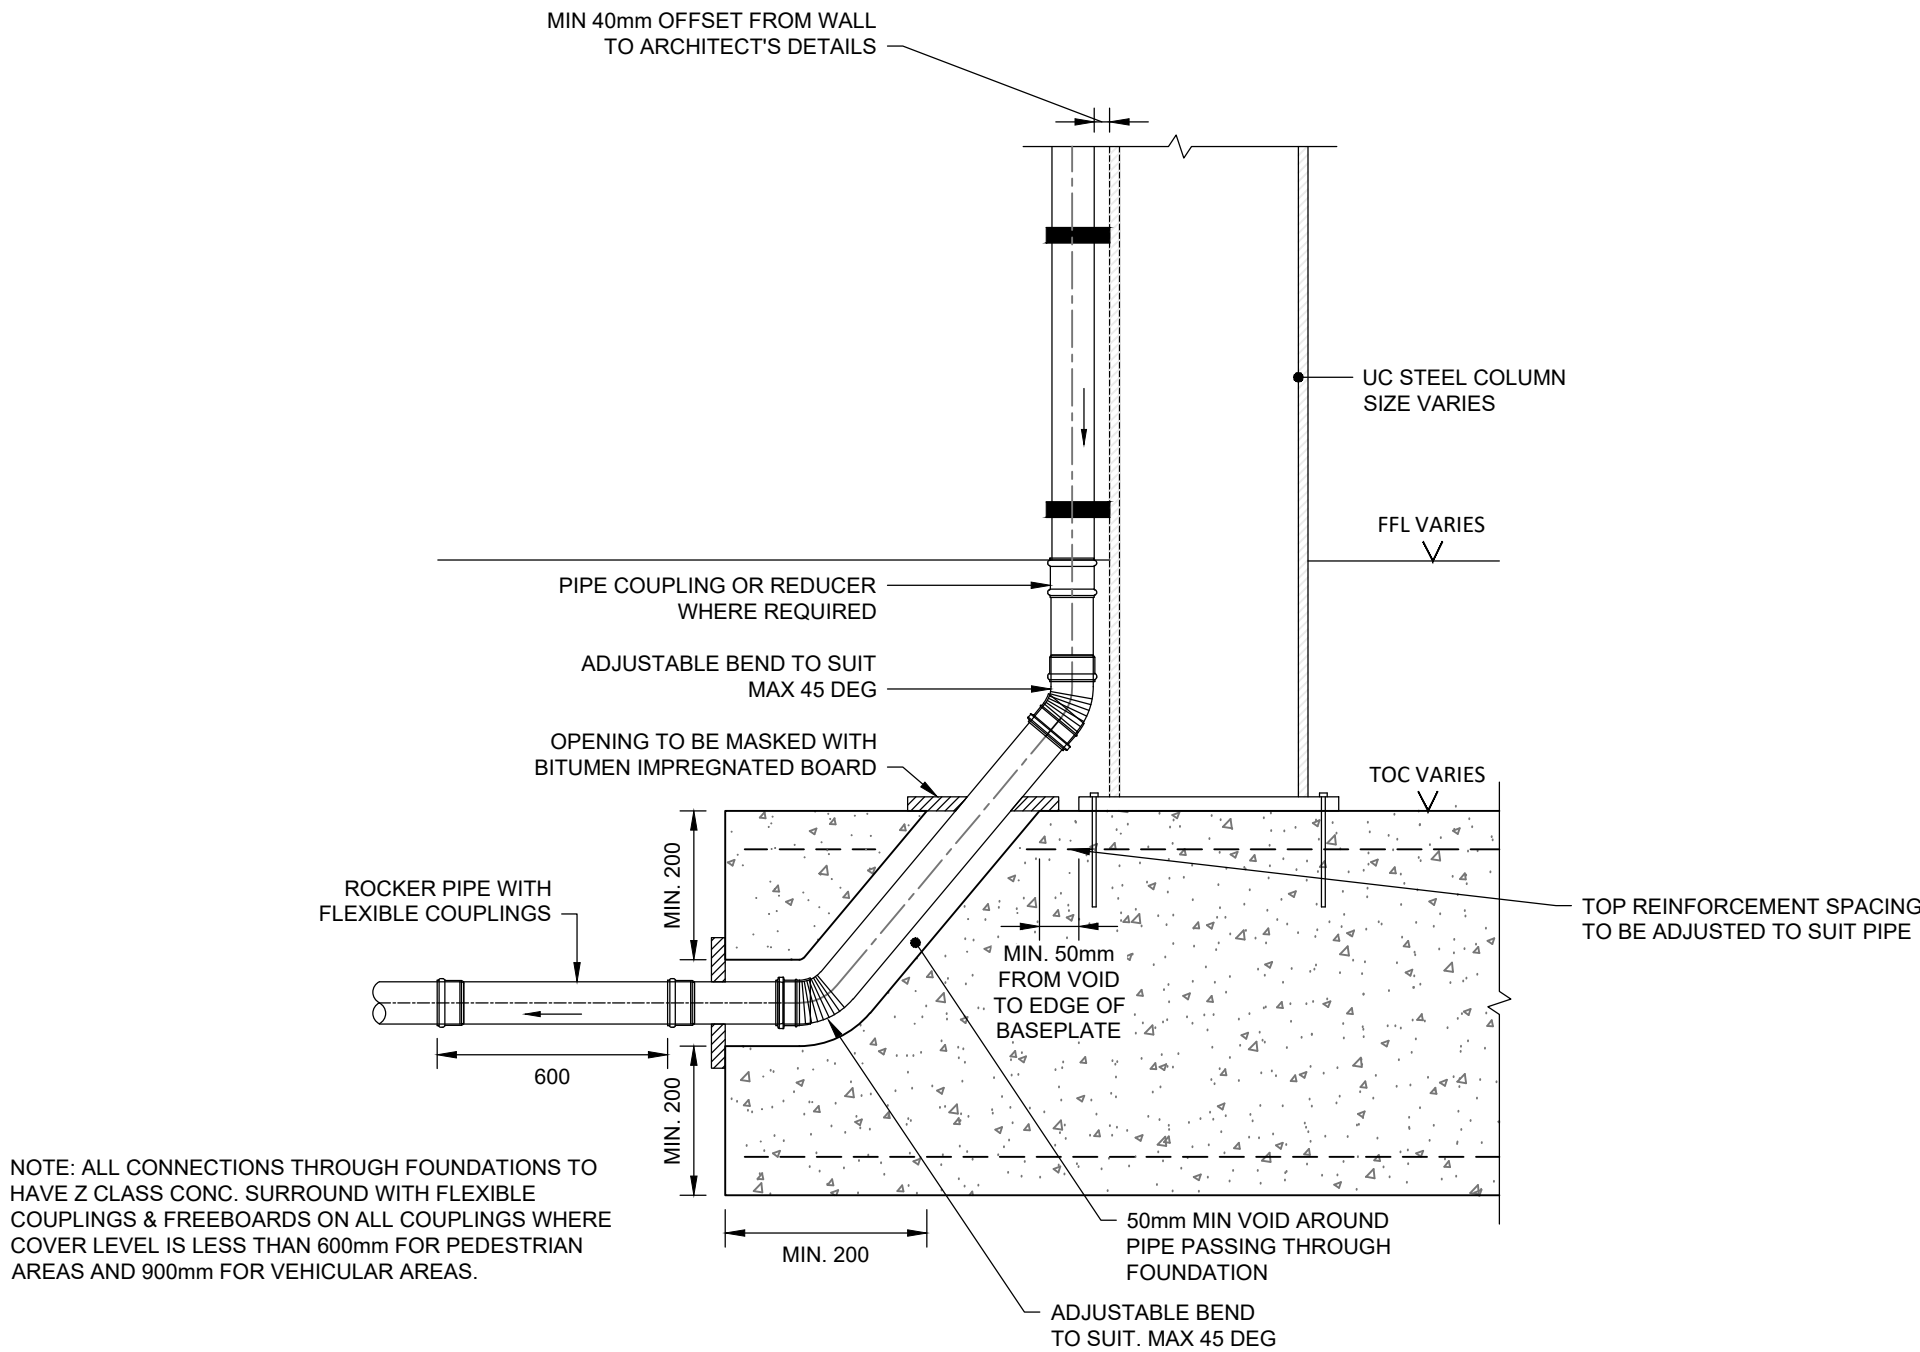

NOTE: ALL CONNECTIONS THROUGH FOUNDATIONS TO HAVE Z CLASS CONC. SURROUND WITH FLEXIBLE COUPLINGS & FREEBOARDS ON ALL COUPLINGS WHERE COVER LEVEL IS LESS THAN 600mm FOR PEDESTRIAN AREAS AND 900mm FOR VEHICULAR AREAS.

TYPICAL PIPE THROUGH FOUNDATION (ADJACENT COLUMN) DETAIL

SCALE 1:20

Standard Notes

1. This drawing is to be read in conjunction with all relevant Architect's and Engineer's drawings and the specification.
2. This drawing should not be scaled.
3. All dimensions are to be verified by the contractor on site.
4. All discrepancies should be reported to the C.A. prior to the commencement of the works.

© CIVIC ENGINEERS

Notes

BENCHING NOTES

Main & branch channels to be bedded and jointed in 1:3 cement mortar.

Main channel benching to be formed vertically to a minimum of the soffit of the outlet pipe. The benching shall be rounded off to a radius of approximately 25mm and sloped upwards at a gradient of 1:10 to 1:30 to chamber walls.

Benching shall be floated to a smooth, hard surface with a 1:2 cement mortar laid monolithic with the benching.

Side branches of diameter up to and including 150Ø should discharge to the main channel in the direction of flow, preferably at half pipe level. Where the connecting angle is more than 45°, three quarter section bends should be shaped so as to contain the flow without permitting fouling and facilitate rodding of branch drains.

A branch with greater than 150Ø should be set with the soffit level with that of the main drain.

COVERS & FRAMES

Internal cover and frame shall be of the recessed type to accommodate infill material. See Architects drawings for finishes

Covers within block paved areas shall be orientated to suit orientation of surrounding blockwork. Manhole covers and frames situated within vehicular areas are to be Class D. Manhole covers and frames situated within non-vehicular areas are to be Class B (Refer Manhole Schedule). Manhole covers and frames are to comply with BS EN124-2 if cast iron.

Manhole access to be orientated such that step irons lead to benching and not pipe channels.

Oversail corbelling shall not exceed 30mm on each course.

Chambers with outgoing pipes greater than 600mm diameter shall be fitted with guard bars, safety chains or other safety devices.

Toe holes to be provided in benching of sewer greater than 450mm diameter for access to pipe invert.

All connections into and out of chambers/gullies to have Class Z concrete surround with flexible couplings and flexiboards on all couplings where cover to pipe soffit is equal to or less than:

- 1) 1200mm under vehicular areas
- 2) 600mm under non-vehicular areas

All adoptable details shown on this drawing shall be constructed in accordance with Sewers for Adoption 6th Edition

All concrete used in construction within sewer/drain and domestic drainage to be constructed with sulphate resisting cement.

23.04.21	C01	Construction	AB	CK
29.01.21	T01	Supersedes drawing 1098-01-CE-YY-XX-DR-DR-DE-0005-T02	LG5	CK

Date	Rev	Description	Drawn	Chkd
------	-----	-------------	-------	------

**Civic Engineers**

MANCHESTER
LONDON
LEEDS
GLASGOW

Civic's Warehouse: 77 Dale Street, Manchester, M1 2DG. Tel: 0161 228 6757
Rivers Wharf, 51 Ash Street, London SE1 2AR. Tel: 020 7513 3977
Tower Works, Unit 02-01, Globe Road, Leeds, LS11 5DG. Tel: 0113 2023 130
Graham Chambers, 40 West Mill St, Glasgow, G3 7PT. Tel: 01441 210 1820

www.civicingineers.com

Project

Addington Street
New Cross

Title

Drainage Strategy
Drainage Details
Sheet 5 of 5

Status

CONSTRUCTION

Scale @ A1	Date Created	Drawn	Checked
1:20	27/09/19	EMM	PJC
Project Number	Originator	Discipline	Drawing Number
AS01	CIV	D	DR-0105
			Revision
			C01