Note: SFS and sub structure drawn indicatively.
Site survey required to confirm accuracy and suitability of components of the substructure.

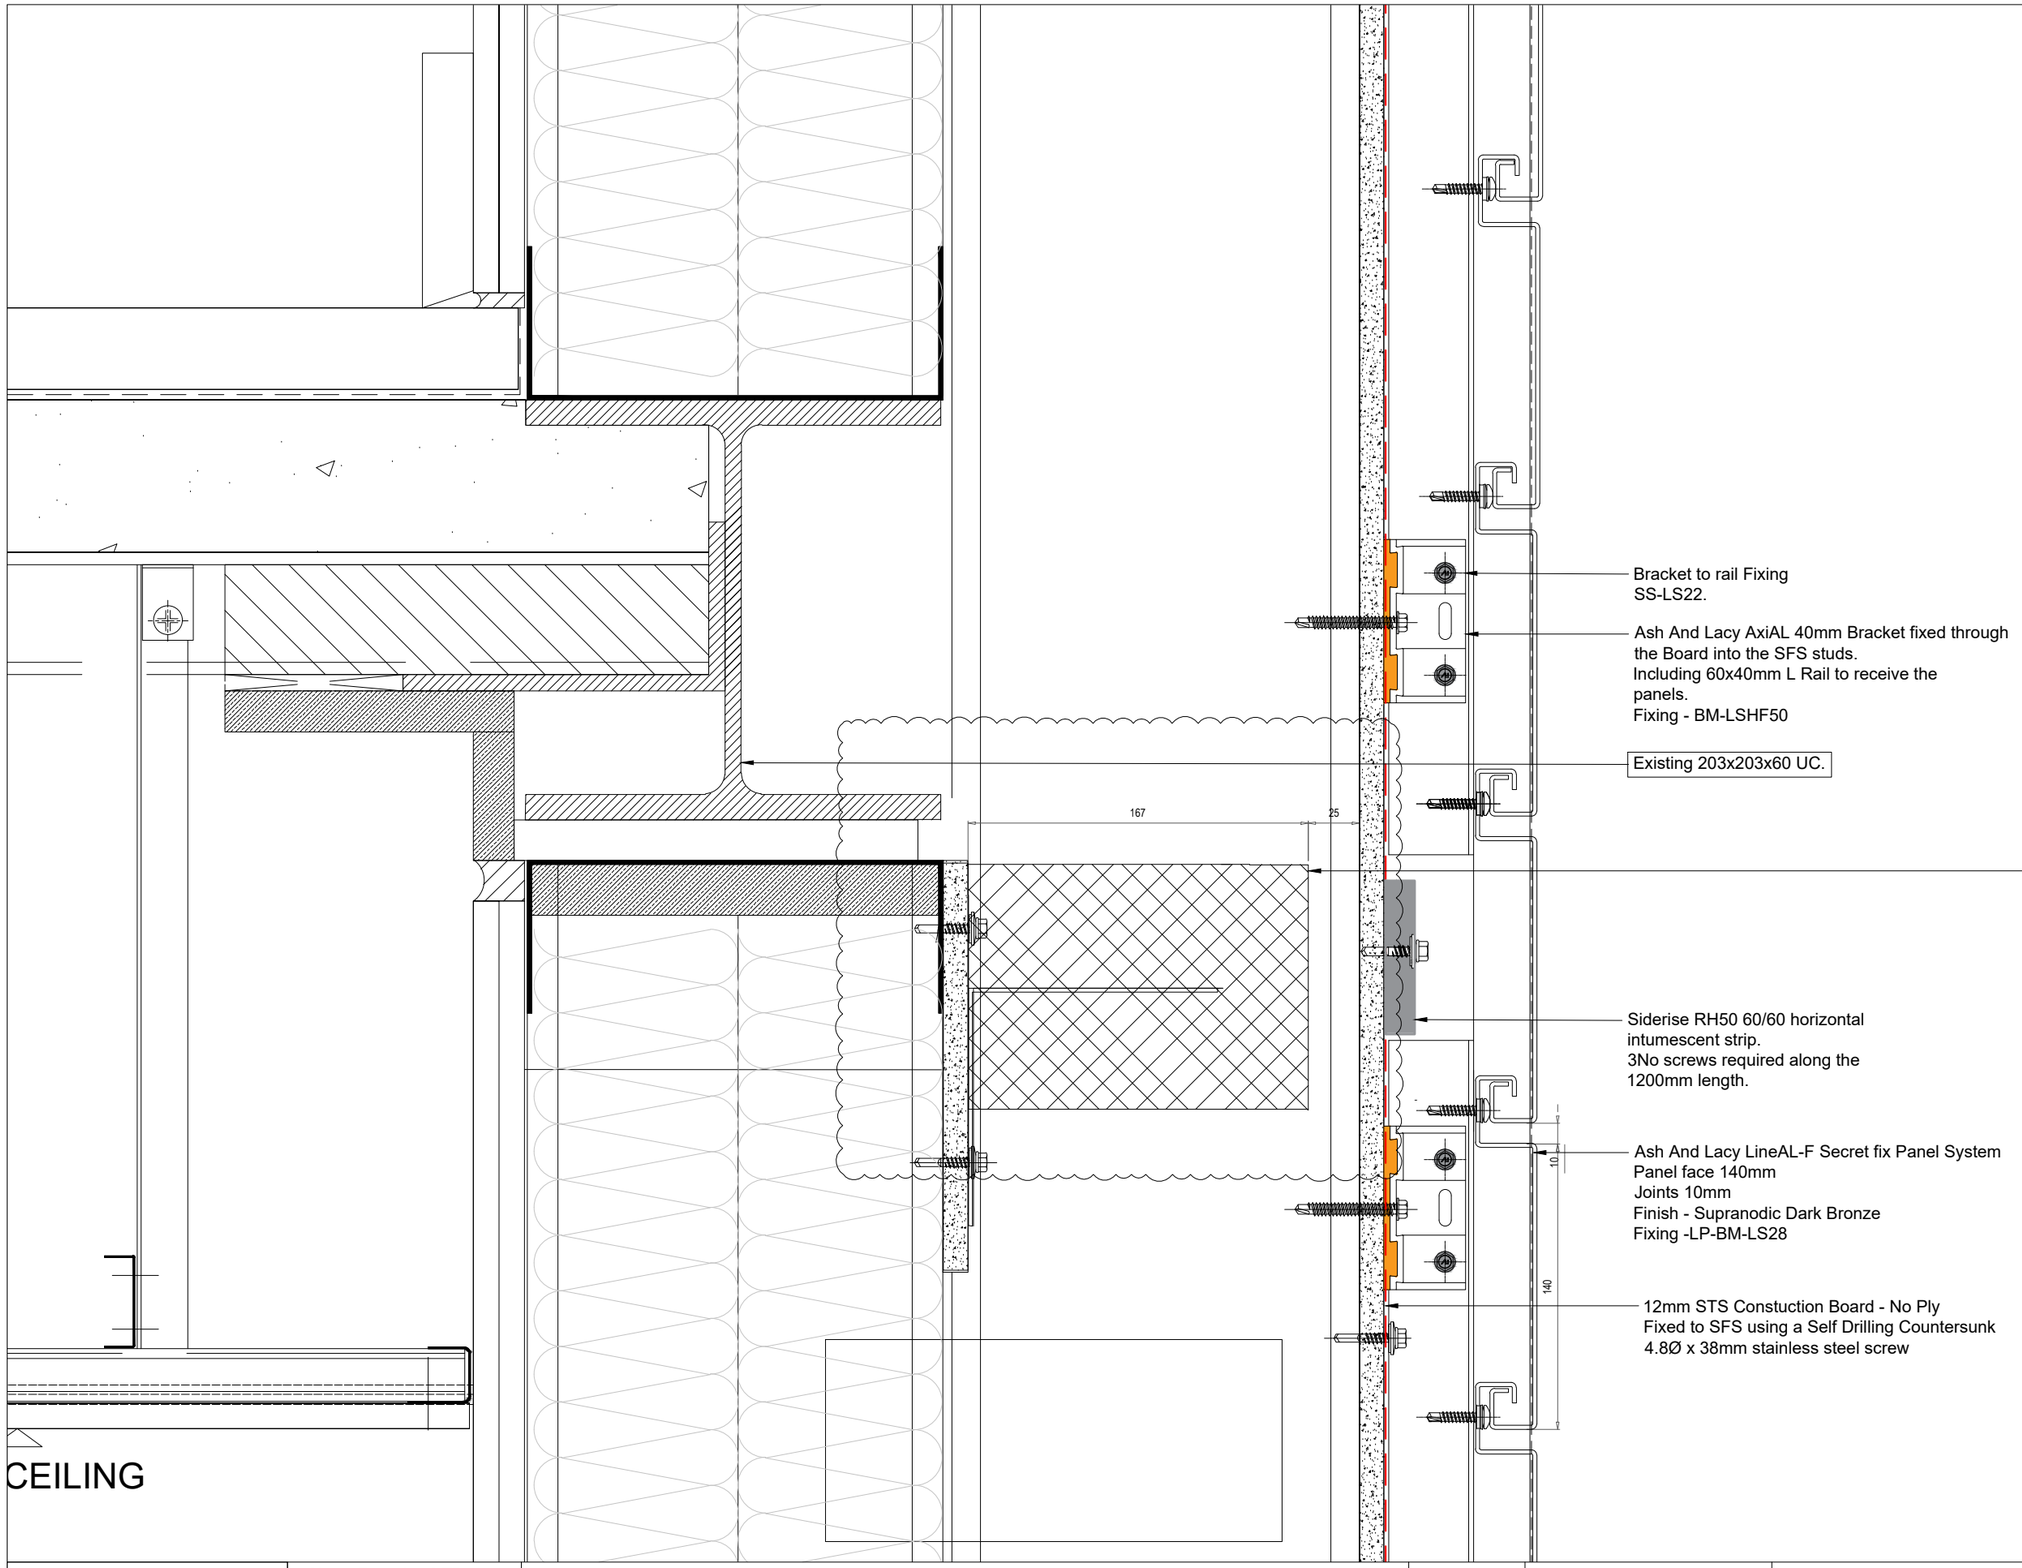

Bracket to rail Fixing
SS-LS22.

Ash And Lacy AxiAL 40mm Bracket fixed through the Board into the SFS studs.
Including 60x40mm L Rail to receive the panels.
Fixing - BM-LSHF50

Existing 203x203x60 UC.

Siderise RH25-120/60 open state cavity barrier. 25mm airgap maintained between barrier and CP board.
E120/i60
fixedr using 3no RS 350 steel brackets to be used at 400mm centers.
Fire Barrier in abeyance discussion on a parallel barrier within the steel rather than a tapered.Steel Placement to be confirmed on site

Siderise RH50 60/60 horizontal intumescent strip.
3No screws required along the 1200mm length.

Ash And Lacy LineAL-F Secret fix Panel System
Panel face 140mm
Joints 10mm
Finish - Supranodic Dark Bronze
Fixing -LP-BM-LS28

12mm STS Constuction Board - No Ply
Fixed to SFS using a Self Drilling Countersunk 4.8Ø x 38mm stainless steel screw

CEILING

APPROVAL

Novo Facades LTD
74 Broadway
Peterborough
PE11SU
Tel 01733 639020
www.novofacades.co.uk

01.12.2023 - P2

Architects Returned Drawing Status ☐ STATUS A ☐ STATUS B ☐ STATUS C

GENERAL NOTES:
DIMENSIONS ARE FOR INSTALLATION PURPOSES ONLY.
SITE DIMENSIONS MAY VARY. ANY DIMENSIONS ARE TO BE CONFIRMED ON SITE.

Project Title	Design House
Location	M4 1HS
Drawing Title	Slab Level Party Floor Detail
Scale	1:3@A3
Drawn by	LJ **Date** 14.11.2023
Checked by	MM **Date**
Drawing No	NV369-DRG-SUB-D3103 **Rev** P2
	Sheet 01 of 01