


NOTES

1. All dimensions are in millimetres unless shown otherwise.


2. The flow control unit shall be manufactured by Hydro International, Shearwater House, Clevedon Hall Estate, Victoria Road, Clevedon, BS21 7RD. Refer to manufacturers instructions for installation. Tel: 01275 878371 Fax:01275874979. www.hydro-international.biz
3. The flow control units supplied shall pass a maximum flow of 11 l/s at a head of 1.0m.

4. The flow control units supplied shall be fitted in accordance with the manufacturers instructions. The Contractor shall ensure the flow control unit does not require an outlet pipe greater than 225mmØ

5. Double Step Rungs shall be used at 300mm Centres. Manholes over 3m deep will require Ladder (contractor to confirm depth / ladder or steps rungs prior to installation and any discrepancies reported back to engineer). 675mm maximum to first step rung / ladder rung from cover level.

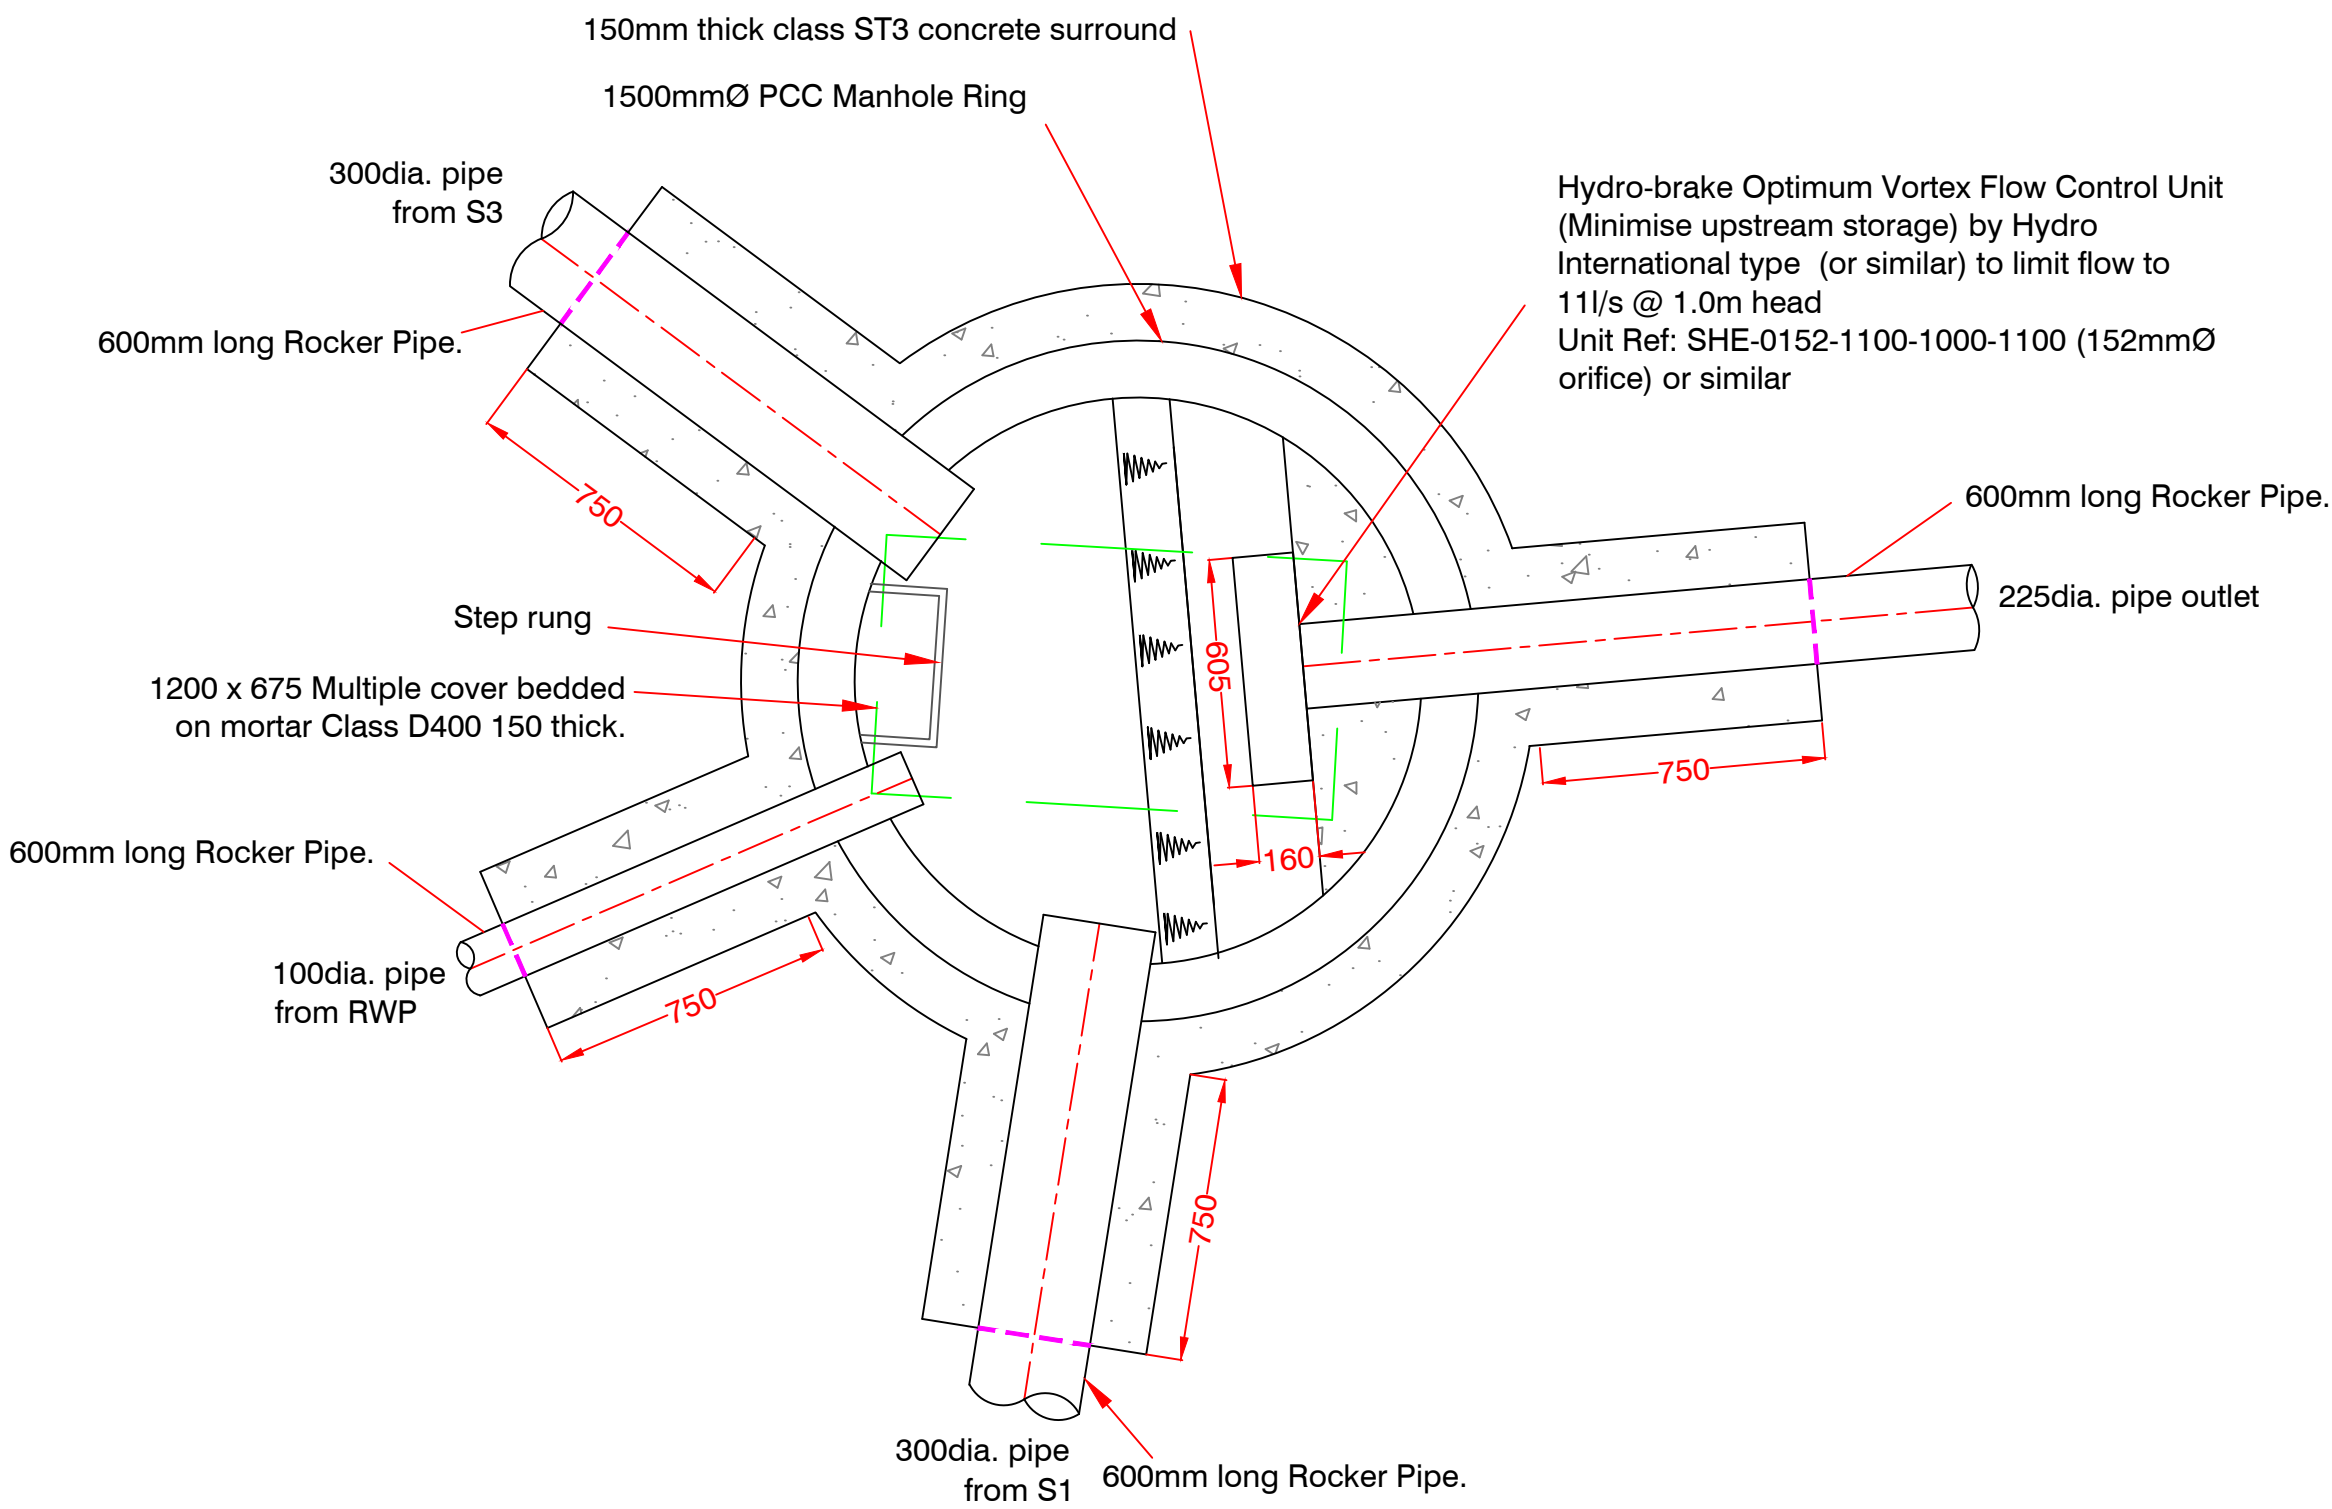

PLAN MH S2

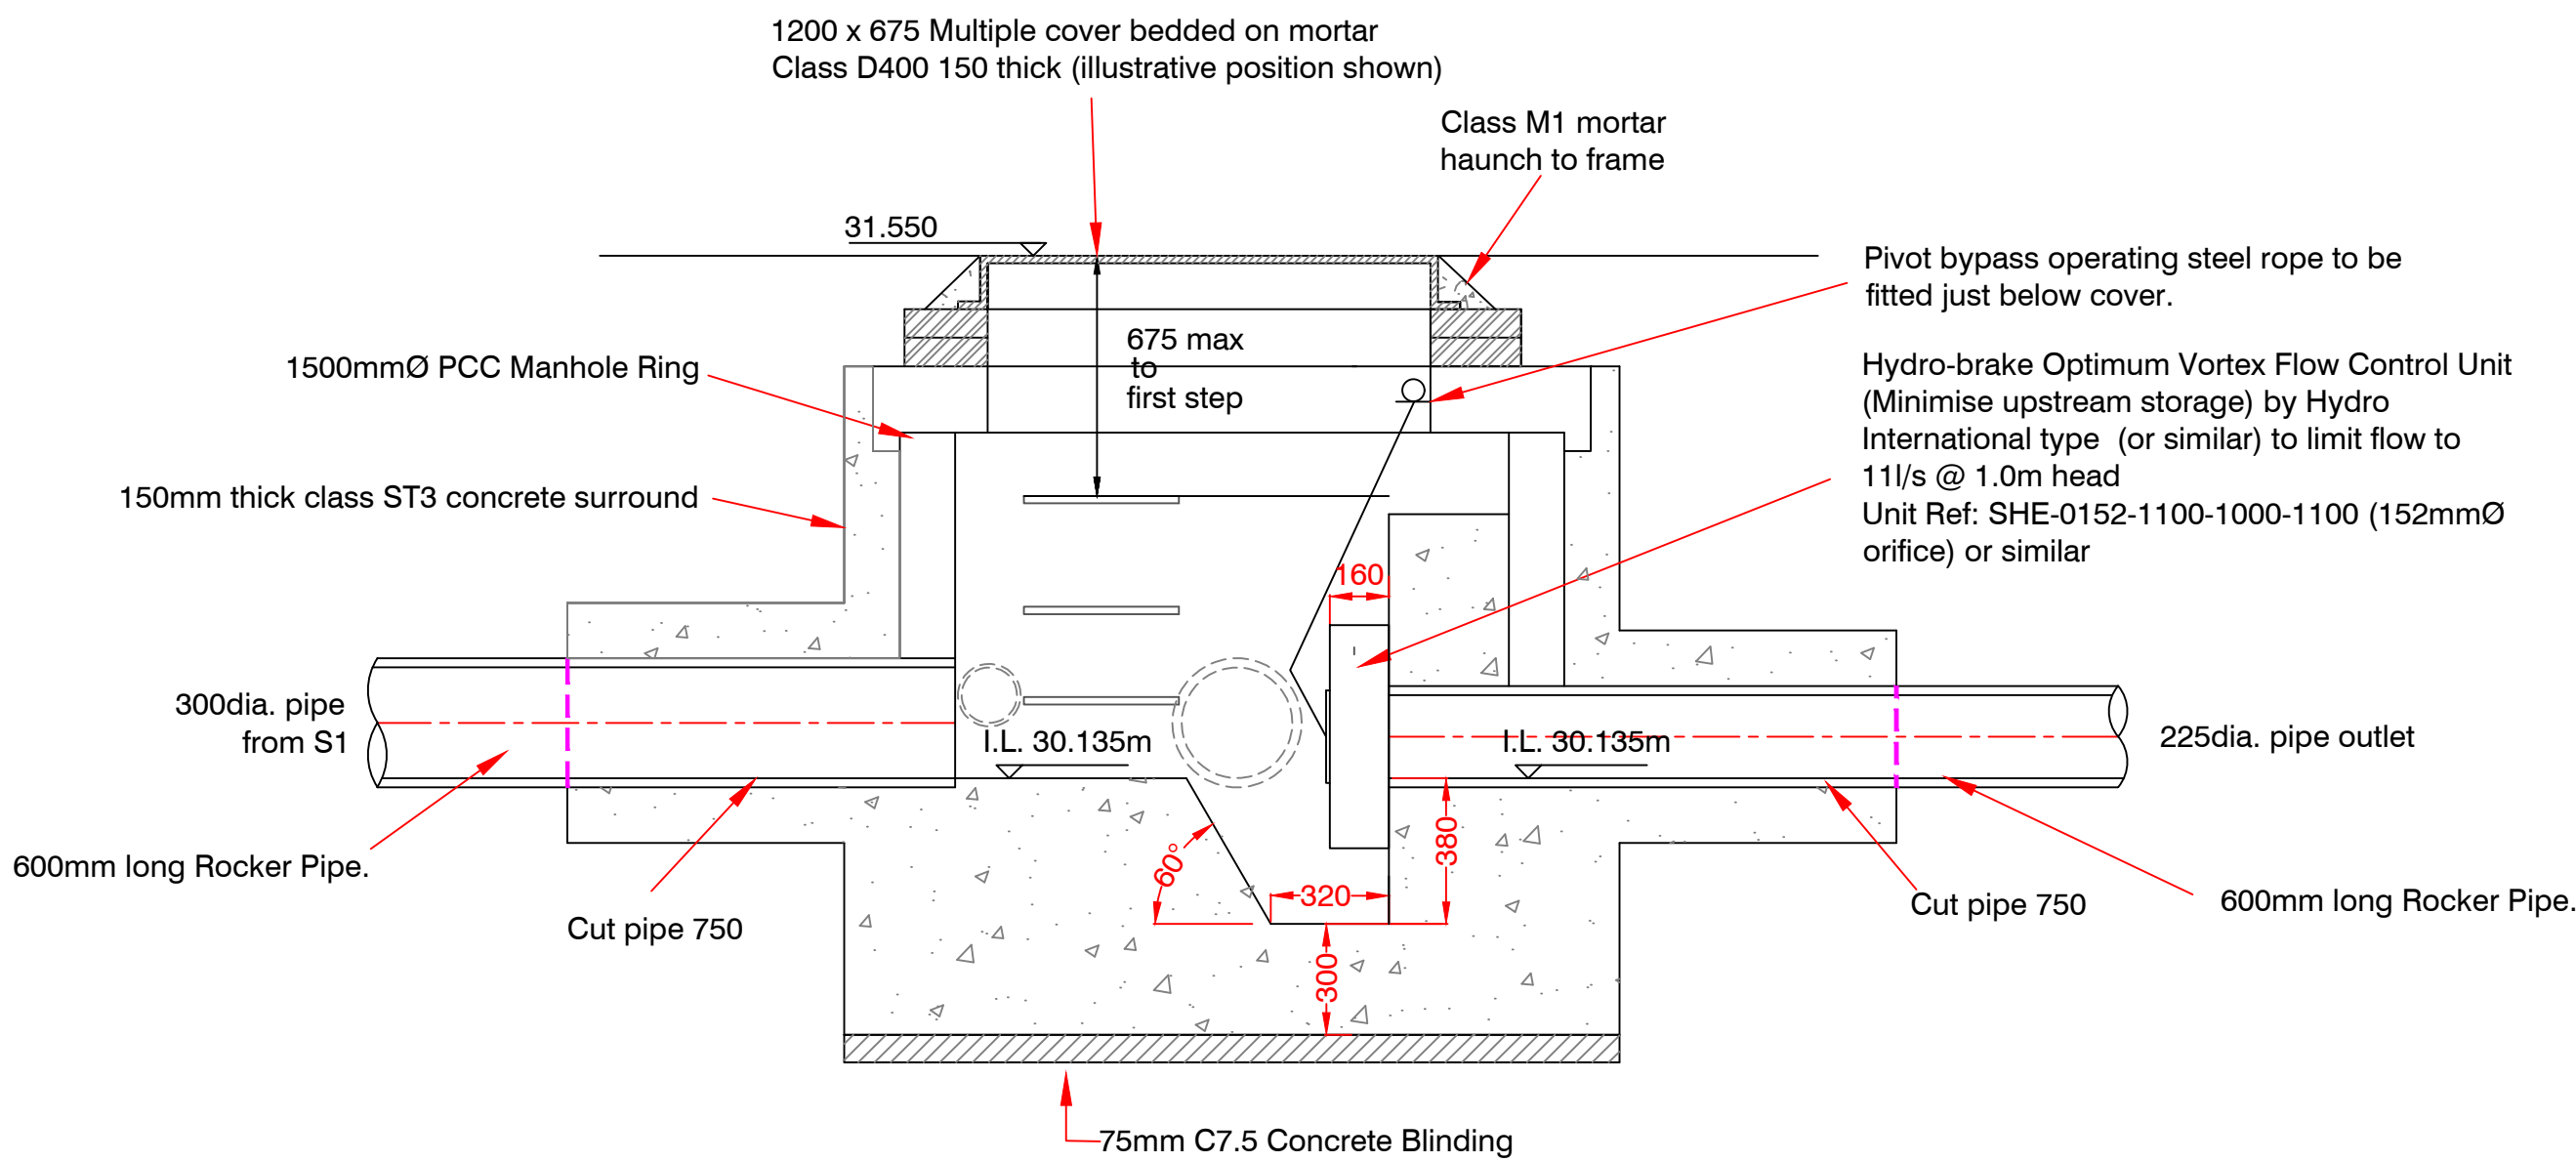

SECTION MH S2

A		28.03.23		KF		Updated to revised drainage design	
Rev	Date	Initials	Details				
Drawing Revisions							
North ↑ ↑		Project		IronsidedFarrar EnvironmentalConsultants EnvironmentalPlanners CivilEngineers LandscapeArchitects GraphicDesign 3 Worsley Court MANCHESTER M28 3JU Tel. 0161 703 8801 Fax. 0161 703 8279 manchester@ironsidefarrar.com EDINBURGH BELLSHILL			
Quality Ass.		Client					
UKAS 005		Triton					
Quality		Construction Limited					
Assurance							
ISO 9001:2008		Title					
SGS Certificate		Control Manhole S2					
GB02/54539		Details					
Original Size		Copyright Acknowledgement		Drawn		Checked By	
A1		Ordnance Survey®		SAP		SP	
		©Crown Copyright.		Date		Scale	
		All rights reserved.		Feb 23		1:20	
		Licence No. AL100017966.					