




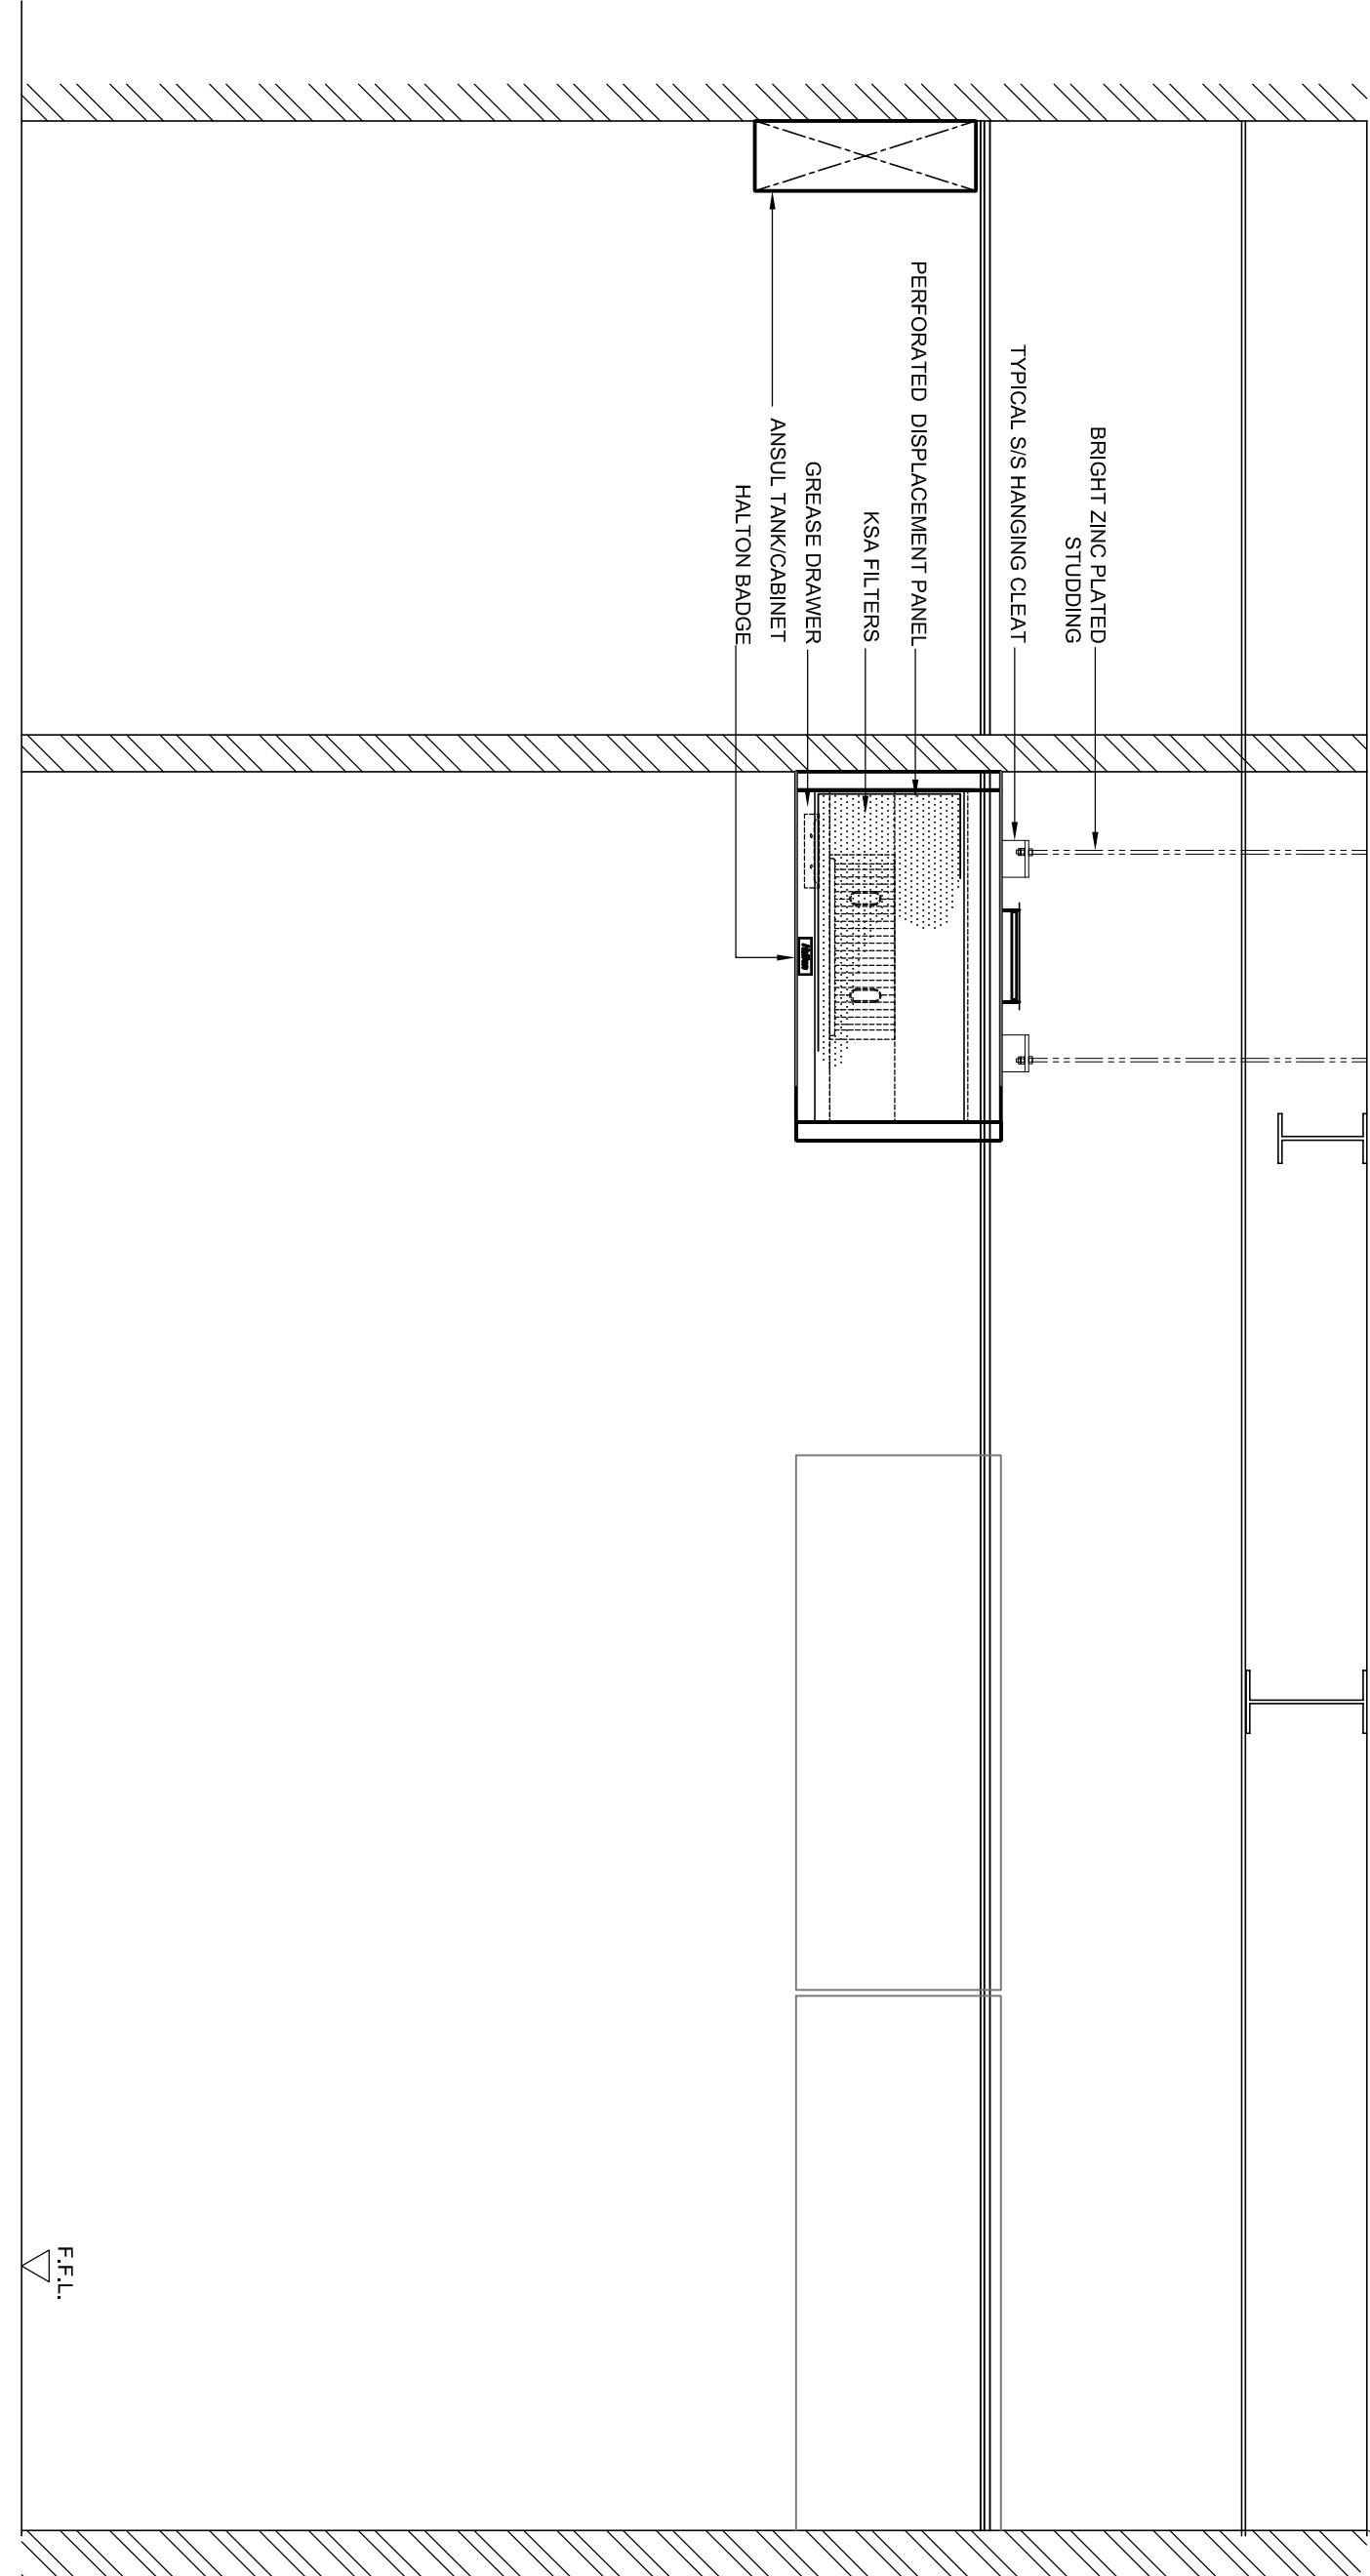

FRONT VIEW

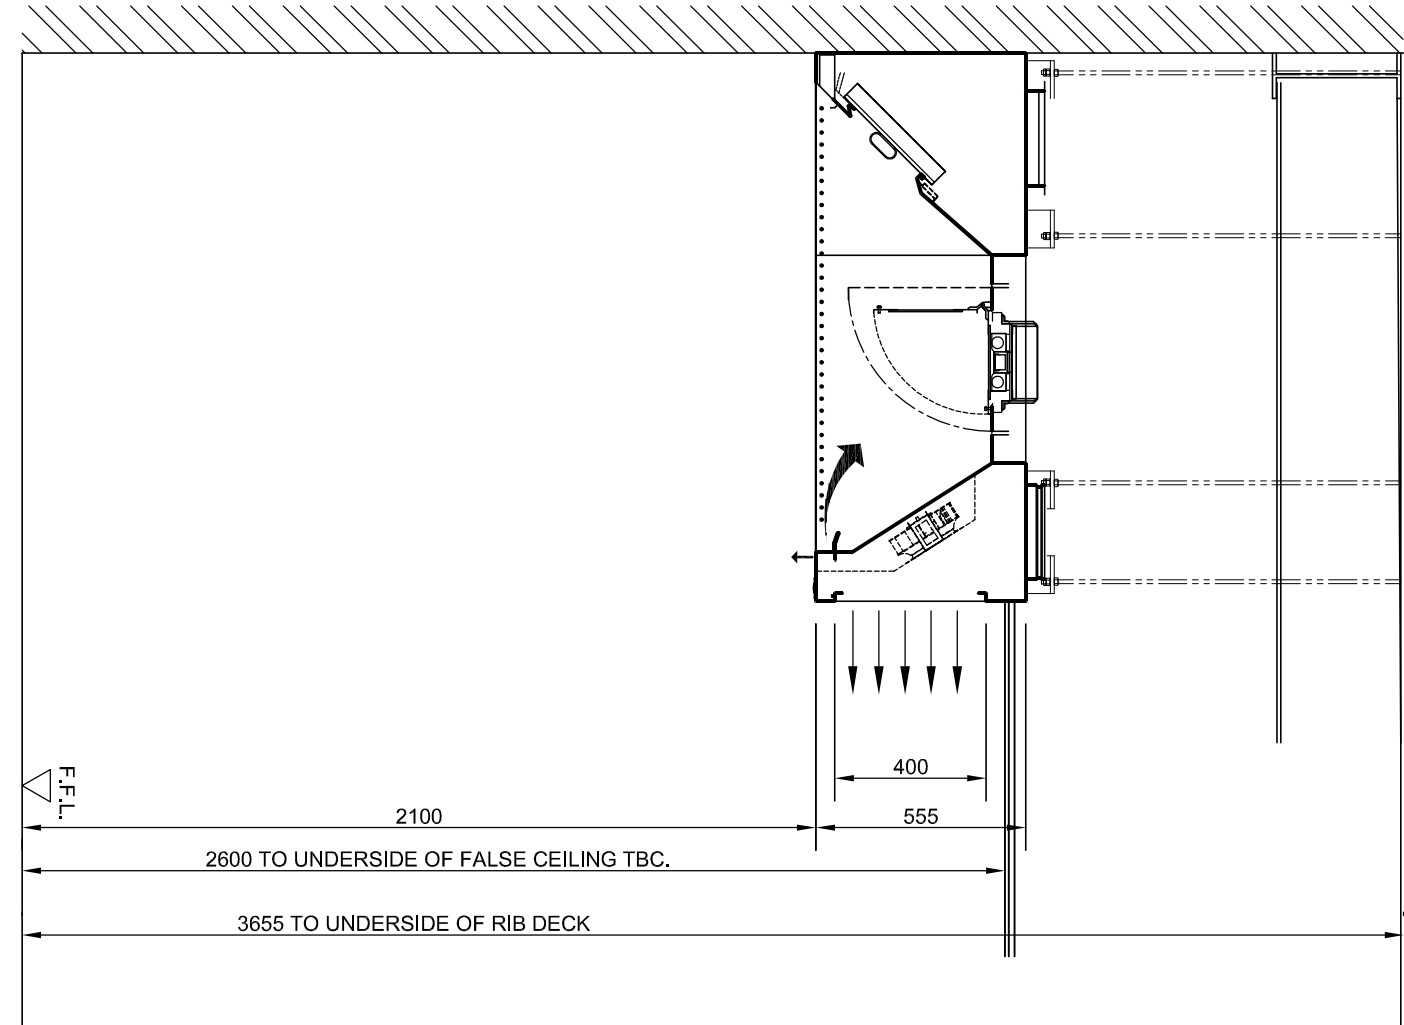


SECTION A-A

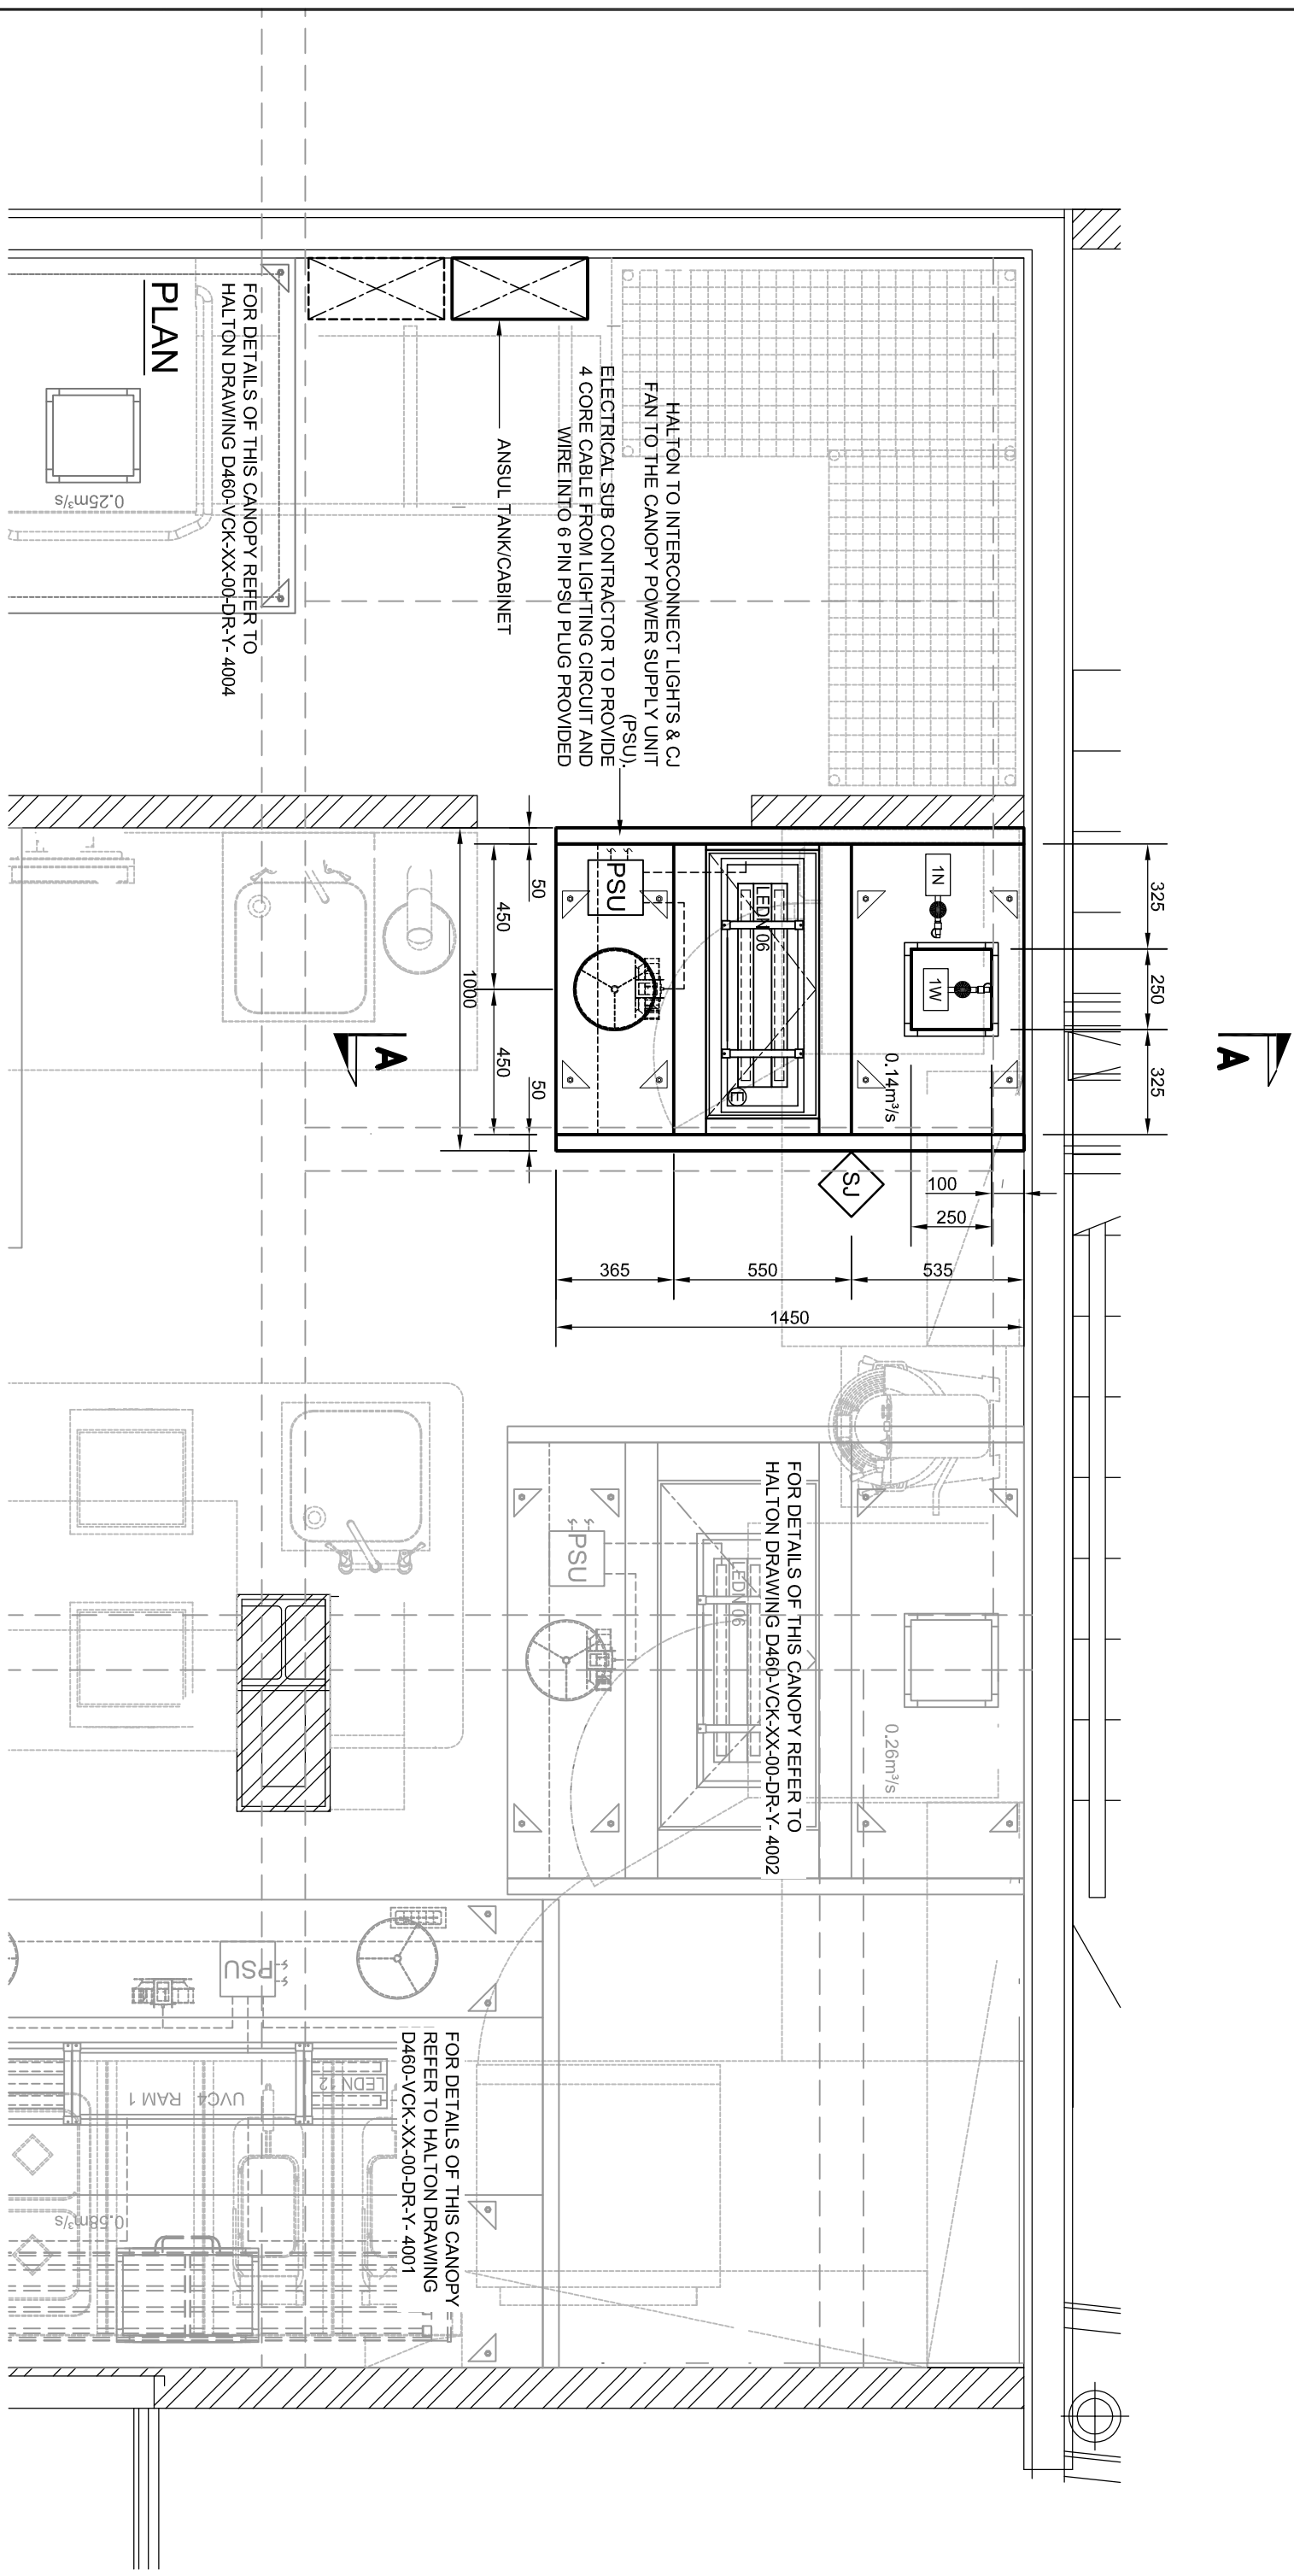

HANGING CLEAT POSITION


(UNLESS OTHERWISE STATED)

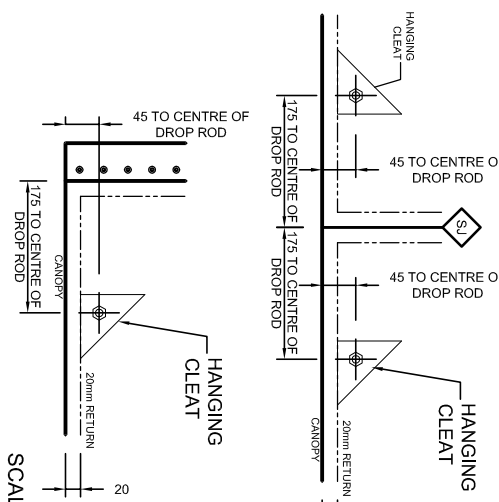

CANOPY DETAILS:

Halton Model: KVF
Canopy Size: 1000 x 1450 x555
Canopy Weight: 0.14m³s
Static Pressure at Exhaust Spigot: 80 Pa
Exhaust Spigots (20 Mm): 1No. 250 x 250
Supply Flow Rate: 0.22m³/s
Static Pressure at Supply Spigot: 50 Pa
Supply Spigots: 1No. Ø250
Approx. Hanging Weight: 116 kg
KSA Filters S00X330X650: 1No.
Grease Drawers: 1No.
O.N. LEDING (15V) 0.22m³/s
EMERGENCY PACK
Lighting Colour Temperature: 4000 K

ANSUL:

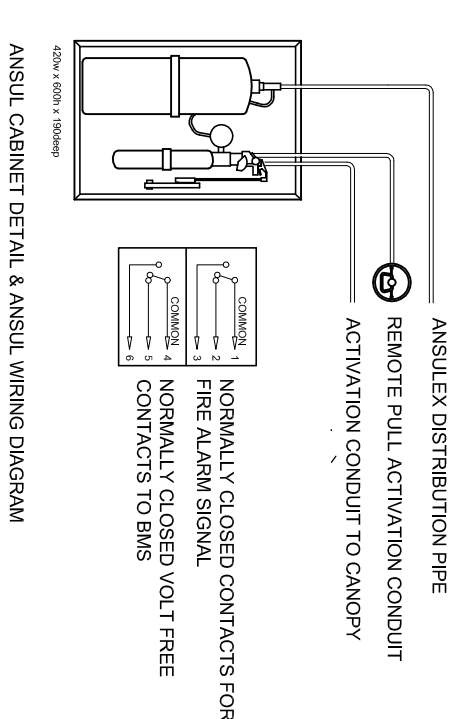

Ansul Nozzle Positions to UL300

INSTALL 5.50m IN TO CENTRE OF EACH ORIGIN
PERIMETER 1200mm
INSTALL 50-100mm FROM FACE OF FILTER, CENTERED
EVENLY IN THE 1.7m HEIGHT DIMENSION MAXIMUM
EVENLY IN THE 1.7m HEIGHT DIMENSION MAXIMUM

DRAWING NOTE:

DO NOT SCALE.

ALL DIMENSIONS IN MILLIMETRES.

±1mm TOLERANCE

HALTON COMPONENTS FABRICATED FROM 16G (1.2mm) STAINLESS STEEL

HALTON COMPONENTS FINISHED TO 200G (SILICONE FINISH), WELDED FORMED & FOLDED CONSTRUCTION.

THIS DRAWING IS THE COPYRIGHT OF HALTON FOODSERVICE LTD. AND MUST NOT BE COPIED WITHOUT PERMISSION OF HALTON FOODSERVICE LTD.

◇ SITE JOINT

SAFETY NOTE:

TO COMPLY WITH BS 5735:2008 MANDATORY INTERLOCKS ARE REQUIRED BETWEEN THE GAS SUPPLY AND THE MECHANICAL EXTRACT VENTILATION SYSTEM (EXTRACT & MAKE UP AIR).

PLEASE ASCERTAIN WHICH CONTRACTOR IS TO SUPPLY THESE INTERLOCKS

NOTES:

REV	DESCRIPTION	DATE	BY
P03	UPDATED AS PER COMMENTS	05.08.2022	LW
P02	UPDATED AS PER SITE SURVEY	26.07.2022	LW
P01	ISSUE FOR APPROVAL	20.07.2022	LW

CLIENT:

Unit A1, Asat Point, Hill Top Road, Heywood, Lancashire, OL10 2BQ
Tel: 0161 831 7210 Email: sales@visionck.co.uk
Website: www.visionck.co.uk Shop: www.shop.visionck.co.uk

PROJECT:

MALMAISON

PEARL ASSURANCE HOUSE

PRINCESS STREET

MANCHESTER

M2 4ER

DRAWING CONTENT

VENTILATION CANOPY

MODEL: KVF

LEVEL: GROUND FLOOR

AREA: KITCHEN

ITEM: 4.07

STATUS

FOR APPROVAL

TYPE	CONTRACT DRAWING	CHECKED:	.
SCALE	1:20 @ A1	DATE	20.07.2022
DRAWING No.	D460-VCK-XX-00-DR-Y-4007	REVISION	P03

Project No. 32485-00-007
Drawing No. 32485-00-007

11 LAKE ROAD, AIRPORT INDUSTRIAL ESTATE,
ROCHESTER, KENT ME1 1XQ
Tel: +44 (0) 1634 666111
www.halton.com/codeservice