


UPGRADING EXISTING CAVITY WALL

External skin of 103mm
existing brickwork

Internal skin of
100mm brick or
blockwork

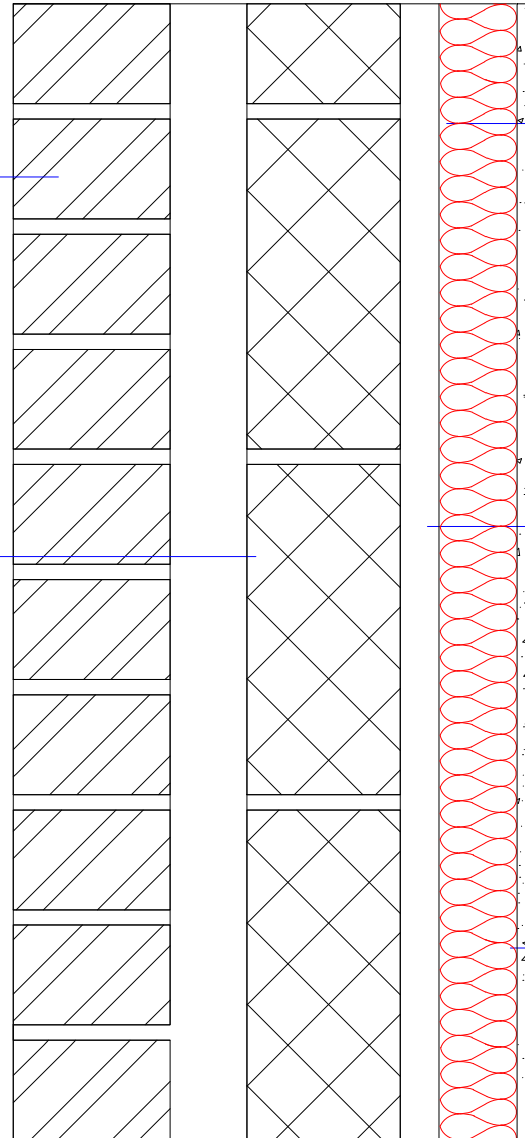

62.5mm Celotex PL4000
insulated
dry lining board manufactured
to EN ISO 9001:2000 with
3mm skim plaster

25 x 50mm treated timber
battens set at maximum
600mm centres and
positioned horizontally at floor
and ceiling level

Tape joints and the seal
perimeter edges with mastic,
to provide a vapour control
layer (VCL). All work in
accordance with BS 8212:
1995 (Code of practice for
dry lining)