

Do not scale from this drawing and work from marked dimensions only. All dimensions and features should be confirmed on site by the Contractor. Where this drawing includes information provided to LK Consult Ltd by others, LK Consult Ltd gives no warranty, representation or assurance as to the accuracy of such information.



Client: _____



Site: _____

Title: _____


Standard Details Drainage 1

Job No:	Scale (See Scale Bar)	Figure:	Revised:
FRA 20 0000	NTS	1	
Drawn By:	Checked By:	Drawn:	
AC	MJ	Jun 2020	



POLYPROPYLENE INSPECTION CHAMBER
(NON PERSONNEL ENTRY) TYPE A
< 1.5m TO INVERT

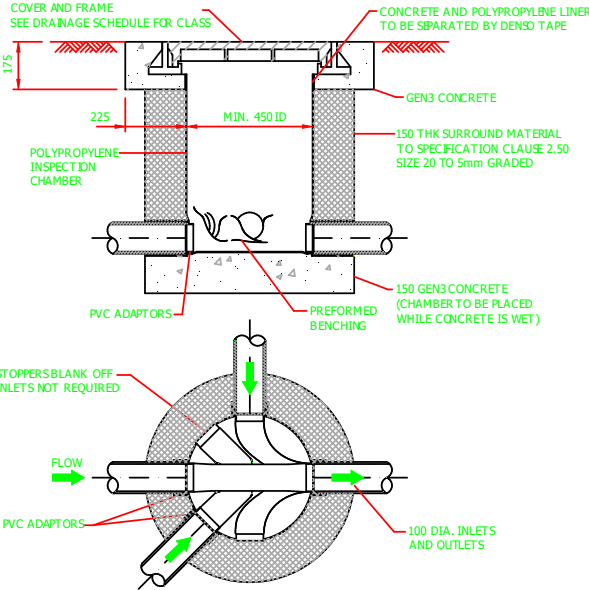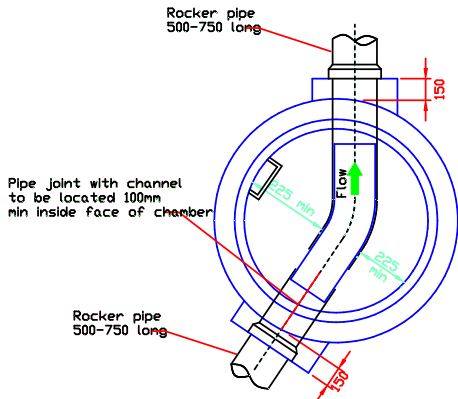


TYPICAL MANHOLE DETAIL TYPE B
depth to soffit 1.5 to 3 m.

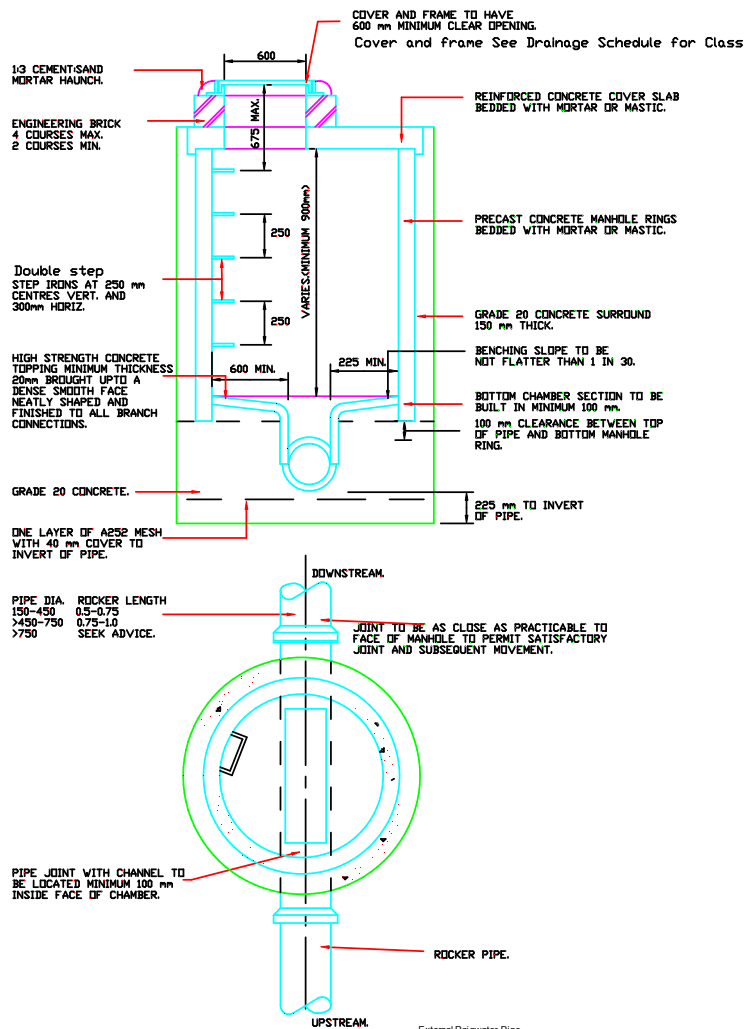


CHAMBER SIZES ARE TO BE IN ACCORDANCE WITH THE TABLE BELOW:-	
Ø OF LARGEST PIPE IN MANHOLE	CHAMBER SECTION Ø
LESS THAN 375mm	1200(1050 WHERE DEPTH LESS THAN 1.5m)
375 - 450mm	1350mm
500 - 700mm	1500mm
750 - 900mm	1800mm

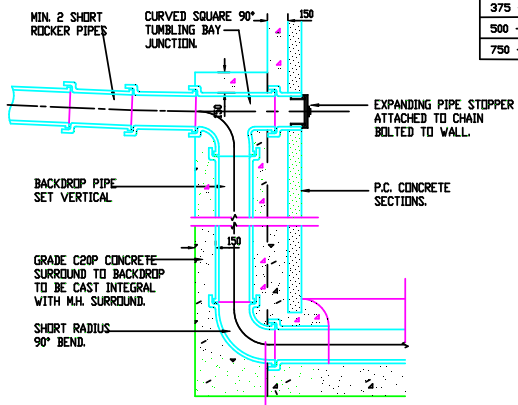

TYPICAL VERTICAL BACKDROP DETAIL




DETAIL OF CONCRETE SURROUND

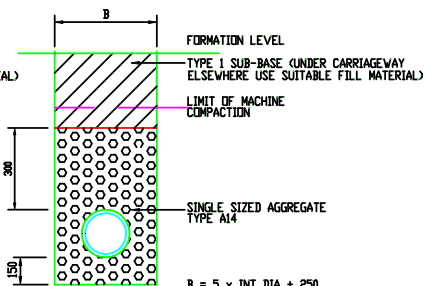


TYPE 'S' BEDDING DETAIL

TYPICAL MANHOLE DETAIL TYPE C
depth to soffit < 1.5 m.

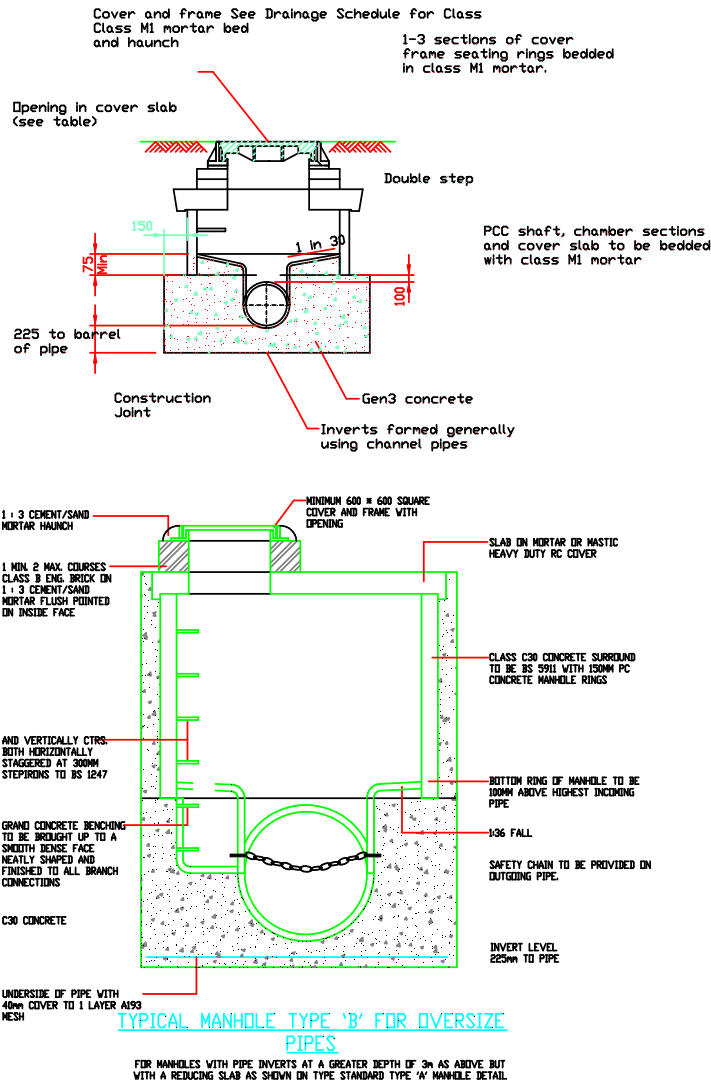

See Manhole Details Specific to required Depth for Access Layout



TYPICAL CATCHPIT DETAIL TYPE D