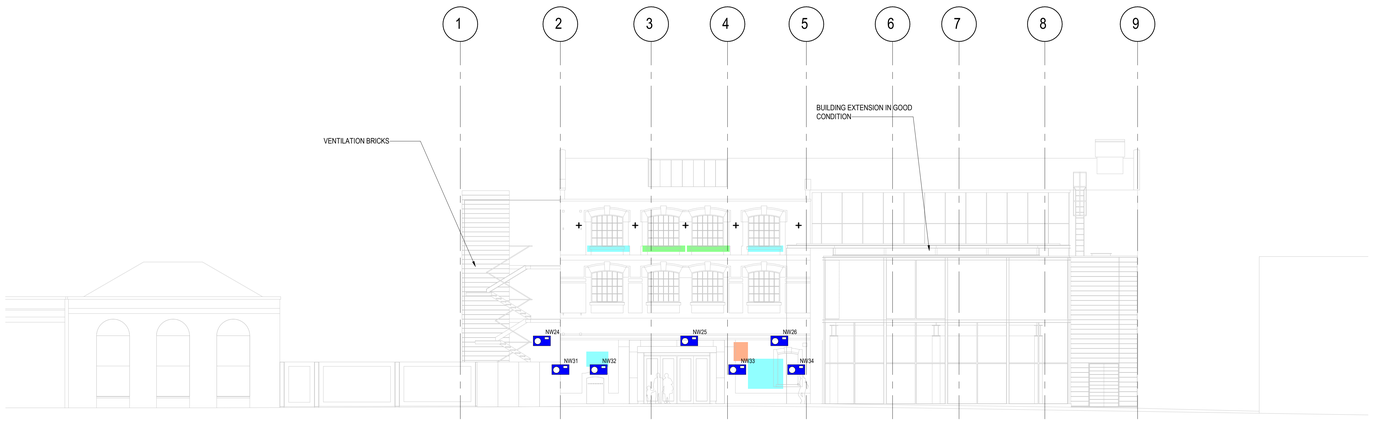
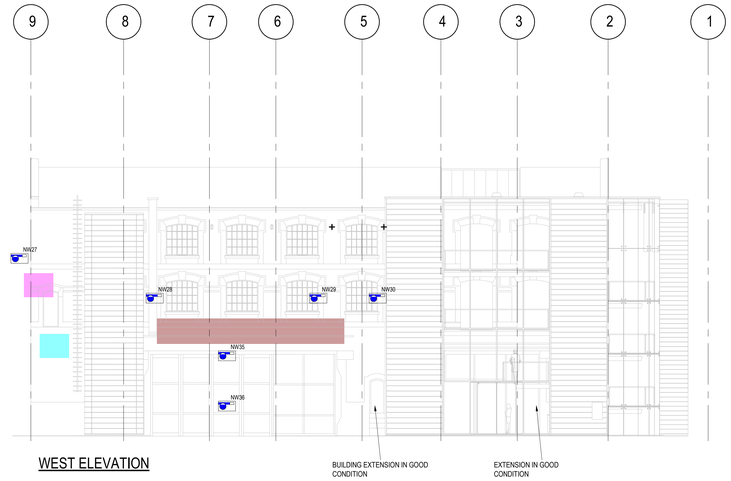
IN GENERAL:
- WINDOWS AND SILLS REPLACED AND IN GOOD CONDITION BUT SHOW SIGNS OF WEATHERING.
- OVERALL BRICKS IN GOOD CONDITION.
- OVERALL STRAIGHT AND SQUARE BRICK LINE FORMATION.
- PATCHWORK BRICKWORK REPLACEMENT / REPEARS SEEN ALONG FACADE.
- BRICK FACADE BROKEN FOR DOWNPIPE INSTALLATION (DATE UNKNOWN). AREAS OF MISSING BRICK WHERE DRAIN PIPES HAVE BEEN POST EMBEDDED INTO FACADE. EDGE OF BRICKWORK CUT OUTS ARE ROUGH AND CRACKED. SOME REQUIRE REPOINTING OR REPLACING.
- AREAS OF BRICK REPOINTING SEE PRIMARILY ALONG THE BOTTOM TWO WINDOW FLOORS.
- STEEL TIES IDENTIFIED NEAR THE TOP OF DOWN PIPES (MATERIAL TBC)
- BOTTOM

NEW WAREHOUSE - EXISTING MASONRY KEY.

HATCH	DESCRIPTION
	SIGNS OF WEATHERING.
	VEGITATION / MOSS STAINING.
	BREAKDOWN / DELAMINATION.
	CRACKING.
	SALTBRICK.
+	STEEL TIES.



EAST ELEVATION



WEST ELEVATION

EAST AND WEST ELEVATION MASONRY REPAIR WORKS

SCALE 1 : 125


PHOTO REF.	PHOTO	DESCPRIPTION	COMMENTS
NW24		BRICK OBSERVED DISCOLOURED ASSUMED FROM DAMP.	
NW25		REBUILT BRICK WORK SEEN.	
NW26		BOTTOM TWO FLOORS SHOW SIGNS OF PATCHWORK REBRICK AND REPOINTING REPAIRS.	
NW27		CRACKS AS THE CORNER IS MOVING OUTSIDES - RECOMMEND CRACK STITCHING AND FURTHER MONITORING OF CRACK LEVEL. .	



PHOTO REF.	PHOTO	DESCPRIPTION	COMMENTS
NW28		ORIGINAL DRAIN PIPE LOCATION.	
NW29		REPLACED GLAZING WINDOWS INKEEPING WITH EXISTING BUILDING.	
NW30		WALL TIES MATERIAL TO BE CONFIRMED.	
NW31		BRICKWORK SHOWING SIGNS OF DRAINPIPE PREVIOUSLY IN PLACE.	


PHOTO REF.	PHOTO	DESCPRIPTION	COMMENTS
NW32		BRICKWORK IN POOR CONDITION REQUIRING CLEANING AND REPOINTING.	
NW33		CRACKING POSSIBLY CAUSED BY MOVEMENT - RECOMMENDING STITCHING AND MONITORING.	
NW34		REPLACED GLAZING.	
NW35		WEATHERED CAST IRON BEAM SHOWING SIGNS OF RUST RECOMMENDED TO BLAST AND REPAINT.	

PHOTO REF.	PHOTO	DESCPRIPTION	COMMENTS
NW36		REPLACED REAR WAREHOUSE OPENING.	

© Buro Happold Limited or its group companies.
All Rights reserved. Buro Happold and its group companies assert (unless otherwise agreed in writing) their rights under s.77 to 89 of the Copyright, Designs and Patents Act 1988.

This drawing has been prepared for the sole use and information of the Client. The liability of Buro Happold in respect of any information contained in the drawing will not extend to any third parties. Buro Happold accepts no liability for any use/misuse of this drawing other than for the purpose for which it has been produced.

DO NOT SCALE THIS DRAWING.

SAFETY HEALTH AND ENVIRONMENTAL INFORMATION

IN ADDITION TO THE HAZARDS/RISKS NORMALLY ASSOCIATED WITH THE TYPES OF WORK DETAILED ON THIS DRAWING, NOTE THE FOLLOWING:

CONSTRUCTION:

MAINTENANCE/CLEANING/OPERATION:

DECOMMISSIONING/DEMOLITION:

Notes

REFER TO DRAWING S-0010 FOR GENERAL NOTES.

Rev	Description	Date	Drn	Appr'd

STAGE 3

Project Stage

S3 - FOR REVIEW AND COMMENT

Status of Drawing

BURO HAPPOLD

2nd Floor Eastgate,
2 Castle Street,
Manchester, M3 4LZ,
UK

Tel: +44 (0)161 233 5000
Fax: +44 (0)870 787 4143
Email: 0054704@burohappold.com
Web: www.burohappold.com

Client: *SCIENCE MUSEUM GROUP*

Architect: *BUTTRESS*

Project: **SIM SITE WIDE CAPITAL WORKS**

Drg Title: NEW WAREHOUSE
MASONRY REPAIR ELATIONS
SHEET 3

Job No.	Scale@ A0
0054704	**As indicated**

Drawn By	Checked By	Approved By
TC	**PC**	**DC**

Drawing No.: **SIM-BHE-NW-XX-DR-SK-S-1153**

Revision