


trench details (do not scale)

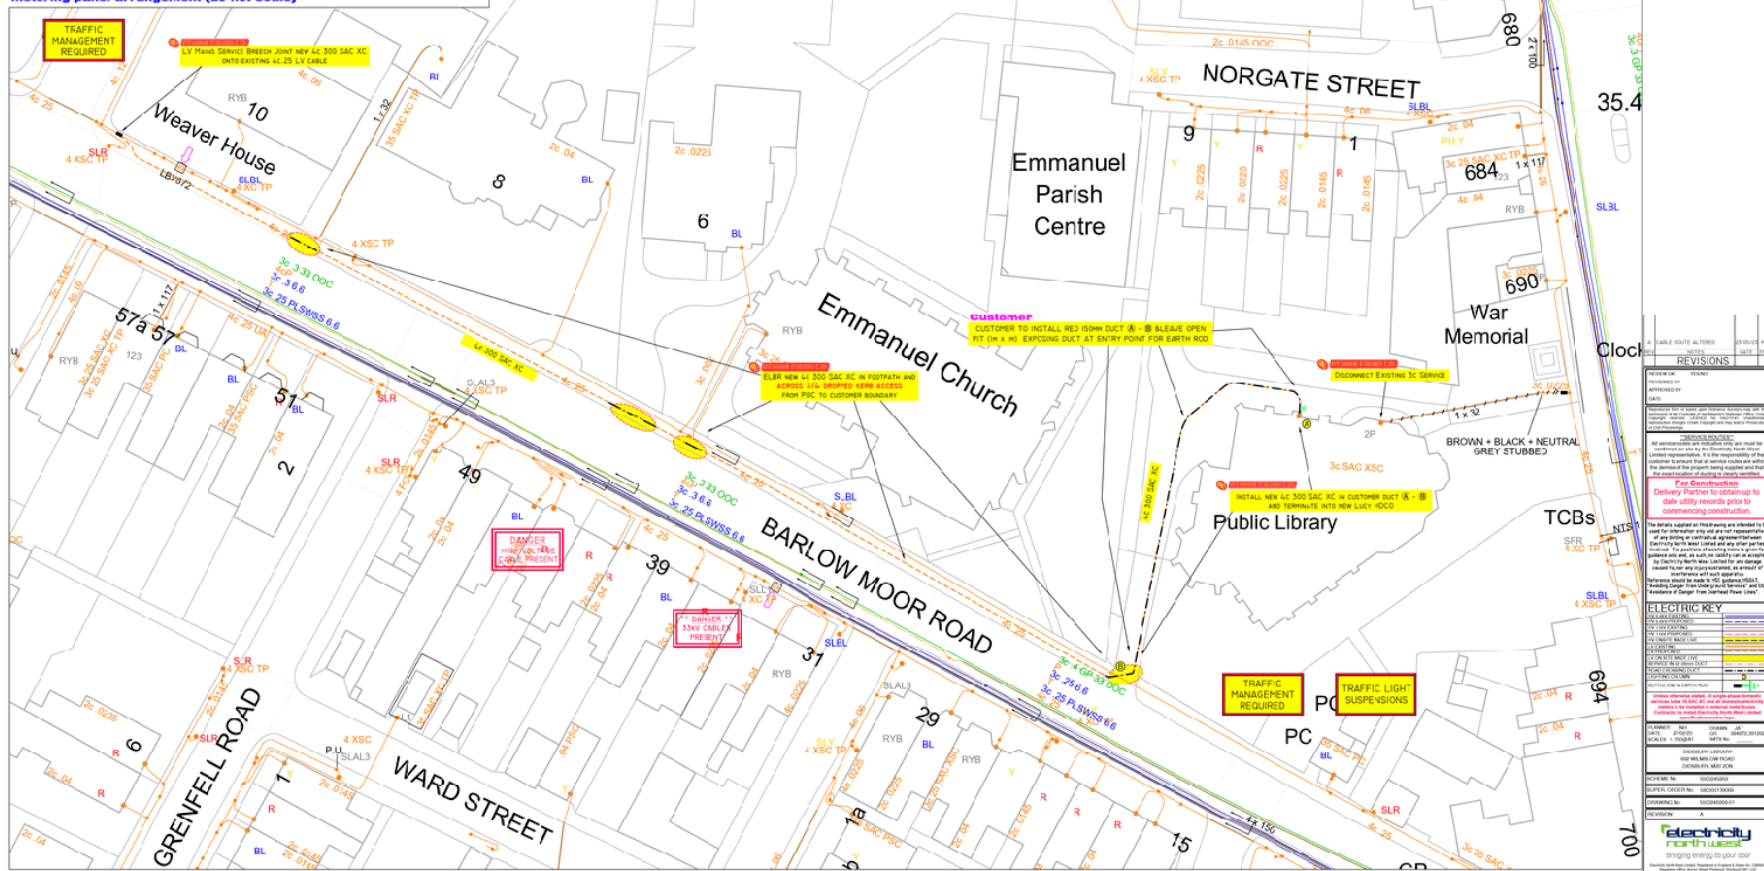

site plan, 1:250

DISCONNECTIONS: Test the cable for load prior to disconnecting - contact ENWL prior to disconnecting if load is present - where possible look to identify source, carry out visual checks for street lighting, feeder pillars etc which may be connected to the cable

DUCTING & MARKER TAPE
ALL DUCTING SHALL COMPLY WITH
ELECTRICITY NORTH WEST LIMITED
SPECIFICATION ES4000.
DUCTING SHALL BE RED AND
DISPLAY THE WORDS
"ELECTRIC CABLE DUCT".
MARKER TAPE TO BE INSTALLED
ABOVE ALL DUCTING AND CABLES.
DUCTS AND MARKER TAPE TO BE
INSTALLED IN ACCORDANCE WITH
ELECTRICITY NORTH WEST LIMITED
SPECIFICATION ES4000.

SITE SPECIFIC HAZARDS: