
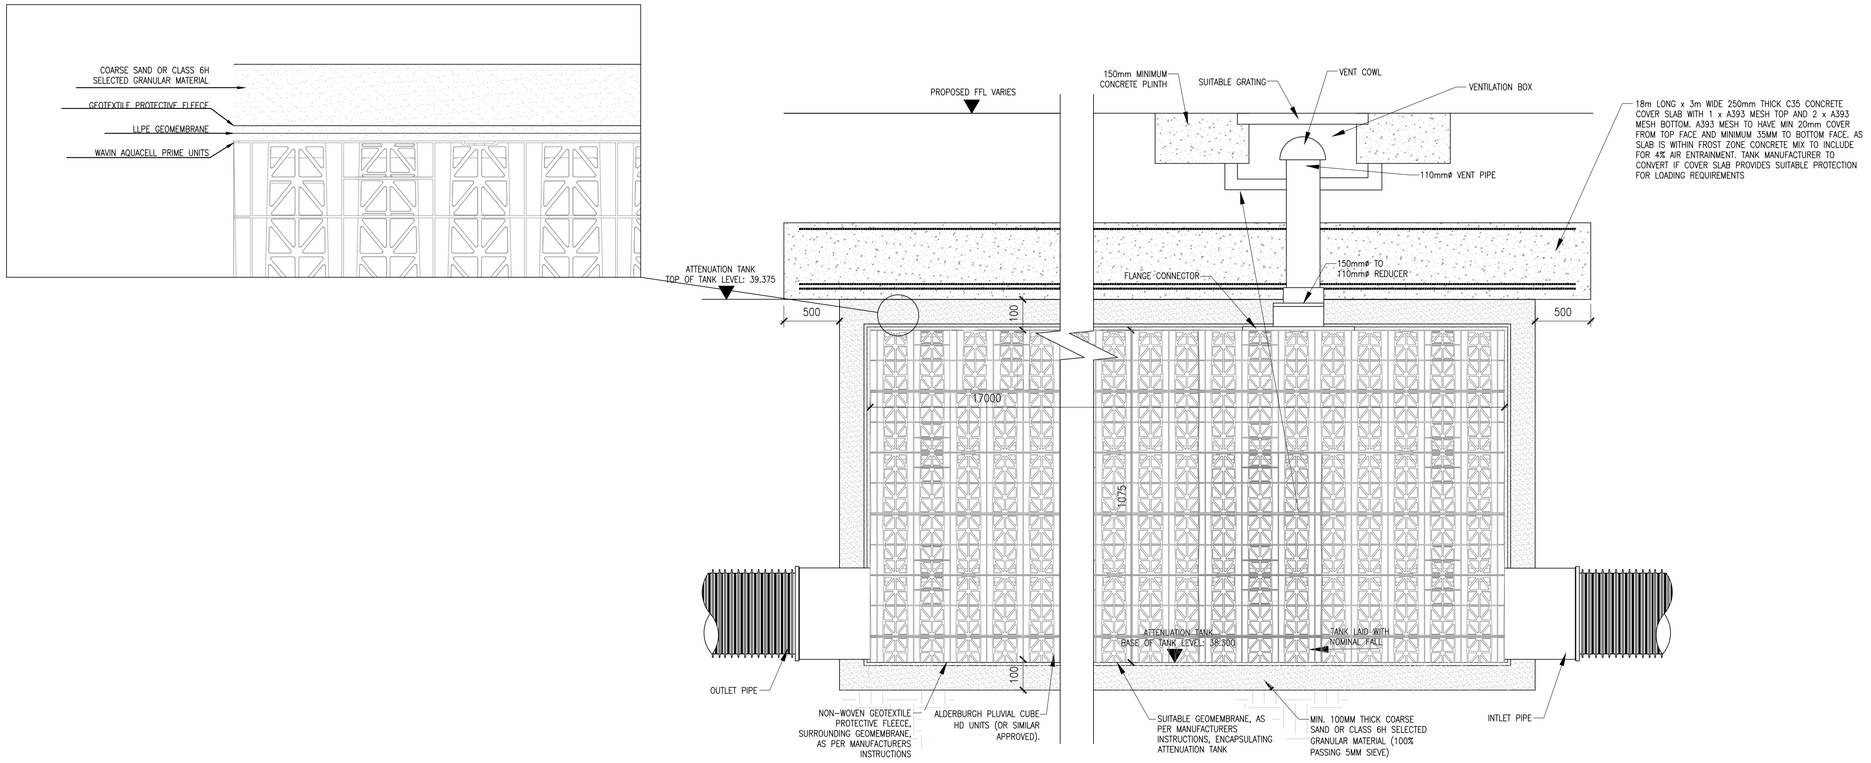


SECTION A–A
SECTION THROUGH ATTENUATION TANK

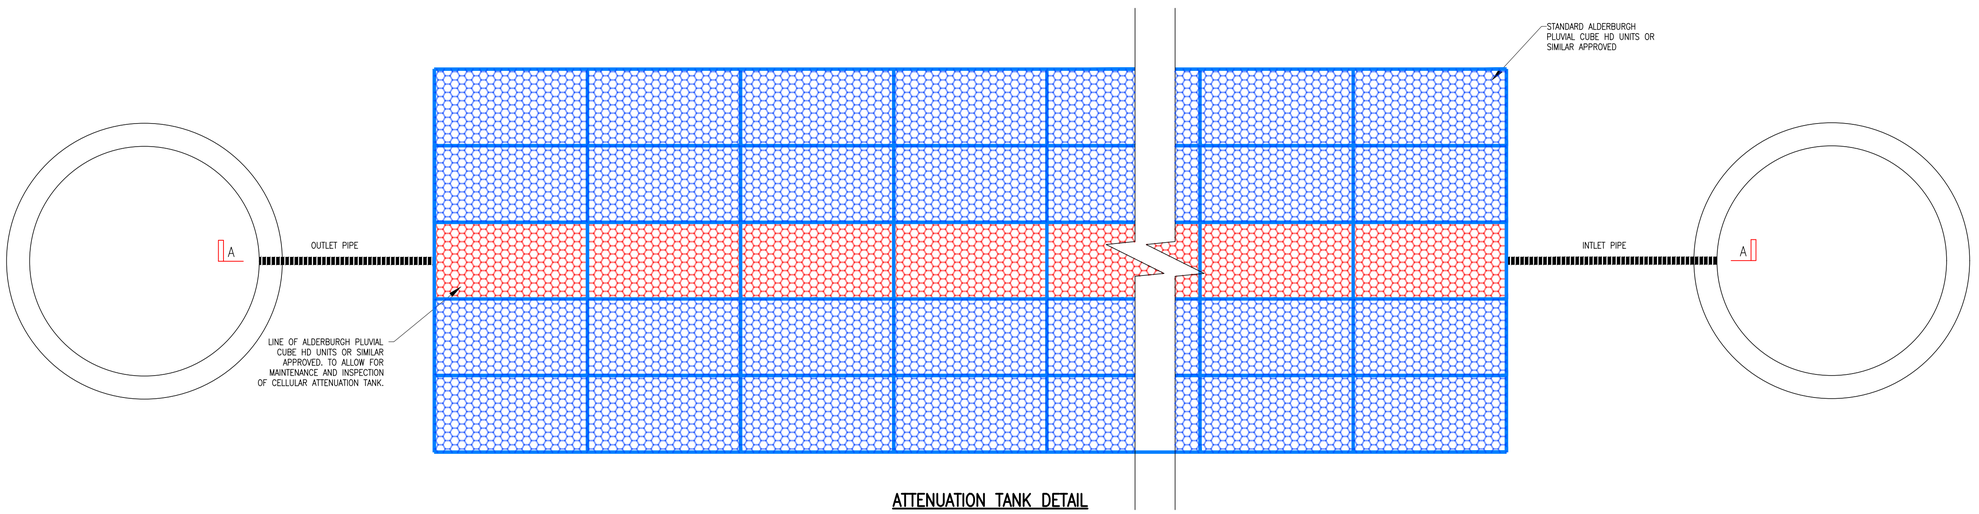

ATTENUATION TANK DETAIL

IMPORTANT NOTES

1. SETTING OUT SHALL BE UNDERTAKEN USING ONLY THE INFORMATION GIVEN. DISTANCES SHOULD NOT BE SCALED FROM THIS DRAWING.
2. ALL SEWERS SHALL BE CONSTRUCTED IN ACCORDANCE WITH SEWERS FOR ADOPTION 7TH EDITION AND UNITED UTILITIES DETAILS & GUIDELINES.
3. THE MINIMUM GRAVITY PIPE DIAMETER UNDER ADOPTABLE HIGHWAYS SHALL BE 150mm
4. IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO VERIFY ALL INFORMATION GIVEN WITH REGARDS TO EXISTING SERVICES AND DRAINAGE CONNECTIONS ETC. PRIOR TO COMMENCING THE WORKS. THE RATES SHALL INCLUDE FOR HAND DIG AROUND SERVICES WHERE NECESSARY. THE CONTRACTOR SHALL ADHERE TO THE CDM REGULATIONS AT ALL TIMES
5. THE OUTSIDES OF ALL SEWERS SHALL BE A MINIMUM OF 1.0m FROM KERB LINES AND THE OUTSIDE OF MANHOLES SHALL BE A MINIMUM OF 0.5m FROM KERB LINES
6. EXISTING FLOWS IN WATERCOURSES, SEWERS AND LAND DRAINS SHALL BE MAINTAINED AT ALL TIMES
7. ONLY TRAINED PERSONNEL SHALL BE PERMITTED TO ENTER CONFINED SPACES
8. ALL MATERIALS TO BEAR THE RELEVANT B.S. KITEMARK AND COMPLY FULLY WITH THE SPECIFICATIONS. ALL CONCRETE & CONCRETE PRODUCTS MUST USE SULPHATE RESISTANT CEMENT (UNLESS THE SITE INVESTIGATION REPORT PROVES THAT SULPHATE ATTACK FROM SOILS AND GROUNDWATER WILL NOT OCCUR TO WITHSTAND A CLASS
9. ALL OPENING NOTICES ETC. AS REQUIRED UNDER HIGHWAYS ACTS ETC. ARE TO BE OBTAINED PRIOR TO COMMENCEMENT OF WORKS. ALL WORKS ARE TO BE INSPECTED BY L.A., NHBC OR THE NETWORK OPERATOR AS APPLICABLE.
10. WHERE "ULTRA RIB" UPVC PIPES (OR SIMILAR APPROVED) ARE USED IN ADOPTABLE DRAINAGE THEY SHALL STILL BE HANDLED AND LAID IN ACCORDANCE WITH THE SPECIFICATION AND GUIDANCE ISSUED BY THE HIGH PERFORMANCE PIPE ASSOCIATION.
11. A CLASS S BED AND SURROUND MUST BE USED FOR SUCH PIPES. TRENCH BACKFILL IN HIGHWAYS TO WITHIN 1M OF HIGHWAY SHALL, AS DIRECTED BY THE HIGHWAY AUTHORITY BE A SUITABLE GRANULAR MATERIAL ALL IN ACCORDANCE WITH SEWERS FOR ADOPTION CL. 4.3.4.
12. SLAB LEVELS SHALL NOT BE VARIED WITHOUT REFERENCE TO THE ENGINEER FOR GUIDANCE
13. DOMESTIC DRAINAGE SHALL BE TO BUILDING REGULATIONS APPROVED DOCUMENT H. 110mm U.P.V.C. PIPES LAID TO THE FOLLOWING MINIMUM FALLS UNLESS OTHERWISE SHOWN.

	FOUL	S.W.
HEAD RUN	1 IN 40	1 IN 60
ELSEWHERE	1 IN 80	1 IN 100

14. ALL GULLY CONNECTIONS TO BE 150mm VITRIFIED CLAY UNLESS NOTED OTHERWISE
15. ALL MANHOLE COVERS TO BE RECESSED TO ACCEPT FINISH AS DETAILED BY LANDSCAPE ARCHITECT
16. SLOW REST BENDS TO BE USED IN ALL LOCATIONS MADE UP FROM 2No. 45 DEG BENDS (600mm TO INVERT FROM FFL)
17. MANHOLE POSITIONS AND ACCESS COVERS TO BE ACCURATELY SET-OUT BY LANDSCAPE ARCHITECT TO SUIT EXTERNAL FINISHES
18. ALL DRAINS CAST THROUGH FOUNDATIONS TO HAVE ROCKER PIPES ON BOTH SIDES OF FOUNDATION
19. ALL POP UP POSITIONS TO BE CONFIRMED SET OUT DIMENSIONS TO BE AGREED & PROVIDED BY OTHERS
20. ALL DISCHARGE RATES TO BE CONFIRMED BY M&E DESIGNER
21. ALL SURFACE WATER COLLECTION FEATURES TO BE CONFIRMED BY THE LANDSCAPE ARCHITECT
22. STORAGE HAS BEEN PROVIDED IN A CELLULAR STORAGE TANK AND UP-SIZED MANHOLES AND PIPES.
23. EXISTING SEWER DEPTHS HAVE BEEN APPROXIMATED FROM LIMITED INFORMATION, NEW CONNECTIONS TO BE CONFIRMED PRIOR TO CONSTRUCTION OF ANY DRAINAGE WORKS.
24. LANDSCAPE ARCHITECT TO CONFIRM GULLY AND DRAINAGE CHANNEL LOCATIONS TO LANDSCAPED AREAS.
25. FOUL NETWORK TO BE CONFIRMED FOLLOWING CONFIRMATION OF BRANCH CONNECTION POINTS FROM BUILDING M&E DESIGNER
26. CCTV SURVEY OF EXISTING SITE DRAINAGE REQUIRED PRIOR TO THE COMMENCEMENT OF ANY WORKS STARTING ON SITE

REV	DATE	DESCRIPTION	BY	CHK	APP
C02	02-08-2022	UPDATED TO SUIT LATEST FOUNDATION INFORMATION	JJR	JRS	PB
C01	16-11-2020	STAGE 5 ISSUE	MR	PB	PB
P02	16-12-2020	STAGE 4 ISSUE	RG	PB	PB
P01	02-10-2020	STAGE 3 ISSUE	RG	PB	PB

DRAWING STATUS: **CONSTRUCTION**

CLIENT: MANCHESTER ROYAL INFIRMARY

ARCHITECT: DAY Architectural Ltd

PROJECT: RED

TITLE: TYPICAL ATTENUATION TANK DETAILS

STATUS:	PROJECT No.	PROJECT	ORIGINATOR	VOL/SYS	LEVEL	TYPE	ROLE	DRAWING No.	REV:
S2	220-096	RED - AJP - 00 - 00 - DR - C - 001062							C02

SCALE @ A1:	DESIGNED:	DRAWN:	CHECKED:	APPROVED:	DATE:
NTS	RG	RG	PB	PB	SEPT 2019

alan johnston partnership LLP
CONSULTING STRUCTURAL & CIVIL ENGINEERS
1 Dale Street, Liverpool L2 2ET
Tel: 0151 227 1462
Fax: 0151 225 1187
E-Mail: Mail@ajpstructeng.com