


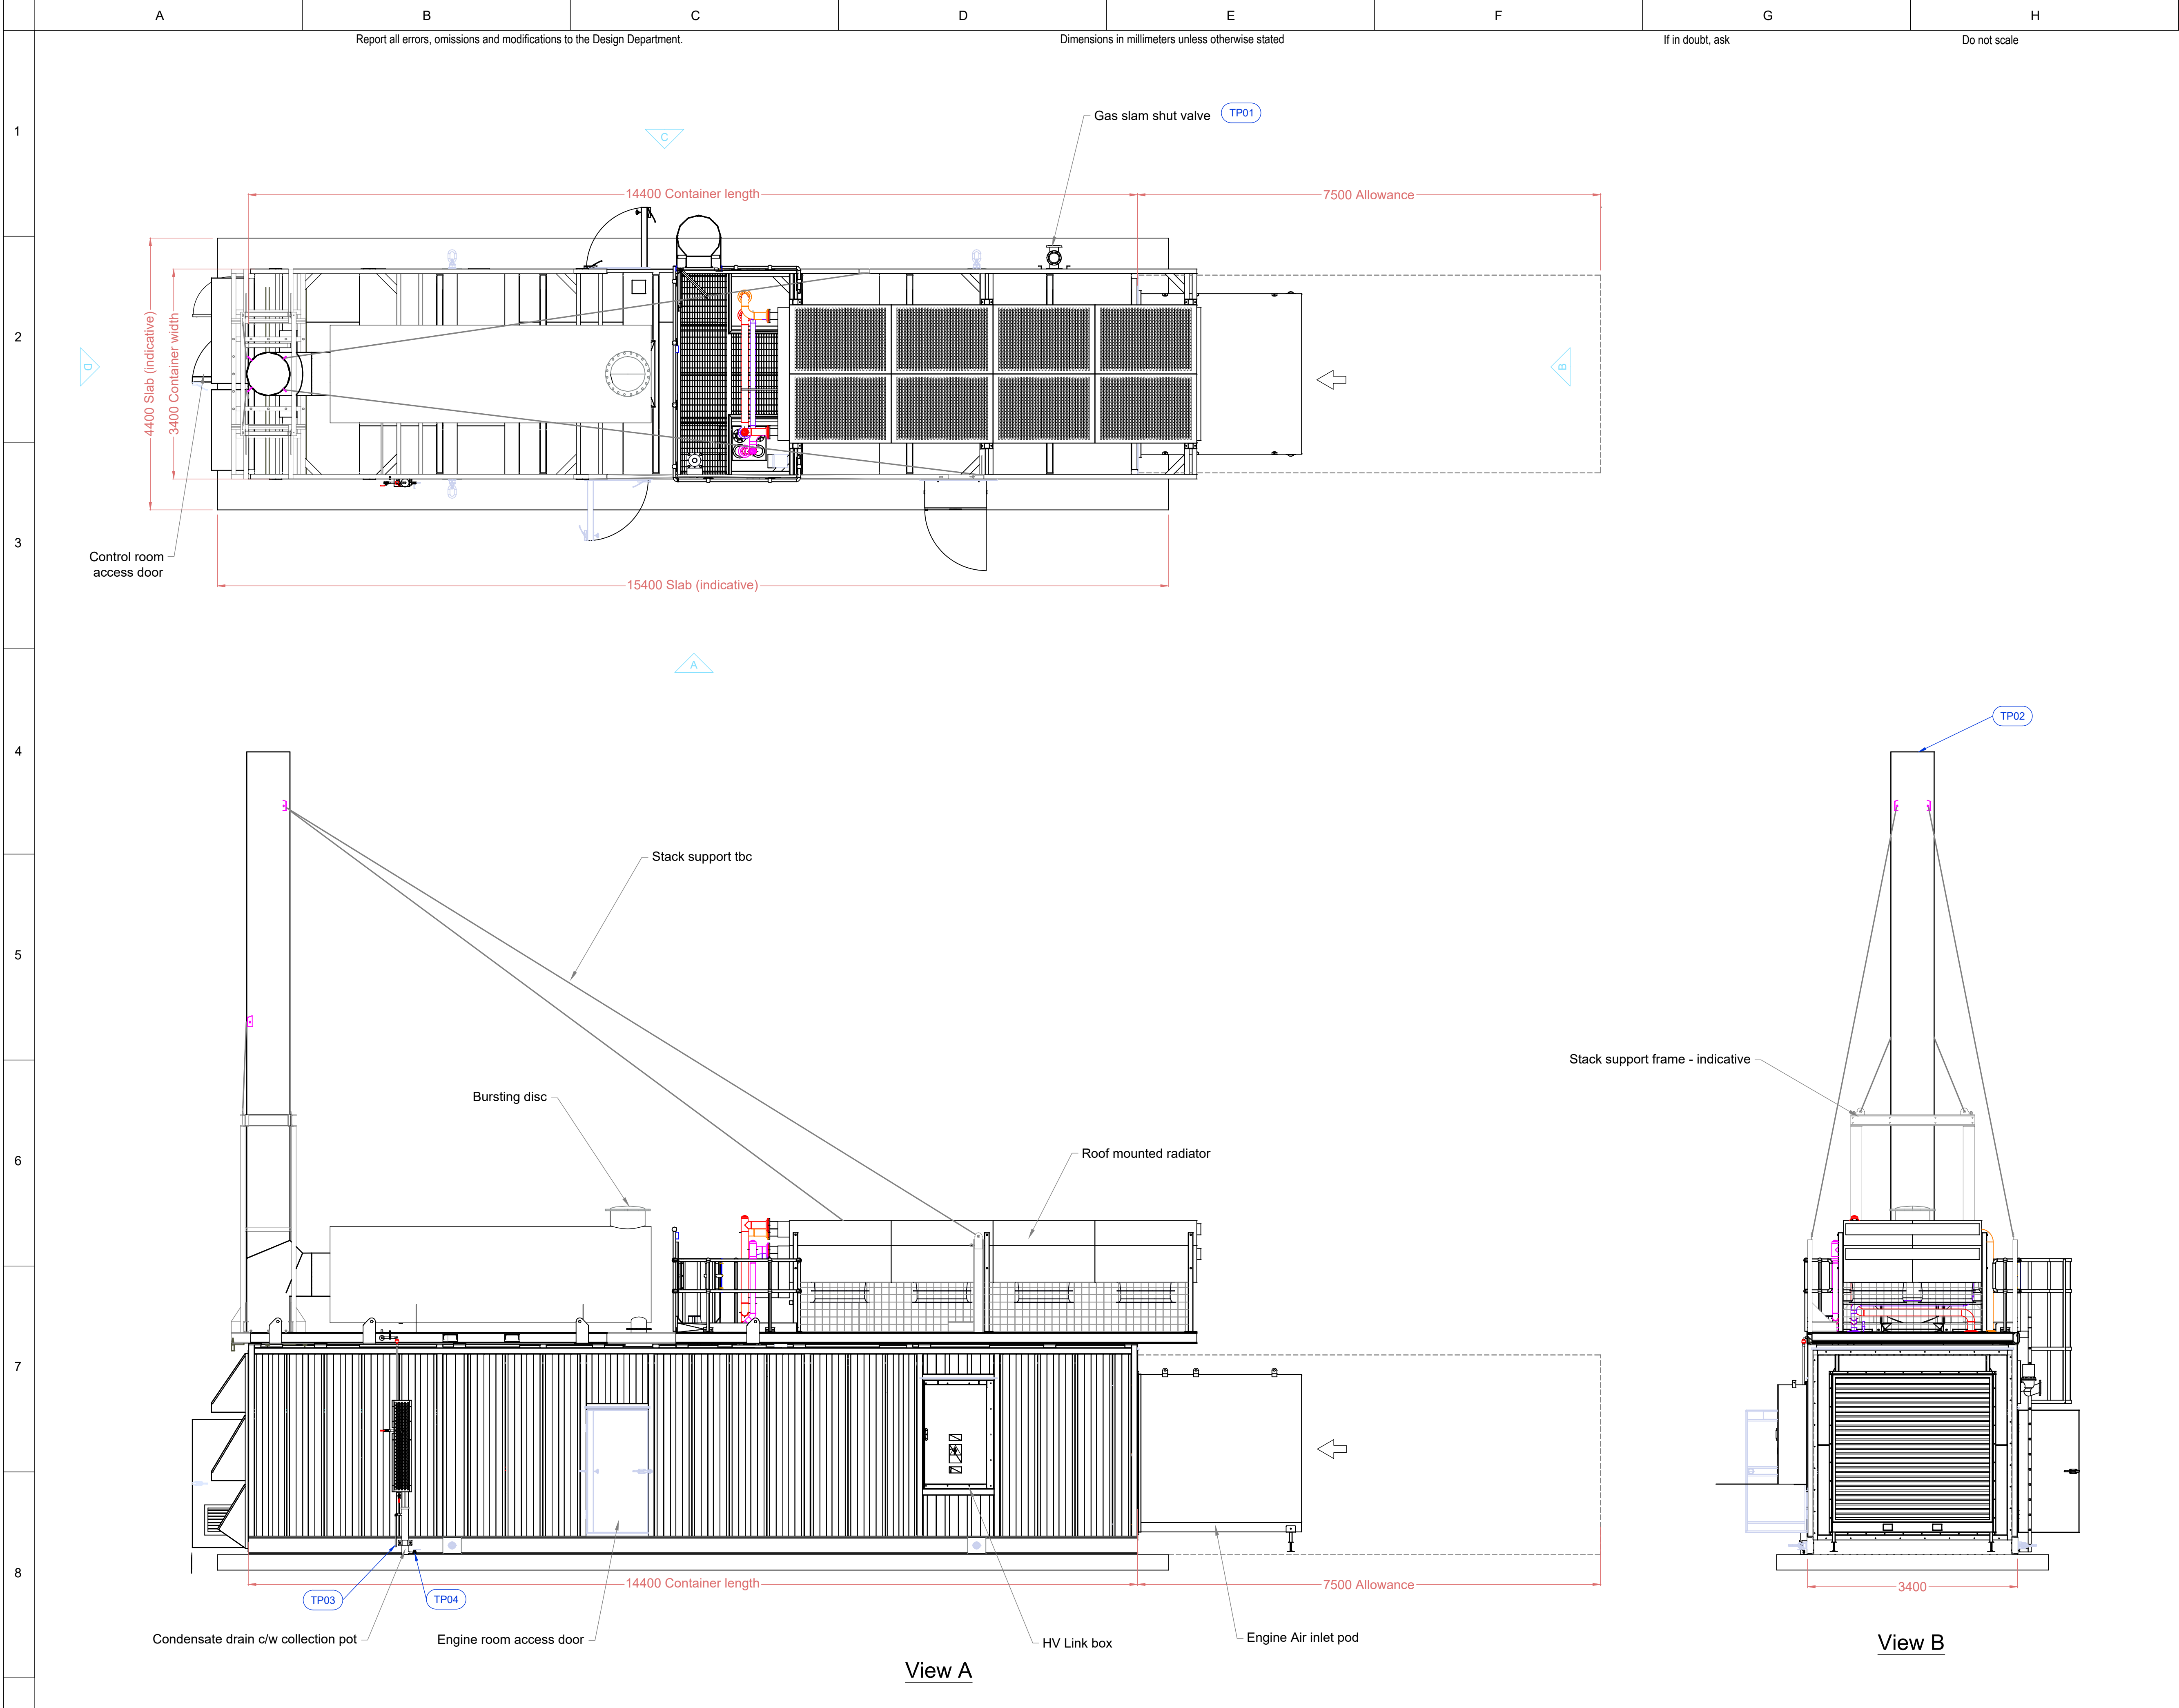

Edina UK Ltd 2022

This drawing and any information or descriptive matter set out herein are the confidential and copyright property of Edina UK Ltd and must not be loaned, copied or disclosed without the prior written consent of Edina UK Ltd

ISO 9001:2015

REGISTERED FIRM

Certificate no CA13188
Certificate no CA 8856
Certificate no IRE 1196

ISO 14001:2015

REGISTERED FIRM

Certificate no EN1369
Certificate no EN 1055
Certificate no IEN 1012

ISO 45001:2018

REGISTERED FIRM

Certificate no HS1442
Certificate no HS1148
Certificate no HS 1004

Notes:

1. If no comment is received against the submitted document within 10 working days from the date of issue, this will be deemed as being approved.

TPxx	Termination Points	
TP	Description	Size
01	Gas slam shut valve inlet	DN125 PN16
02	Exhaust gas to atmosphere	DN500 PN10
03	Exhaust condensate pot overflow	DN15
04	Exhaust condensate pot drain valve	DN25
05	Fresh oil tank - Fresh oil inlet	DN50
06	Waste oil tank - Waste oil outlet	DN50

Weights	Kg approx
Genset fully fitted - dry	54,500
Genset fully fitted - operational	57,000

xx

Denotes revision

R01 Client layout added. Stack height increased to 13m

MS AB DB 07/02/23

Specialists in Power Generation

Edina UK Ltd

Units 12-13 Rugby Park

Bletchley Road, Stockport

Cheshire SK4 3EJ

T: +44 (0) 161 432 8833

F: +44 (0) 161 975 1499

e mail: info@edina.eu

Internet: www.edina.eu

Drawn: MS

Checked: AO

Date: 20/12/22

Approved: DB

Client: STOR 128 Ltd

Project: STOR 128 Ltd - Ashton

Title: Genset Layout

Sheet 2 of 4

Sheet Title: Container views


Status: For Review

Scale: 1:50 @ A1

Drawing No: EDS-PR0372-0005

Sheet size: A1

Rev. no: R01

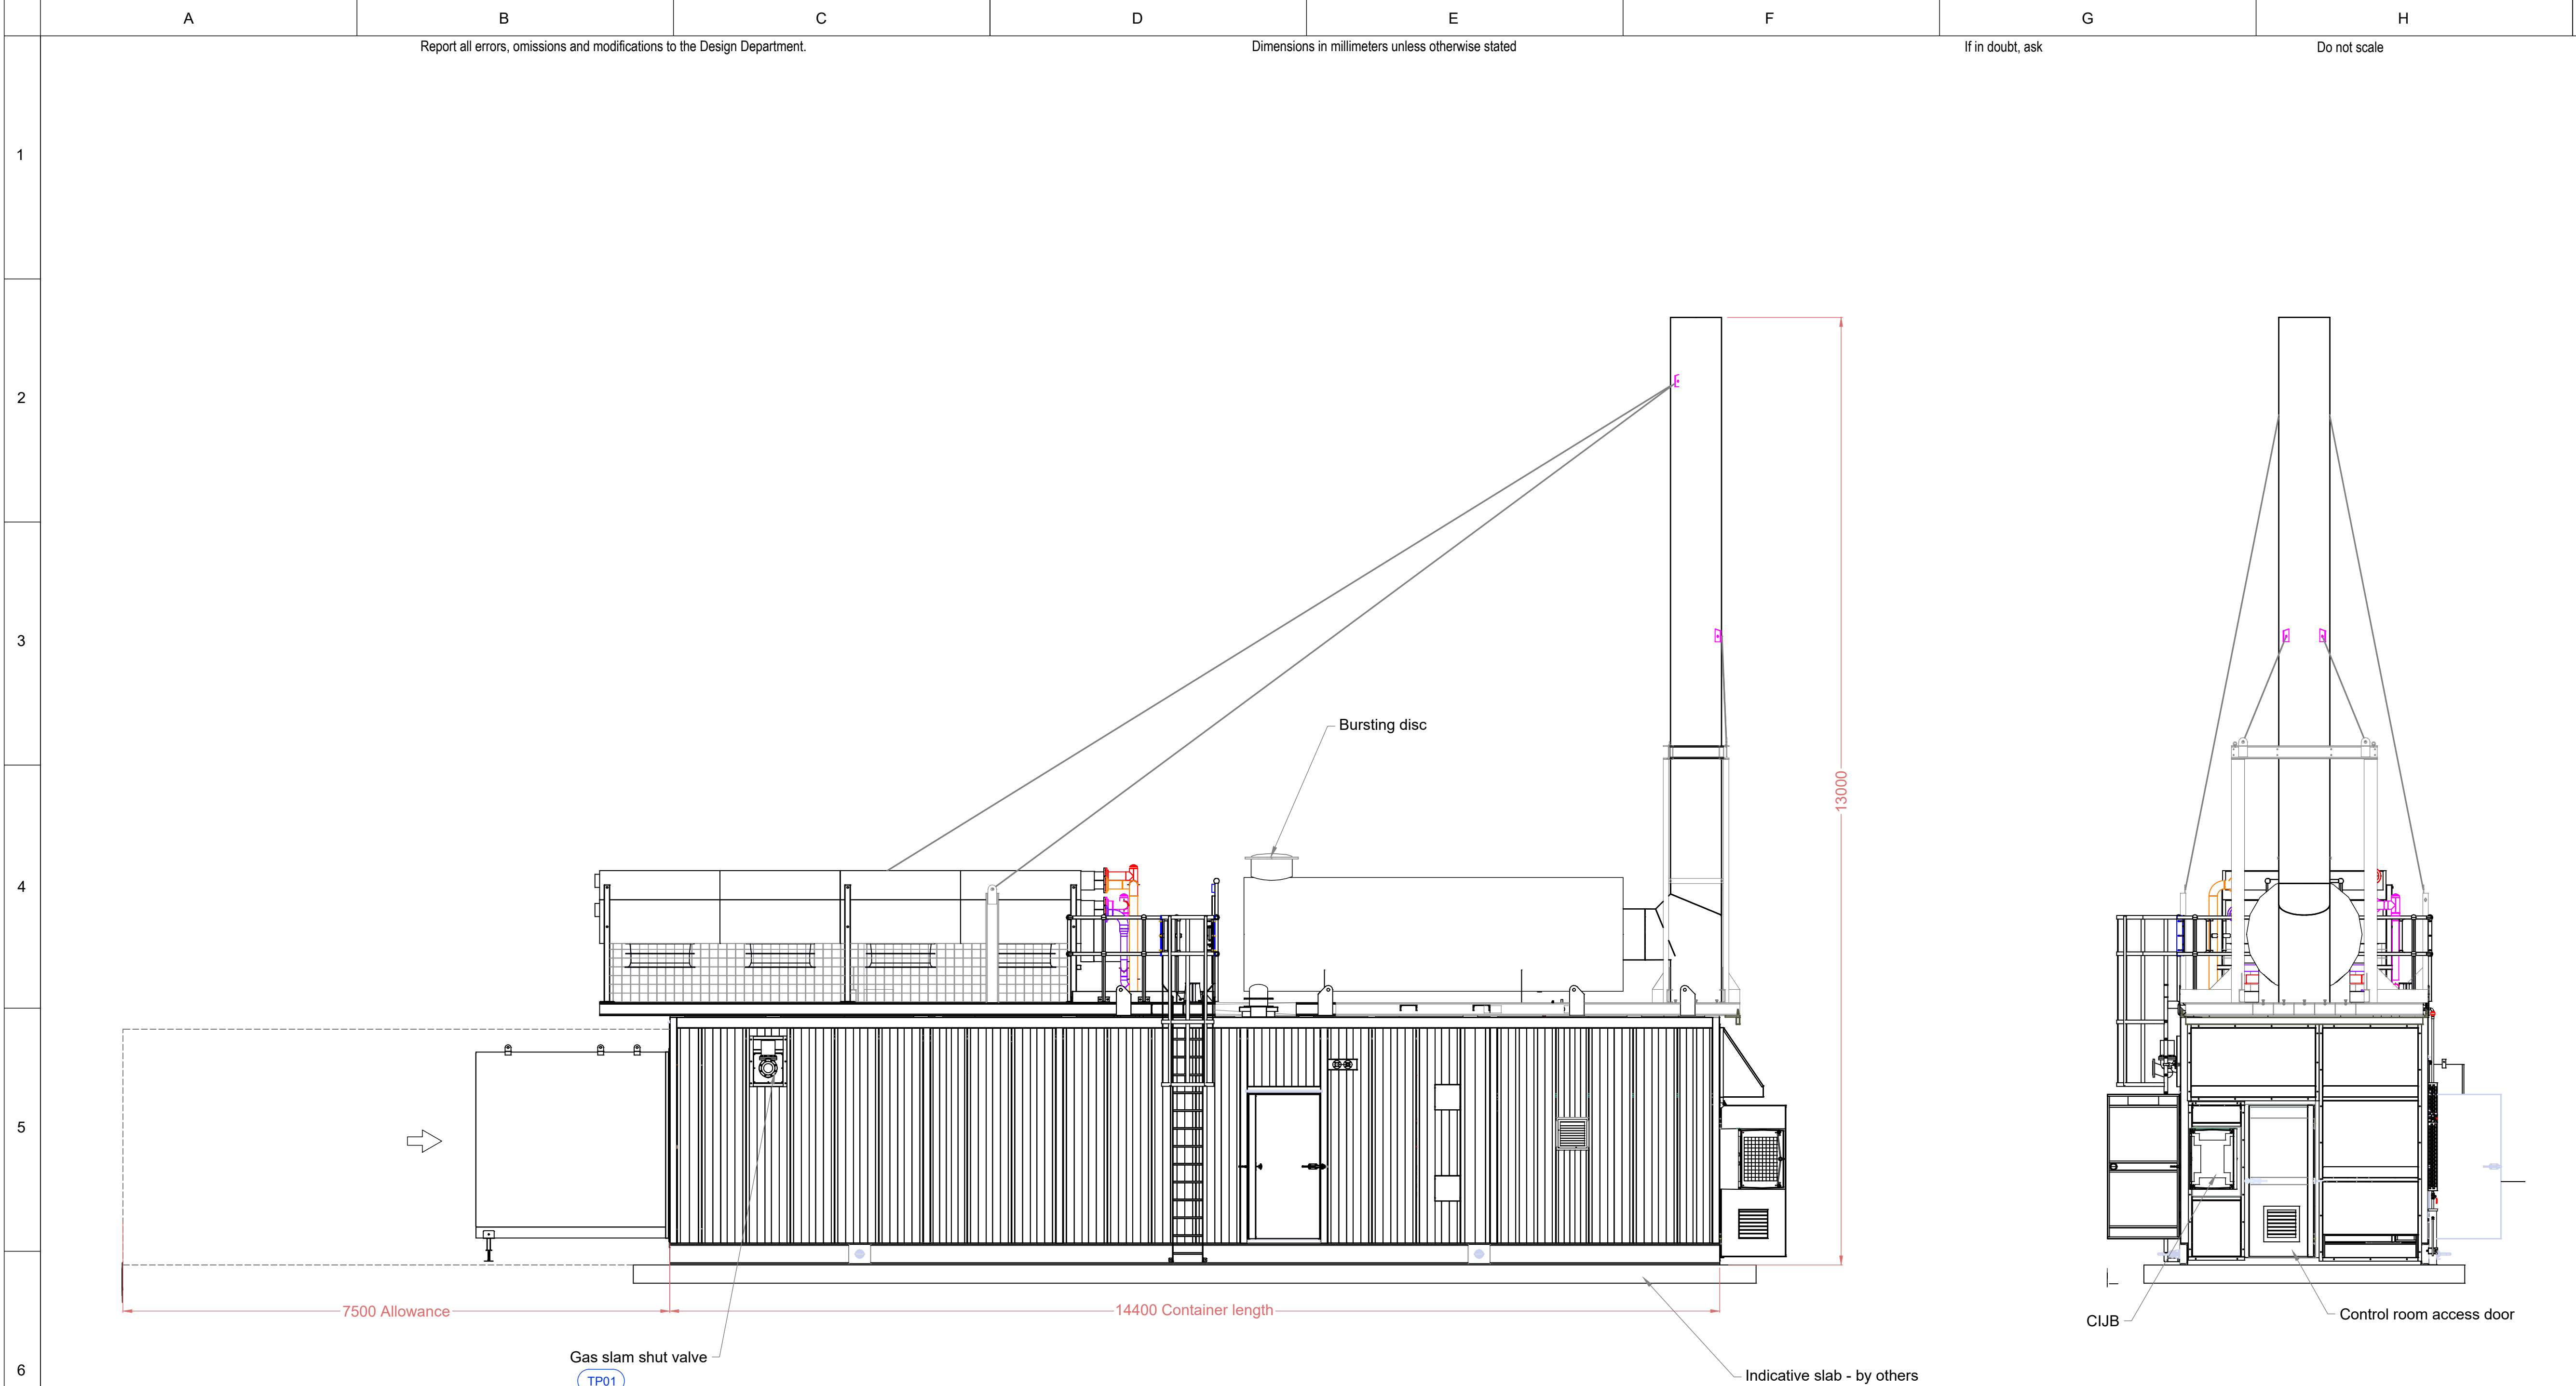

View C

View D

Edina UK Ltd 2022

This drawing and any information or descriptive matter set out herein are the confidential and copyright property of Edina UK Ltd and must not be loaned, copied or disclosed without the prior written consent of Edina UK Ltd

ISO 9001:2015

REGISTERED FIRM

Certificate no CA 13188

Certificate no CA 8856

Certificate no IRE 1196

ISO 14001:2015

REGISTERED FIRM

Certificate no EN1369

Certificate no EN 1056

Certificate no IEN 1012

ISO 45001:2018

REGISTERED FIRM

Certificate no HS1442

Certificate no HS1148

Certificate no HS 1004

Notes:

1. If no comment is received against the submitted document within 10 working days from the date of issue, this will be deemed as being approved.

TPxx	Termination Points	
TP	Description	Size
01	Gas slam shut valve inlet	DN125 PN16
02	Exhaust gas to atmosphere	DN500 PN10
03	Exhaust condensate pot overflow	DN15
04	Exhaust condensate pot drain valve	DN25
05	Fresh oil tank - Fresh oil inlet	DN50
06	Waste oil tank - Waste oil outlet	DN50

Weights	Kg approx
Genset fully fitted - dry	54,500
Genset fully fitted - operational	57,000

xx

Denotes revision

R01

Client layout added. Stack height increased to 13m

MS AB DB 07/02/23

Specialists in Power Generation

Edina

UK Ltd

Units 12-13 Rugby Park

Bletchley Road, Stockport

Cheshire SK4 3EJ

T: +44 (0) 161 432 8833 F: +44 (0) 161 975 1499

e mail: info@edina.eu Internet: www.edina.eu

Drawn:	Checked	Client Drawing No.
MS	AO	
Date:	Approved	Client:
20/12/22	DB	
Project:		
STOR 128 Ltd - Ashton		
Title:		
Genset Layout		
Sheet	3 of 4	Sheet Title
Status		Sheet size
For Review		A1
Scale:	Drawing No.	Rev. no.
1:50 @ A1	EDS-PR0372-0005	R01

Report all errors, omissions and modifications to the Design Department.

Dimensions in millimeters unless otherwise stated

If in doubt, ask

Do not scale

Edina UK Ltd 2022

This drawing and any information or descriptive matter set out herein are the confidential and copyright property of Edina UK Ltd and must not be loaned, copied or disclosed without the prior written consent of Edina UK Ltd.

ISO 9001:2015

REGISTERED FIRM

Certificate no CA 13188

Certificate no CA 8856

Certificate no IRE 1196

ISO 14001:2015

REGISTERED FIRM

Certificate no EN1369

Certificate no EN 1056

Certificate no IEN 1012

ISO 45001:2018

REGISTERED FIRM

Certificate no HS1442

Certificate no HS1148

Certificate no HS 1004

Notes:

TPxx	Termination Points	
TP	Description	Size
01	Gas slam shut valve inlet	DN125 PN16
02	Exhaust gas to atmosphere	DN500 PN10
03	Exhaust condensate pot overflow	DN15
04	Exhaust condensate pot drain valve	DN25
05	Fresh oil tank - Fresh oil inlet	DN50
06	Waste oil tank - Waste oil outlet	DN50

ISO 1

ISO 2

R01 Client layout added. Stack height increased to 13m MS AB DB 07/02/23

Specialists in Power Generation



an ERM company

Edina UK Ltd

Units 12-13 Rugby Park

Bletchley Road, Stockport

Cheshire SK4 3EJ

T: +44 (0) 161 432 8833 F: +44 (0) 161 975 1499

e mail: info@edina.eu Internet: www.edina.eu

Drawn: MS	Checked: AO	Client Drawing No.	
Date: 20/12/22	Approved: DB		
Client: STOR 128 Ltd			
Project: STOR 128 Ltd - Ashton			
Title: Genset Layout			
Sheet 4 of 4	Sheet Title ISO Views		
Status For Review		Sheet size A1	
Scale: nts @ A1	Drawing No. EDS-PR0372-0005	Rev. no. R01	