
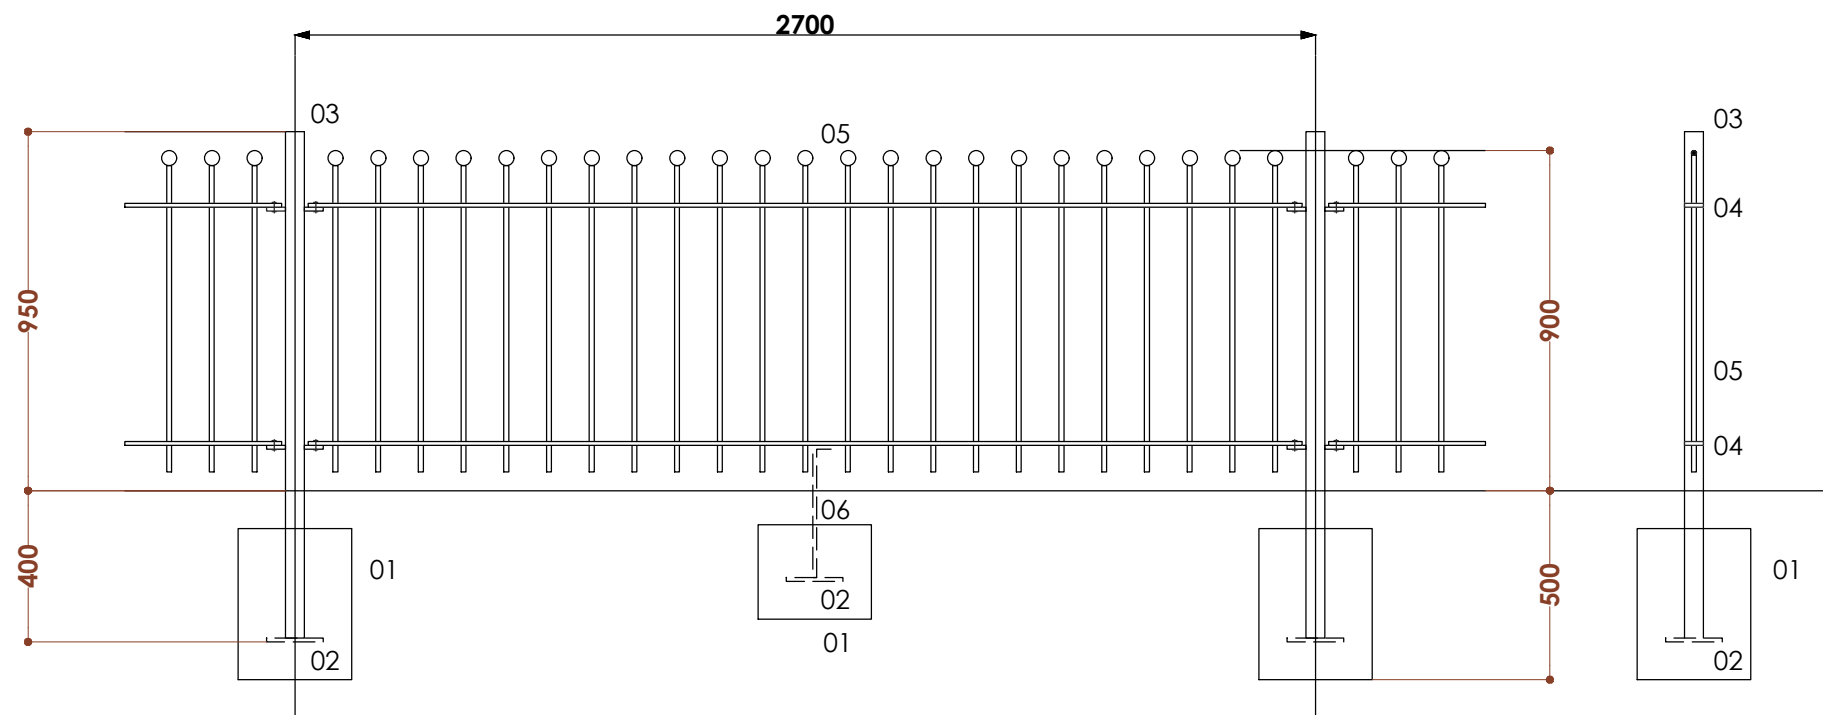


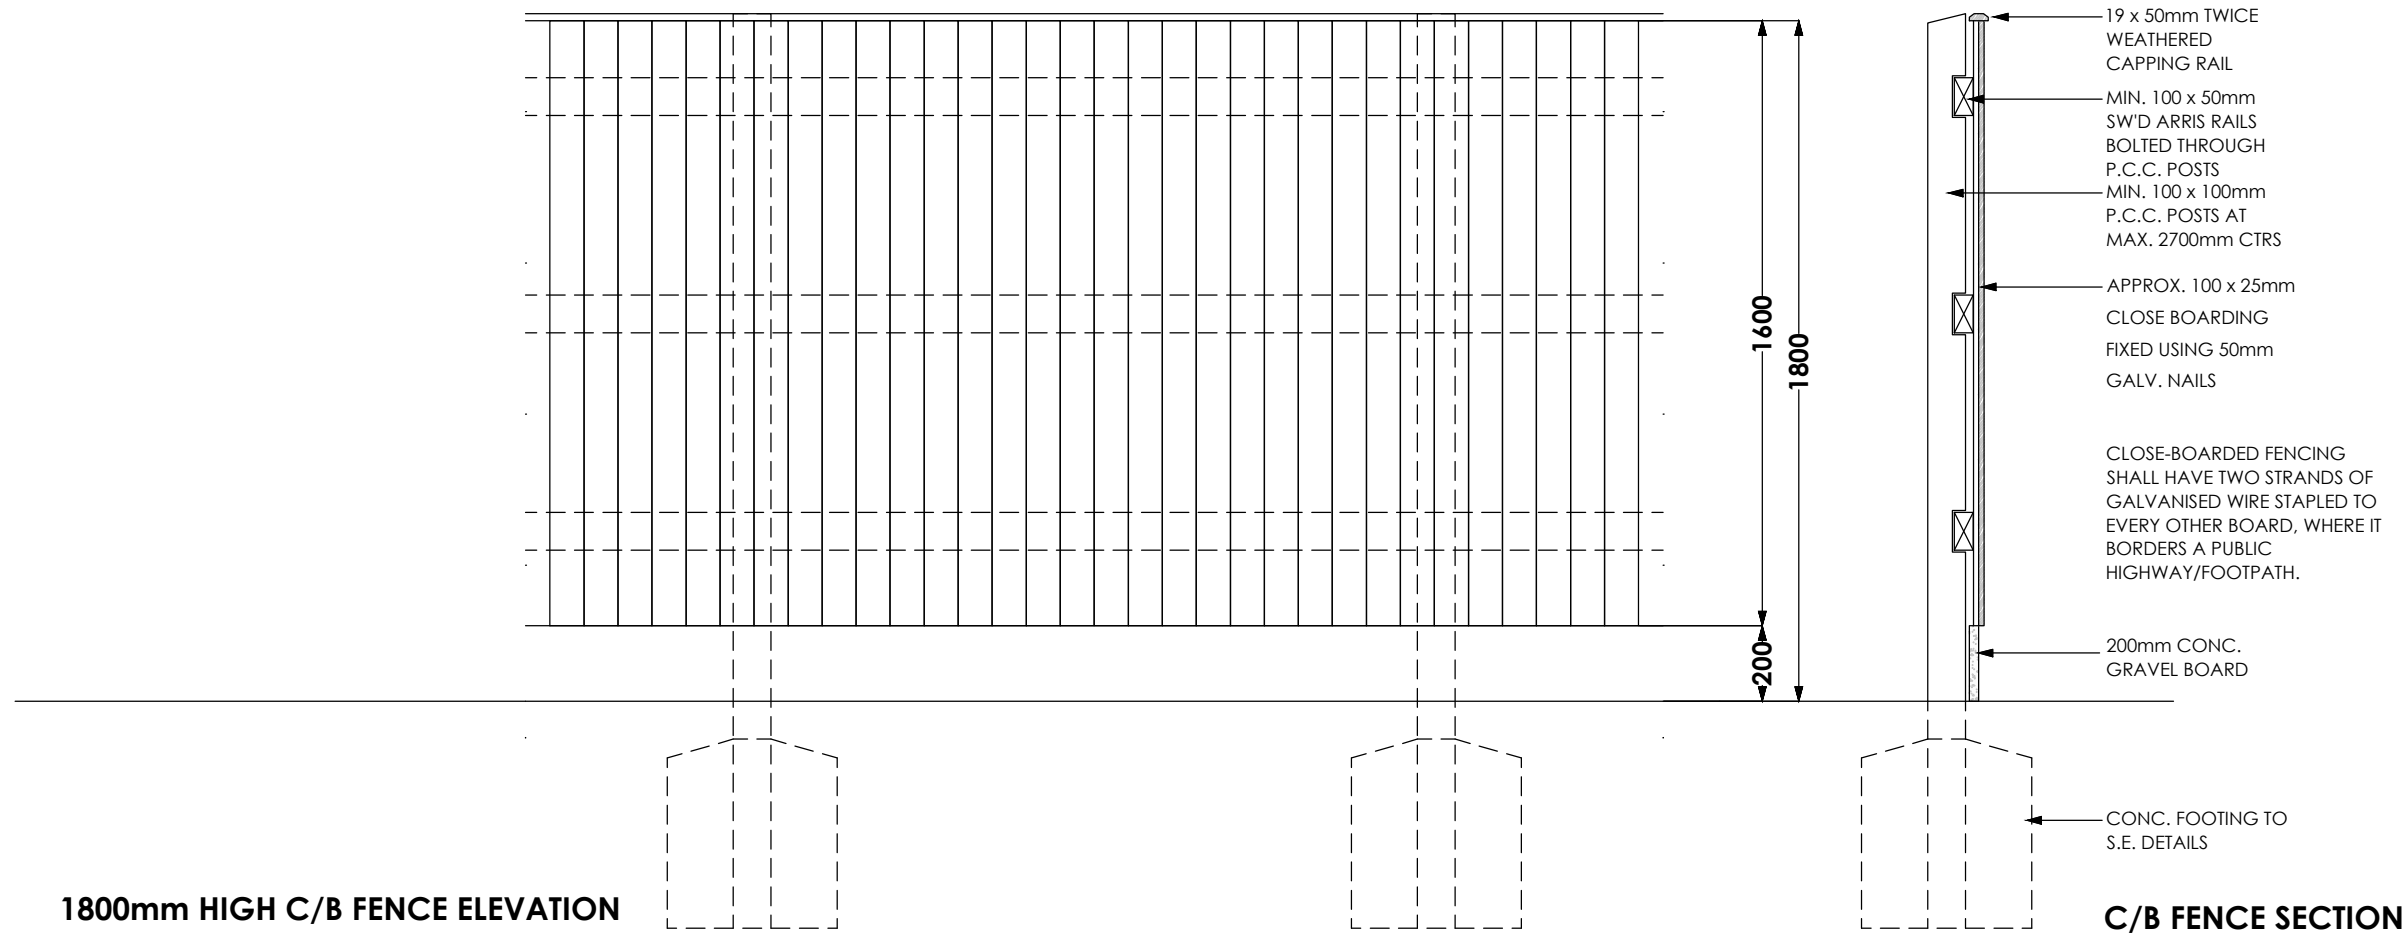

- 01 FOUNDATION TYPE/ FOOTINGS, CONCRETE GRADE, SIZE & FORMATION LEVELS ARE TO THE PROJECT STRUCTURAL ENGINEER'S ADVICE AND DETAILS
- 02 MIN. 150 x 150 x 5mm THICK GALV. M.S. BASE PLATES SUBJECT TO THE PROJECT STRUCTURAL ENGINEER'S ADVICE
- 03 MIN. 50 x 50mm M.S. RECTANGULAR HOLLOW SECTION (R.H.S.) STANDARDS WITH TOP CAPPING PLATES AND WELDED FIXING LUGS POSITIONED AT NOT MORE THAN 2,700mm CENTRES
- 04 50 WIDE x 10mm THICK GALV. M.S. FLAT BARS SCREW OR BOLT FIXED TO LUGS
- 05 NOMINALLY 13mm DIAMETER GALV. M.S. BALLTOP BARS FIXED TO FLATS
- 06 50 WIDE x 10mm THICK GALV. M.S. LEGS AT MID-POINTS TO POST CENTRES WELDED TO FENCE BOTTOM RAIL

**PLEASE NOTE:-**

- 1.) ALL EXPOSED EDGES ARE TO BE WELL ROUNDED
- 2.) ALL METALWORK IS TO BE HOT DIP GALVANISED UPON FABRICATION
- 3.) EXTERNAL QUALITY FINISHES ARE SUBJECT TO CLIENT/ DEVELOPER CONSULTATION

| rev | date | revision | by | by |
|-----|------|----------|----|----|
|-----|------|----------|----|----|