

NOTES

- 1000

BE
ND
TO BE
OPEN
ELS. MAIN
ERIDE

L11 LUMINAIRE MOUNTED TO VERTICAL SURFACE AND FOCUSED 45DEG UPWARD TO PROVIDE INDIRECT ILLUMINATION

L12 TO BE SOFFIT MOUNTED, LUMINAIRE LOCATED WITHIN CEILING BANDING DETAIL. TROUGH WIRE SOLUTION TO BE USED.

ALL L12CE-d LUMINAIRES TO OUTPUT AT 25% IN EMERGENCY MODE.

EM10E

EM4

EM4

EM4

EM16CE


A7

TH-GR-DIRE-70-8002

TH-L1-GR-DIRE-70-8011

TH-L1-GR-DIRE-70-8011

ORCHESTRA PIT TO HAVE GRID OF 'A81' RECESSED
DOME FITTINGS ARRANGED BOTH HORIZONTALLY
AND VERTICALLY. REFER TO RYDER AND PRATER
DRAWINGS FOR DETAIL.

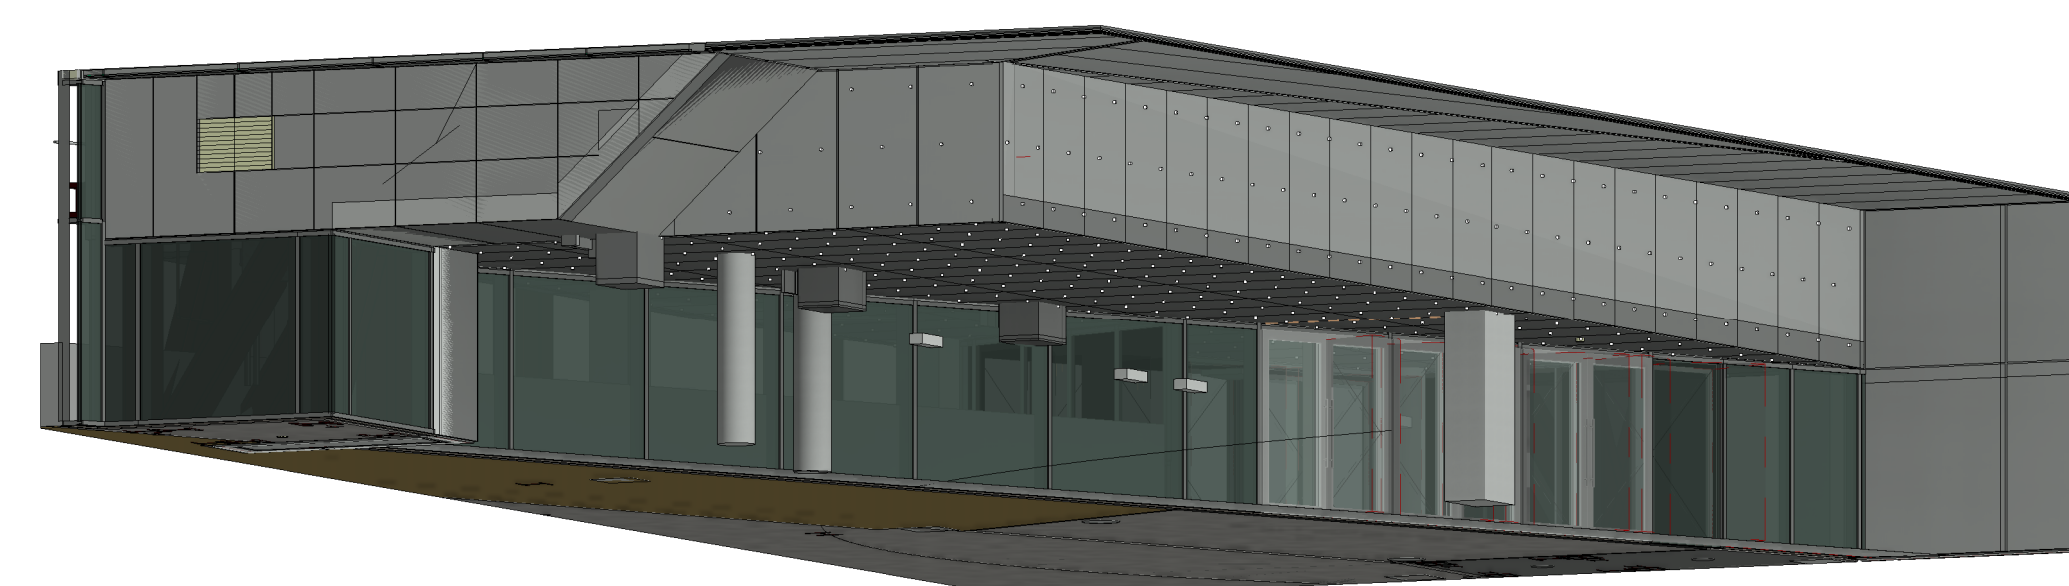

Orchestra Plt

BDP.

Contract					
PROJECT P20080903 Manchester Factory					
DESCRIPTION Electrical Engineering Services					
WORKS TO BE DONE Theatre Ground Floor Lighting Systems Reflected Ceiling Plan					
PROJECT CODE CC	SUBJECT NM	DATE FIRST ISSUED 13/11/20	COUNT 1 : 100[®]		
REFERENCE NO. MF-BDP-TH-GF-DR-E-70-8002				REVISION C03	